GRADING NOTES:

- 1. A Geotechnical Engineer shall be employed by the owner and be on site during grading operations. All soils tests shall be verified by the Geotechnical Engineer concurrent with the grading and back filling operations.
- 2. The grading contractor shall perform a complete grading and compaction operation as shown on the plans, stated in these notes, or reasonably implied there from, all in accordance with the plans and notes as interpreted by the Geotechnical Engineer.
- 3. The Contractor shall notify the Soils Engineer at least two days in advance of the start of the grading operation.
- 4. All areas shall be allowed to drain. All low points shall be provided with temporary ditches.
- 5. A sediment control plan that includes monitored and maintained sediment control basins and/or straw bales should be implemented as soon as possible. No graded area is to be allowed to remain bare over the winter without being seeded and mulched. Care should be exercised to prevent soil from damaging adjacent property and silting up existing downstream storm drainage system.
- 5. Any existing trash and debris currently on this property must be removed and disposed of off-site.
- 7. Soft soil in the bottom and banks of any existing or former pond sites or tributaries should be removed, spread out and permitted to dry sufficiently to be used as fill. None of this material should be placed in proposed right-of-way locations or on storm sewer locations.
- 8. Site preparation includes the clearance of all stumps, trees, bushes, shrubs, and weeds; the grubbing and removal of roots and other surface obstructions from the site; and the demolition and removal of any man-made structures. The unsuitable material shall be properly disposed of off-site. Topsoil and grass in the fill areas shall be thoroughly disced prior to the placement of any fill. The Soils Engineer shall approve the discing operation.
- 9. Compaction equipment shall consist of tamping rollers, pneumatic-tired rollers, vibratory roller, or high speed impact type drum rollers acceptable to the Soils Engineer. The roller shall be designed so as to avoid the creation of a layered fill without proper blending of successive fill layers.
- 10. The Soils Engineer shall observe and test the placement of the fill to verify that specifications are met. A series of fill density tests will be determined on each lift of fill. Interim reports showing fill quality will be made to the Owner at regular intervals.
- 11. The Soils Engineer shall notify the Contractor of rejection of a lift of fill or portion thereof. The Contractor shall rework the rejected portion of fill and obtain notification from the Soils Engineer of its acceptance prior to the placement of additional fill.
- 12. All areas to receive fill shall be scarified to a depth of not less than 6 inches and then compacted in accordance with the specifications given below. Natural slopes steeper than 1 vertical to 5 horizontal to receive fill shall have horizontal benches, cut into the slopes before the placement of any fill. The width and height to be determined by the Soils Engineer. The fill shall be loosely placed in horizontal layers not exceeding 8 inches in thickness and compacted in accordance with the specifications given below. The Soils Engineer shall be responsible for determining the acceptability of soils placed. Any unacceptable soils placed shall be removed at the Contractor's expense.
- 13. The sequence of operation in the fill areas will be fill, compact, verify acceptable soil density, and repetition of the sequence.
- 14. The surface of the fill shall be finished so that it will not impound water. If at the end of a days work it would appear that there may be rain prior to the next working day, the surface shall be finished smooth. If the surface has been finished smooth for any reason, it shall be scarified before proceeding with the placement of succeeding lifts. Fill shall not be placed on frozen ground, nor shall filling operations continue when the temperature is such as to permit the layer under placement to freeze.
- 15. All siltation control devices shall be inspected by the contractor after any rain of 1/2" or more with any appreciable accumulation of mud to be removed and siltation measures repaired where necessary.
- 16. No slope shall be steeper than 3(Harizontal): 1(Vertical). All slopes shall be sadded or seeded and mulched.
- 17. Any contaminated soil encountered during excavation shall be hauled and placed as directed by the owners environmental engineering representative.
- 18 No grading will begin prior to approval of a grading plan by the City of O'Fallon.
- 19. All grades shall be within 0.2 feet of those shown on the grading plan.
- 20. All rip-rap shown at flared ends shall be evaluated in the field after installation for effectiveness and field modified if necessary to reduce erosion on and off-site.
- 21. All drop structures shall have compacted rock backfill in the disturbed ground around the structure.
- 22. All inlets shall have a %" trash bar.
- 23. Developer must supply the City Construction Inspectors with soil reports prior to or during site soil testing. "The soil report will be required to contain the following information on the soil test curves (Proctor Reports) for projects within the City:
 - Maximum dry density
- Optimum moisture content Maximum and minimum allowable moisture content. 4. Curve must be plotted to show density from a minimum of 95% compaction and above as determined by the "Modified
- AASHTO T-180 Compaction Test" (A.S.T.M.-D-1157) or from a minimum of 100% as determined by the "Standard Proctor Test ASSHTO T-99, Method C" (A.S.T.M.-D-698). Proctor type must be designated on document.
 - 5. Curve must have at least 5 density points with moisture content and locations listed on documents.
 - Specific gravity National maisture content
 - 8. Liquid limit 9. Plastic limit

A SET OF AS-BUILT PLANS FOR FRED WEBER

ASPHALT FACILITY

A TRACT OF LAND BEING PART OF U.S. SURVEY 1780 TOWNSHIP 47 NORTH, RANGE 2 EAST OF THE FIFTH PRINCIPAL MERIDIAN

ST. CHARLES COUNTY, MISSOURI

PRINCIPLES & STANDARDS:

- 1. All excavations, grading, or filling shall have a finished grade not to exceed a 3:1 slope (33 %). Steeper grades may be approved by the designated official if the excavation is through rock or the excavation or the fill is adequately protected (a designed head wall or toe wall may be required). Retaining walls that exceed a height of four (4) feet shall require the construction of safety guards as identified In the appropriate section(s) of the adopted BOCA Codes and must be approved by the Building Department. Permanent safety guards will be constructed in accordance with the appropriate section(s) of the adopted BOCA Codes.
- 2. Sediment and erosion control plans for sites that exceed 20,000 square feet of grading shall provide for sediment or debris basins, silt traps or filters, staked straw bales or other approved measures to remove sediment from run-off waters. The design to be approved by the Designated Official. Temporary siltation control measures (structural) shall be maintained until vegetative cover is established at a sufficient density to provide erosion control on the site. All siltation control devices and their placement shall meet "St.Charles County Soil and Water Conservation District Erasian and Sediment Control" guidelines.
- 3. When grading operations are completed or suspended for more than 14 days permanent grass must be established at sufficient density to provide erosion control on the site. Between permanent grass seeding periods, temporary cover shall be provided according to the City Engineer's recommendations. All finished grades (areas not to be disturbed by future improvement) in excess of 20% slopes (5:1) shall be mulched and tacked at the rate of 100 pounds per 1,000 square feet when seeded.
- 4. Provisions shall be made to accommodate the increased runoff caused by changed soils and surface conditions during and after grading. Unvegetated open channels shall be designed so that gradients result in velocities of 2 fps (feet per second) or less. Open channels with velocities more than 2 fps and less that 5 fps shall be established in permanent vegetation by use of commercial erosion control blankets or lined with rock rip rap or concrete or other suitable materials as approved by the City Engineer. Detention basins, diversions, or other appropriate structures shall be constructed to prevent velocities above 5 fps.
- 5. The adjoining ground to development sites (lots) shall be provided with protection from accelerated and increased surface water, silt from erosion, and any other consequence of erosion. Run-off water from developed areas (parking lots, paved sites and buildings) above the area to be developed shall be directed to diversions, detention basins, concrete gutters and/or underground outlet systems. Sufficiently anchored straw bales may be temporarily substituted with the approval of the City Engineer.
- 6. Development along natural watercourses shall have residential lot lines, commercial or industrial improvements, parking areas or driveways set back a minimum of 25 feet from the top of the existing stream bank. The watercourse shall be maintained and made the responsibility of the subdivision trustees or in the case of a site plan by the property owner. Permanent vegetation should be left intact. Variances will include designed stream bank erosion control measures and shall be approved by the City Engineer. FEMA and U.S. Army Corps of Engineers guidelines shall be followed where applicable regarding site development areas designated as flood plains and wetlands.
- 7. All lots shall be seeded and mulched at the minimum rates defined in Appendix A or sodded before an occupancy permit shall be issued except that a temporary occupancy permit may be issued by the Building Department in cases of undue hardship because of unfavorable ground conditions.

VEGETATIVE ESTABLISHMENT For Urban Development Sites APPENDIX A

Seeding Rates:

Permanent: Tall Fescue - 30 lbs./ac. Smooth Brome - 20 lbs./ac.

Combined Fescue @ 15 lbs./gc. and Brome @ 10 lbs./gc.

Temporary:

Wheat or Rye - 150 lbs./ac. (3.5 lbs. per 1,000 square feet) - 120 lbs./ac. (2.75 lbs. per 1,000 square feet)

Seeding Periods:

Fescue or Brome - March 1 to June 1 August 1 to October 1 Wheat or Rye - March 15 to November 1

March 15 to September 15

Mulch Rates:

100 lbs. per 1,000 sq. feet (4,356 lbs. per acre)

Fertilizer Rates:

Nitrogen 30 lbs./ac. Phosphate 30 lbs./ac. Potassium 30 lbs./ac. Lime 600 lbs./ac. ENM*

* ENM = effective neutralizing material as per State evaluation of guarried rock,

GRADING QUANTITIES:

30,128 C.Y. CUT (INCLUDES SUBGRADES) 264 C.Y. FILL (INCLUDES 8% SHRINKAGE)

29,864 C.Y. HEAVY

THE ABOVE GRADING QUANTITY IS APPROXIMATE ONLY, NOT FOR BIDDING PURPOSES. CONTRACTOR SHALL VERIFY QUANTITIES PRIOR TO CONSTRUCTION.

SITE BENCHMARK - ELEVATION 570.56 "O" IN OPEN ON HYDRANT LOCATED IN THE NORTH EASTERN CORNER OF PROPERTY CONVEYED TO FRED WEBER INC. BY DEED RECORDED IN BOOK 1011 PAGE 356 OF THE ST. CHARLES COUNTY RECORDS.

JSGS BENCHMARK (destroyed) - ELEVATION 595.53. CUT CROSS ON BOLT OF F.H. AT NORTHEAST CORNER OF MEXICO AND BRYAN ROAD.

LANDSCAPE LEGEND



TY. (11) ~ INDICATES PROPOSED EVERGREEN TREE (6 to 8 feet tall)

> LANDSCAPING AS DEPICTED IS SUBJECT TO FINAL DESIGN BY A QUALIFIED LANDSCAPE DESIGNER

SHEET INDEX

SHEET 1 SHEET 2 COVER SHEET SITE PLAN PROFILES SHEET

GENERAL NOTES


- 1. Underground utilities have been plotted from available information and therefore their locations shall be considered approximate only. The verification of the location of all underground utilities, either shown or not shown on these plans shall be the responsibility of the contractor, and shall be located prior to any grading or construction of the improvements.
- All filled places under proposed storm and sanitary sewer, proposed roads. and/or paved areas shall be compacted to 95% of the maximum density as determined by the "Modified AASHTO T-180 Compaction Test, or 100% of maximum density as determined by the standard Proctor Test AASHTO T-99. All filled places in proposed roads shall be compacted from the bottom of the fill up. Note that the moisture content of the soil in fill greas is to correspond to the compactive effort as defined by the Standard or Modified Proctor Test. Optimum moisture content shall be determined using the some test that was used for compaction. Soil compaction curves shall be submitted to the City of O'fallon prior to the placement of fill. Proof rolling may be required to verify soil stability at the discretion of the City of O'fallon.
- 3. No area shall be cleared without the permission of the Project Engineer.
- 4. The City of D'Fallan shall be notified 48 hours prior to construction for coordination and inspection
- 5. All existing site improvements disturbed, damaged or destroyed shall be repaired or replaced to closely match pre-construction conditions.
- 6. All construction and materials shall conform to the current construction standards of the City of O'Fallon.
- 7. Any permits, licenses, easements, or approvals required to work on public or private properties or roadways are the responsibility of the developer
- 8. The Contractor shall assume complete responsibility for controlling all siltation and erosion of the project area. The Contractor shall use whatever means necessary to control erosion and siltation including, but not limited to, staked straw bales and/or silitation fabric fences (possible methods of control are detailed in the plan). Control shall commence with grading and be maintained throughout the project until acceptance of the work by the Owner and/or the City of O'Fallon and/or MODOT. The Contractor's responsibilities include all design and implementation as required to prevent erosion and the depositing of silt. The Owner and/or the City of O'Fallon and/or MODOT may at their option direct the Contractor in his methods as deemed fit to protect property and improvements. Any depositing of silts or mud on new or existing pavement or in new or existing storm sewers or swales shall be removed after each rain and affected areas cleaned to the satisfaction of the Owner and/or the City of O'Fallon and/or MODOT.
- 9. Erosian control systems shall not be limited to what is shown on the plan. Whatever means necessary shall be taken to prevent siltation and erosion from entering natural streams and adjacent roadways, properties and ditches.
- 10. All building mounted lights shall be pointed downward and fully screened to prevent light from spilling over onto adjacent properties.
- 11. All rooftop hvac mechanical units to be screened by parapet wall and ground mounted units with materials and/or landscaping.
- 12. The Developer must supply City Construction inspectors with soil reports prior to or during site soil testing.
- 13. All paving to be in accordance with St. Charles County standards and specifications except as modified by the City of O'Fallon ordinances.
- 14. All sidewalks, curb ramps, ramps and accessible parking spaces shall be constructed in accordance with the current approved "Americans with Disabilities Act Accessibility Guidelines" (ADAAG) along with the required grades, construction materials, specifications and signage. If any conflict accurs between the above information and the plans, the ADAAG guidelines shall take precedence and the contractor prior to any construction shall notify the Project Engineer. Ensure at least one 8' wide handicap access aisle is provided and curb ramps do not project into handicap access aisles.
- 15. Brick shall not be used in the construction of storm or sanitary sewer structures. 16. The Contractor shall ensure all storm and sanitary sewer joint shall be gasketed
- 17. Lighting values will be reviewed on the site prior to the final occupancy inspection.
- Corrections will need to be made if not in compliance with City standards.

Planning Division. Please contact Brandy Williams @ 636-379-5542 if there are any

18. All proposed signage and proposed fencing requires a separate permit through the

- questions. 19. All sign locations and sizes must be approved separately through the Planning
- 20. All sign post and backs and bracket arms shall be painted black using Carboline Rustbond Penetrating Sealer SG and Carboline 133 HB paint (or equivalent as approved by the City of D'Fallon and MoDOT). Sign designating street names shall be on the opposite side of the street from traffic control signs.
- 21. All new utility line shall be located underground.
- 22. All erasion control systems shall be inspected and necessary corrections shall be made within 24 hours of any rainstorm resulting in one-half inch of rain or more.
- 23. All graded areas that are to remain bare for over 2 weeks shall be seeded and mulched per DNR requirements.
- 24. Ensure all sanitary laterals and sanitary main crossings under roadways must have the proper rock fill and to required compaction.
- 25. Water meter location shall be coordinated with Alliance.
- 26. Traffic control within R.O.W. to be per MUTCD or MoDOT.
- 27. Wall design to be submitted by structural/soils engineer with footing plans.
- 28. Connections at all sanitary or storm structures to be made with A-lock joint or
- 29. HDPE pipe is to be N-12WT or equal and to meet ASTM F1417 water tight field
- 30. Marking to be provided on storm sewer inlets. The City will allow the following markers and adhesive procedures only as shown in the table below. "Peel and Stick" adhesive pads will not be allowed.

Manufacturer	Size	Adhesive	Style	Message (Port #)	Website
ACP International	3 7/8"	Ероху	Crystal Cap	No Dumping Drains To Waterways (SD-W-DC)	www.acpinternational.com
DAS Manufacturing, Inc.	47	Ероху		No Dumping Drains To Stream (#SDS)	www.dasmonufacturing.co



-800-DIG-RITE

LEGEND

OHW - OVERHEAD UTILITY WIRES

TO -UTILITY POLE

● —IRON PIPE

⊕ GAS LINE

W -WATER LINE

GAS VALVE

-TREE

FIRE HYDRANT

-WATER VALVE

-GUY WIRE

-SIGN

CALL BEFORE YOU DIG!

1. Area of Tract: 26.82 Acres Area to be disturbed: 4.46 Acres

DEVELOPMENT

2. Existing Zoning: I-2 Heavy Industrial (City of O'Fallon)

Proposed Use: Quarry w/Office Building: 3,400 s.f.

The required building setbacks are as follows:

Minimum Front Yard: Minimum Side Yard: Minimum Rear Yard:

5. Owner Fred Weber, Inc. 2320 Creve Coeur Mill Rd. Maryland Heights, Missouri 63043

NOTES

30 feet

25 feet

50 feet

Site is served by:

City of O'Fallon Sewer 636-272-6818 1-800-55-ASKUE Ameren UE Laciede Gas Company 636-946-0352 City of O'Fallon Water 636-272-6818 Verizon Telephone Company 636-332-7318 O'Fallon Fire Protection District 636-272-3493

Parking Calculations:

1 space for every 300 s.f. of floor area. 3,400/300 = 11.33 spaces required Spaces Provided = 11 (including 1 handicap)

- 8. All runoff shall be contained on-site and directed to the East to the existing
- 9. According to the Flood Insurance Rate Map of St. Charles County -Map 29183C0220-E Dated: August 2, 1996 This property lies in Zone "X". Zone "X" is defined as a non flood hazard area.
- 10. Site Calculations:

(Areas are for proposed area only and do not include all buildings/pavement on site.) Building Area: 3,400 s.f. Impervious Area: 3.56 Acres (this includes parking, drives and surrounding

- 11. Prior to Construction Plan approval, a photometric lighting plan in accordance with the City's Exterior Lighting Standards shall be submitted for review and approval for all proposed exterior lighting.
- 12. All HVAC and Mechanical units on site shall be properly screened as required by City Code. Rooftop units shall be screened by a parpet that extends around the entire perimeter of the building; the parpet shall have a minimum height that is at least as tall as the talest unit to be screened mounted on the roof; ground mounted HVAC and Mechanical units shall be screened by fencing. vegetation, or some other means (approved by the Planning and Zoning Commission) that has a minimum height that is at least as tall as the tallest unit to be screened. (Show the location of the Mechanical units on the Construction Plans).
- 13. Prior to approval of Building Permit, A Construction Site Plan must be reviewed and approved by the City Staff.
- 14. Any business occupying the site requires approval of Business License.
- 15. The developer shall comply with current Tree Preservation Ordinance Number 1689 and provide landscaping as set forth in Article 23 of the City of O'Fallon zoning ordinances. 20% of existing trees or 15 trees per acre shall remain whichever is greater. Existing Tree Masses = 0.32 Ac. Existing Tree Mass to Remain = 0.24 Ac. (75%) No proposed trees needed to meet requirement.
- Roof drain shall discharge at grade.
- 17. Estimated designed sanitary flow is 4,320 gpd based on a pump that delivers 9 gpm for an 8 hour workday. Existing site is delivering 660 gpd, the new plant will generate 330 gpd for a total of 990 gpd from this site. No modifications to the pump are necessary based on previously approved designed pump under the 2002 office building construction.
- 18. Trees, organic debris, rubble, foundations and other deletrious material shall be removed for the site and disposed in compliance with all applicable laws and regulations. Landfill tickets for such disposal shall be maintained on file by the developer. Burning on site shall be allowed only by permit from the local fire district. If a burn pit is proposed the location and mitigation shall be shown on the grading plan and documented by the soils engineer.
- No trees are to be removed.
- 20. Site complies with Phase II Illicit Storm water discharge guidelines per Ordinance 5082. Site currently has a storm water quality unit that collects all storm water before discharge along West Terra as noted in the drawing
- 21. All lightpoles to be located out of trafficways.
- 22. Retaining wall construction will be under seperate permit.

SEWER MEASUREMENTS

THE EXISTING SEWER LENGTHS, SIZES, FLOWLINES, DEPTHS OF STRUCTURES AND SEWERS AND LOCATIONS WITH RESPECT TO EXISTING OR PROPOSED EASEMENTS HAVE BEEN MEASURED. THE RESULTS OF THOSE MEASUREMENTS ARE SHOWN ON THIS SET OF FINAL MEASUREMENT PLANS

ALL PUBLIC SEWERS ARE LOCATED WHITH TO SCHOOL EXISTING OR PROPOSED EASEMENTS EXCEPT AS FOLLOWS: MAJKE P.E/L.S. COLUMB !

APRIL 19, 2007 CITY # 98-59.05

RD 330 ₩ W 0 JF 몽 0 11 2 WEBE CREV AND 00> 320 320 14-

E Z N

0 D

DISCLAIMER OF RESPONSIBILITY I hereby specify that the documents intended to be authenticated by my seal are limited to this sheet, and I hereby disclaim any responsibility for all other Drawings, Specifications, Estimates, Reports or other documents or instruments relating to or intended to be w for any part or parts of the architectural of engineering project or survey.

Copyright 2008 Box Engineering Company, Inc. All Rights Reserved REVISIONS 09/24/08 CITY COMMENTS



ENGINEERING PLANNING SURVEYING


221 Point West Blvd. St. Charles, MO 63301 636-928-5552 FAX 928-1718

09/22/08

84-1628G PROJECT NUMBER

FILE NAME DRAWN


DESIGNED CHECKED

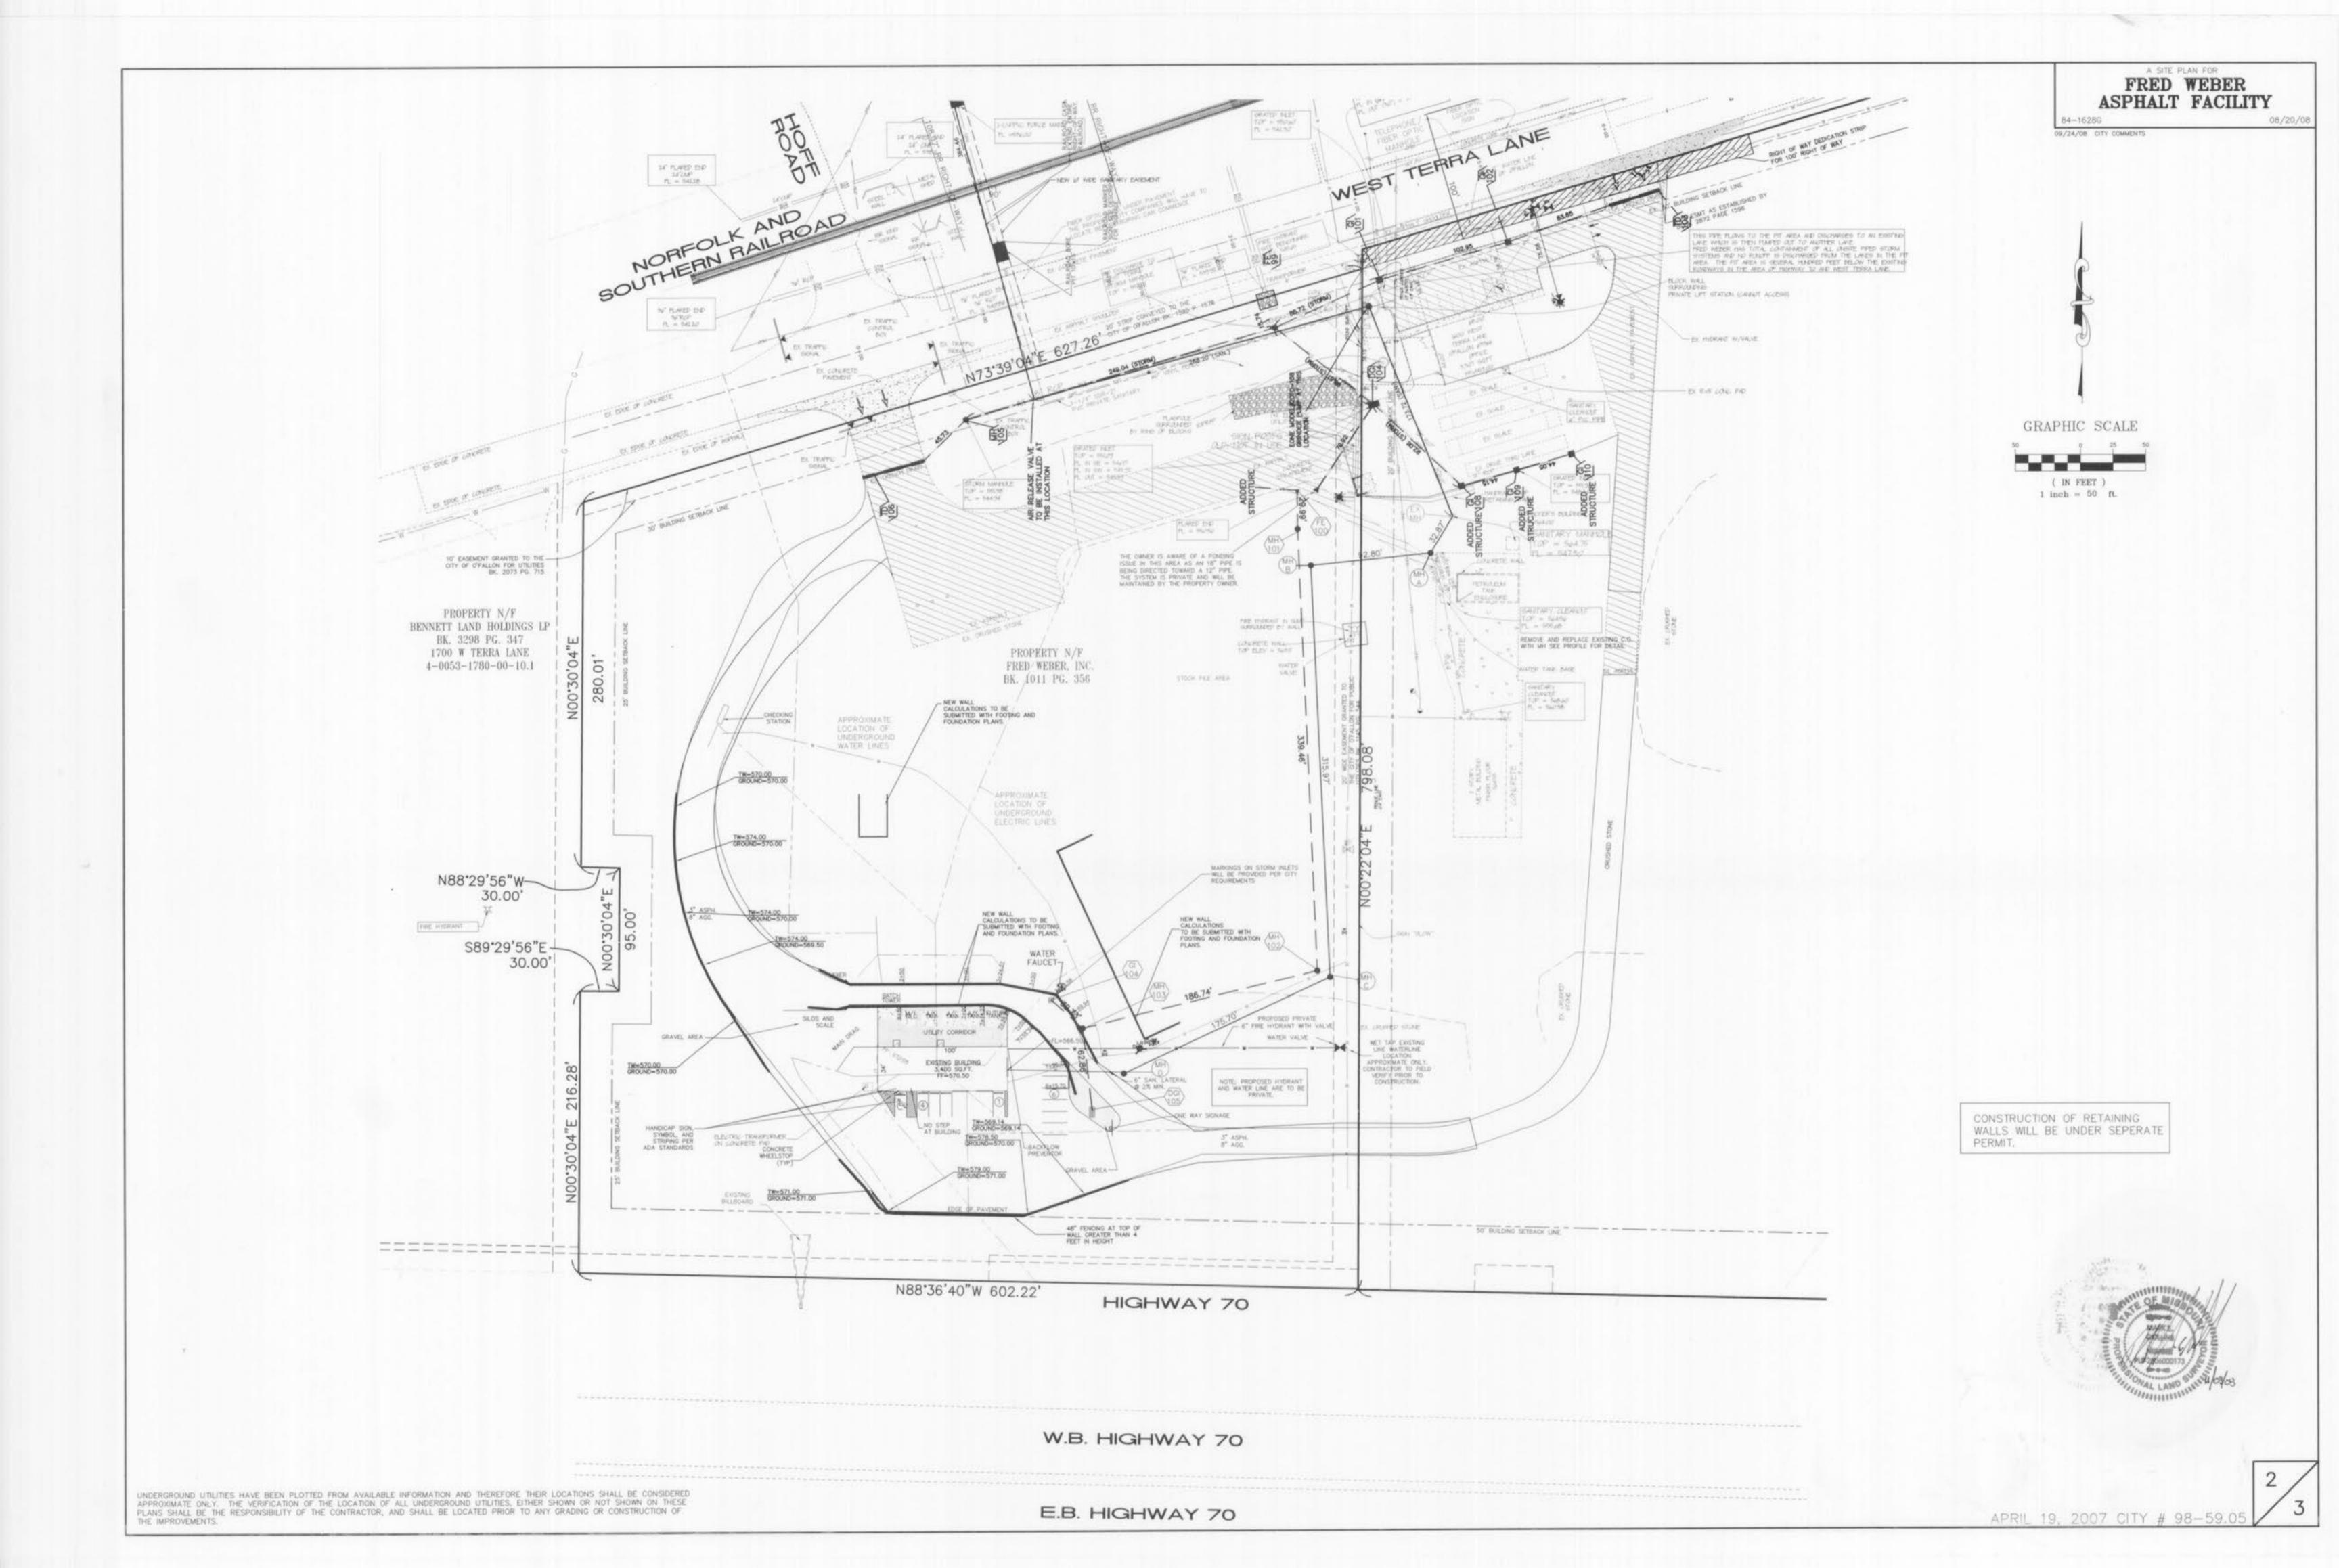


FRED WEBER
ASPHALT FACILITY

84–1628G 08/20/08

00/24/08 CITY COMMENTS

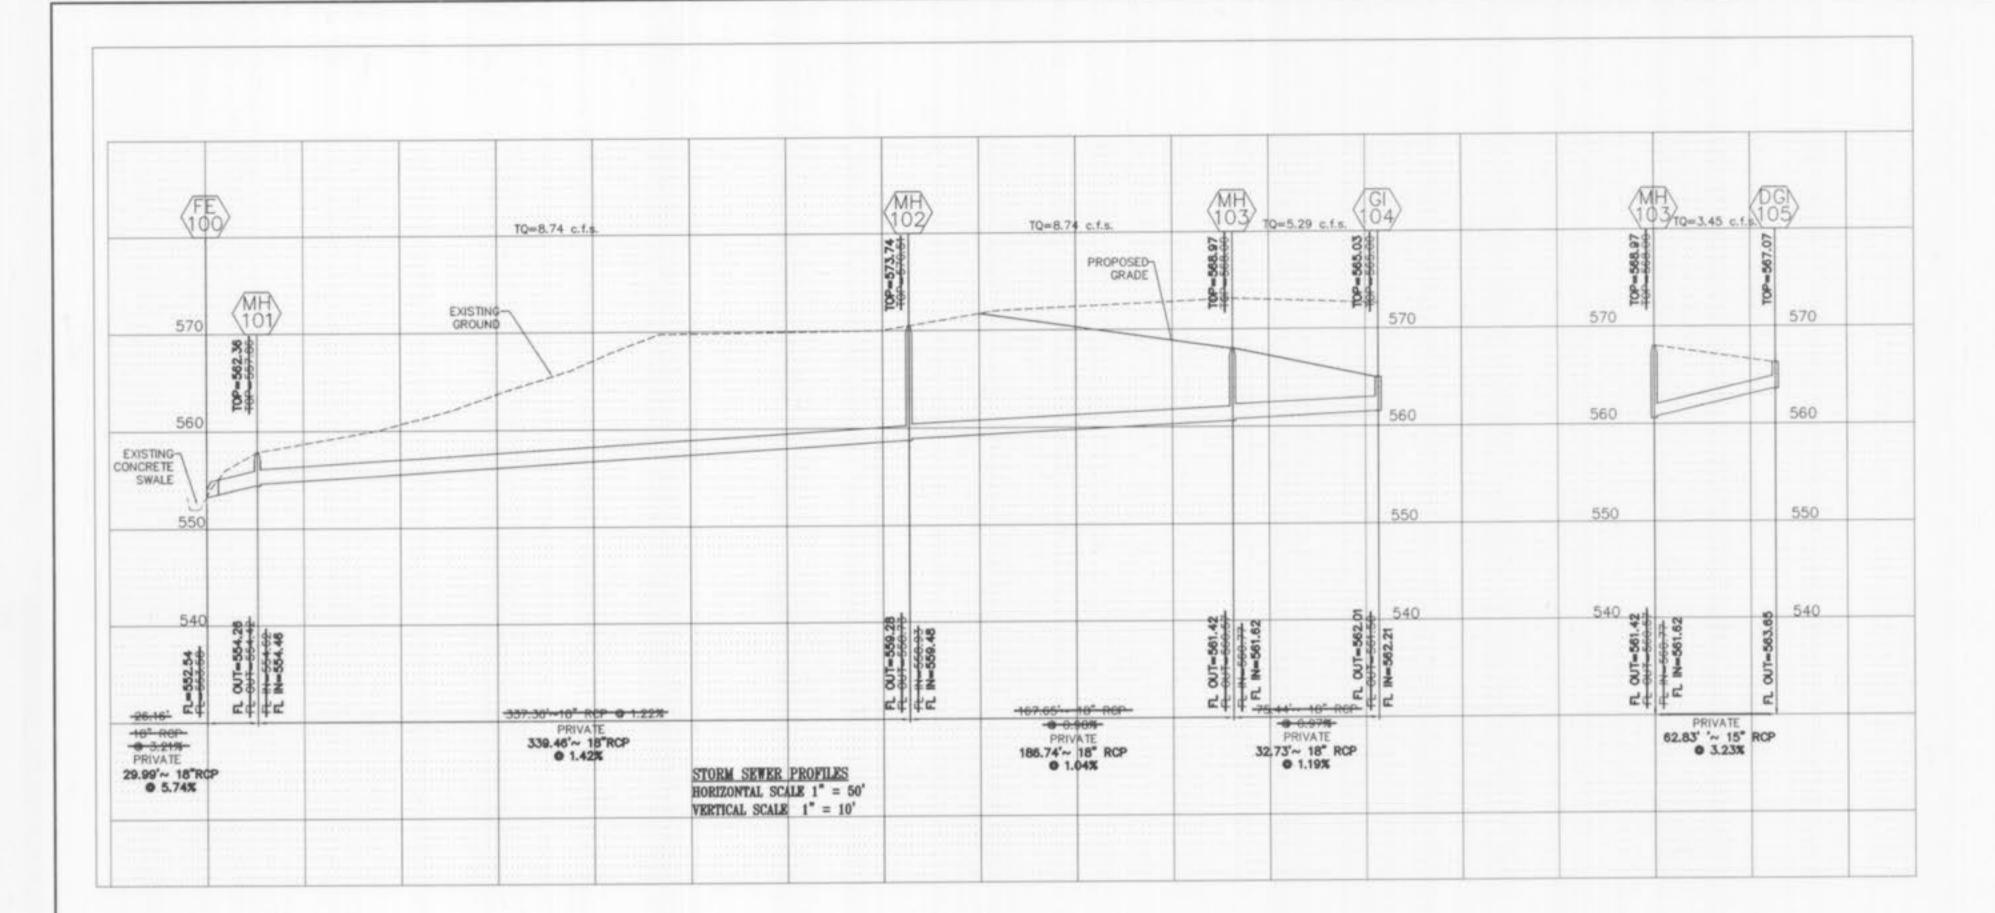

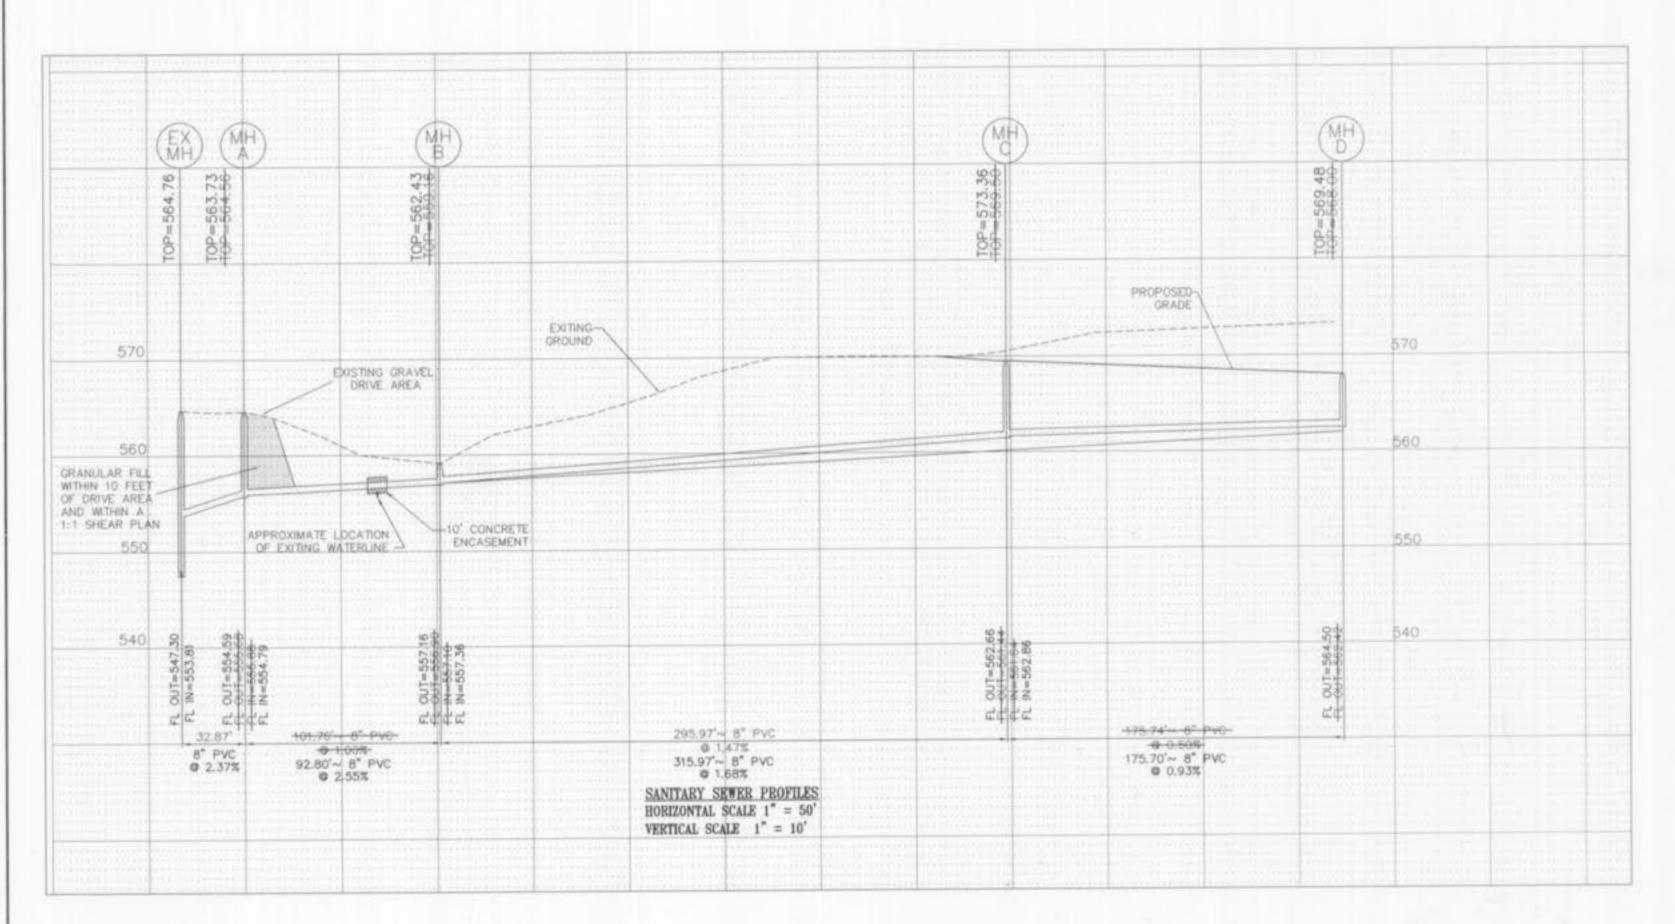

BAX PROJECT NO. : 84-1628G
DESIGN DATE : 10-14-08
DESIGN DATE : 10-1

* INDICATES CRITICAL DEPTH

MOLINA DE MANTE DE LA PROPERTIE DE LA PROPERTI