

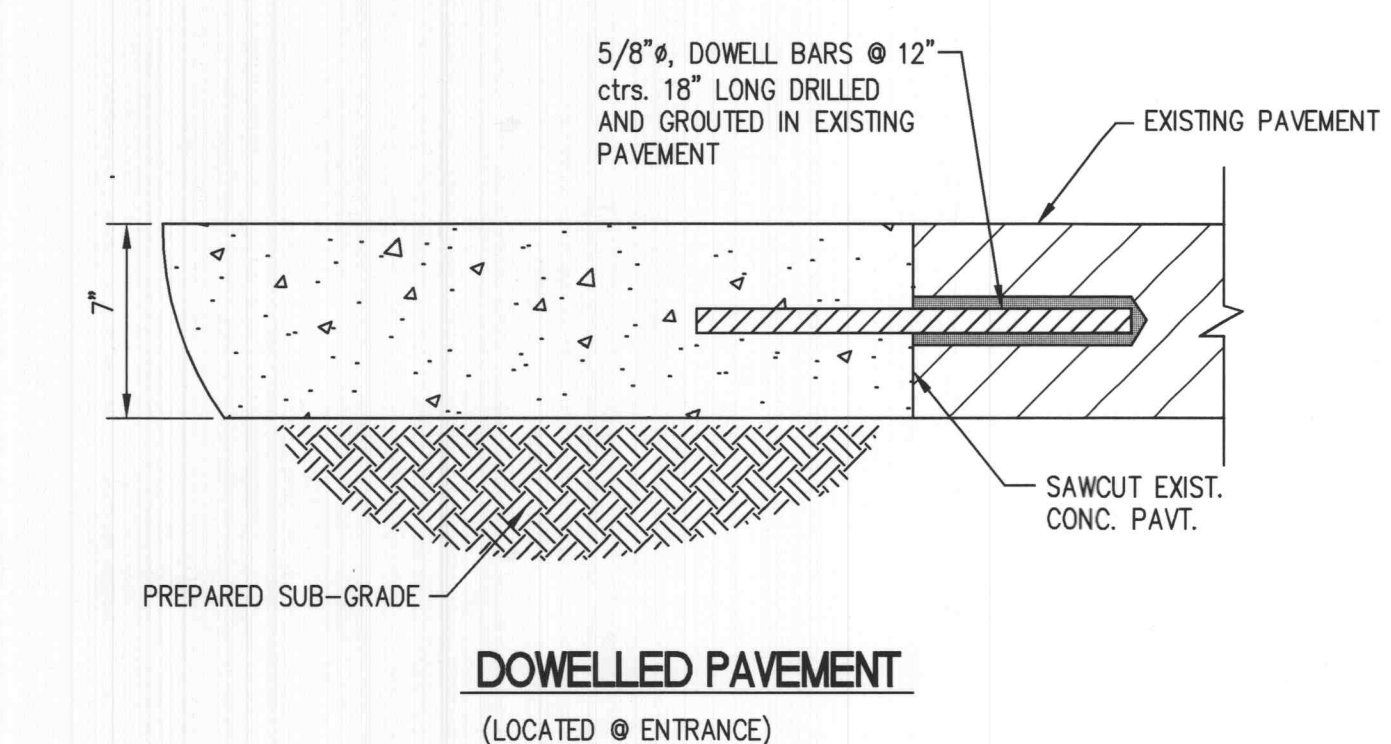
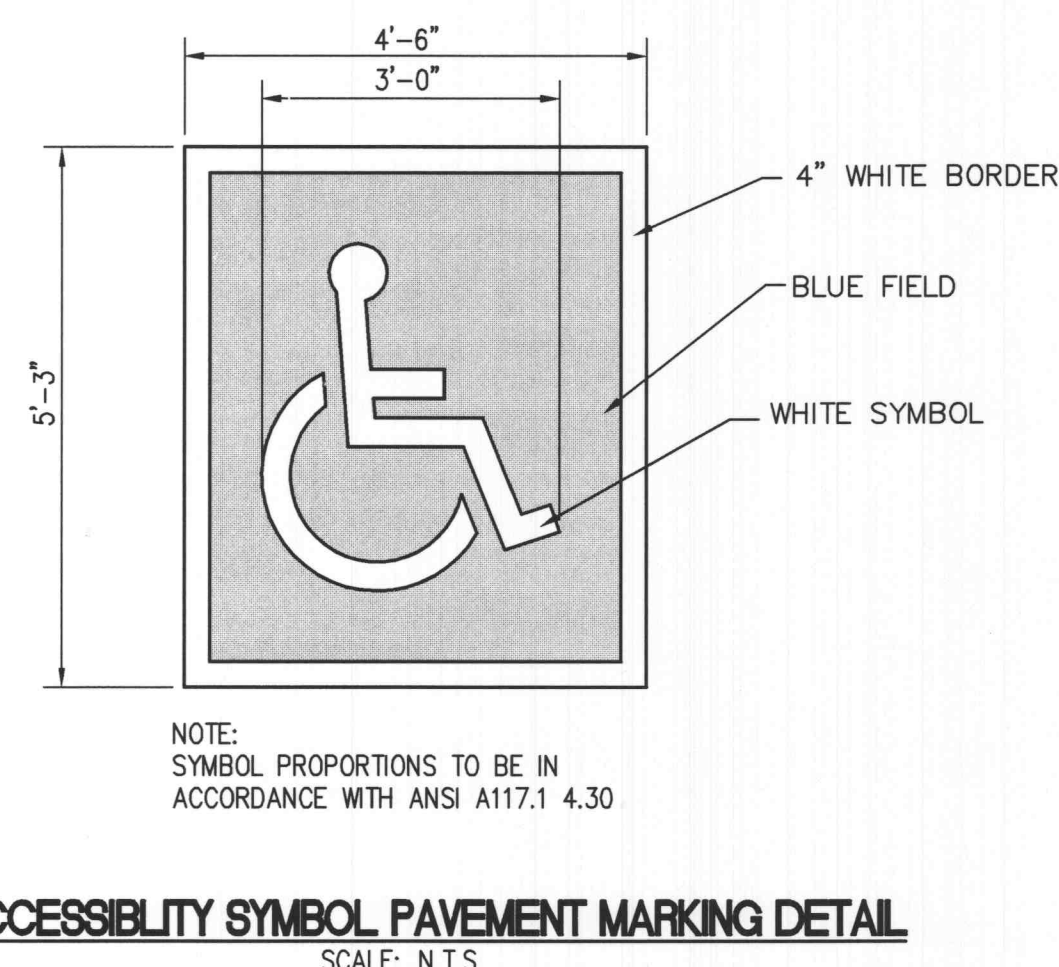
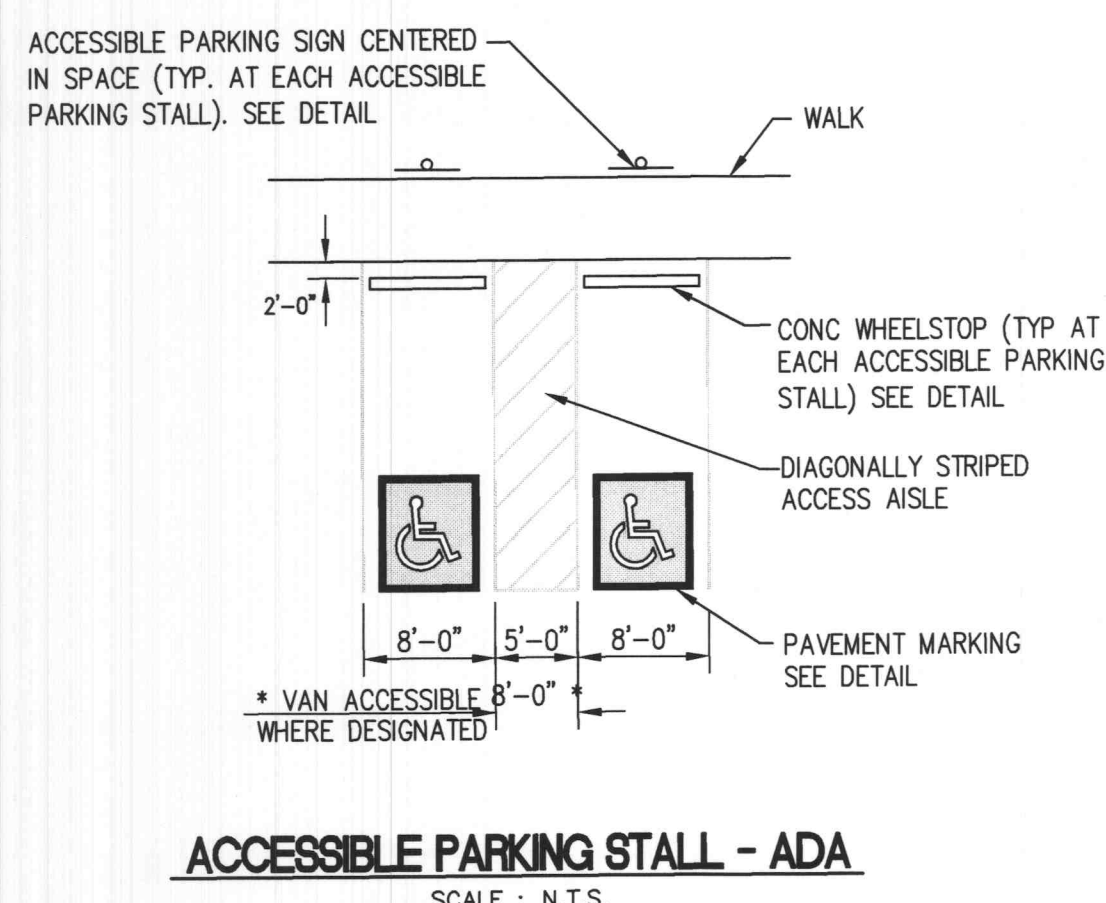


- NOTES:
- ALL CONCRETE SHALL BE MIN. FC.=3000 P.S.I. (UNLESS OTHERWISE NOTED).
 - ANY UNSUITABLE SOIL (AS DETERMINED BY SOILS ENGINEER) BELOW STRUCTURE SHALL BE REMOVED AND REPLACED WITH SELECT EARTHEN MATERIAL COMPACTED IN PLACE WITH VIBRATORY TAMPER.
 - ALL EXPOSED CONCRETE EDGES TO HAVE 3/4" CHAMFER.
 - DIMENSIONS SHOWN ARE TO BACK OF CURB.

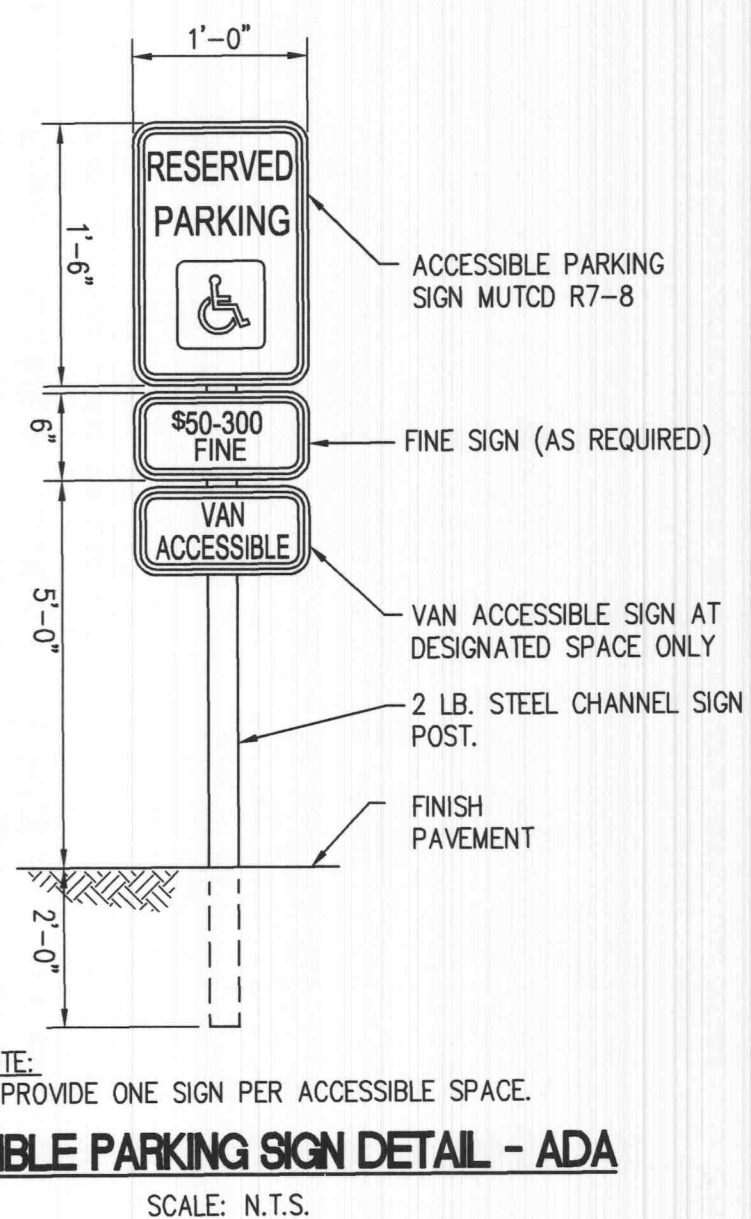

- △ - 06/09/06 REVISED AmerenUE COMMENTS.
- △ - 05/15/06 REVISED PER SEWER DISTRICT COMMENTS. ADDED ABANDONMENT NOTES TO SHEETS C3 and C4, REVISED LATERAL STATIONING, ADDED CONCRETE ENCASUREMENT.
- △ - 05/03/06 REVISED PER CITY COMMENTS
- △ - 04/25/06 REVISED PER CITY, SEWER DISTRICT AND CLIENT COMMENTS
- △ - 03/22/06 REVISED PER CITY AND CLIENT COMMENTS

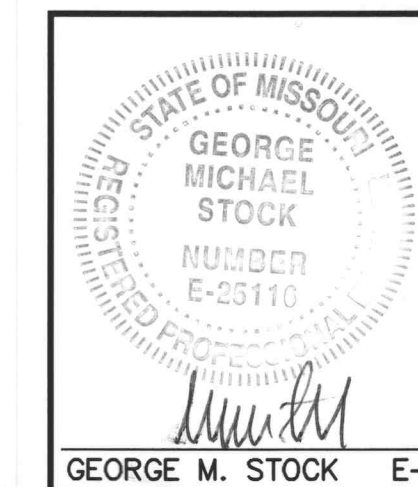

**APC LAB FACILITY
DETAIL SHEET**

STOCK & ASSOCIATES
Consulting Engineers, Inc.

257 Chesterfield Business Parkway
St. Louis, MO 63005
PH. (636) 530-9100
FAX (636) 530-9130
e-mail: general@stockassoc.com
Web: www.stockassoc.com

DRAWN BY: A.C.D. DATE: 01/23/06 CHECKED BY: D.P.B. DATE: 01/23/06 JOB NUMBER: 205-3635.1 SHEET: C9 of C12