


TORUSHED STONE.

INSTALLATION)

THROUGH

SOLID ROCK EXCAVATION

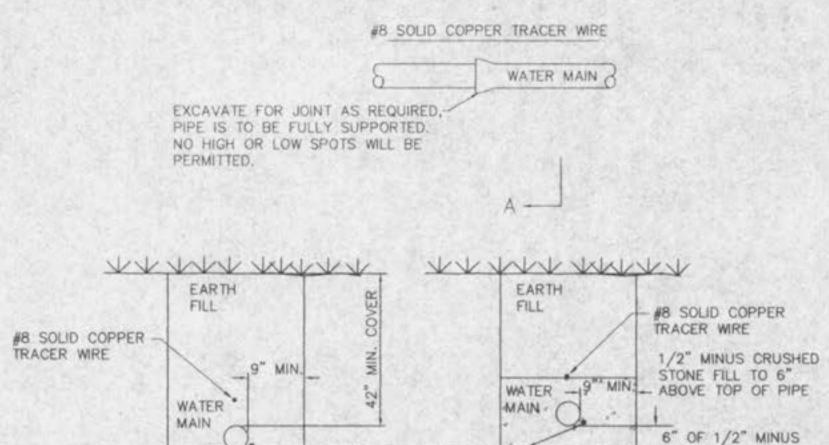


TYPICAL WATER MAIN INSTALLATION DETAILS

SECTION A-A

600 V. INSULATED

LOCATER WIRE


EARTH EXCAVATION

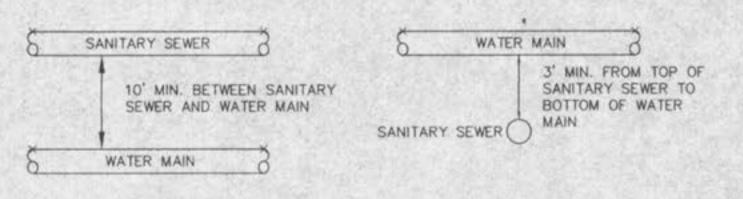


HORIZONTAL DISTANCE

VERTICAL DISTANCE


TYPICAL WATER AND SEWER SEPARATION NOT TO SCALE

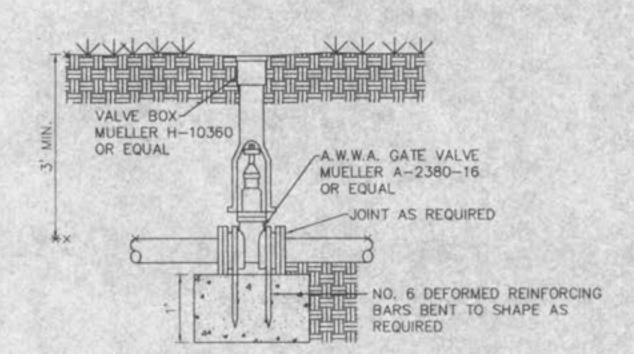


GATE VALVE W/THRUST BLOCK

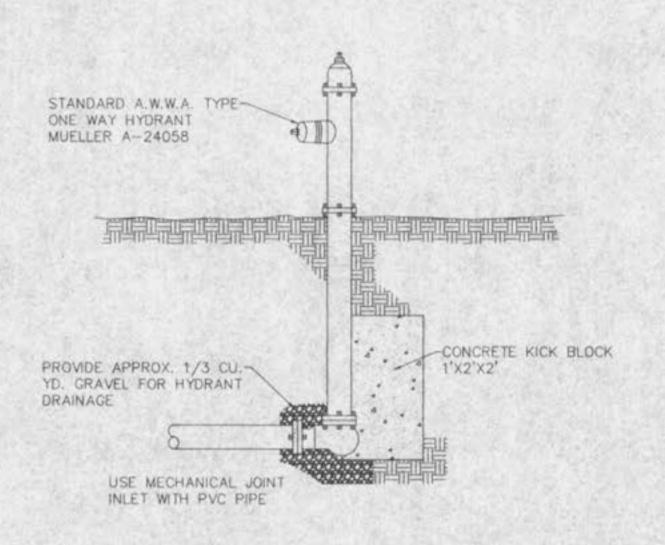

FLUSHING HYDRANT

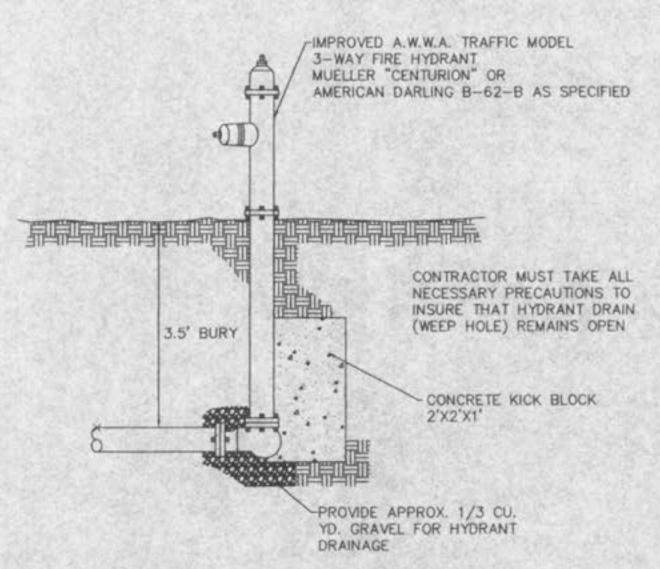

FIRE HYDRANT INSTALLATION DETAIL
NOT TO SCALE

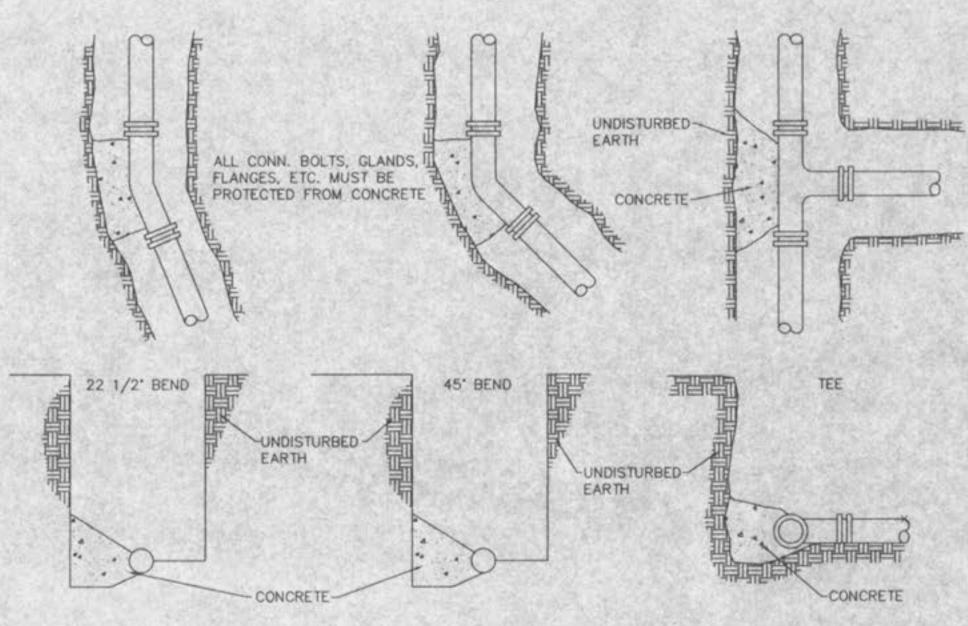

TYPICAL THRUST BLOCK DETAILS

MAIN SIZE (i.D.)	MIN. THRUST BLOCK BEARING DIMENSIONS TO BEAR AGAINST UNDISTURBED EARTH				
	45° BEND	22 1/2" BEND	TEE	VALVE	CROSS
2"	.5' X 1'	.5' X 1'	.5' X 1'	.5' X 1'	.5' X 1'
4"	1' X 1'	1' X 1'	2' X 1'	2' X 1'	1' X 1'
6"	1.5' X 1'	1' X 1'	2' X 1'	2' X 1'	1' X 1'
8"	2' X 1'	1' X 1'	2' X 2.5'	2' X 2'	1' X 1.5'
10"	2' X 2.5'	1.5' X 2'	2' X 3.5'	2' X 3'	2' X 2'
12"	2' X 3.5'	1.5' X 2.5'	3' X 3.5'	3' X 3'	2' X 3'
16"	3' X 4'	2' X 3'	4' X 4.5'	3' X 4.5'	3' X 3.5'

TYPICAL WATER INSTALLATION DETAILS

Baxid-driveNDWG\BOOOPLUS\BE4BCOV GMg THU NOV 12 15 15:28 1998 STATION 24 TMC