


ASHFORD PLACE  
STORM PROFILES

Rev. 3-22-95, C.M.P. 415195

SCALE: Horiz 1"=50'  
VERT. 1"=10'

DATE: \_\_\_\_\_  
BY: \_\_\_\_\_  
REVISIONS:  
NO. DATE DESCRIPTION  
1. 5/21/96  
2. 5/8/96


DATE: \_\_\_\_\_  
BY: \_\_\_\_\_  
REVISIONS:  
NO. DATE DESCRIPTION  
1. 5/21/96  
2. 5/8/96

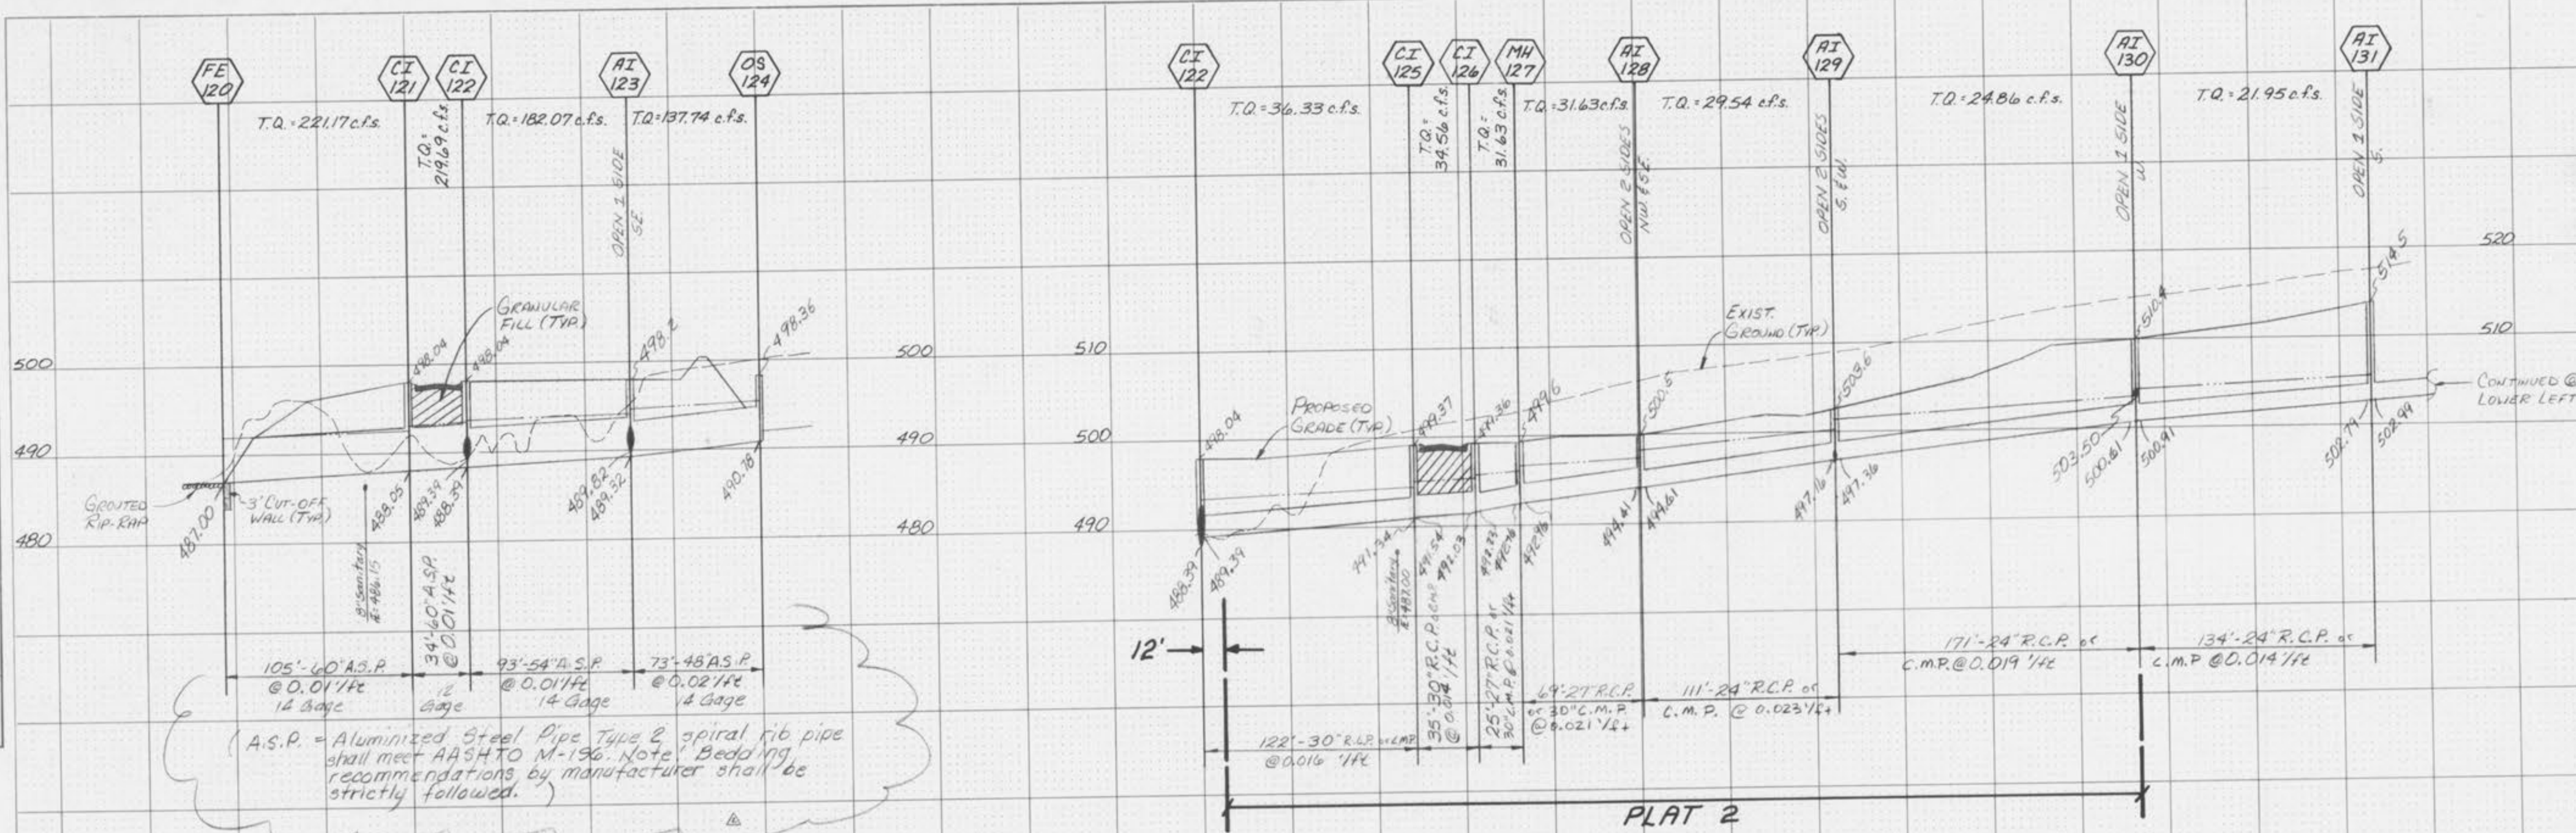

(A.S.P. = Aluminized Steel Pipe Type 2 spiral rib pipe shall meet AASHTO M-196. Note: Bedding recommendations by manufacturer shall be strictly followed.)

The use of High Density Polyethylene Corrugated Pipe with smooth interior wall will be permitted as an acceptable alternative to R.C.P. outside of Public R/W. Pipe shall meet ASTM D-2321 AASHTO M-294-921. Concrete Flared End Sections & Inlet Structures shall be required.

The underground utilities shown herein were plotted from available information and do not necessarily reflect the actual existence, nonexistence, size, type, number, or location of these or other utilities. The general contractor shall be responsible for verifying the actual location of all underground utilities, shown or not shown, and said utilities shall be located in the field prior to any grading, excavation, or construction of improvements. These provisions shall in no way absolve any party from complying with the Underground Facility Safety and Damage Prevention Act, Chapter 319, RSMo.

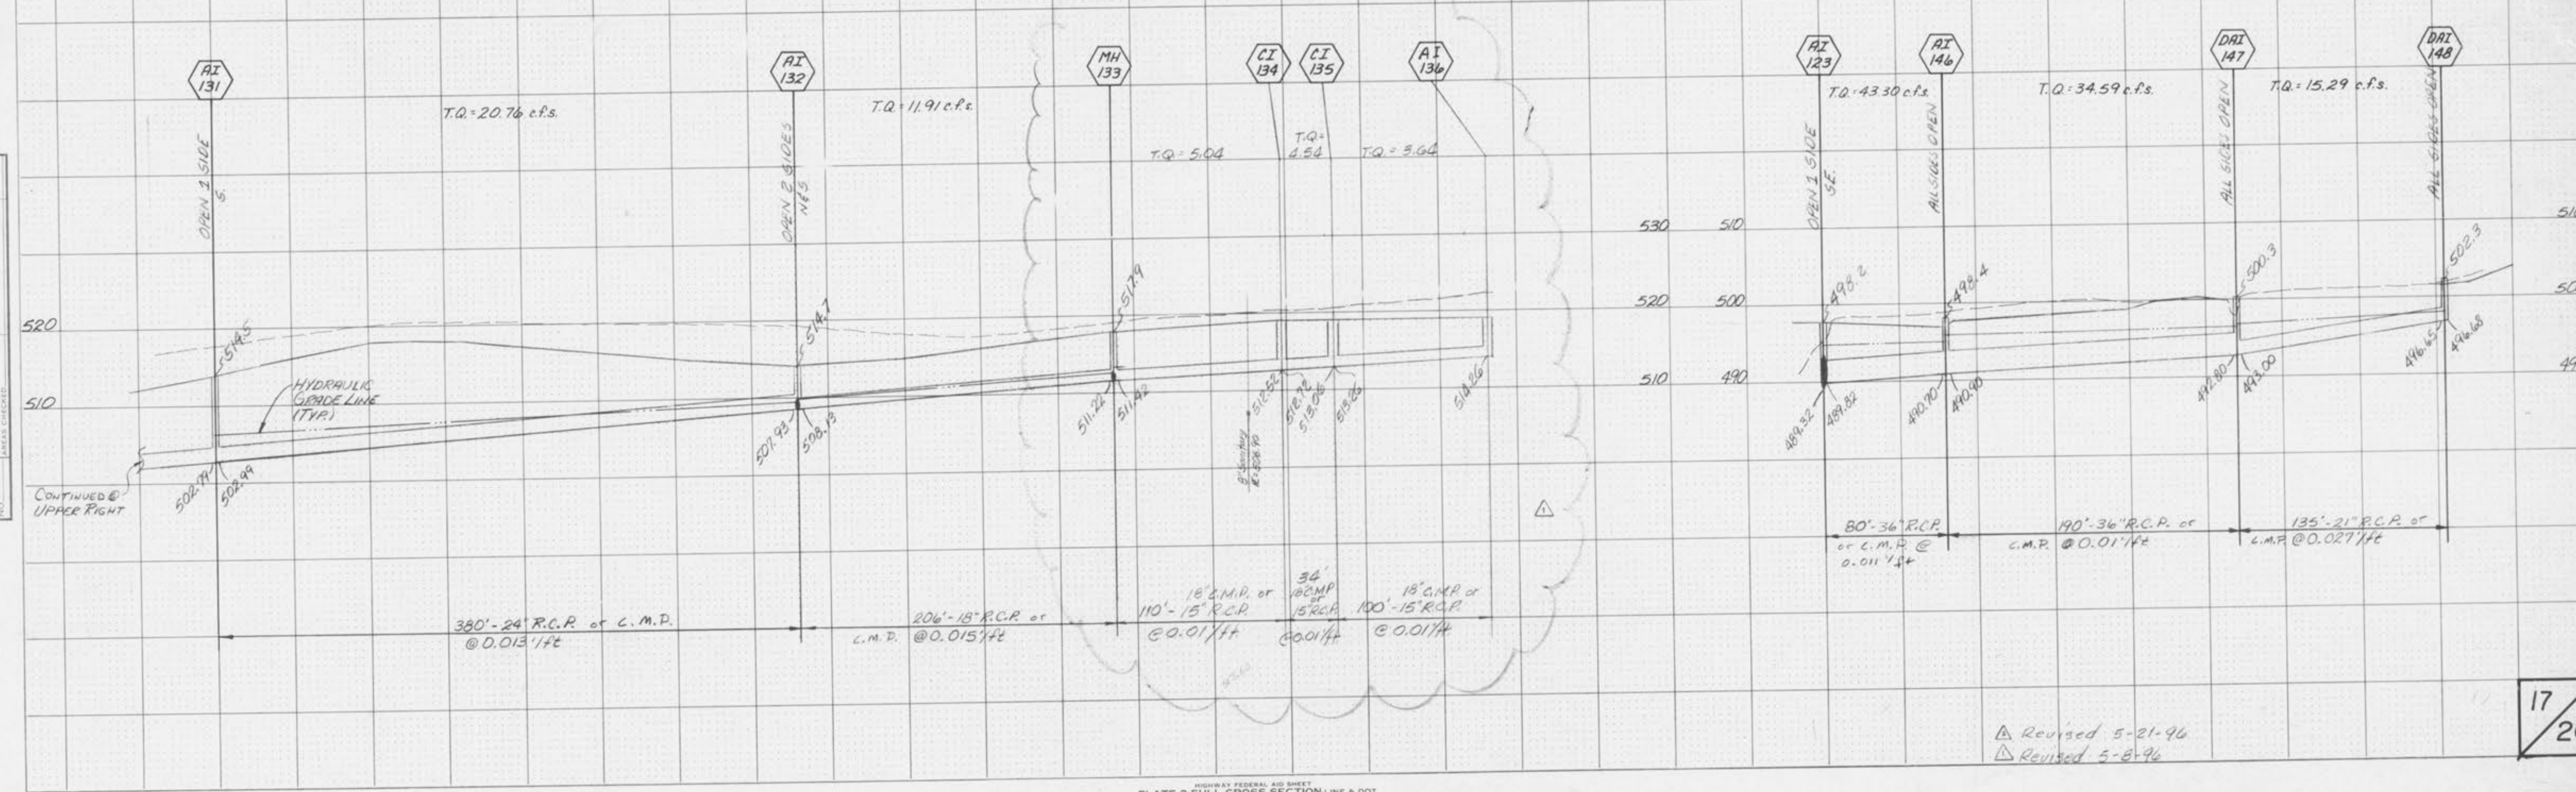

Revised 5-21-96  
Revised 5-8-96