A TRACT OF LAND BEING PART OF U.S. SURVEY 55, TOWNSHIP 47 NORTH, RANGE 3 EAST ST. CHARLES COUTY, MISSOURI

CITY OF O'FALLON GENERAL NOTES


- 1. Gas, water and other underground utilities shall not conflict with the depth or horizontal locations of existing and proposed sanitary and storm sewers, including house laterals.
- 2. Underground utilities have been plotted from available information and, therefore, their locations must be considered approximate only. The verification of the location of all underground utilities, either shown or not shown on these plans, shall be the responsibility of the contractor and shall be located prior to grading or construction of improvements.
- 3. Polyvinyl Chloride (PVC) shall conform to the requirements of ASTM D-3034 Standard Specifications for the PSM Polyvinyl Chloride (PVC) Sewer Pipe and Fittings,
- 4. Storm sewers 18" in diameter or smaller shall be ASTM
- 5. Storm sewers 21" in diameter or larger shall be ASTM C-76, Class II.
- shall be reinforced concrete pipe (ASTM C-76, Class III) unless noted otherwise in the plans.

6. All storm sewer pipe under pavement, regardless of size,

- 7. Corrugated metal pipe shall conform to the standard specifications for corrugated culvert pipe M-36, A.A.S.H.O. See plans for gauge.
- 8. All filled places under buildings, proposed sanitary and storm sewer lines, and/or paved areas including trench backfills shall be compacted to 98% of maximum density as determined by the "A.A.S.H.O. T-99 Standard Proctor Test" (ASTM D-698) unless otherwise specified by the local governing authority specifications. All tests will be verified by a soils engineer.
- 9. All earthen filled places within State, County, or City roads (Highways) shall be compacted to 98% of maximum density as determined by the "Standard Proctor Test A.A.S.H.O. T-99" (ASTM D-698) unless otherwise specified by local governing authority specifications. All tests will be verified by a soils engineer.
- 10. All storm and sanitary trench backfills shall be water jetted. Granular fill will be used under paved areas.
- 11. Easements shall be provided for storm sewers, sanitary sewers, and all utilities on the record plat. See record plat for location and size of easements. This does not apply to house laterals.
- 12. No area shall be cleared without the permission of the
- 13. All grades shall be within 0.2 feet (more or less) of those shown on the grading plan.
- 14. No slope shall be greater than 3:1 and shall be either sodded or seeded and mulched.
- 15. Hazard markers will consist of three (3) standard specification, "Manual on Uniform Traffic Control Devices," end of roadway markers mounted on two (2) pound "U" channel sign post. Each marker shall consist of an eighteen (18) inch diamond reflectorized red panel. The bottom of each panel shall be mounted a minimum of four (4) feet above the elevation of the pavement surface.
- 16. All manhole and curb inlet tops built without elevations furnished by the Engineer will be the responsibility of the sewer contractor. At the time of construction stakeout of the sewer lines, all curb and grate inlets will be face staked. If normal face stakes fall in line with sewer construction, the Engineer will set these stakes on a double offset. It shall be the responsibility of the sewer contractor to preserve all face stakes from destruction.
- 17. All standard street curb inlets to have front of inlet 2 feet behind curb.
- 18. The minimum vertical distance from the low point of the basement to the flowline of a sanitary sewer at the corresponding house connection shall not be less than the diameter of the sanitary sewer plus a vertical distance not less than two and one-half feet (2-1/2').
- 19. Water lines, valves, sleeves, meters and etc., shall meet all specifications and installation requirements of the local governing authority.

- 20. All cast iron pipe for water mains shall conform to A.W.W.A. specification C-106 and/or C-108. The cast iron fittings shall conform to A.W.W.A. specification C-110. All rubber gasket joints for water cast iron pressure pipe and fittings shall conform to A.W.W.A. specification
- 21. All water hydrants and valves shall be cast iron and installed in accordance with plans and details.
- 22. All sanitary and storm sewers shall meet all specifications and installation requirements of the local governing authority.
- 23. All PVC water pipe shall have a minimum pressure rating of PR-200 or SDR-21.
- 24. All PVC sanitary sewer pipe shall be DR-35 or equal with crushed stone bedding uniformly graded between 1" and 1/4" size. This bedding shall extend from 6" below the pipe to 12" above the top of the pipe.
- 25. All grading on Missouri State Highway Right-of-Way shall be seeded and mulched and all disturbed Right-of-Way markers shall be reest at the completion of grading.
- 26. All streets must meet the specifications and installation requirements of the City of O'Fallon.
- 27. All sanitary manholes top shall be set 0.2' higher than the proposed ground except in pavement areas.
- 28. All sanitary manholes shall have a 31 mil thick coat of coal tar pitch waterproofing.
- 29. All sanitary service lines shall have a 6" diameter for Multi-family and a 4" diameter for single-family
- 30. Manhole frame and cover shall be Clay and Bailey No. 2008 or Neenah R-1736 or Deeter 1315 or approved equal.
- 31. A drop of 0.2 feet is required through each sanitary
- 32. The City of O'Fallon shall be notified at least 48 hours prior to construction of sanitary sewers for coordination
- 33. Brick shall not be used on manholes.
- 34. Sewer contractor shall maintain 24" vertical separation between all storm sewers and the sludge force main. Contractor shall be responsible for verifying separation prior to storm sewer installation.
- 35. Waterproofing: Waterproofing will be required on the exterior of all manholes. The bitumen shall consist of two coats of asphalt, coat-tar pitch, or a coating meeting American Society for Testing and Materials (ASTM) D-41. Asphalt shall conform to the requirements of ASTM D 449. Coal-tar pitch shall conform to the requirements of ASTM D-450. Coating shall be 31 mils thickness.

LOCATION MAP

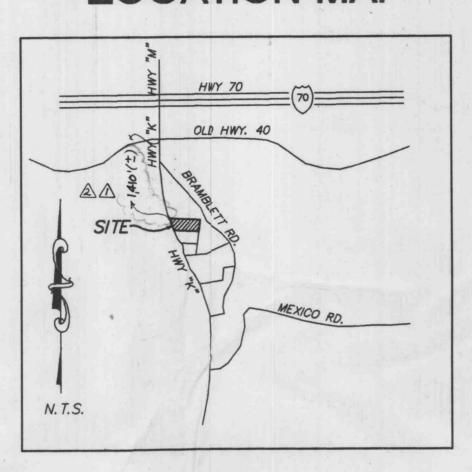

BENCH MARKS

BM #2-83 Highway plans for relocation of Highway "K" square on concrete light standard base 97 feet right at Station 12+43 New Highway

Elev. 574.04

TBM #3-83 80d Spike in base of power pole near northeast corner of Thoele Property at Bramblett Road.

Elev. 567.41

UTILITY COMPANIES

T.C.I. Cable Company 4160 Old Mill Parkway St. Peters, Missouri 63376 Attn: Mr. Rick Macias Phone: (314) 441-7737

G.T.E. Telephone Company 1000 G.T.E. Drive Building "E" Wentzville, Missouri 63385 Attn: Mr. Larry Norris Phone: (314) 639-3928

Union Electric Company 200 Callahan Road Wentzville, Missouri 63385 Attn: Mr. Ralph Crank Phone: (314) 327-6203

St. Charles County Water District No.2 100 Water Drive O'Fallon, Missouri 63366 Attn: Mr. Robert Trader Phone: (314) 625-3737

St. Charles Gas Corporation #1 Westbury Square Building "D" St. Charles, Missouri 63301 Attn: Mr. Gene Bohler Phone: (314) 946-8937

Duckett Creek Sanitary District 2950 Creens Bottom Road St. Charles, Missouri 63303 Attn: . Mr. Mike O'Brien Phone: (314) 441-1244

O'Fallon Fire Protection 119 East Elm Street O'Fallon, Missouri 63366 Attn: Chief David House Phone: (314) 272-3493

Attn: Bill Angel Phone: (314) 340-4100

138 South Main O'Fallon, Missouri 63366 Phone: (314) 240-2000 Missouri State Highway Department (Entrance Permits) 1590 Woodlake Dr. Chesterfield, Missouri 63017

City of O'Fallon (Zoning) (Storm Sewer) (WATER)

ALLIANCE WATER RESOURCES - SANITARY SELVER 205 EAST ELM ST. O'FALLON, MO 13366

DRAWING INDEX

Sheet	Description
1	COVER SHEET
2	GRADING PLAN
3	SITE DETAILS AND SEWER PROFILES
4	SEWER DETAILS
5	DRAINAGE AREA MAP

LEGEND

Sanitary Sewer (Proposed)	M.H. 20	Sanitary Structure	R.C.P.	Reinforced Concrete Pipe
Sanitary Sewer (Existing)	(C.I.) 30)	Storm Structure	C.M.P.	Corrugated Metal Pipe
Storm Sewer (Proposed)	•	Test Hole	C.I.P.	Cast Iron Pipe
======Storm Sewer (Existing)	-OPP	Power Pole	P.V.C.	Polyvinyl Chloride
-8"w- Water Line & Size	-	Light Standard	V.C.P.	Vitrified Clay Pipe
-EX W- Existing water line	⊗9	Double Water Meter Setting		
Tee & Valve	•	Single Water Meter Setting	C.O.	Clean Out
* Hydrant	C.1.	Curb Inlet	V. T.	Vent Trap
E Cap	S.C.I.	Skewed Curb Inlet	T.B.R.	To Be Removed
18 Lot or Building Number	D.C.1	Double Curb Inlet	T.B.R.&R	To Be Removed & Relocate
- x - Existing Fence Line	G.1.	Grate Inlet	T.B.P.	To Be Protected
Existing Tree Line	A.1.	Area Inlet	T.B.A.	To Be Abondoned
s Street Sign	D. A.I.	Double Area Inlet	B.C.	Base Of Curb
Existing Contour	C.C.	Concrete Collar	T.C.	Top Of Curb
Proposed Contour	F.E.	Flored End Section	7. W.	Top Of Wall
Grouted Rip-Rap	E.P.	End Pipe	B.W.	Base Of Wall
End of Lateral	E.D.	Energy Dissipator	(TYP)	Typical
Asphalt Pavement	M.H.	Manhole	U.N.O.	Unless Noted Otherwise
Concrete Pavement	C.P.	Concrete Pipe	U.I.P.	Use in Place

A REV. 1-23-95 PER CITY COMMENTS, L.T.R., DTD 1-19-95 MREV. 12-14-94 PER MHTD & CITY COMMENTS REV. 11-28-94 PER SITE PLAN CMMT. LTR. DTD 11-16-94

P.R.S. PROJECT NO. 87-059

PROJ. MANAGER: R.J.T.

DRAWN BY: R.D.W.

DATE: 11-16-94 7NR