
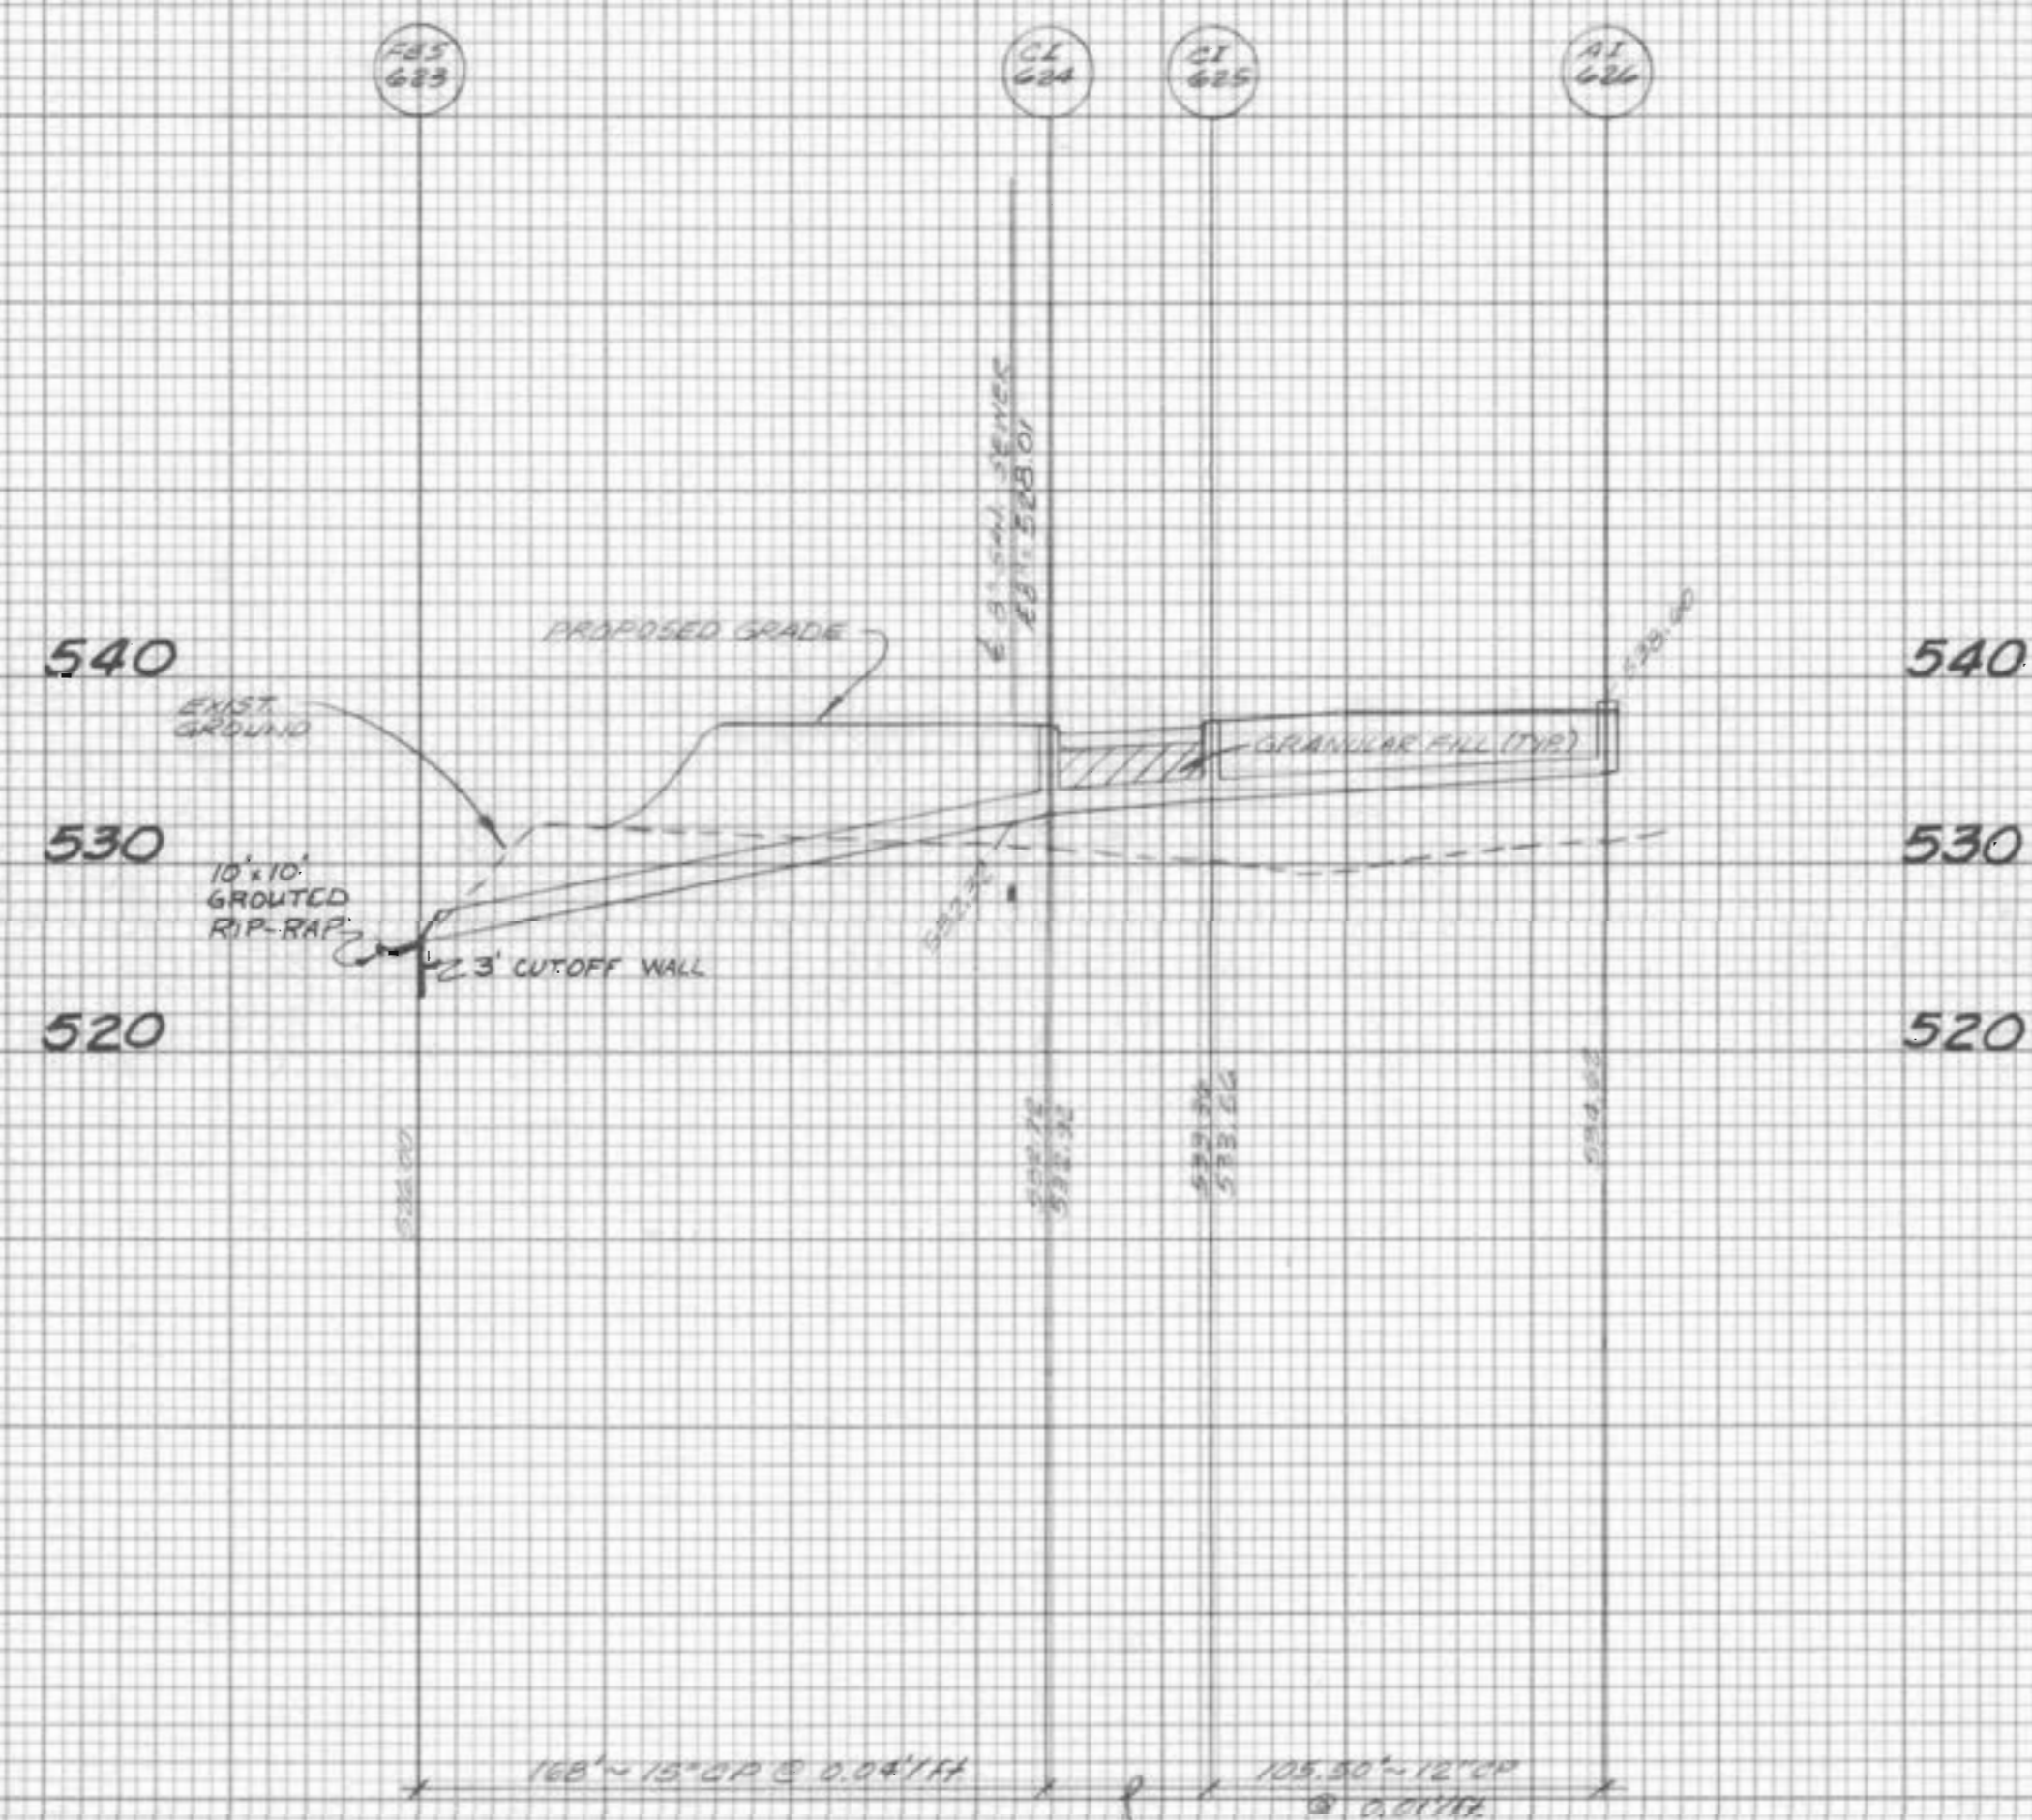
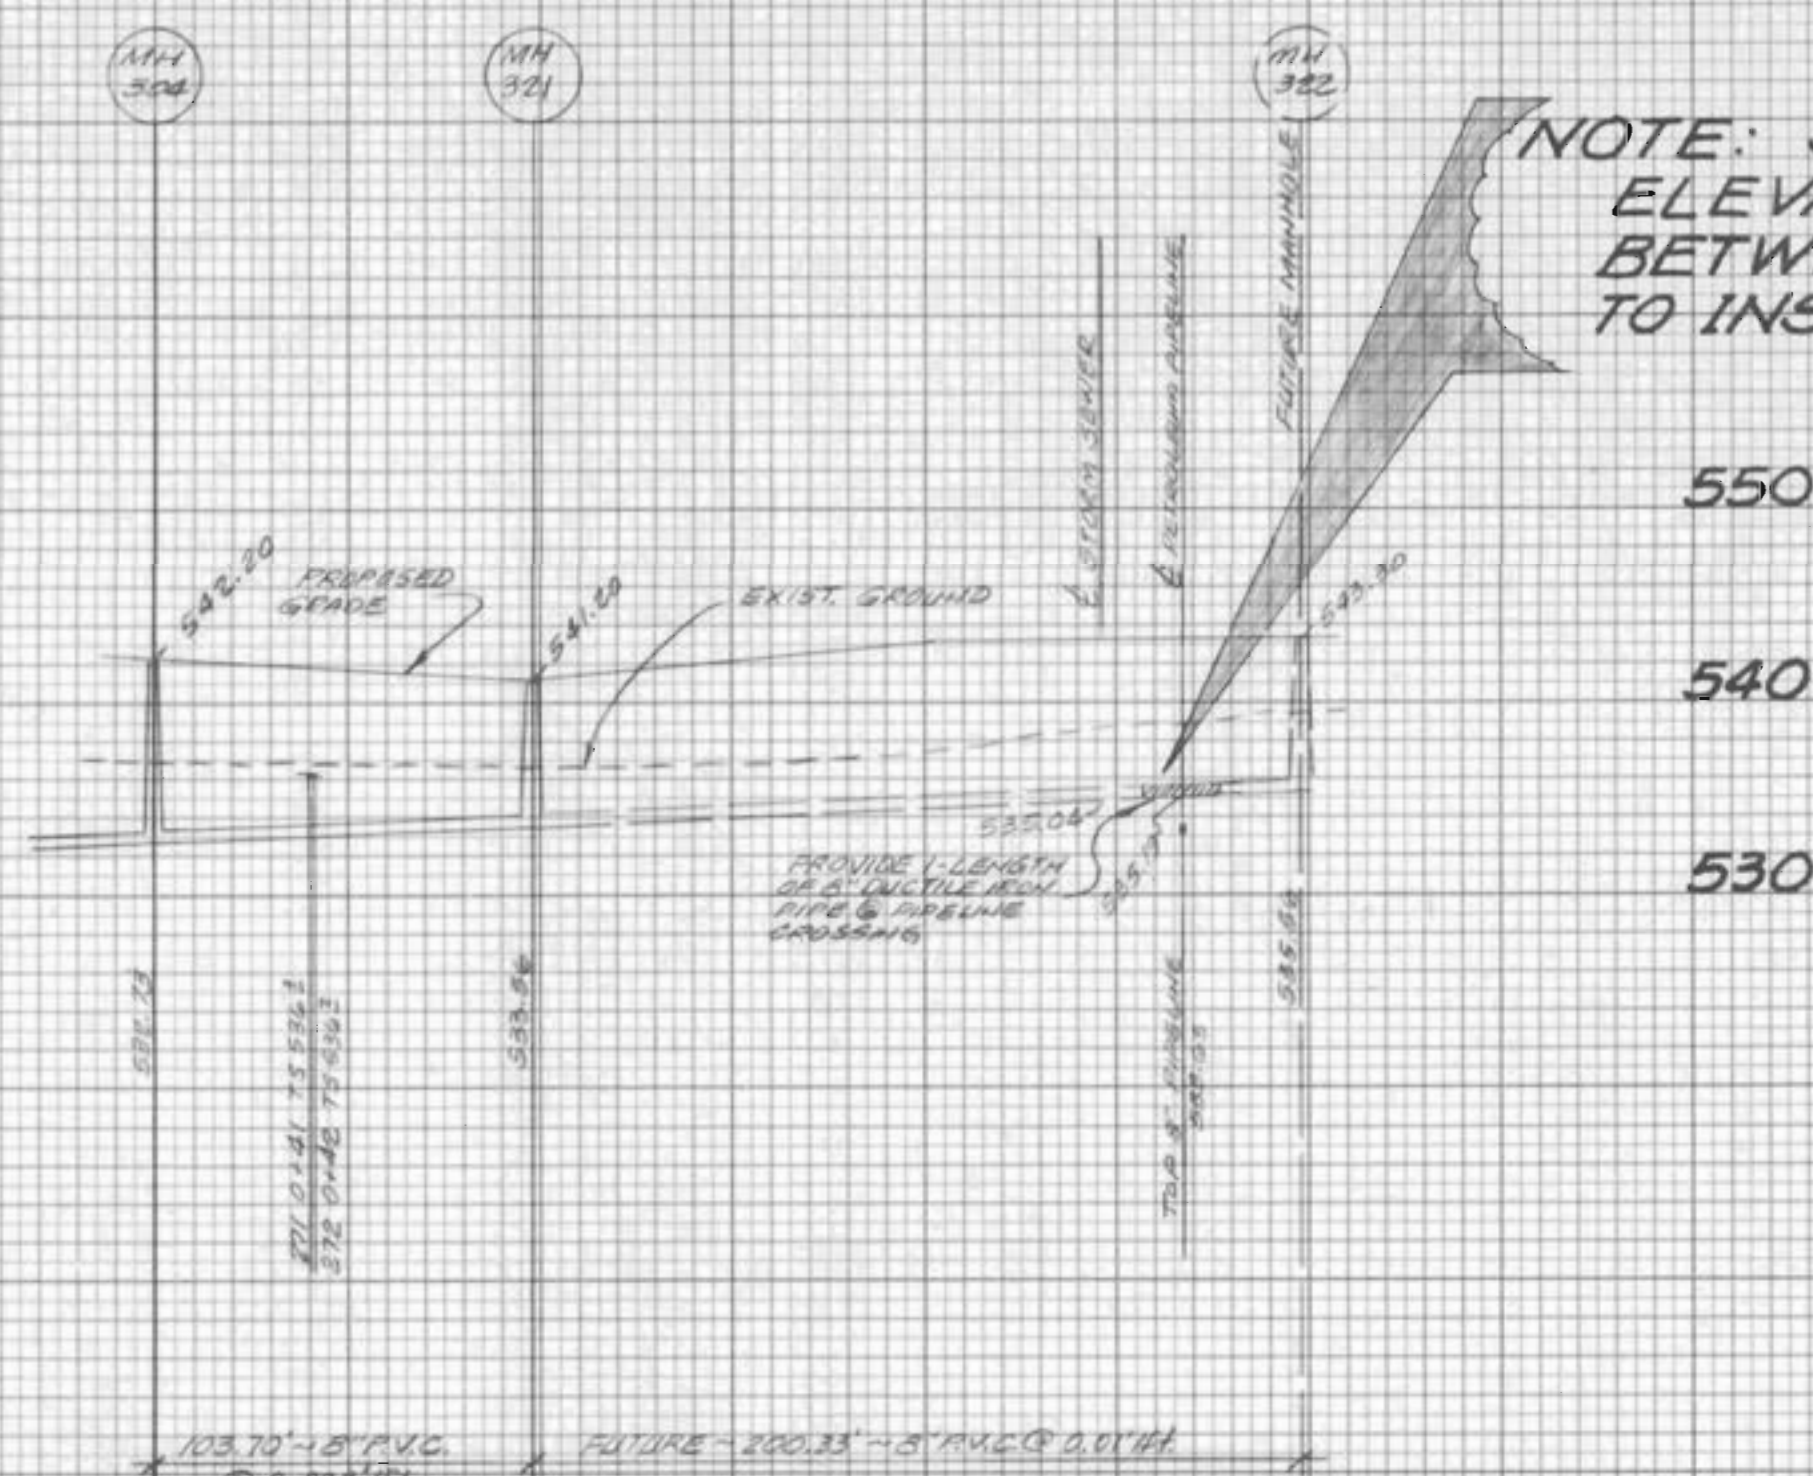


NOTE: SEWER CONTRACTOR TO VERIFY ELEVATION OF PETROLEUM PIPELINE BETWEEN MH 321 & FUTURE M.H. 322 PRIOR TO INSTALLATION OF ANY SANITARY SEWERS.

FINAL SURVEY  
DATE: \_\_\_\_\_  
BY: \_\_\_\_\_  
REVIEWED: \_\_\_\_\_  
PLOTTED: \_\_\_\_\_  
NOTE BOOK: \_\_\_\_\_  
NO. \_\_\_\_\_  
CHECKED: \_\_\_\_\_

ORIGINAL SURVEY  
DATE: \_\_\_\_\_  
BY: \_\_\_\_\_  
REVIEWED: \_\_\_\_\_  
PLOTTED: \_\_\_\_\_  
NOTE BOOK: \_\_\_\_\_  
NO. \_\_\_\_\_  
CHECKED: \_\_\_\_\_

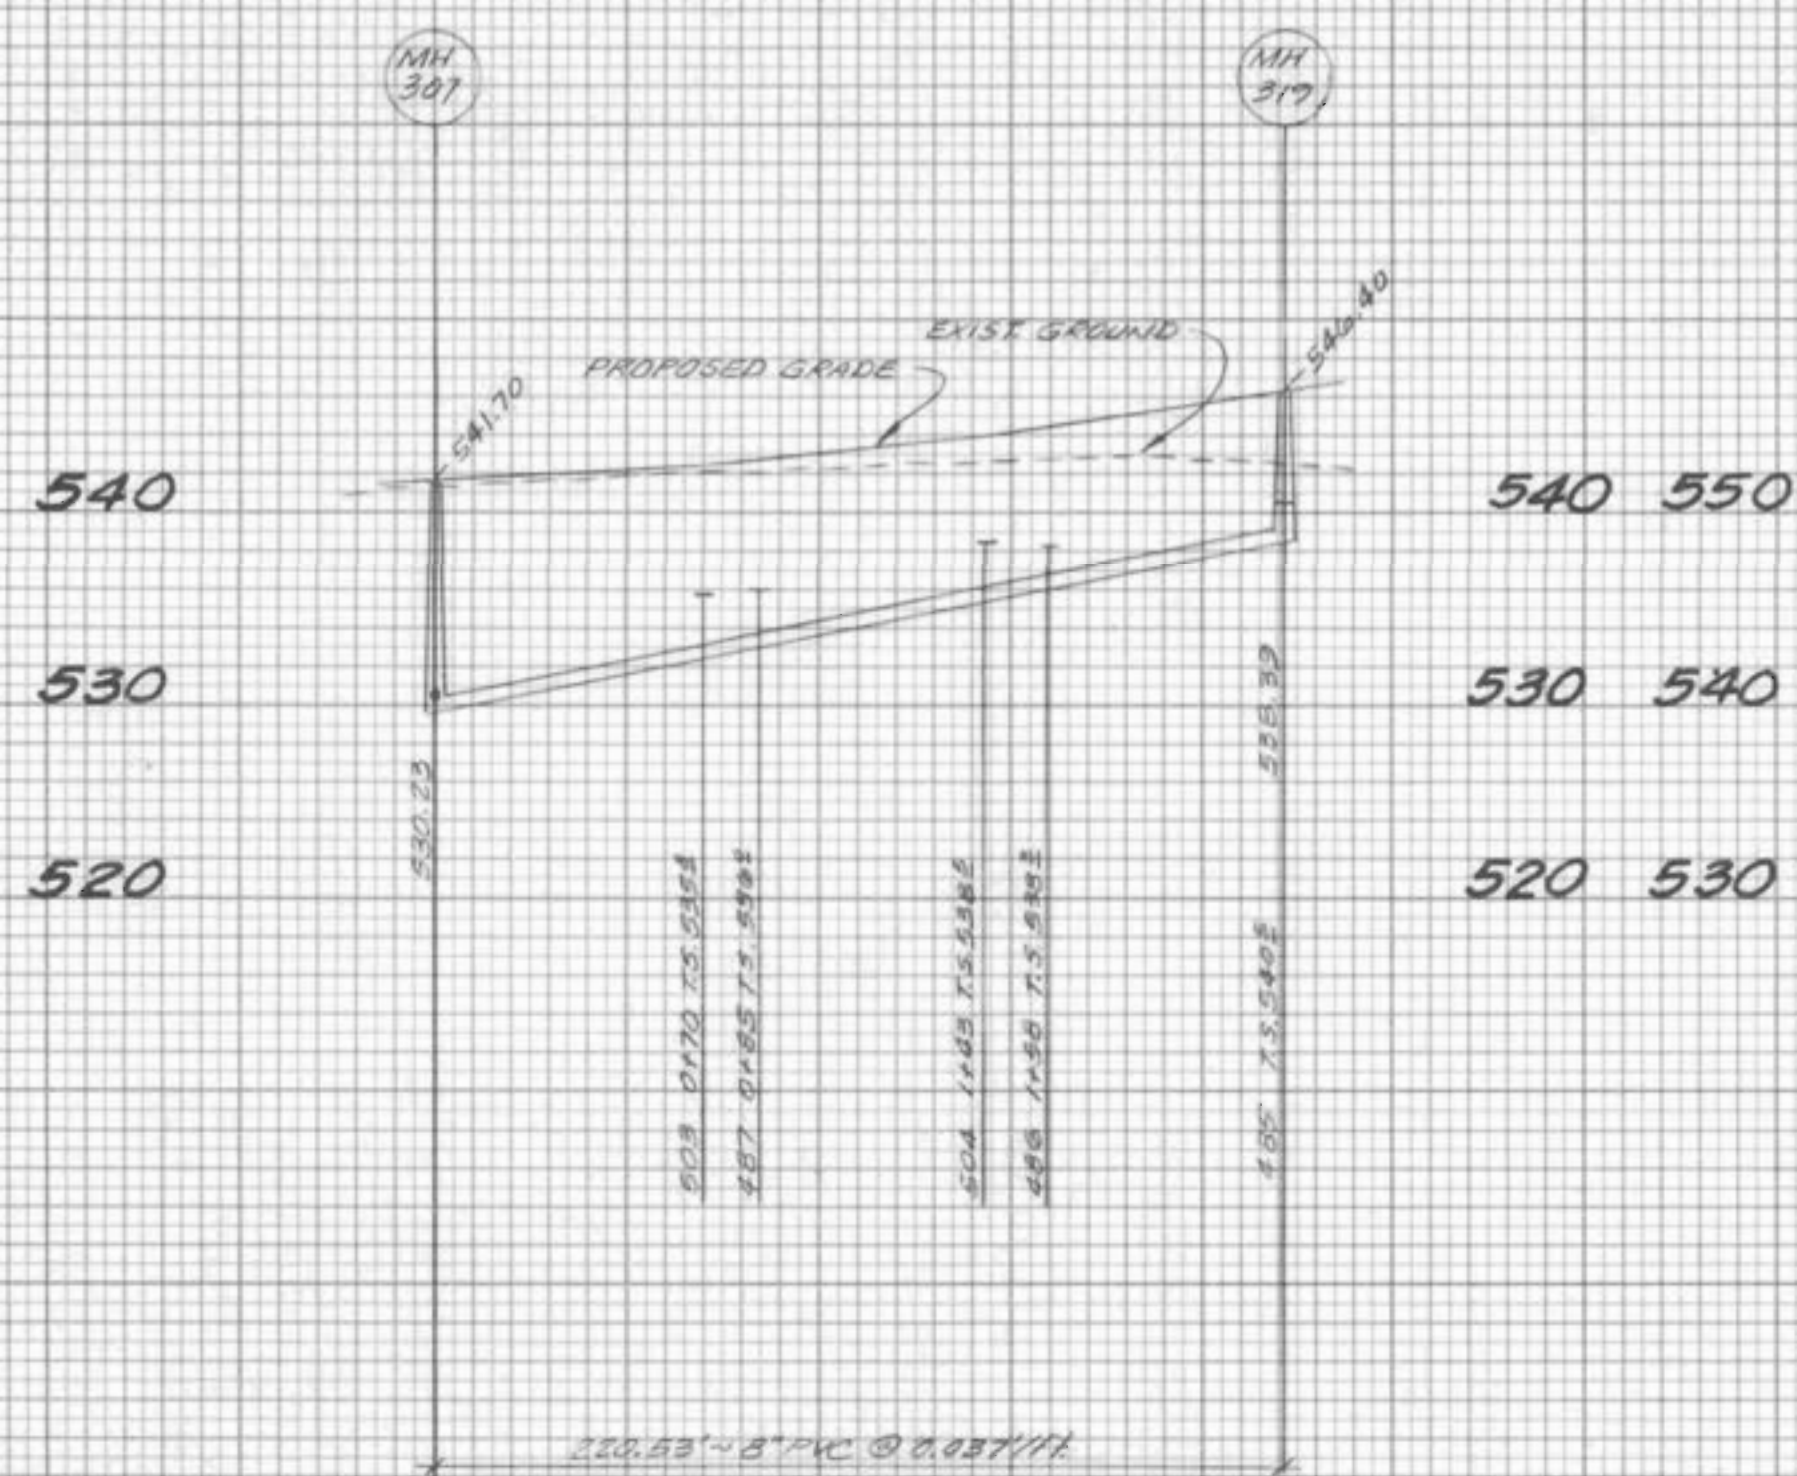

Any sanitary sewer that is placed at any slope less than 0.008'/ft. must have the actual slope verified by the project engineer before placement of any backfill. Any portion that has a slope of less than 0.007'/ft. must be removed and replaced at a minimum slope of 0.007'/ft.