


APPROVED
Watt
Letter

All Mechanical Work Shall
Meet the Requirements of
The Basic Mechanical Code.
MRE

THESE DRAWINGS ARE HEREBY
APPROVED FOR PERMIT AND
ANNOTATED AS NEEDED TO
MEET THE REQUIREMENTS
OF THE CITY
MAY 1986
SHEETS 11 OF
DATE OF PLANS 4/3/86


All Electrical Work
Shall Meet The Requirements
Of The
National Electrical Code.

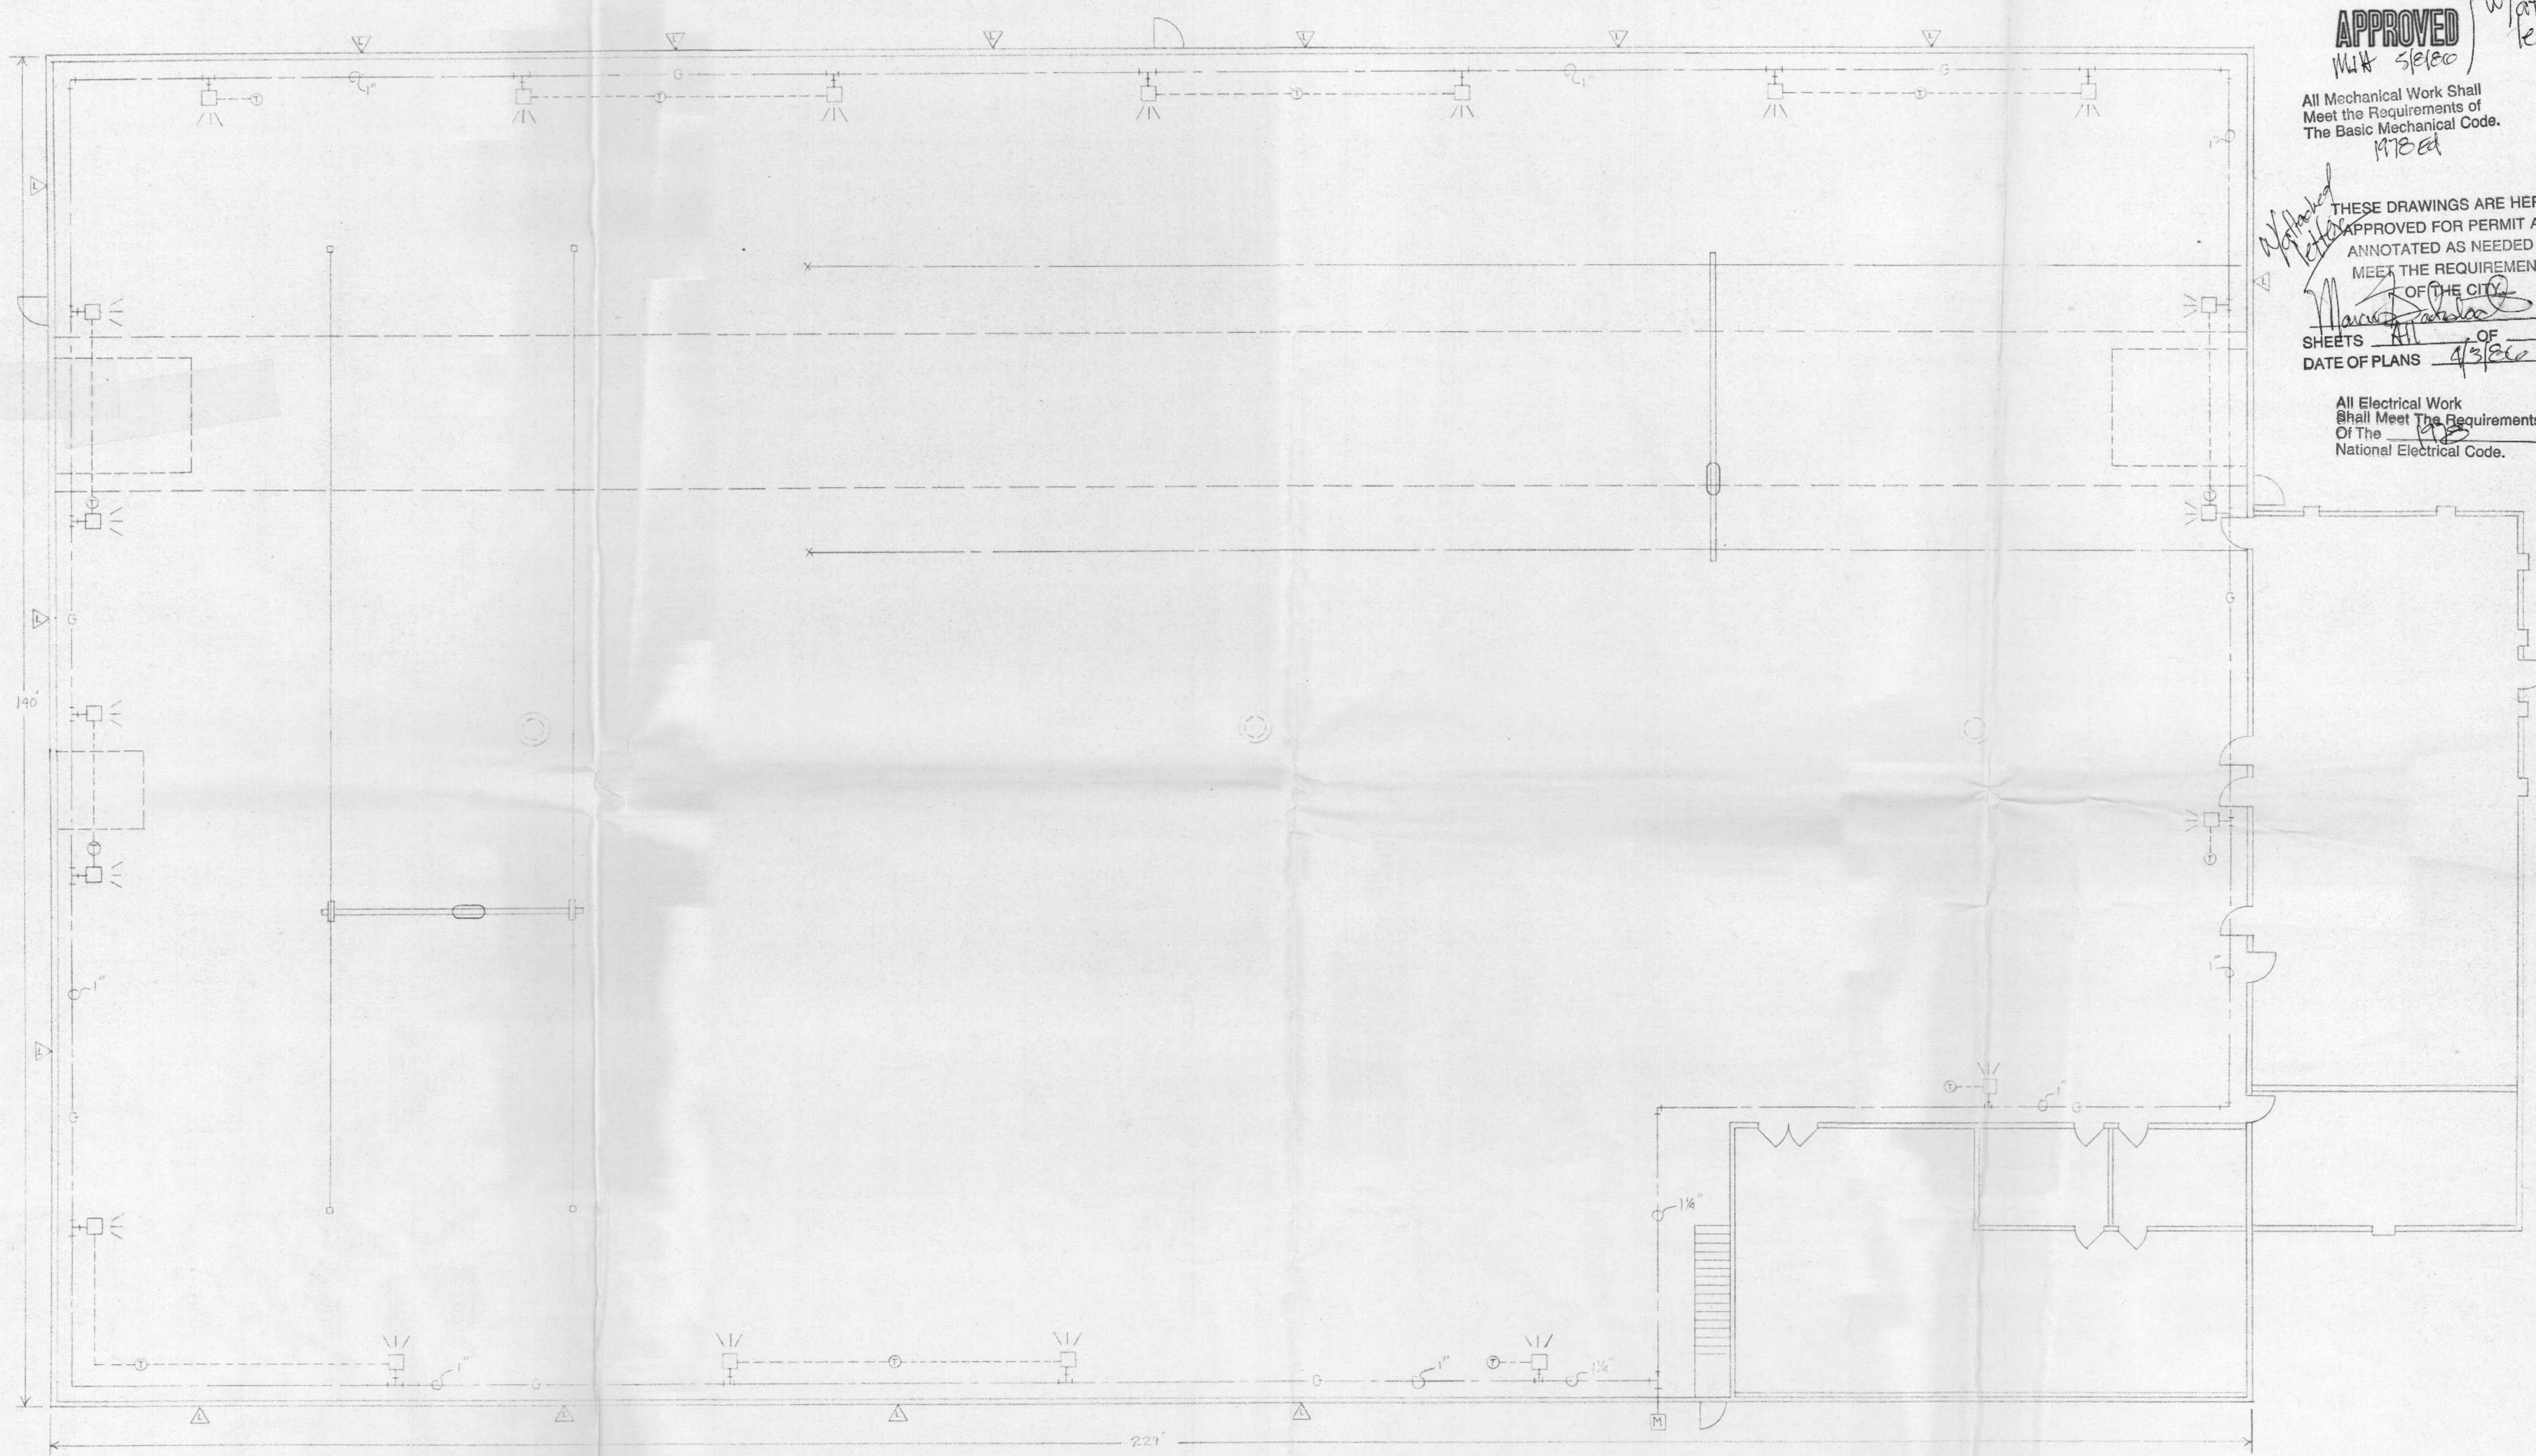

- LEGEND
- DR-60 NSPI-8 RADIANT HEATER
 - ⊙ LINE VOLTAGE THERMOSTAT
 - △ NFA 8"x16" LOUVERS

CLEARANCE TO COMBUSTIBLES

	SIDES	BACK	TOP	BELOW
DR-60-NSPI-8	32"	18"	40"	72"

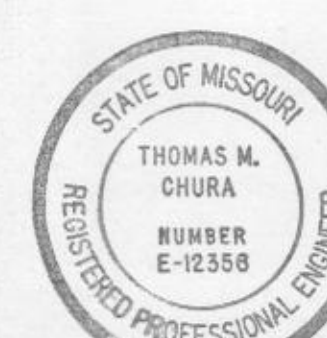

RADIANT HEAT LAYOUT HEX MACHINE SERVICE, INC.		
SCALE: 1/4" = 1'-0"	APPROVED BY: [Signature]	DRAWN BY: [Signature]
DATE: 4-3-86	A/C & HTS SPECIALISTS MARYLAND RTS. INC.	
MID-VALLEY RADIANTS & IND. INC. ST. LOUIS, MO.		DRAWING NO. 85-240