ASPHALT PAVEMENT (PARKING AREAS)

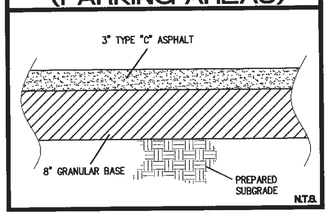

1. ASPHALT PAVEMENT SHALL BE COMPACTED TO 98% MAXIMUM DENSITY.
2. SUB GRADE AND BASE BENEATH PAVEMENTS SHALL BE COMPACTED TO ST. CHARLES COUNTY HIGHWAY DEPARTMENT SPECIFICATIONS. THE MOISTURE RANGE SHALL BE DETERMINED BY THE STANDARD OR MODIFIED PROCTOR DENSITY METHOD AASHTO T-99 AND WITHIN -2/+4 PERCENTAGE POINTS OF THE OPTIMUM MOISTURE CONTENT.

ASPHALT PAVEMENT (DRIVE AISLES)

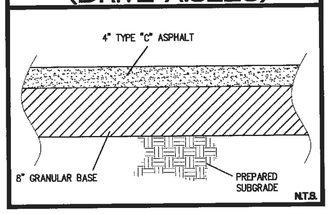

1. ASPHALT PAVEMENT SHALL BE COMPACTED TO 98% MAXIMUM DENSITY.
2. SUB GRADE AND BASE BENEATH PAVEMENTS SHALL BE COMPACTED TO ST. CHARLES COUNTY HIGHWAY DEPARTMENT SPECIFICATIONS. THE MOISTURE RANGE SHALL BE DETERMINED BY THE STANDARD OR MODIFIED PROCTOR DENSITY METHOD AASHTO T-99 AND WITHIN -2/+4 PERCENTAGE POINTS OF THE OPTIMUM MOISTURE CONTENT.

6" VERTICAL CONCRETE CURB (3" Type "C" with 8" Rock)

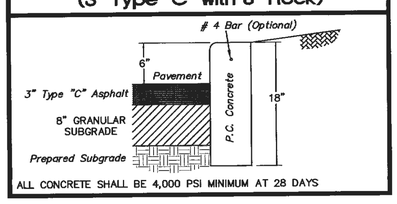

CONCRETE PAVEMENT FOR TRASH ENCLOSURE

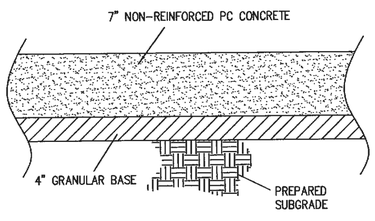

Call BEFORE you DIG
TOLL FREE
1-800-344-7483
MISSOURI ONE-CALL SYSTEM, INC.

UNDERGROUND UTILITIES HAVE BEEN PLOTTED FROM AVAILABLE INFORMATION AND THEREFORE THEIR LOCATIONS SHALL BE CONSIDERED APPROXIMATE ONLY. THE VERIFICATION OF THE LOCATION OF ALL UNDERGROUND UTILITIES, EITHER SHOWN OR NOT SHOWN ON THESE PLANS, SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR, AND SHALL BE LOCATED PRIOR TO ANY GRADING AND/OR CONSTRUCTION OF IMPROVEMENTS.

DOWNCAST LIGHT STANDARD

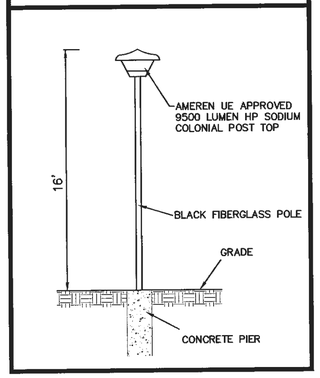

TYPICAL WROUGHT IRON FENCE (POOL FENCE)

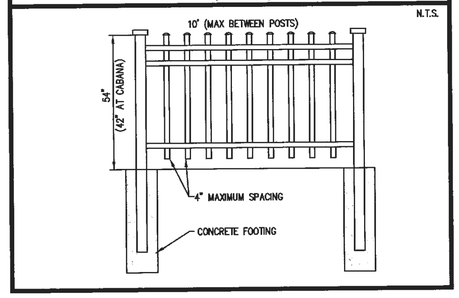

TRASH ENCLOSURE
(PASSIVE ACCESS PLAN VIEW)



TRASH ENCLOSURE DETAIL



1. Walls shall be constructed of a redish-brown split face CMU on the viewable side and a 4" white concrete cap.
2. Enclosure to be constructed with a six-foot high solid wall with a vinyl gate consistent with the architectural theme of the primary structure in site. Gate to be 1"x4" PVC slats spaced 6" O.C. and mounted on a painted steel tube frame.

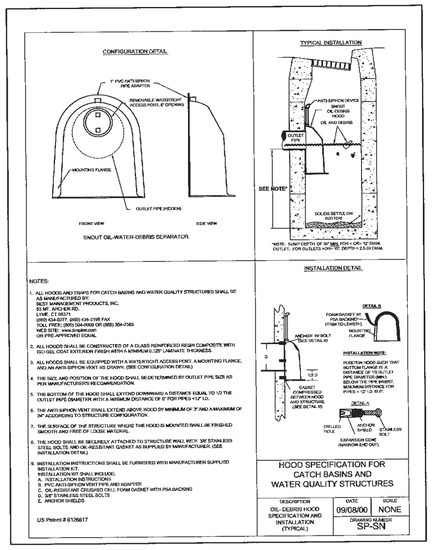





HANDICAPPED PARKING SIGN

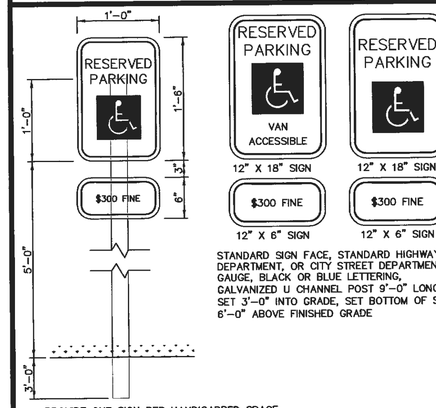

STANDARD SIGN FACE, STANDARD HIGHWA
DEPARTMENT, OR CITY STREET DEPARTMEN
GAUGE, BLACK OR BLUE LETTERING,
GALVANIZED U CHANNEL POST 9'-0" LONG
SET 3'-0" INTO GRADE, SET BOTTOM OF S
6'-0" ABOVE FINISHED GRADE

-PROVIDE ONE SIGN PER HANDICAPPED SPACE.
-NO STEPS AT BUILDING ENTRANCES.
-PROVIDE RAMPS OR DROP CURBS AT HANDICAPPED SPACES.
-PROVIDE 60"X60" AREA OUTSIDE ENTRANCE FOR WHEELCHAIR MANEUVERABI
N

FLUSH HANDICAP RAMP DETAIL

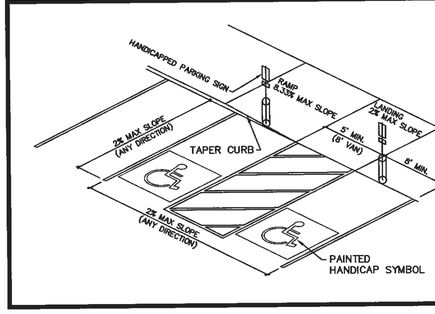

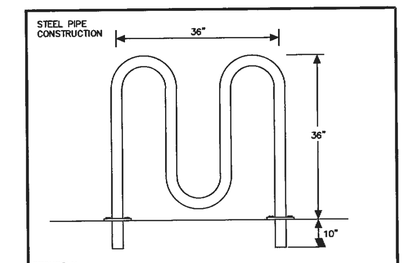

BICYCLE RACK DETAIL