




FIRE HYDRANT INSTALLATION DETAIL
NO SCALE

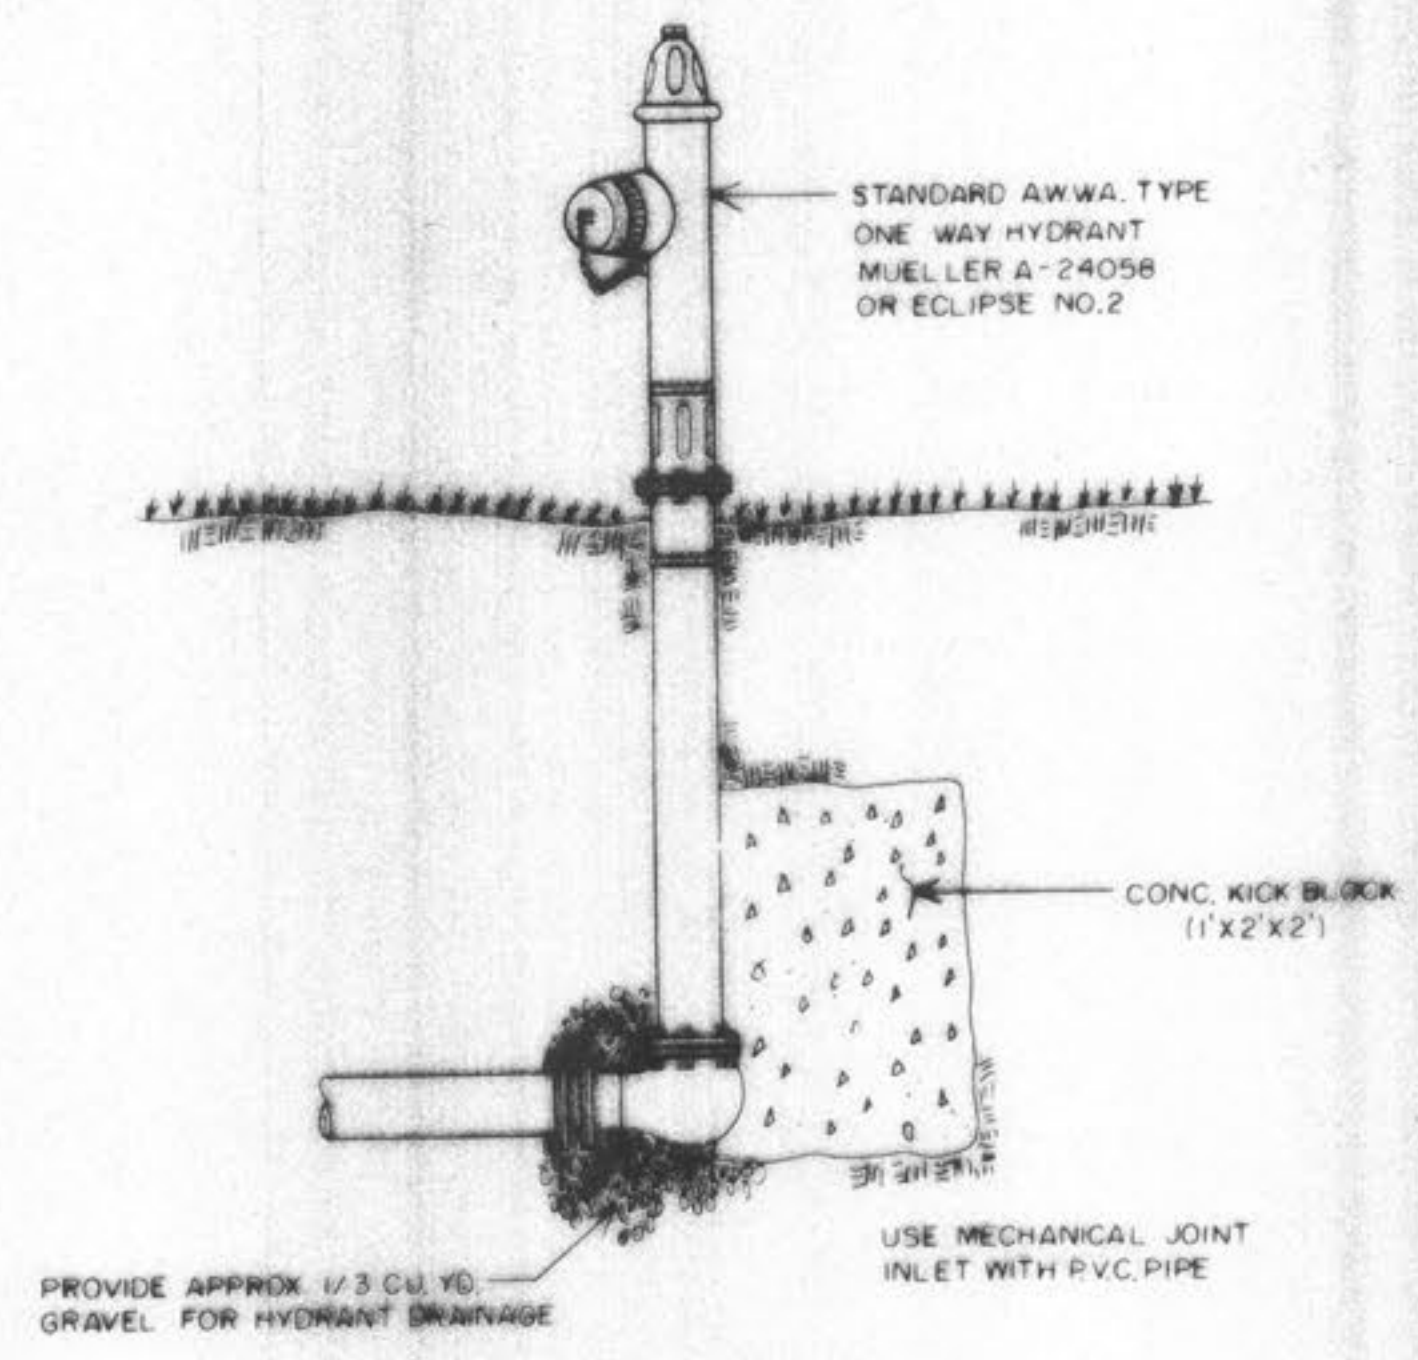


FLUSHING HYDRANT
NO SCALE

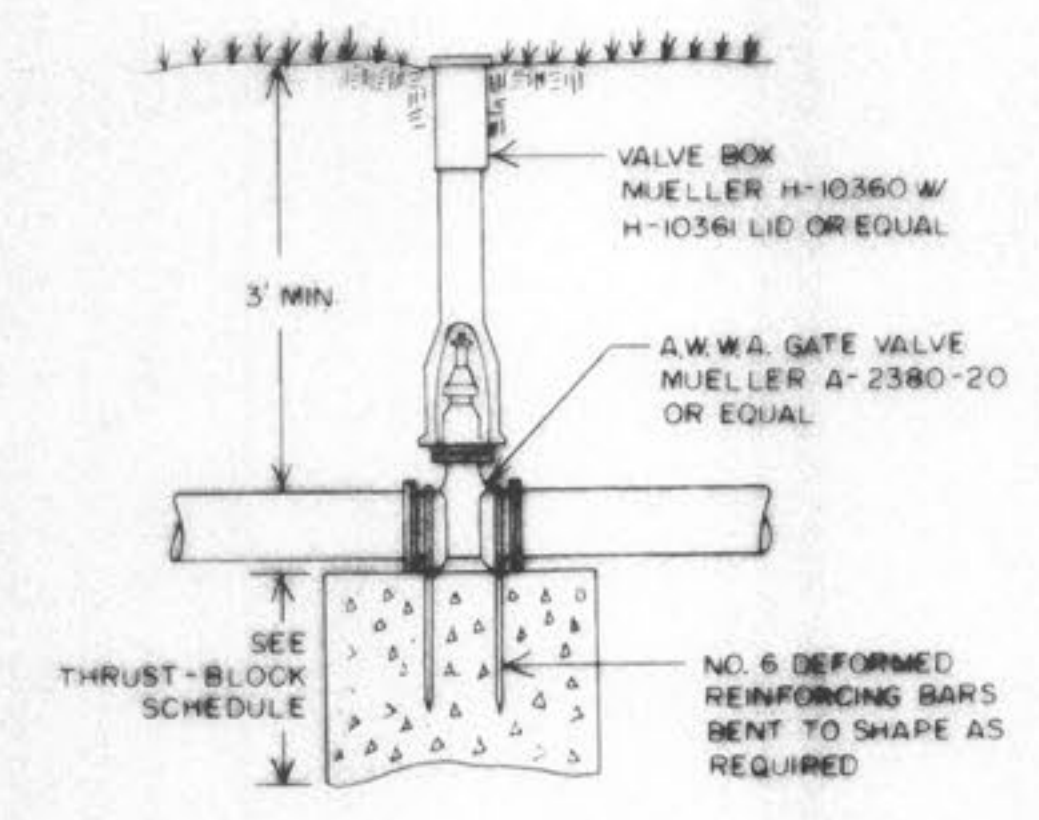


GATE VALVE W/ THRUST-BLOCK DETAIL
NO SCALE

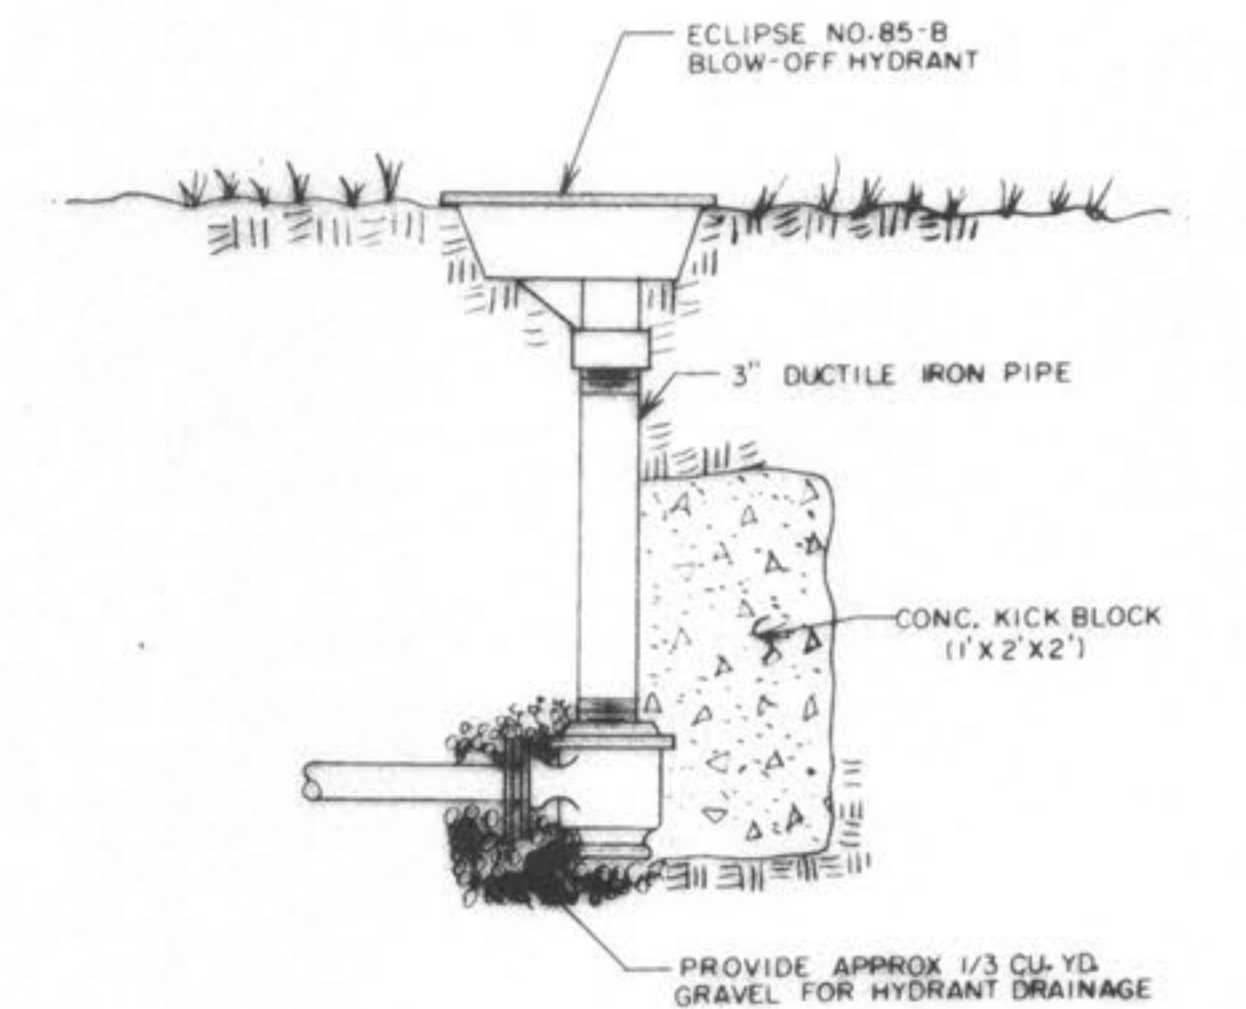


BLOW-OFF HYDRANT
NO SCALE

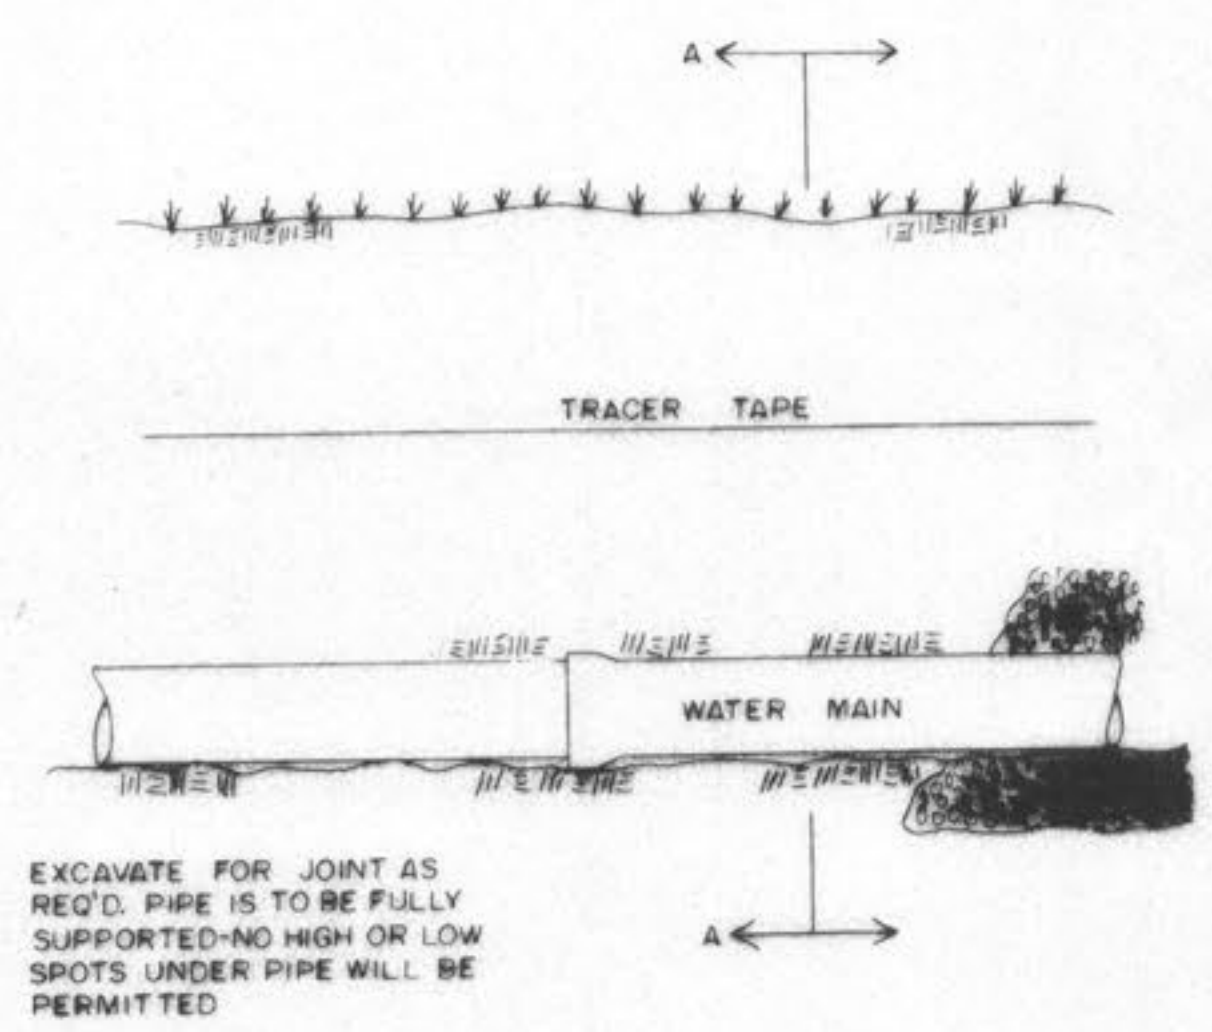


TYPICAL WATER MAIN TRENCHING DETAIL
NO SCALE

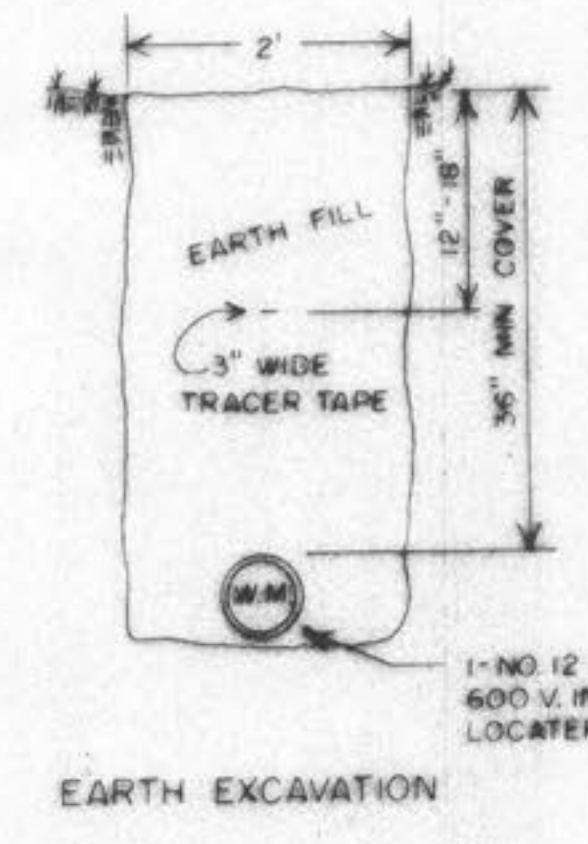


EARTH EXCAVATION

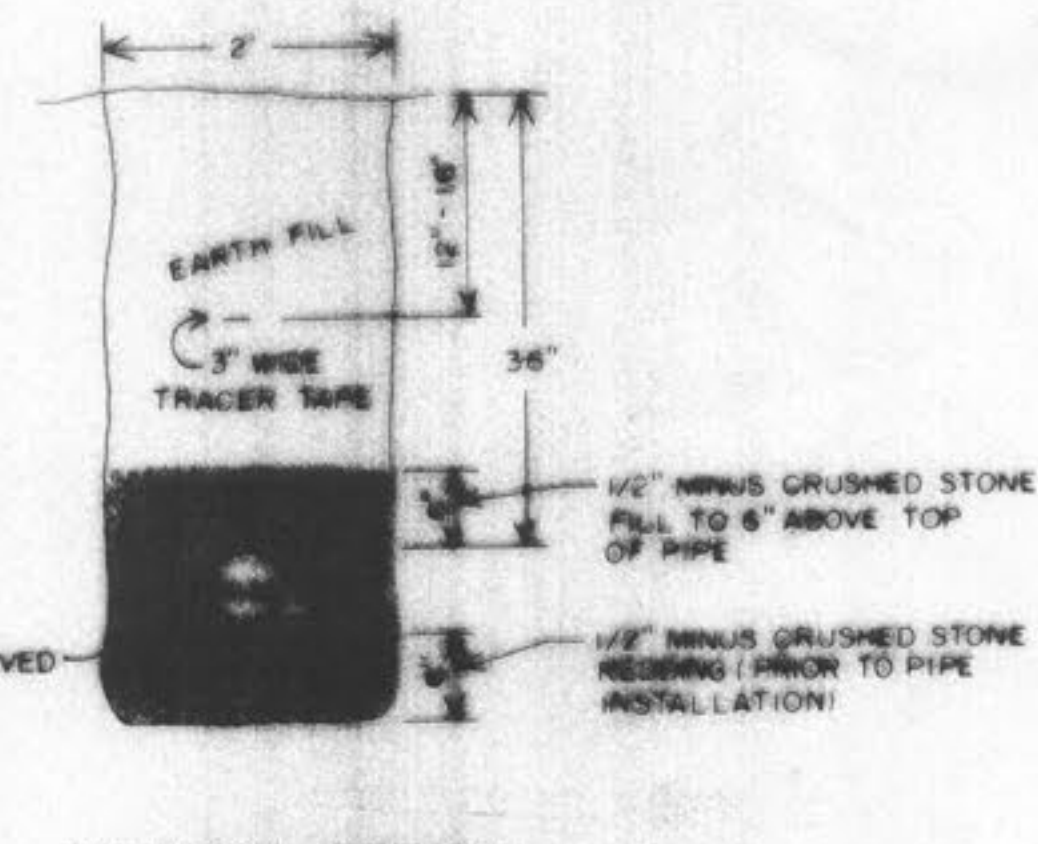

EXCAVATION THROUGH SOLID ROCK

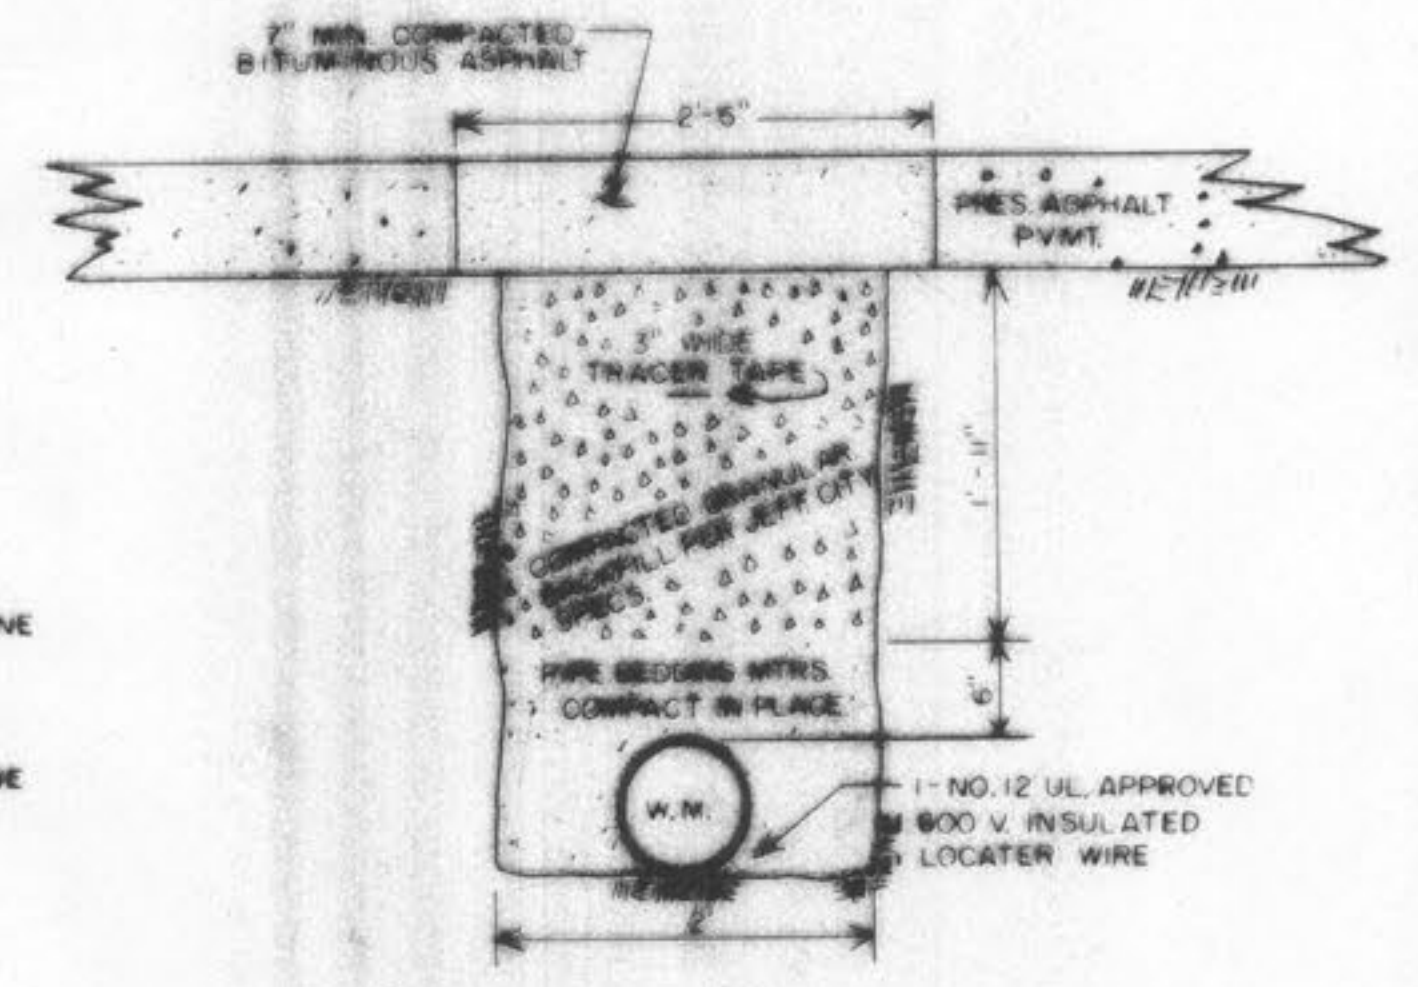


TYPICAL PAVED STREET OR ROAD TRENCH BACKFILL & SURFACE REPLACEMENT DETAIL
SCALE: 1" = 1'-0"

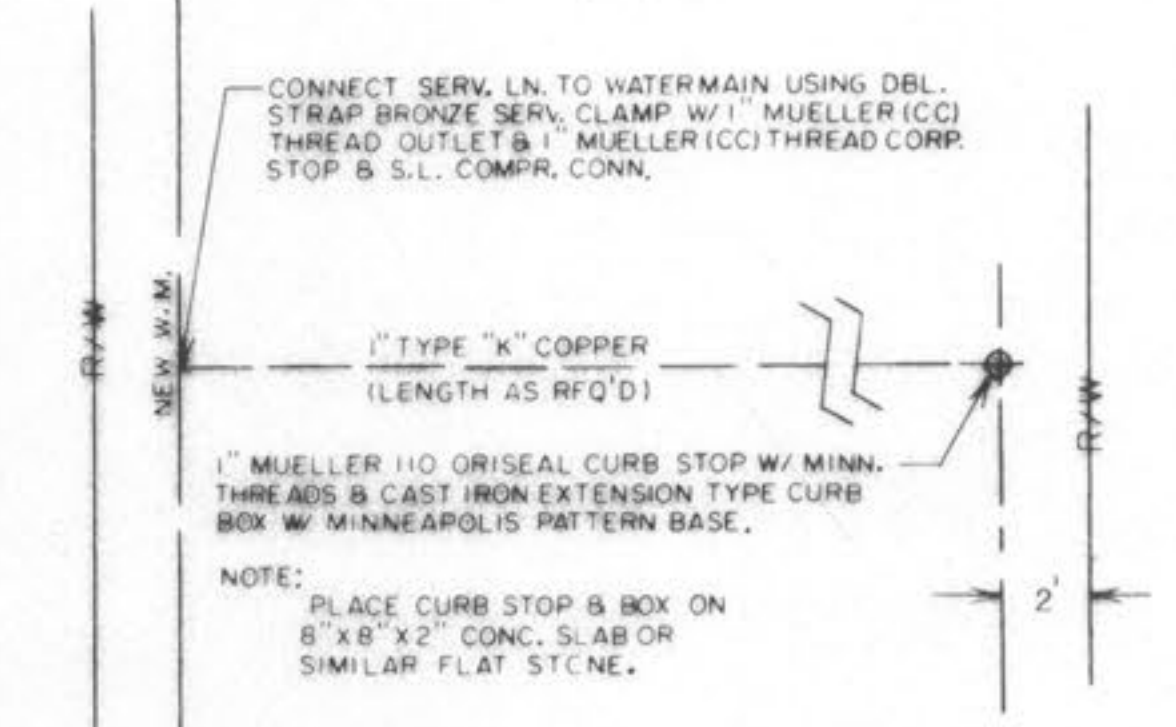


TYPICAL SERVICE CONNECTION INSTALLATION TO OPPOSITE SIDE OF STREET
SCALE: 1" = 10'-0"

MAIN SIZE	MIN. THRUSTBLOCK BEARING DIMENSIONS TO BEAR AGAINST UNDISTURBED EARTH				
	45° BEND	22 1/2° BEND	TEE	VALVE	CROSS
2"	5'x1'	5'x1'	5'x1'	5'x1'	5'x1'
4"	1'x1'	1'x1'	2'x1'	2'x1'	1'x1'
6"	1.5'x1'	1'x1'	2'x1'	2'x1'	1'x1'
8"	2'x1'	1'x1'	2'x2.5'	2'x2'	1'x1.5'
10"	2'x2.5'	1.5'x2'	2'x3.5'	2'x3'	2'x2'

THRUST-BLOCK SCHEDULE

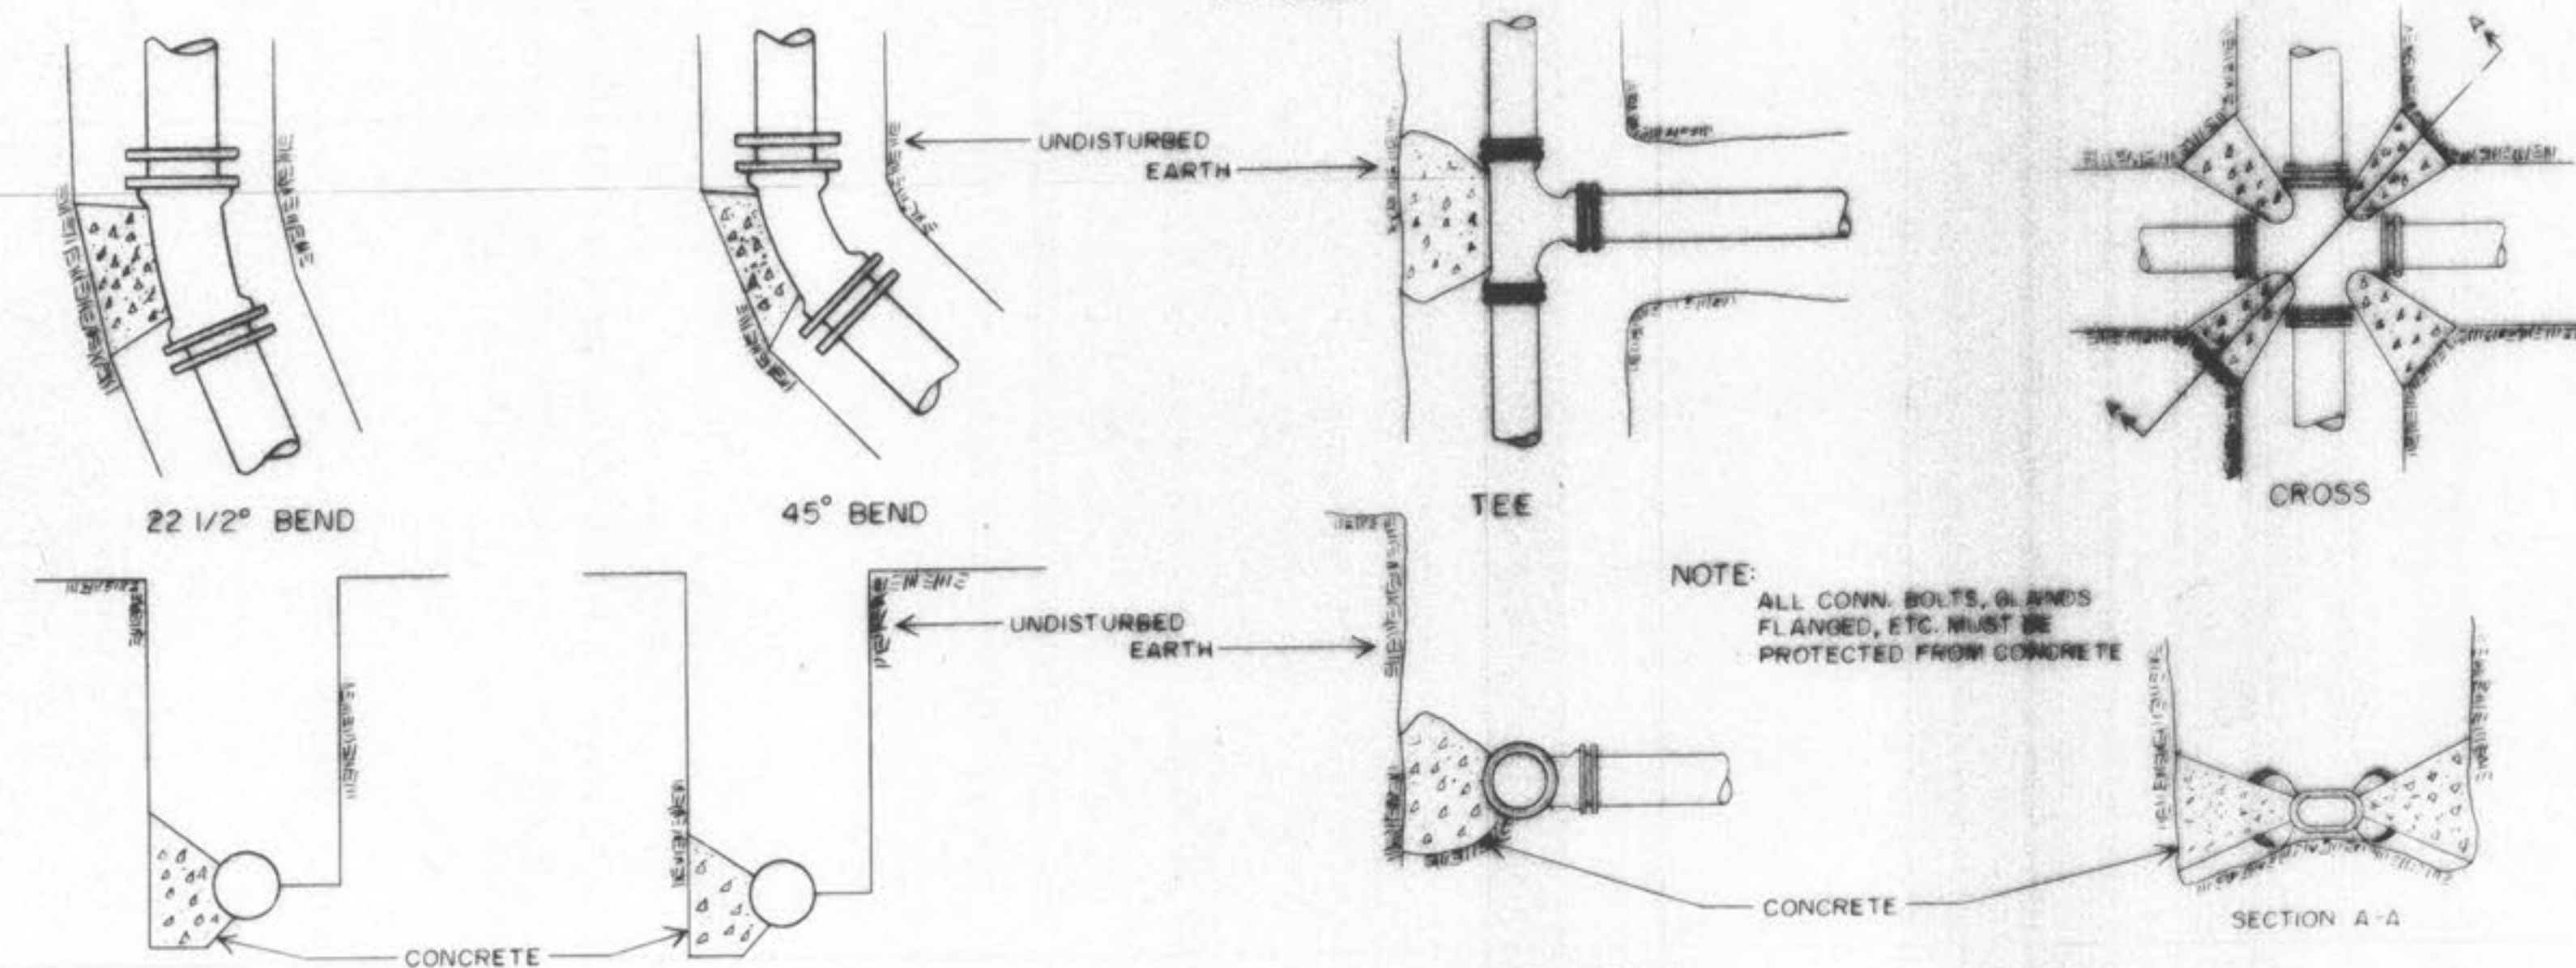

TYPICAL THRUST-BLOCK DETAIL
NO SCALE

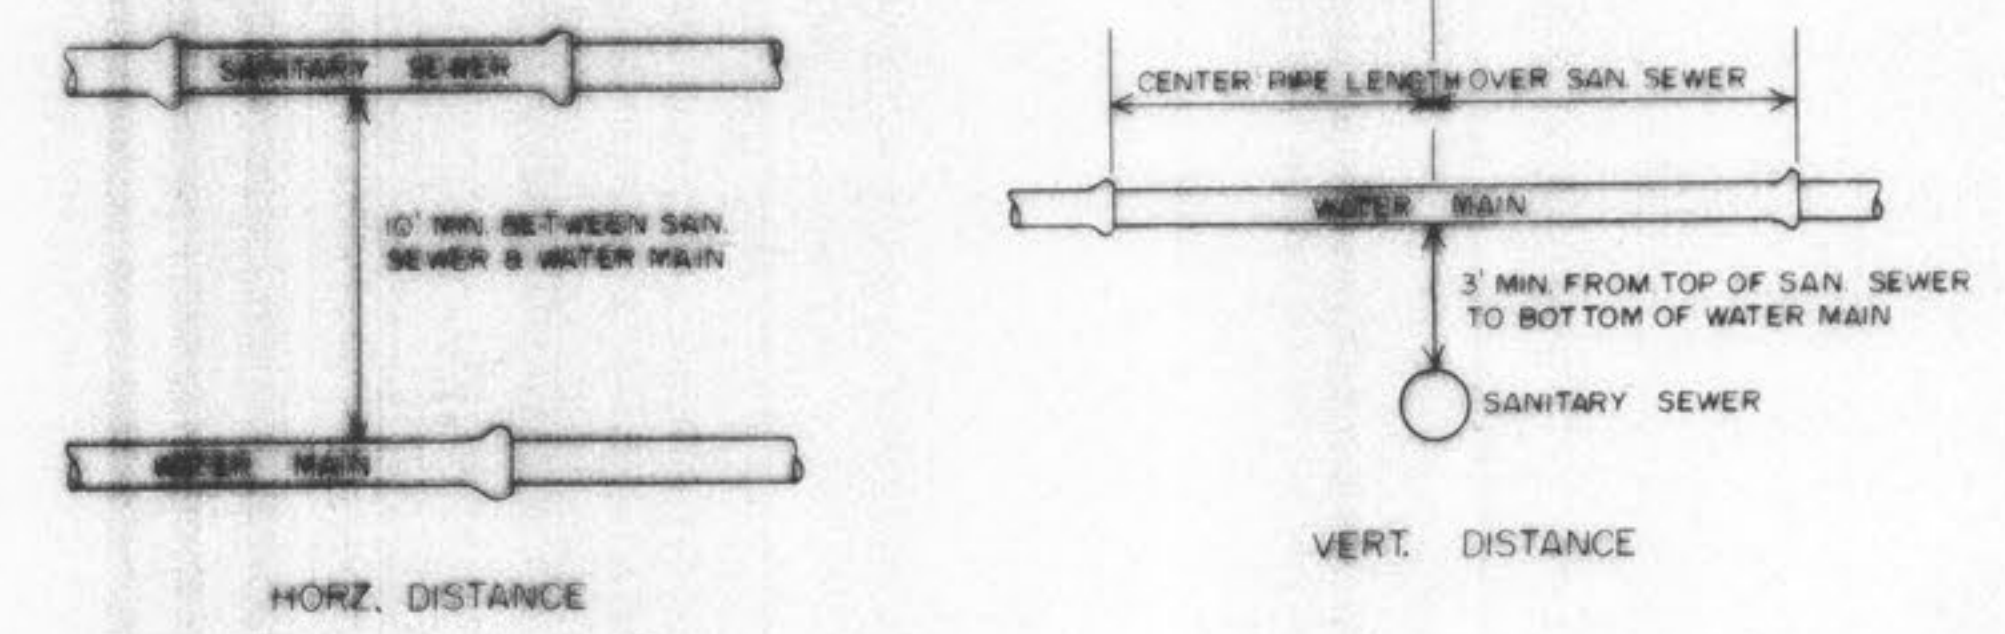

TYPICAL WATER & SEWER SEPARATION
NO SCALE

ST CHARLES COUNTY
PUBLIC WATER SUPPLY DISTRICT
NO. 2

APPROVED: _____

TYPICAL WATER INSTALLATION DETAILS

DATE: _____ SCALE: _____ AS SHOWN

SHEET 12 OF 14

REV. 11-2-88