



PIPE DIA.	ALL FTGS.		TEE PLUG TAPPING		90 DEGREE		45 DEGREE BEND		22-1/2 BEND		11-1/4 BEND	
	Α	В	С	Н	С	Н	С	Н	С	Н	С	Н
4	14	4	24	12	26	15	18	12	12	12	12	12
6	16	6	36	18	36	24	30	18	24	12	12	12
8	20	8	36	30	42	36	36	24	24	18	18	12
10	20	10	48	36	66	36	36	36	28	24	18	18
12	24	12	68	36	82	42	52	36	40	24	28	18
							HAN 12	', SPEC RED.	IAL			

HORIZONTAL THRUST BLOCKING DETAIL "C"

NOTE: THIS DETAIL IS FROM PWSD#2

Buffalo box is an acceptable product to use. Tyler 562—S and 564—S are acceptable products.

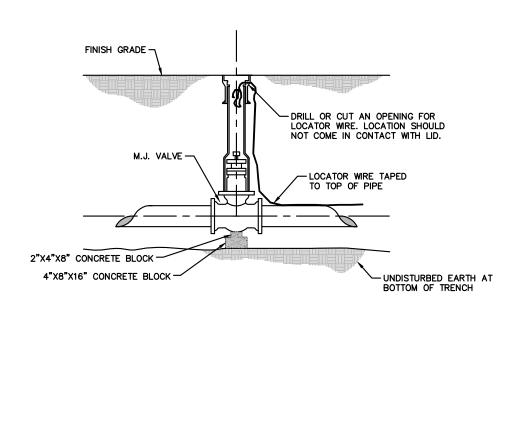

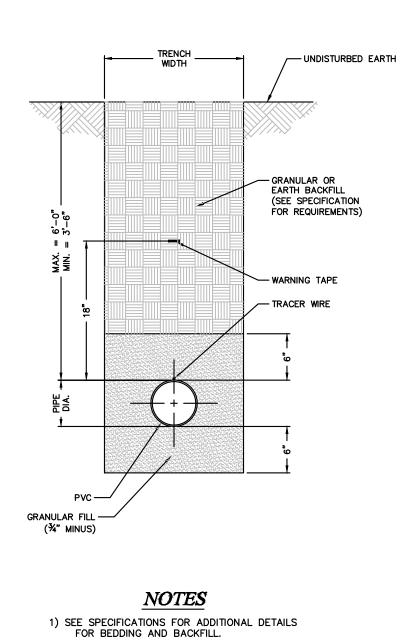



TYPICAL TRENCH SECTION FOR PVC PIPE

NOT TO SCALE

DETAIL "A"


PAGE 1 OF 2

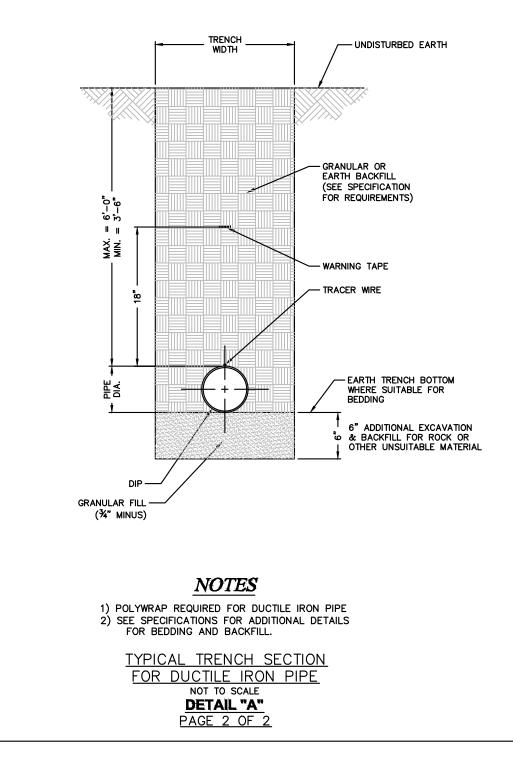

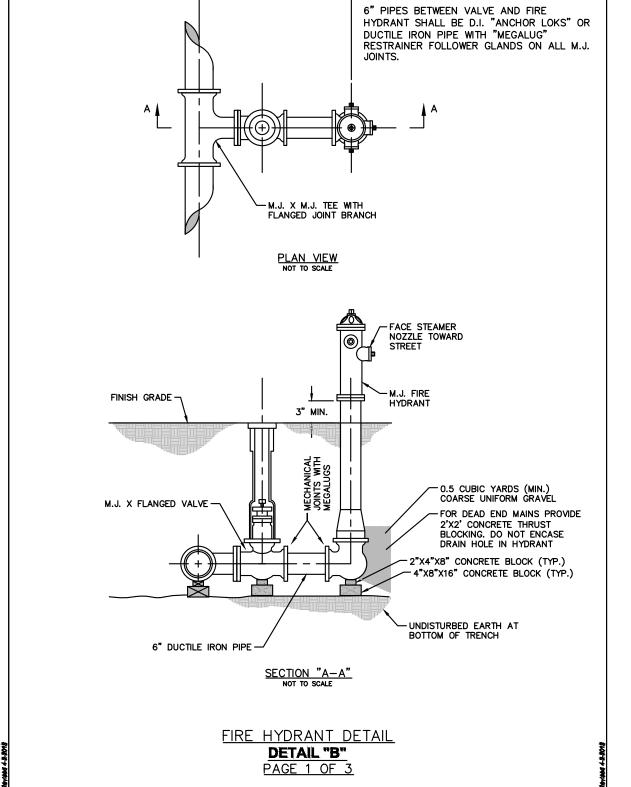


— AS NEEDED ——

NOTES

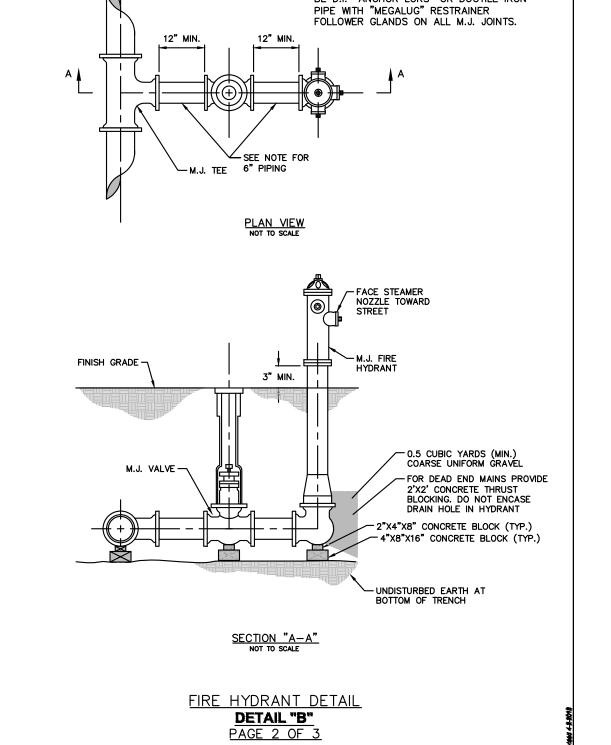

6" PIPES BETWEEN TEE AND VALVE AND BETWEEN VALVE AND FIRE HYDRANT SHALL

BE D.I. "ANCHOR LOKS" OR DUCTILE IRON

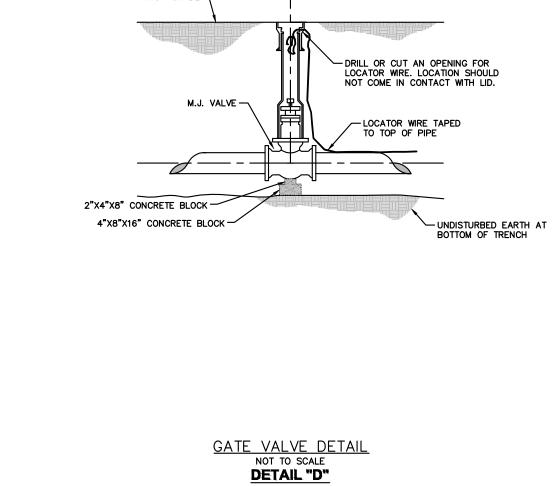

UTILITY DETAILS

REVISIONS BY

COLLISION TE CENTRE DRIVE N, MO 63368

111111111004/23/20

DRAWN BAC CHECKED TMB DATE 03/19/2021 SCALE DRAWING

00