
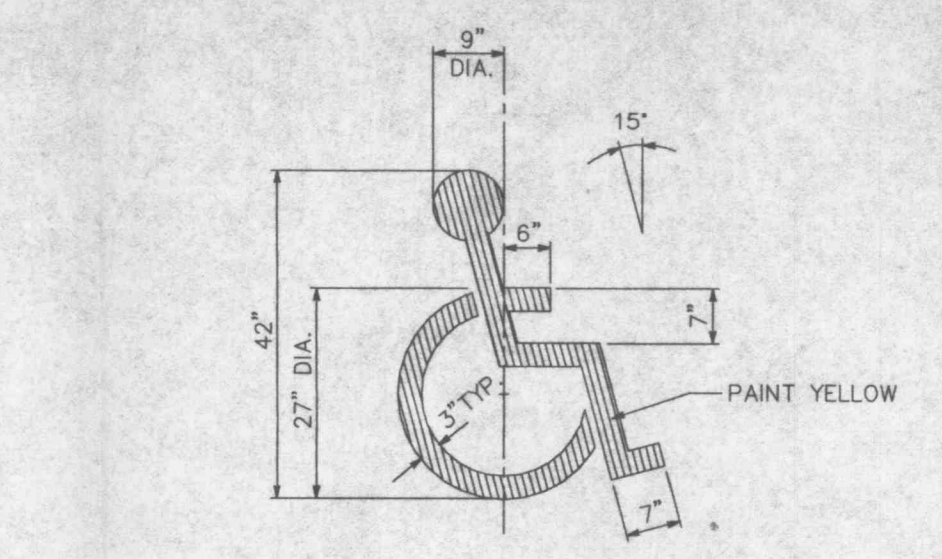
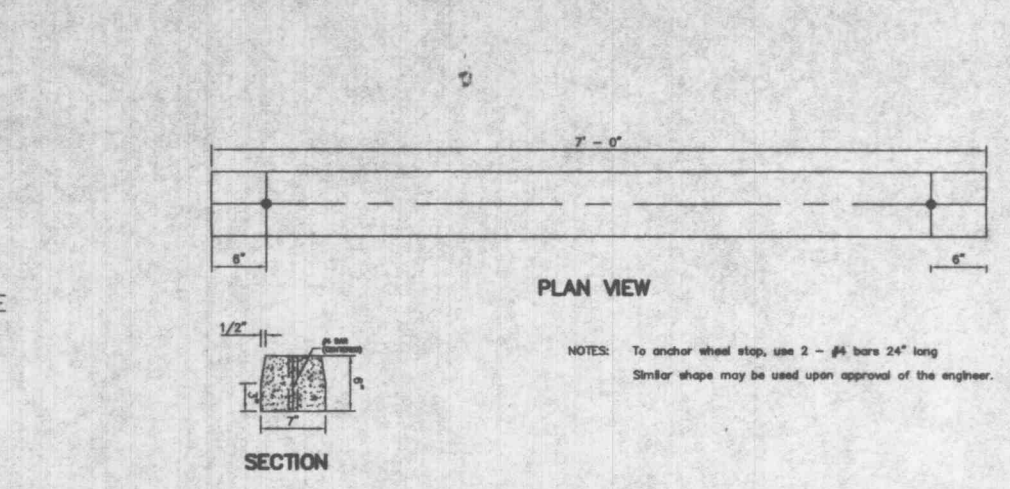
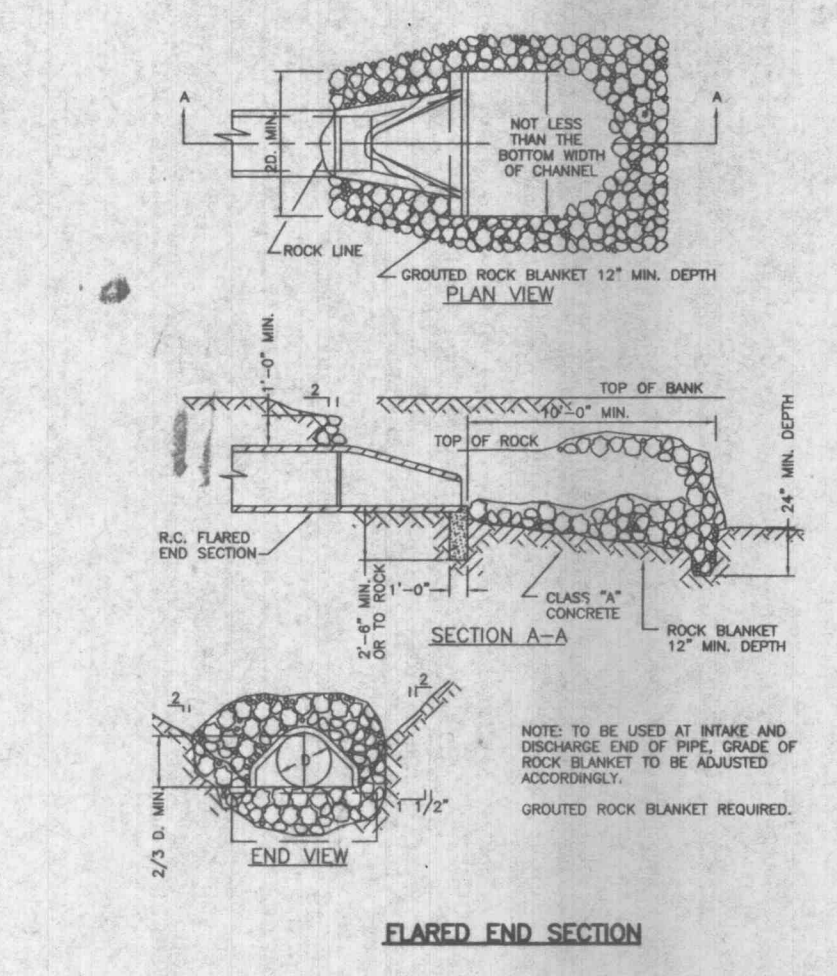



- CONSTRUCTION SPECIFICATIONS**
- Stone Size - Use 2" stone, or reclaimed or recycled concrete equivalent.
  - Length - As required, but not less than 50 feet (except on a single residence lot where a 30 foot minimum length would apply).
  - Thickness - Not less than six (6) inches.
  - Width - Twenty (20) foot minimum, but not less than the full width of points where ingress or egress occurs.
  - Filter Cloth - Will be placed over the entire area prior to placing of stone. Filter will not be required on a single family residence lot.
  - Surface Water - All surface water flowing or diverted toward construction entrances shall be piped across the entrance. If piping is impractical, a mountable berm with S-1 wheels will be permitted.
  - Maintenance - The entrance shall be maintained in a condition which will prevent tracking or flowing of sediment onto public rights-of-way. This may require periodic top dressing with additional stone as conditions demand and repair and/or cleanup of any measures used to trap sediment. All sediment spilled, dropped, washed or tracked onto public rights-of-way must be removed immediately.
  - Washing - Wheels shall be cleaned to remove sediment prior to entrance onto public rights-of-way. When washing is required, it shall be done on an area stabilized with stone and which drains into an approved sediment trapping device.
  - Periodic inspection and needed maintenance shall be provided after each rain.

**STABILIZED CONSTRUCTION ENTRANCE/WASHDOWN AREA**  
 NOT TO SCALE

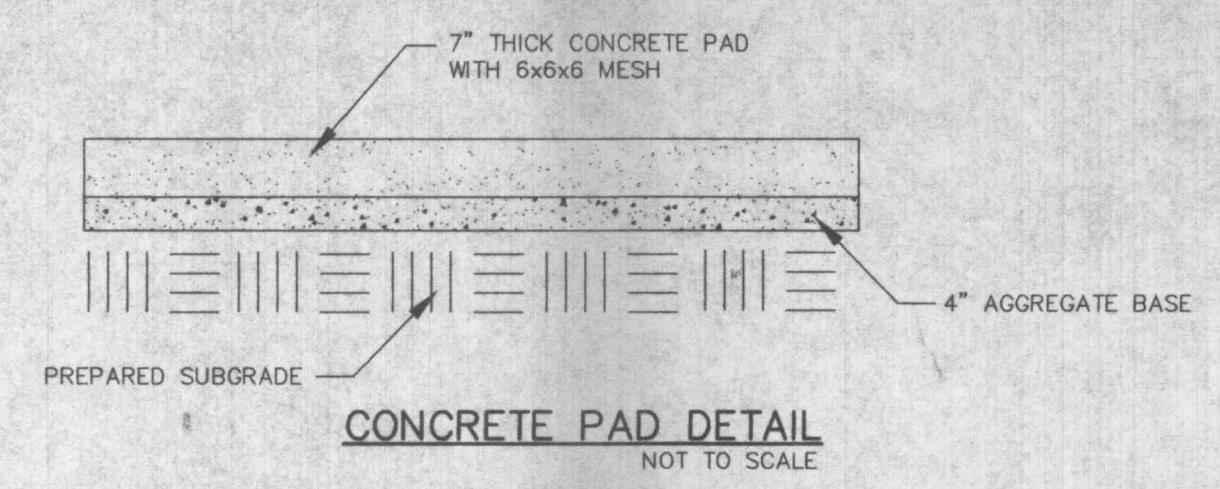


12" X 18" SIGN  
 STANDARD SIGN FACE, STANDARD HIGHWAY DEPARTMENT, OR CITY STREET DEPARTMENT GAUGE, BLACK OR BLUE LETTERING, GALVANIZED STEEL POST 9'-6" LONG, SET 3'-0" INTO GRADE, SET BOTTOM OF SIGN 5'-0" ABOVE FINISHED GRADE.

**HANDICAP PARKING SIGN**  
 NOT TO SCALE

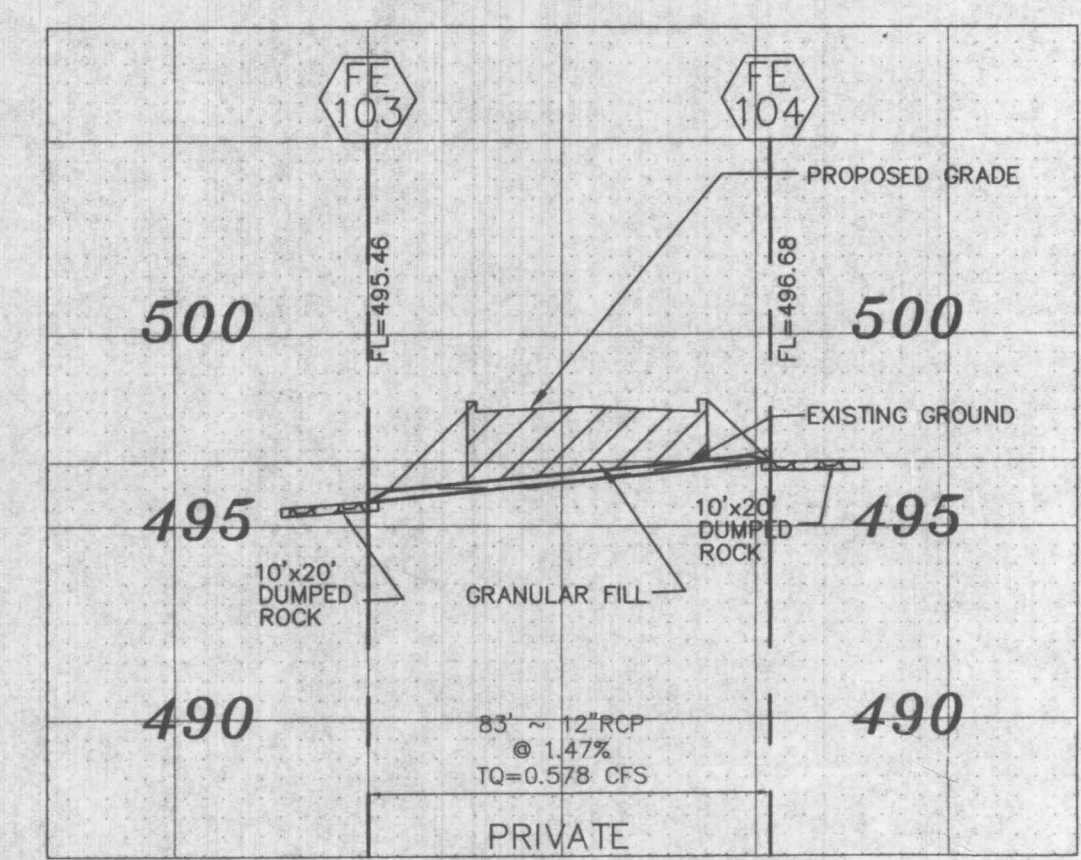


**STORM PROFILE**  
 HORIZONTAL SCALE: 1"=40'  
 VERTICAL SCALE: 1"=5'


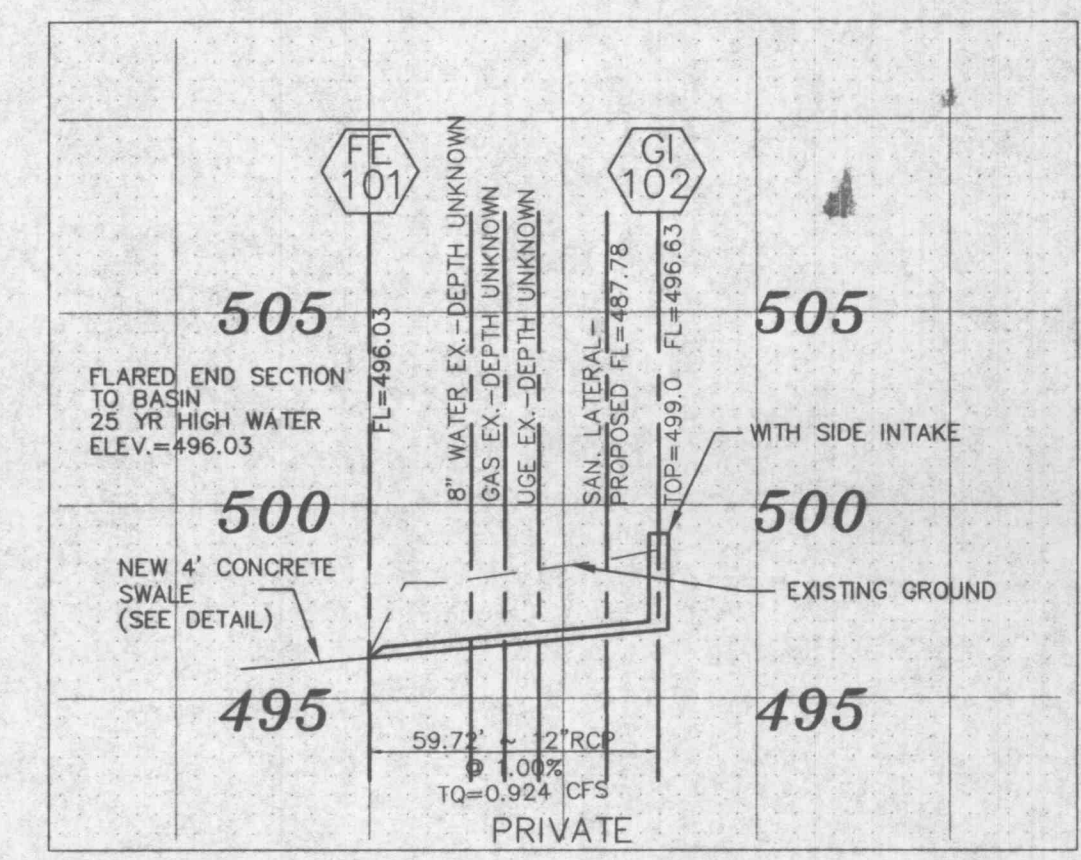


**STORM PROFILE**  
 HORIZONTAL SCALE: 1"=40'  
 VERTICAL SCALE: 1"=5'


NOTE: IF THERE IS A CONFLICT BETWEEN THE PROPOSED STORM LINE AND THE EXISTING AND/OR PROPOSED UTILITIES THE ENGINEER SHALL BE NOTIFIED IMMEDIATELY

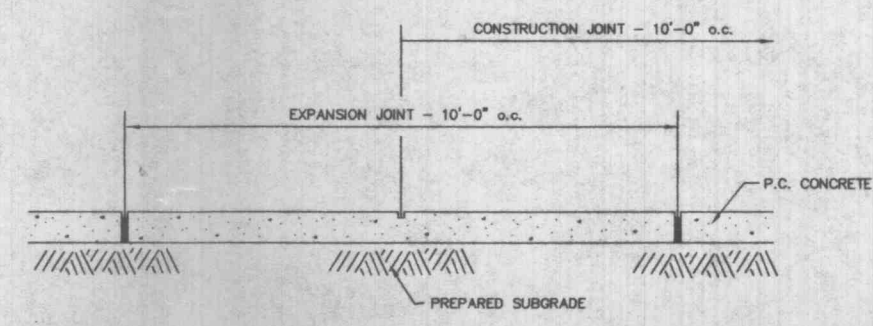


**CONCRETE SWALE**  
 NOT TO SCALE

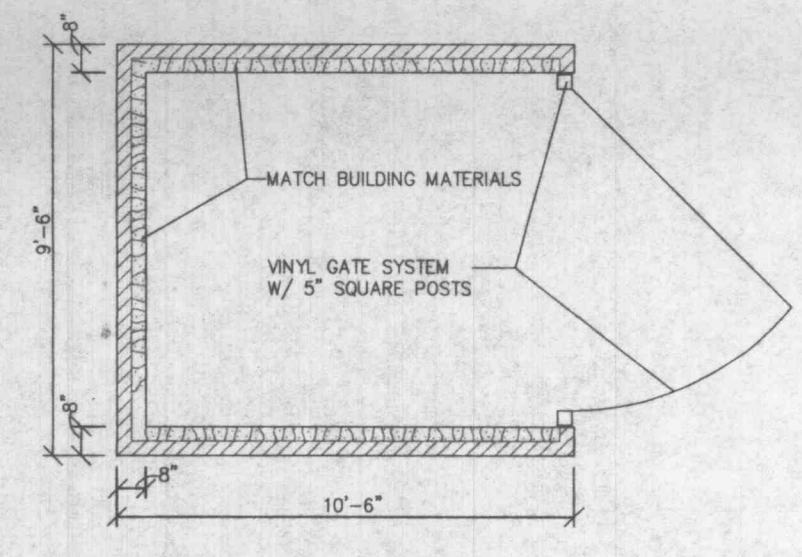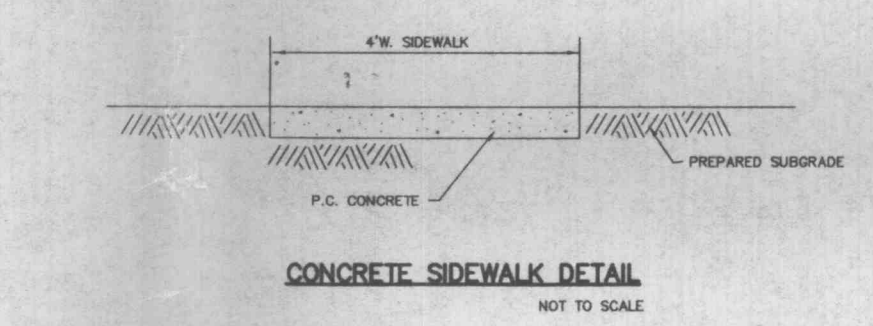

**ELEV. AT TRASH ENCLOSURE GATE**  
 N.T.S.

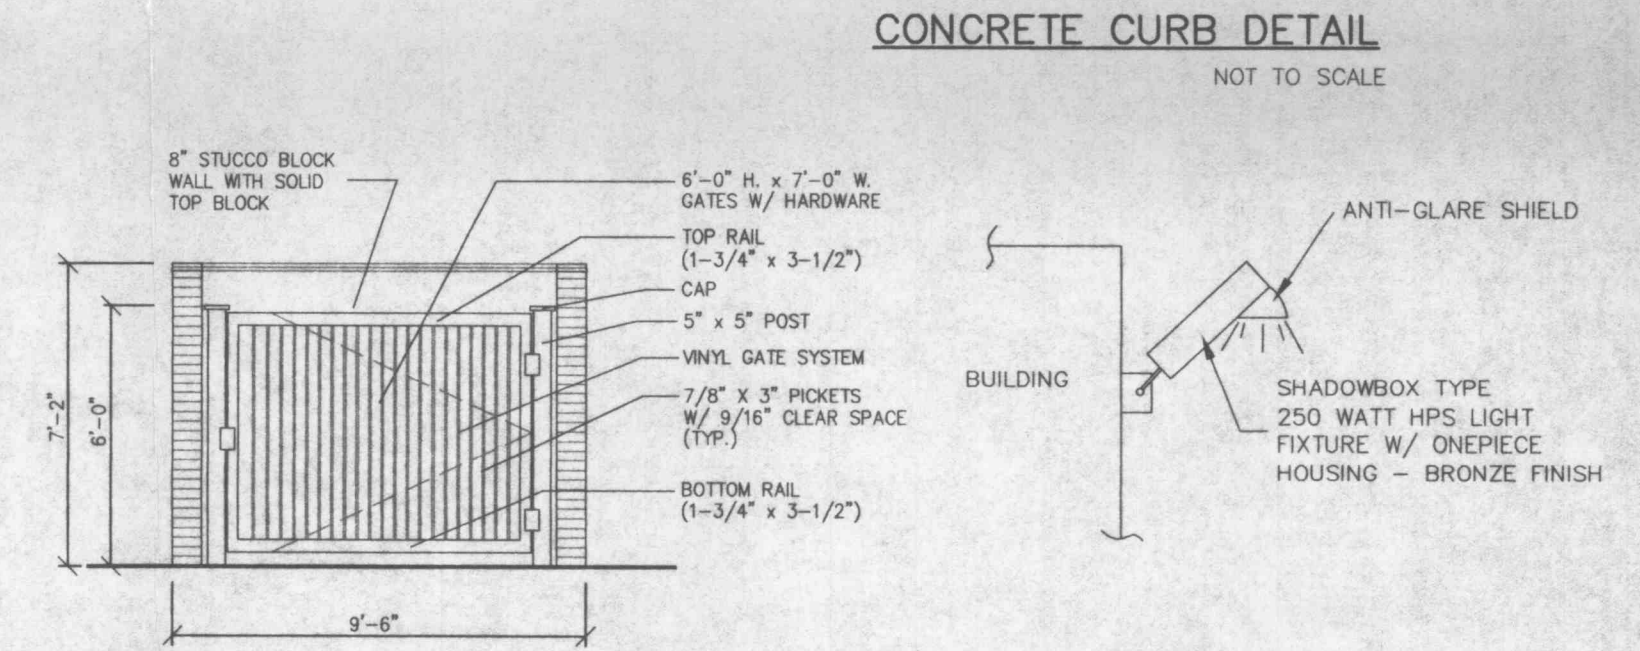


**CONCRETE CURB DETAIL**  
 NOT TO SCALE

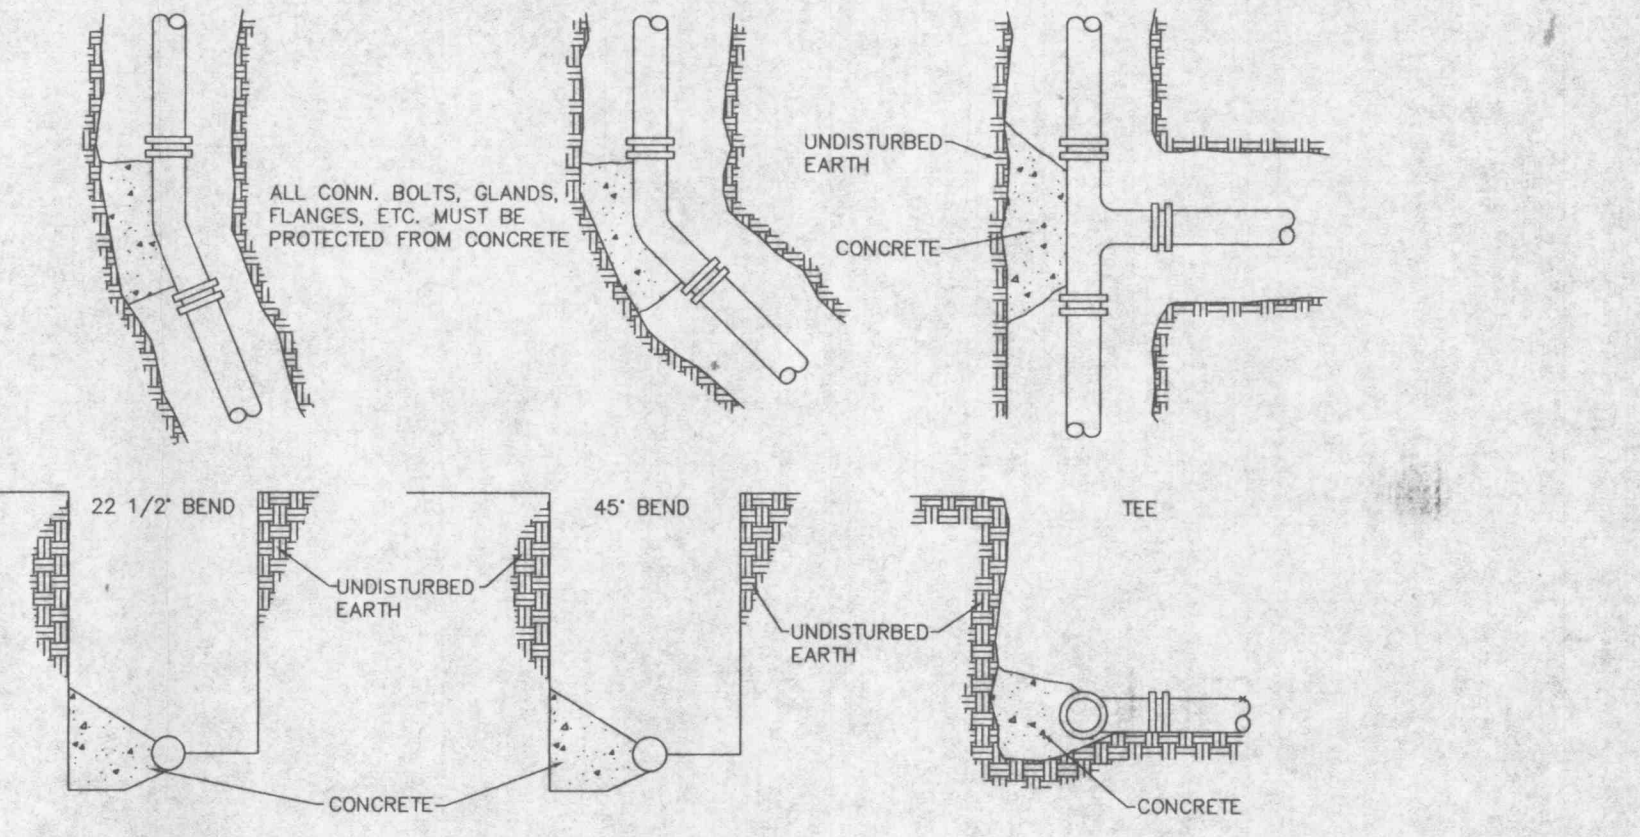


**TYPICAL THRUST BLOCK DETAILS**  
 NOT TO SCALE


MAIN SIZE (I.D.)	MIN. THRUST BLOCK BEARING DIMENSIONS TO BEAR AGAINST UNDISTURBED EARTH			
	45° BEND	22 1/2° BEND	TEE	VALVE CROSS
2"	5" x 1"	5" x 1"	5" x 1"	5" x 1"
4"	1' x 1'	1' x 1'	2' x 1'	1' x 1'
6"	1.5' x 1'	1' x 1'	2' x 1'	1' x 1'
8"	2' x 1'	1' x 1'	2' x 2.5'	1' x 1.5'
10"	2' x 2.5'	1.5' x 2'	2' x 3.5'	2' x 2'
12"	2' x 3.5'	1.5' x 2.5'	3' x 3.5'	2' x 3'
16"	3' x 4'	2' x 3'	4' x 4.5'	3' x 3.5'

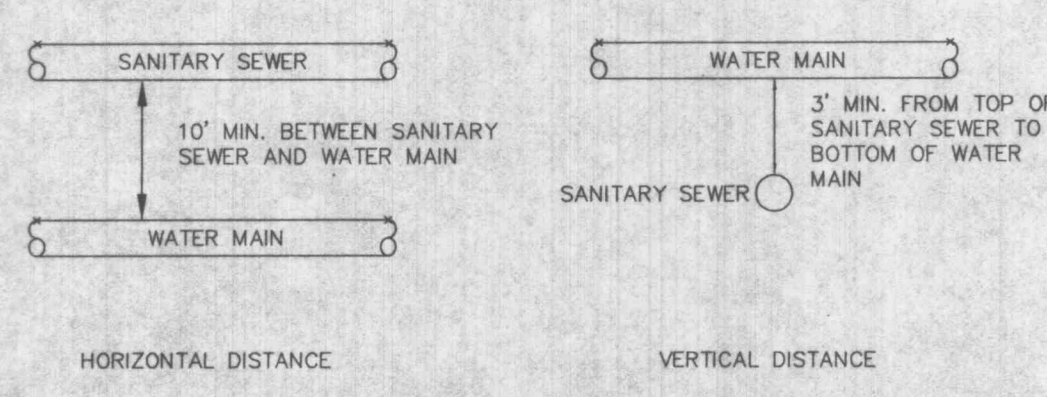


**TYPICAL WATER AND SEWER SEPARATION**  
 NOT TO SCALE

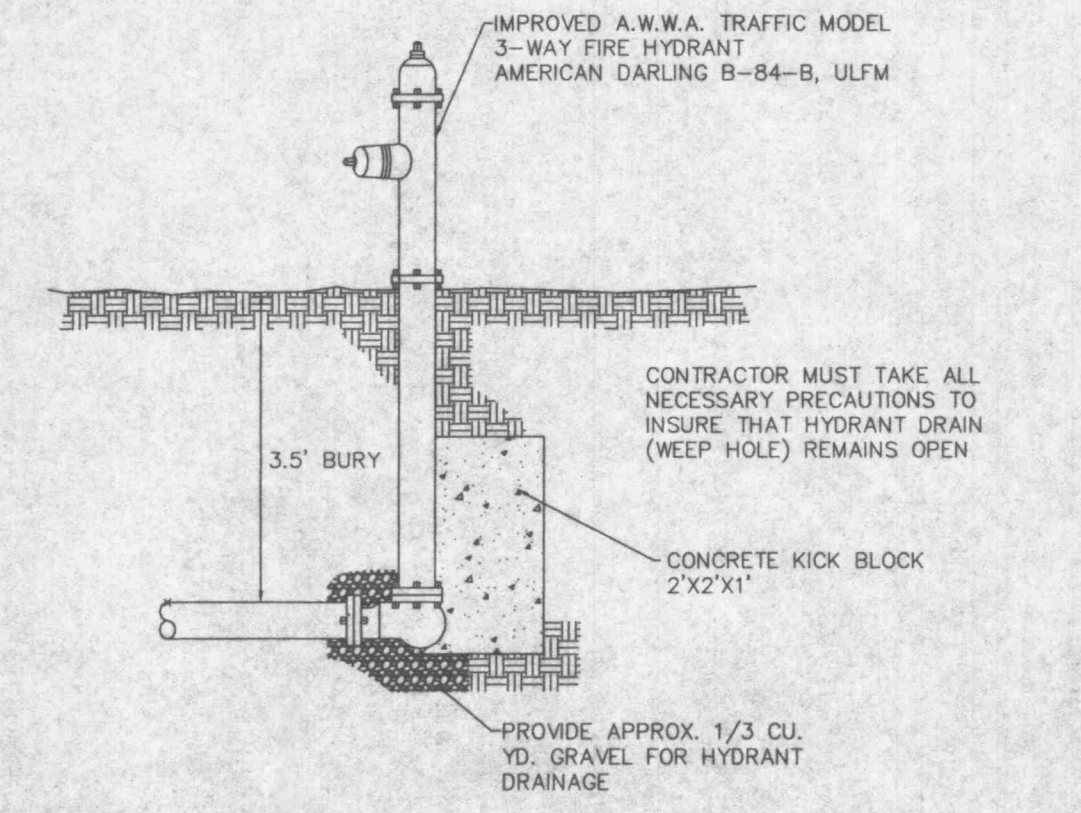

**FIRE HYDRANT INSTALLATION DETAIL**  
 NOT TO SCALE

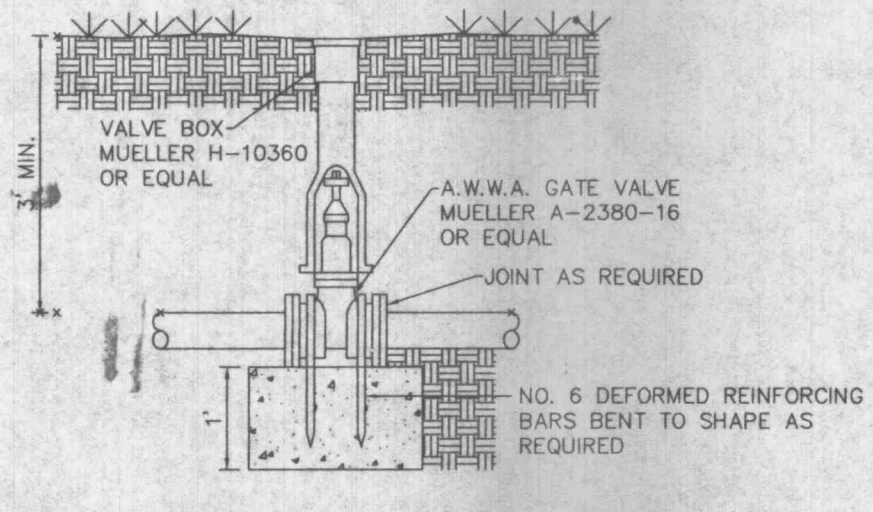

**GATE VALVE W/THRUST BLOCK**  
 NOT TO SCALE

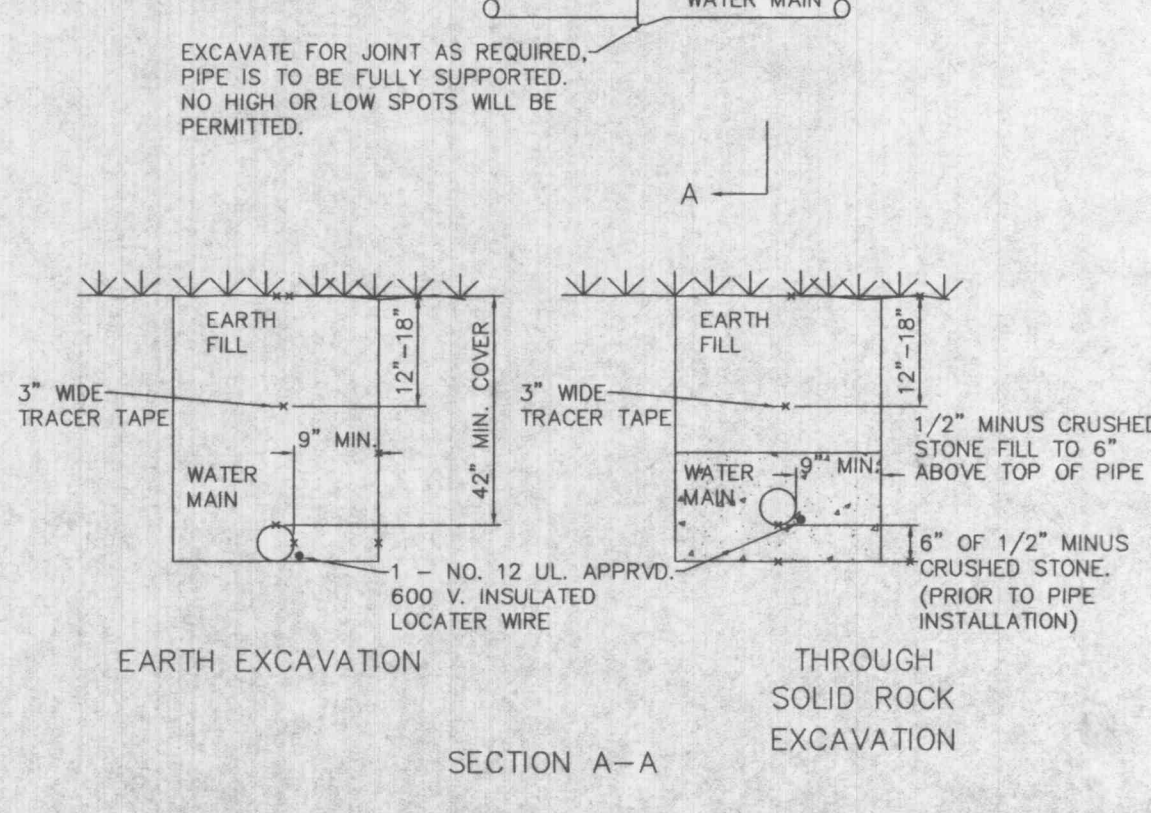

**TYPICAL WATER MAIN INSTALLATION DETAILS**  
 NOT TO SCALE