
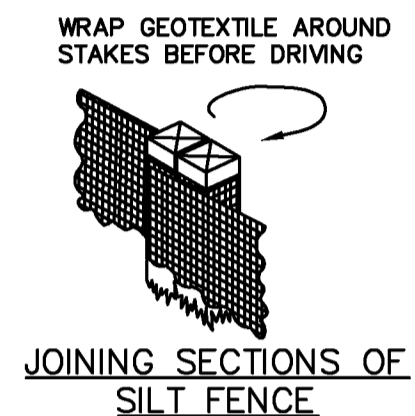
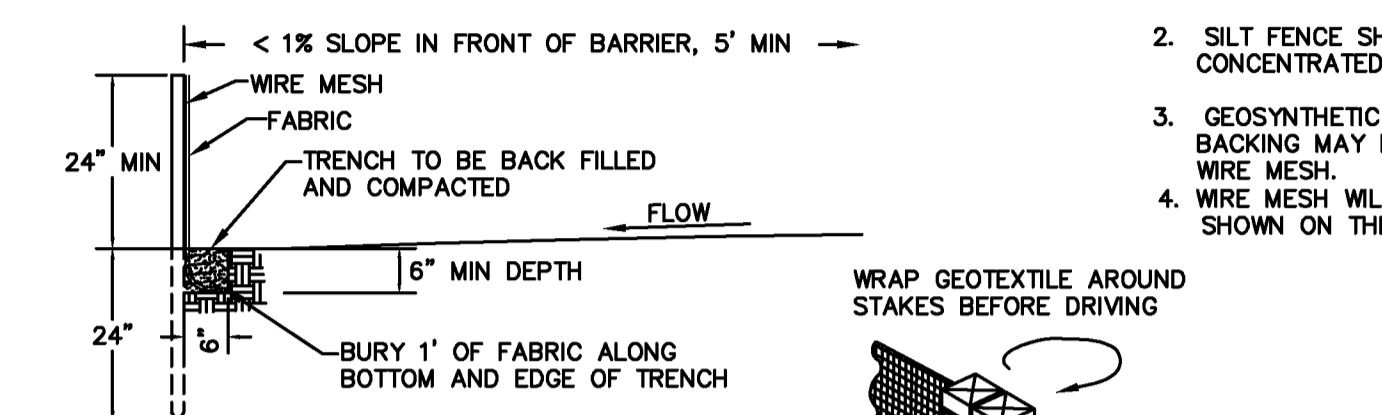


- DESIGN CRITERIA**
- SILT FENCE FOR SHEET FLOW SHALL HAVE A MAXIMUM DRAINAGE AREA OF 1/4 ACRE PER 100 LF.
  - STRAW BALE BARRIERS FOR SHEET FLOW SHALL HAVE A MAXIMUM DRAINAGE AREA OF 1/4 ACRE PER 100 LF.
  - REFER TO INDIVIDUAL ESC FIGURE FOR INSTALLATION.
  - TERRACING INCLUDES LOGS, WATTLES & FILTER SOCKS.

CITY OF O'FALLON  
ENGINEERING DEPARTMENT  
O'FALLON, MISSOURI

**SPACING CHART FOR ESC DEVICES**

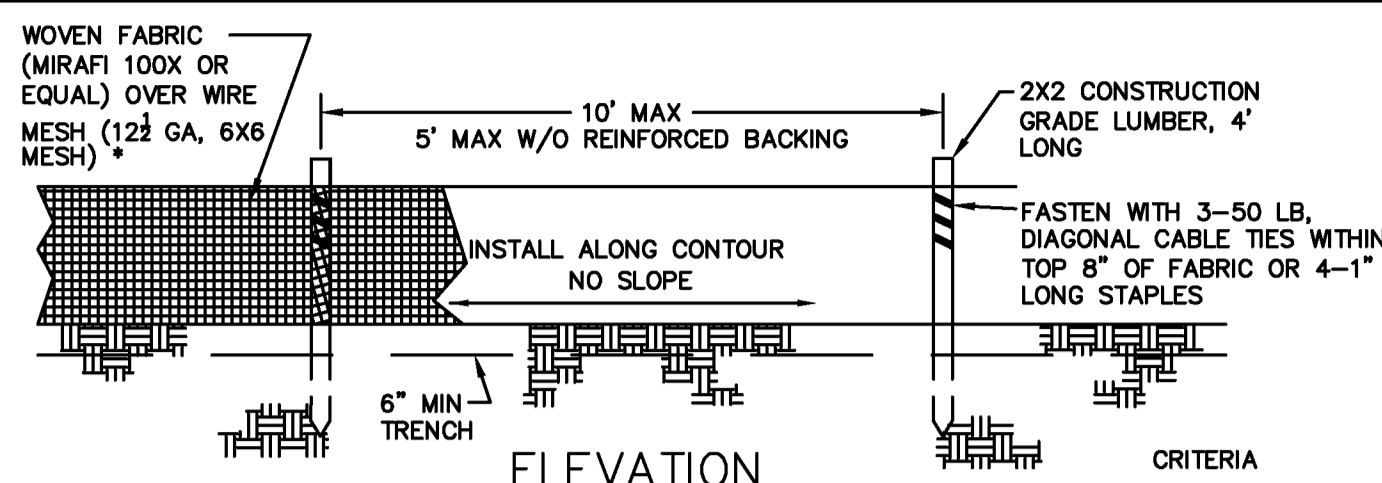


- CRITERIA**
- SILT FENCE SHALL BE 24 INCHES HIGH.
  - SILT FENCE SHALL NOT BE USED FOR CONCENTRATED FLOWS.
  - GEOSYNTHETIC REINFORCED SILT FENCE BACKING MAY BE USED IN LIEU OF WIRE MESH.
  - WIRE MESH WILL BE USED AT LOCATIONS SHOWN ON THE APPROVED SWPPP.

NOTE: IF FABRIC IS INSTALLED BY EQUIPMENT DESIGNED TO SLICE INTO THE GROUND, THE TRENCH IS NOT REQ'D.

CITY OF O'FALLON  
ENGINEERING DEPARTMENT  
O'FALLON, MISSOURI

**SILT FENCE INSTALLATION (SHEET FLOW ONLY)**

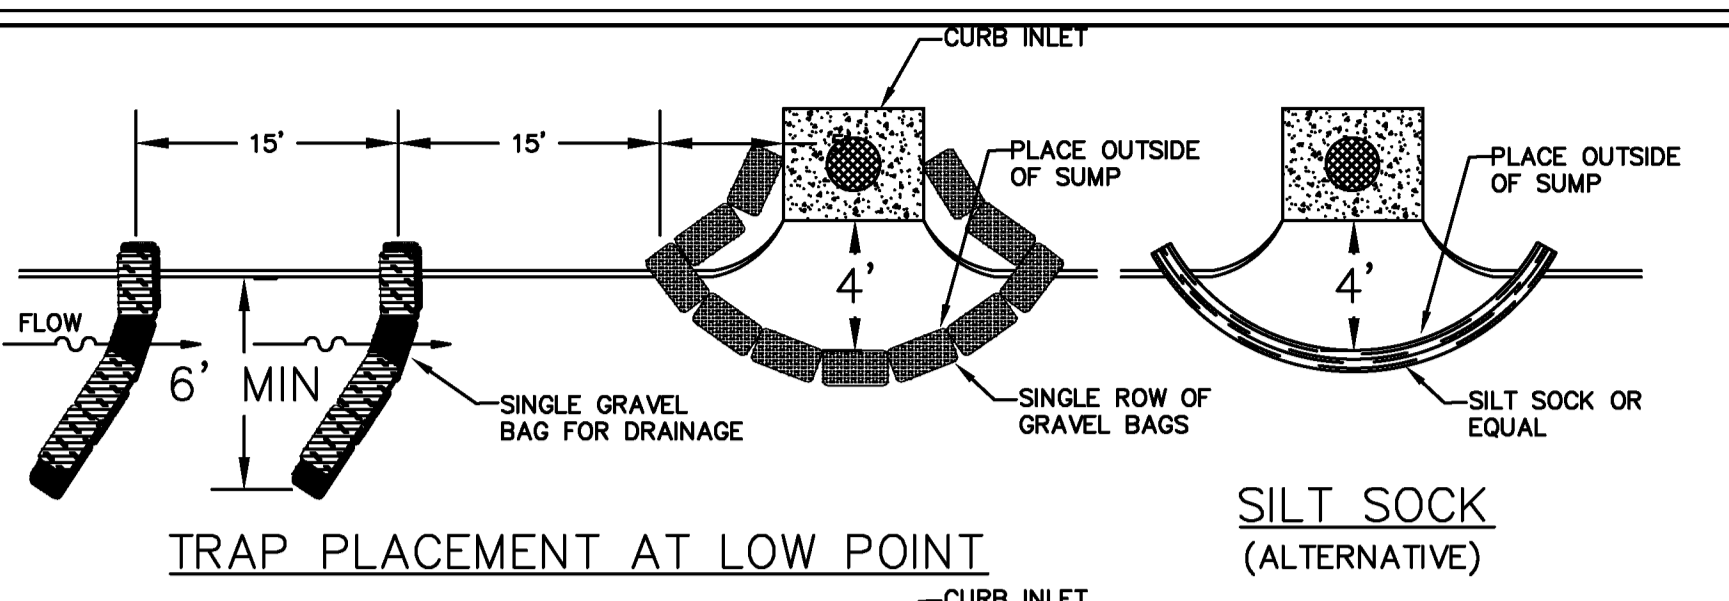



**SPACING OF TRAPS**

GUTTER SLOPE	S
LOW PT	15'
2%	20'
3% MAX	15'
	10'

- DESIGN CRITERIA**
- MAXIMUM DRAINAGE AREA - 1 ACRE.
  - PEAK RUNOFF SHALL BE ≤ 2 CFS BASED ON THE 6-MONTH STORM.
  - STACK GRAVEL BAGS DOUBLE HIGH. PROVIDE GAP FOR DRAINAGE.

CITY OF O'FALLON  
ENGINEERING DEPARTMENT  
O'FALLON, MISSOURI






**CURB INLET PROTECTION**

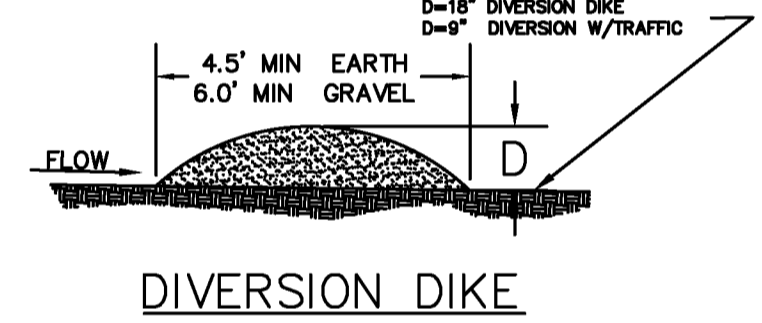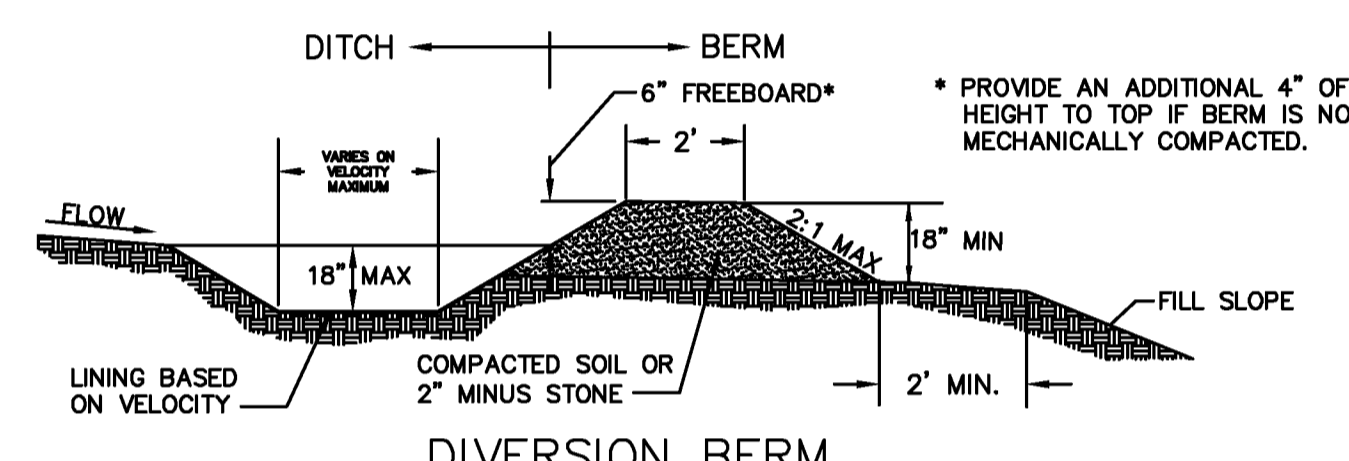

- DESIGN CRITERIA**
- DIVERSIONS SHALL BE USED FOR DRAINAGE AREAS ≤ 3 ACRES.
  - DIVERSION CHANNELS SHALL BE DESIGNED TO CONVEY THE 6-MO STORM AT NON-EROSIVE VELOCITIES.
  - CRITICAL LOCATIONS SHALL BE DESIGNED FOR THE 15YR / 20Min. STORM.
  - MAXIMUM CHANNEL SLOPE OF 3% WITHOUT CHECK DAMS.
  - SWALE SEDIMENT TRAPS ARE TO BE USED IN HIGHLY EROSION AREAS.
  - CHANNELS MUST BE PROTECTED USING APPROPRIATE CHANNEL LINERS.
  - CHANNEL OUTLETS MUST BE STABILIZED.
  - STORM SEWERS MAY BE USED IN LIEU OF OPEN CHANNELS.

CITY OF O'FALLON  
ENGINEERING DEPARTMENT  
O'FALLON, MISSOURI


**DIVERSION BERMS + DIKES**

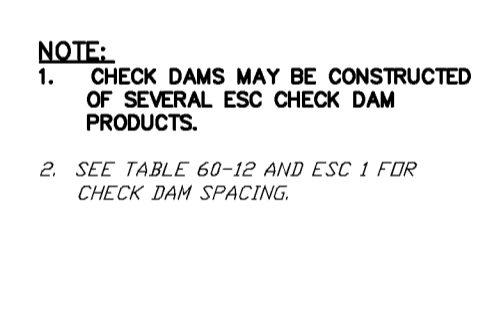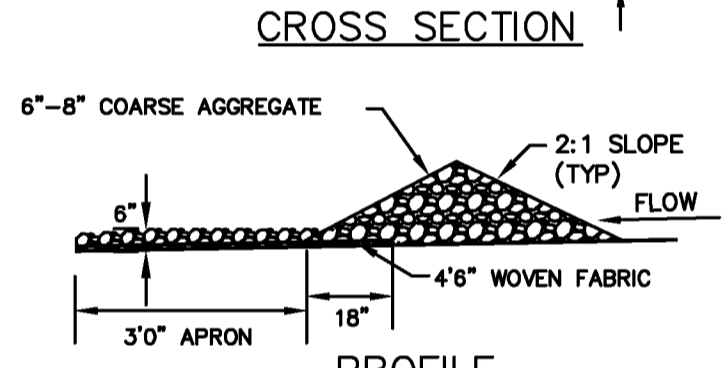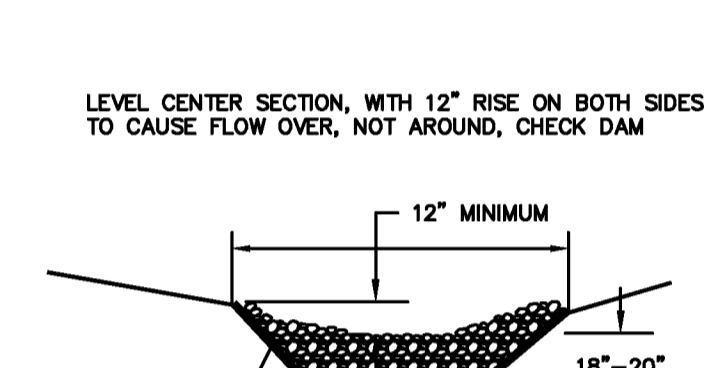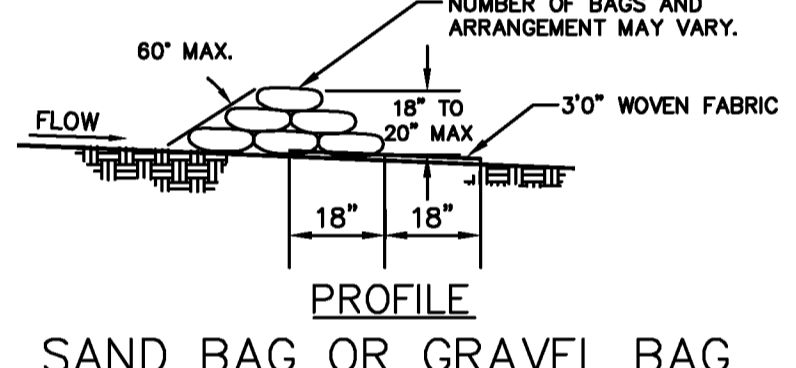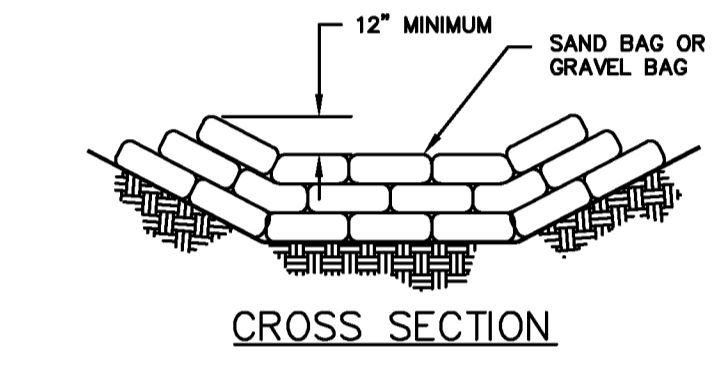

- NOTE:**
- CHECK DAMS MAY BE CONSTRUCTED OF SEVERAL ESC CHECK DAM PRODUCTS.
  - SEE TABLE 60-10 AND ESC. 1 FOR CHECK DAM SPACING.

CITY OF O'FALLON  
ENGINEERING DEPARTMENT  
O'FALLON, MISSOURI

**CHECK DAMS**

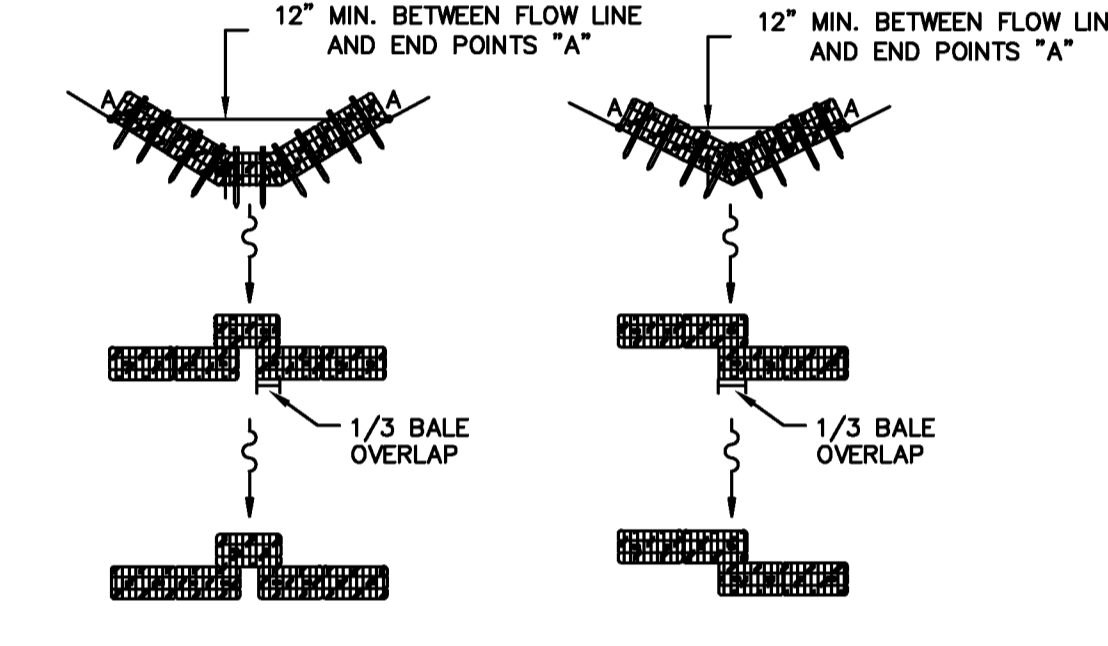



- CRITERIA FOR LOW CONCENTRATED FLOWS**
- DRAINAGE AREAS SHALL BE LESS THAN 1 ACRE.
  - INSTALL TWO STAKES PER BALE.
  - BALES WILL BE TRENCHED 4" DEEP INTO EARTH.
  - MAXIMUM CHANNEL SLOPE OF 3%.
  - SEDIMENTATION TRAPS TO BE USED IN HIGHLY EROSION AREAS.

**CHECK DAM SPACING**

Ditch Slope	Maximum Spacing
3%	50%
2%	75%


CITY OF O'FALLON  
ENGINEERING DEPARTMENT  
O'FALLON, MISSOURI

**STRAW BALE CHECK DAM**

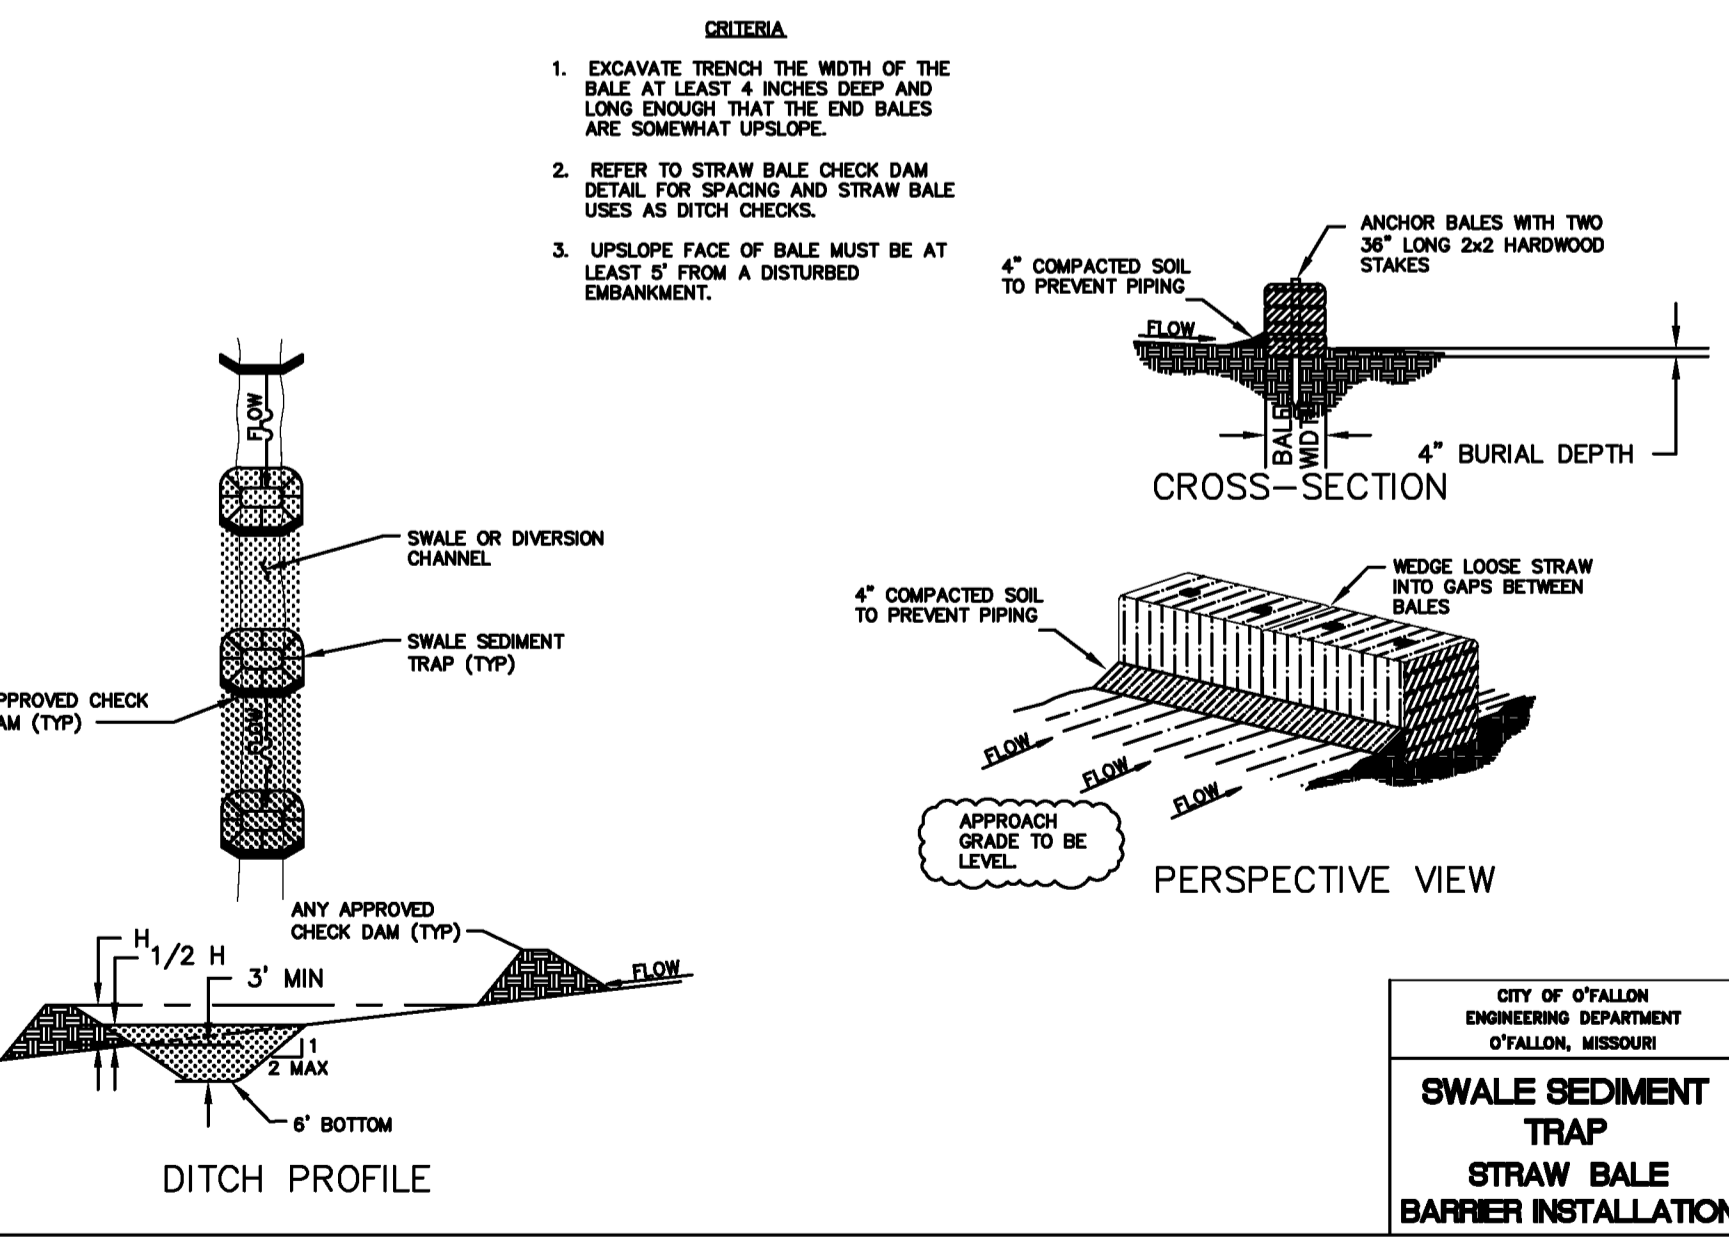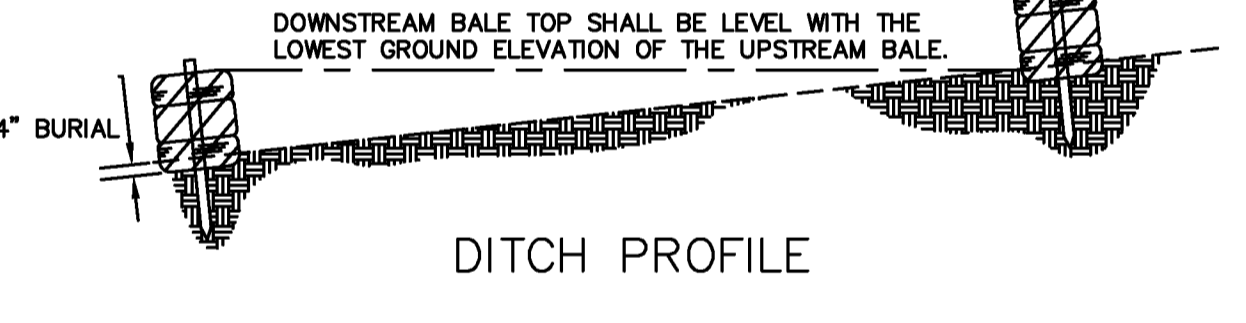


CITY OF O'FALLON  
ENGINEERING DEPARTMENT  
O'FALLON, MISSOURI

**SWALE SEDIMENT TRAP STRAW BALE BARRIER INSTALLATION**

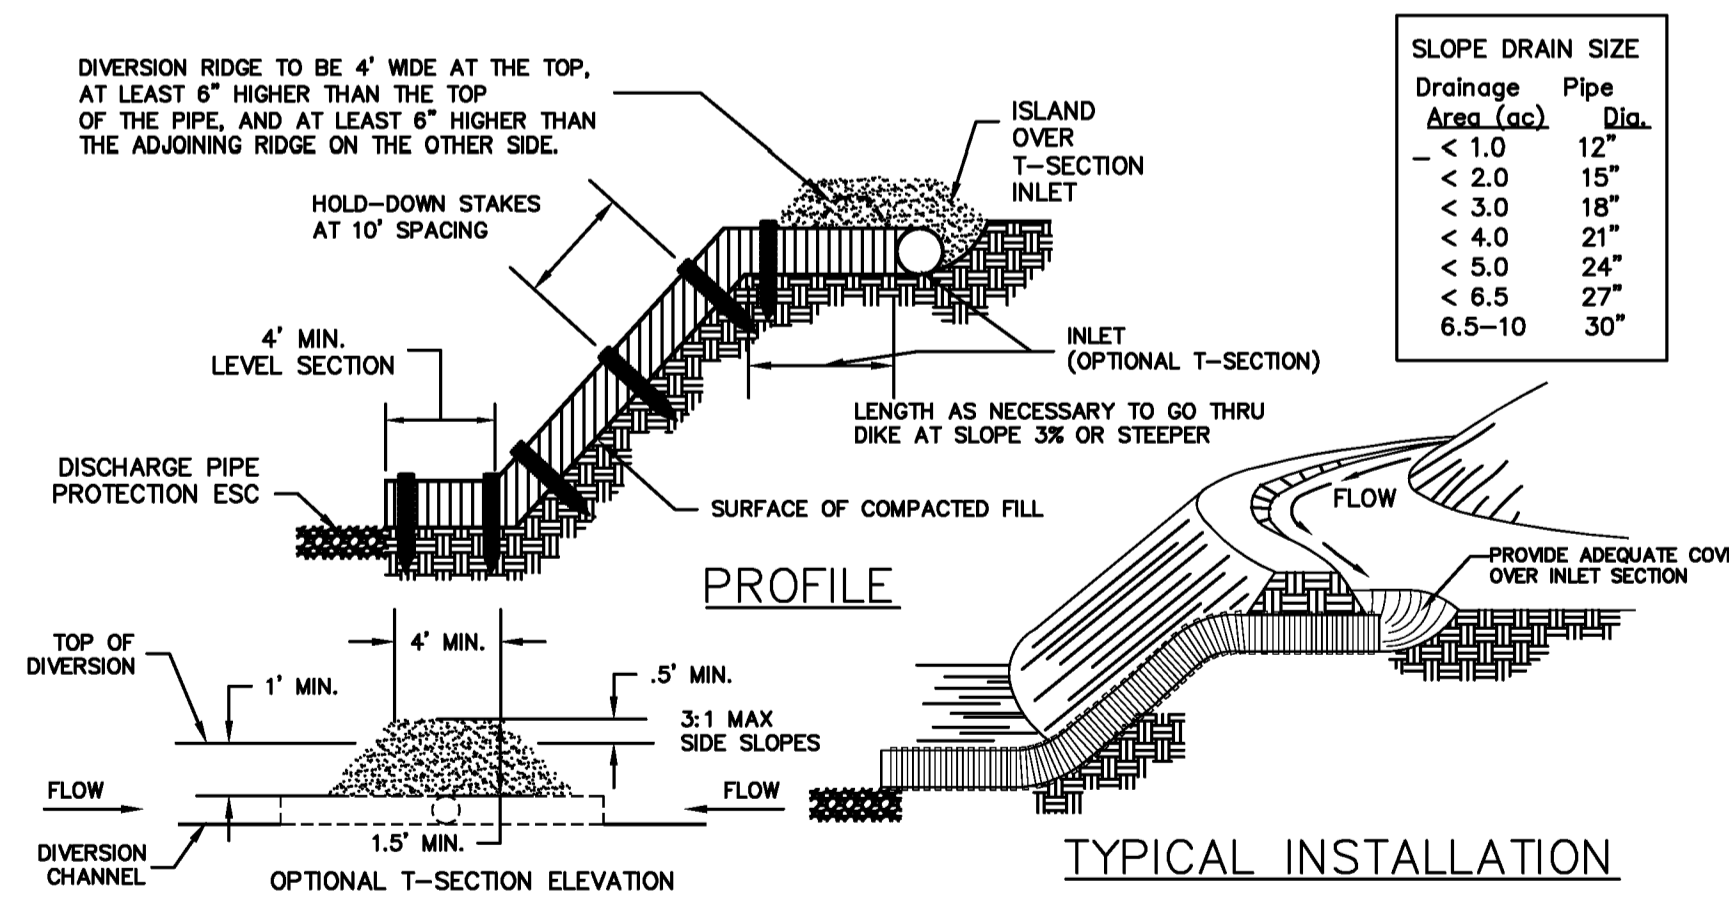

CITY OF O'FALLON  
ENGINEERING DEPARTMENT  
O'FALLON, MISSOURI

**TEMPORARY SLOPE DRAIN**

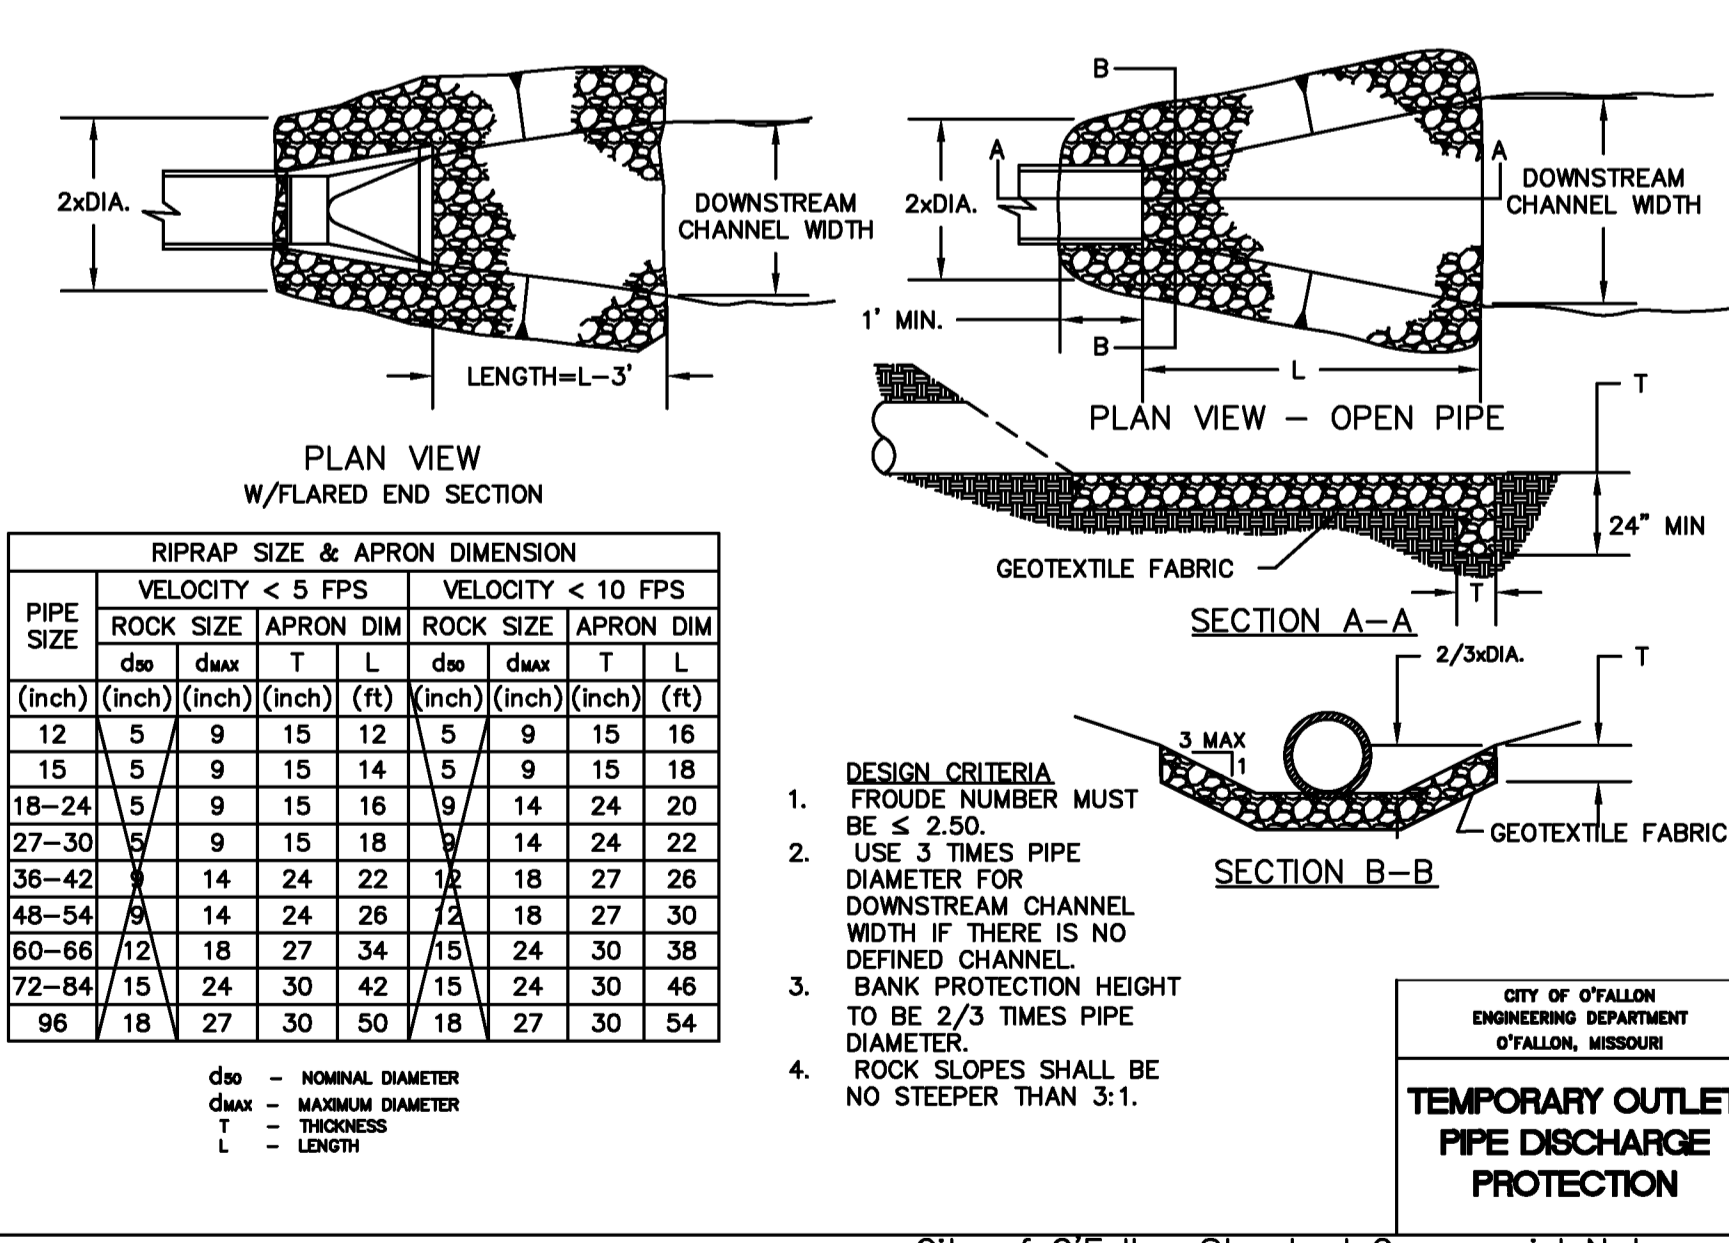

CITY OF O'FALLON  
ENGINEERING DEPARTMENT  
O'FALLON, MISSOURI

**TEMPORARY OUTLET PIPE DISCHARGE PROTECTION**

**THD DESIGN GROUP, INC.**  
"your solution for engineering and surveying"  
COPYRIGHT 2016  
146 CHESTERFIELD INDUSTRIAL BLVD, CHESTERFIELD, MO 63005  
TEL. 636-594-2972  
WEB: THDDESIGNGROUP.COM

**Developer / Owner Information:**  
KK+G, LLC. / Hoerman Family, LP  
Contact: Allen Walz  
1920 Jefferson Street  
Jefferson City, MO 65109

P+Z No.: 3805.08.02  
Approval Date:  
01/07/2016  
City No.