


WATER MAIN GENERAL NOTES

1. Fire hydrants shall be Mueller Centurion "6" Three-way or equal and shall consist of hydrant, main tee, valve, valve box and all fittings and hardware necessary for installation.
2. Water main shall be PVC, ASTM D2241.
3. Water main installation and specifications shall be as set down in Article II of City of Fallon ordinance N 6615.



NORTH  
 Scale 1"=50'

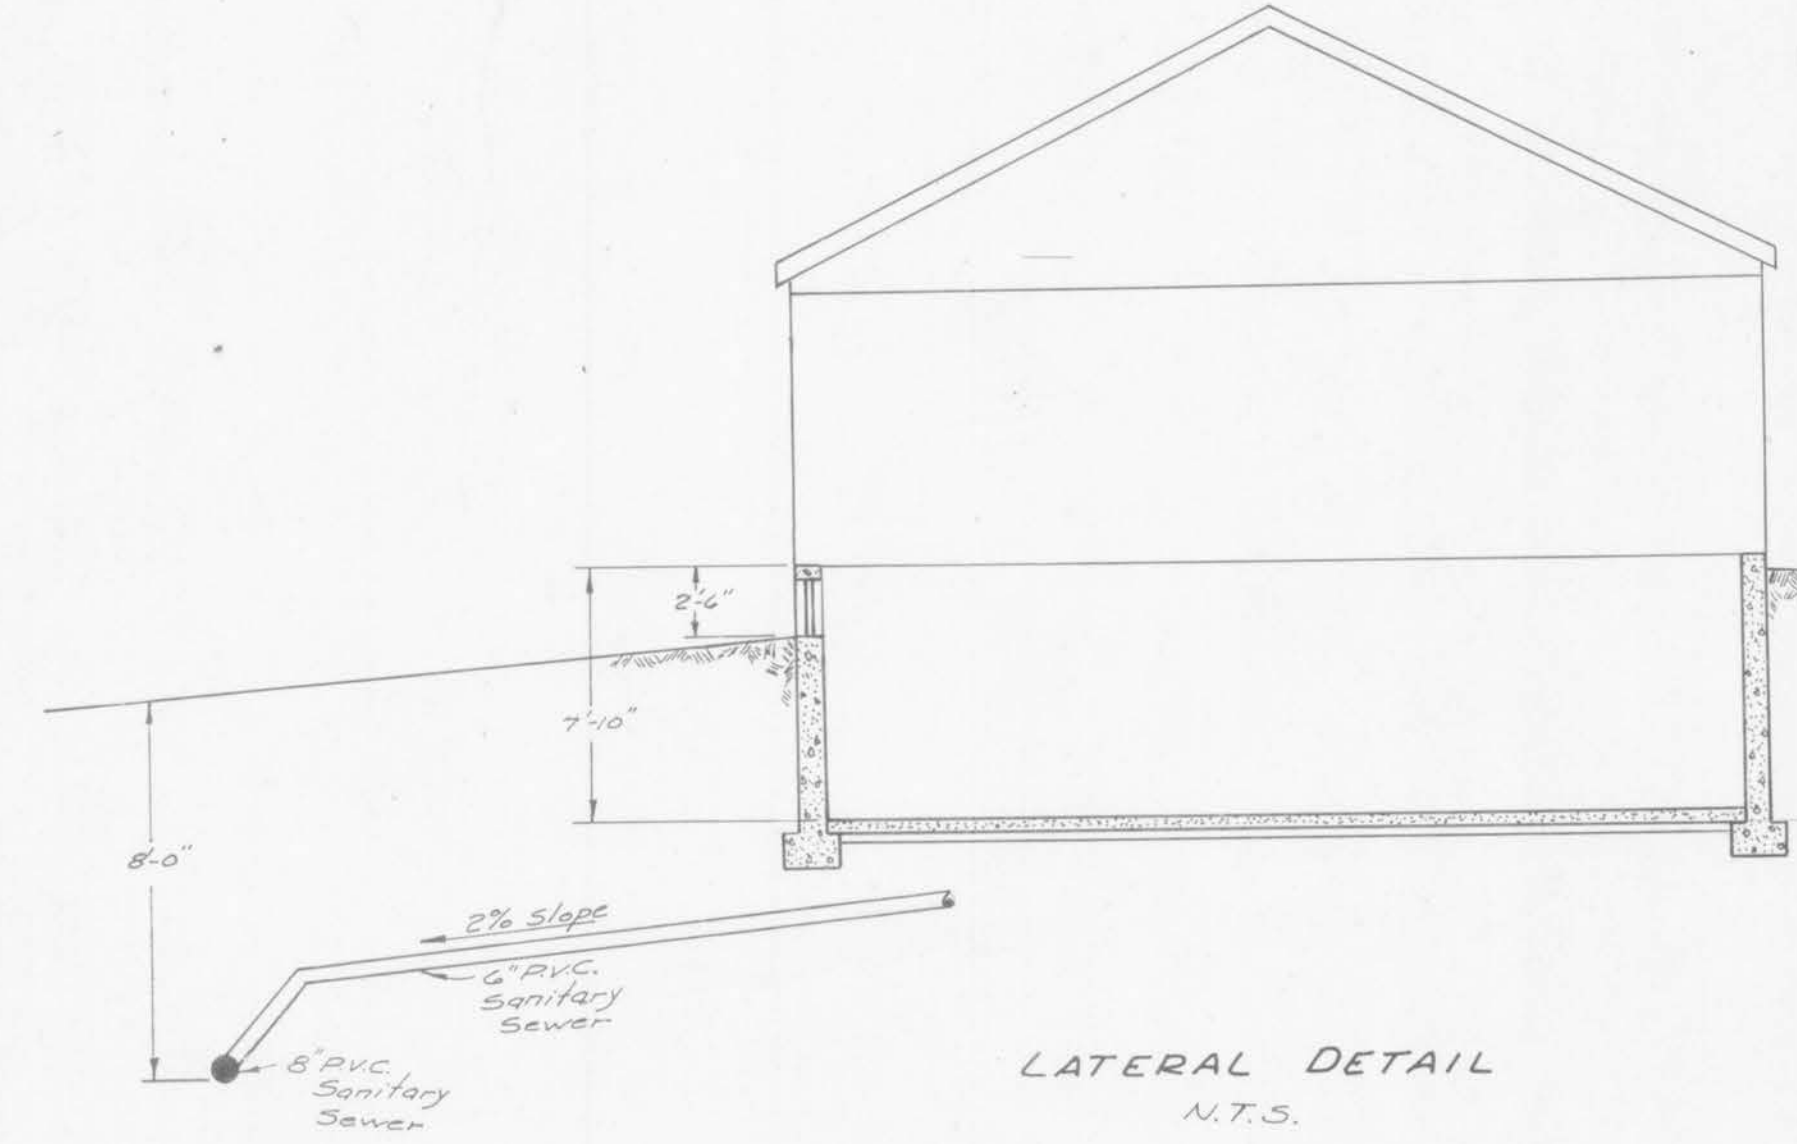