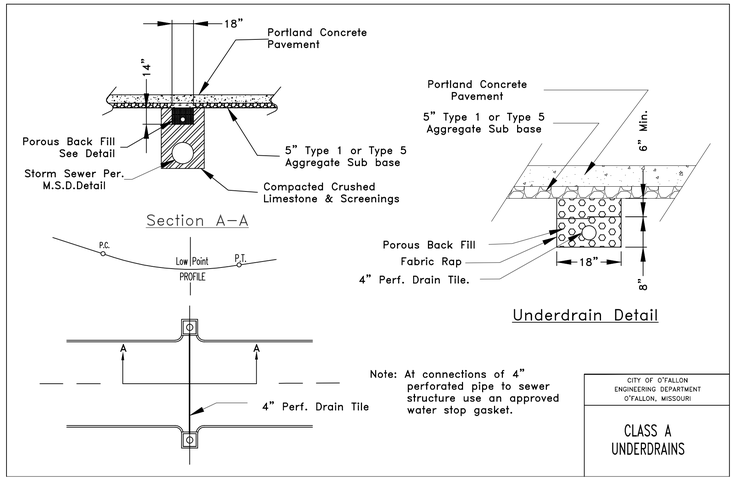

Note: At connections of 4" perforated pipe to sewer structure use an approved water stop gasket.

CITY OF O'FALLON
ENGINEERING DEPARTMENT
O'FALLON, MISSOURI

CLASS A UNDERDRAINS

* All other Storm or Sanitary Sewer Details will be by M.S.D. Standards and Specifications.
** All inlets shall have 5/8" trash bar centered with the opening(s).

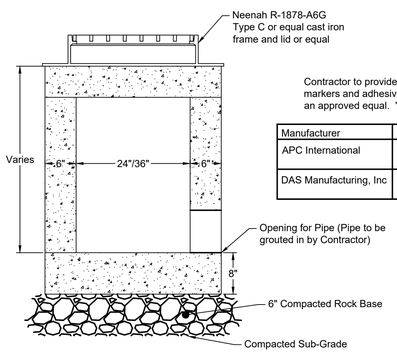

Contractor to provide marking on storm sewer inlets per the City allowed markers and adhesive procedures only as shown in the table below or an approved equal. "Peel and Stick" adhesive pads are not allowed.

Manufacturer	Size	Adhesive	Style	Message (Part #)	Website
APC International	3-7/8"	Epoxy	Crystal Cap	No Dumping Drains to Waterways (SD-W-CC)	www.acpinternational.com
DAS Manufacturing, Inc	4"	Epoxy	Standard Style	No Dumping Drains to Stream (#SDS)	www.dasmanufacturing.com

1 / C4.3 2'x2' & 3'x3' Inlet
Not To Scale

THESE DOCUMENTS ARE THE EXCLUSIVE PROPERTY OF MICHAEL E. NEIKIRK, PE AND THEREBY PROTECTED UNDER COPYRIGHT LAWS. ALL ORIGINAL DESIGNS, SPECIFICATIONS AND IDEAS REPRESENTED HERE ARE FOR THE SOLE USE OF THIS PROJECT AND SHALL NOT BE REPRODUCED OR ALTERED IN ANY MANNER WITHOUT THE WRITTEN CONSENT OF MICHAEL E. NEIKIRK, PE.
Copyright 2021 Michael E. Neikirk, PE. All rights reserved.

REVISIONS

NO.	DESCRIPTION	DATE
	CONSTRUCTION DOCUMENTS	11/29/22

MICHAEL E. NEIKIRK PE
Civil Engineer
306 North Market Street, Ste 101
Mt. Carmel, IL 62863
Phone: (618) 263-4100

SCALE:	NTS
DRAWN BY:	RM
DESIGNER:	TJL,RM
CHECKED BY:	TJL
ENGINEER:	Michael E. Neikirk
ARCHITECT:	IDesign
OWNER:	Bluegrass Hospitality Group

CERTIFIED BY

JOB TITLE
DRAKE'S RESTAURANT
900 HIGHWAY K
O'FALLON, MO

DRAWING TITLE
STORM DETAILS

FILE LOCATION

DRAWING NUMBER
C4.3

REV #