


FORCE MAIN TEST PRESSURE: 75 PSI
 PUMP SHUT OFF HEAD = 50 FEET = 25 PSI
 TEST PRESSURE = 25 PSI + 50 PSI = 75 PSI

NOTE:
 EXISTING SANITARY
 SEWER SERVICE
 SHALL NOT BE
 INTERRUPTED.

1"=10'
 1"=50'

ISSUE	REMARKS/DATE
1	10-17-06 FIRST SUBMITTAL
2	12-11-06 REVISED PER DCS&P W/ COMMENTS
3	12-28-06 REVISED PER ST. CHARLES CO. COMMENTS
4	01-25-07 REV. PER ST. CHARLES CO. & OFALCON
5	02-09-07 REVISED PER DCS&P & PWS&P COMMENTS
6	06-24-07 REVISED PER DCS&P COMMENTS
7	07-30-07 REV. PER ST. CH. CO. DCS&P & PWS&P COMMENTS

PREPARED FOR:
CROSS DEVELOPMENT OF MISSOURI INC.
 1609 PROSPECT VILLAGE DR.
 LAKE ST. LOUIS, MO. 63367
 314-713-4054

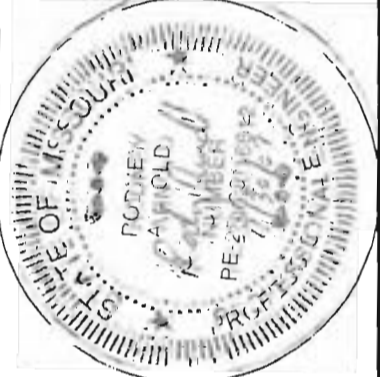

PREPARED BY:
THE STERLING CO.
ENGINEERS & SURVEYORS
 5055 NEW BAUMGARTNER ROAD
 ST. LOUIS, MISSOURI 63129
 (314)-487-0440 FAX 487-8944
 E-Mail: Sterling@sterling-eng-sur.com

PROJECT	THE ENCLAVE AT SOMMERS POINTE	
NO.	07	06 123
M.S.D.	SHEET	
PH	13.1	
DIGITAL PLOT DATE		
OF		

BASE MAP