
10-29-07 CITY COMMENTS 12-04-07 CITY COMMENTS 12-18-07 ROW DEDICATION 4-30-08 GRADING REVISIONS

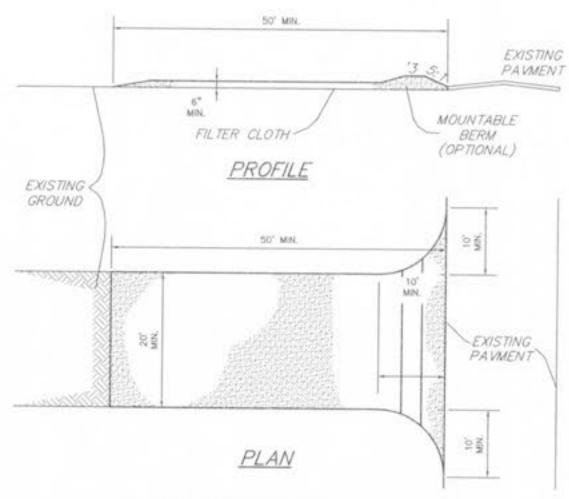

## CONSTRUCTION SPECIFICATIONS

- Stone Size Use 2" stone, or reclaimed or recycled concrete equivalent.
- 2. Length As required, but not less than 50 feet (except on a single residence lot where a 30 foot minimum length would apply).
- Thickness Not less than six (6) inches.
- 4. Width Twenty (20) foot minimum, but not less than the full width at points where ingress or egress
- 5. Filter Cloth Will be placed over the entire area prior to placing of stone. Filter will not be required on a single family residence lot.
- 6. Surface Water All surface water flowing or diverted toward construction entrances shall be piped across the entrance. If piping is impractical, a mountable berm with 5:1 slopes will be permitted.
- 7. Maintenance The entrance shall be maintained in a condition which will prevent tracking or flowing of sediment onto public rights-of-way. This may require periodic top dressing with additional stone as conditions demand and repair and/or cleanout of any measures used to trap sediment. All sediment spilled, dropped, washed or tracked onto public rights—of—way must be removed immediately.
- Washing Wheels shall be cleaned to remove sediment prior to entrance onto public rights—of—way. When washing is required, it shall be done on an area stabilized with stone and which drains into an approved sediment trapping device.
- 9. Periodic inspection and needed maintenance shall be provided after each rain.


STANDARD SIGN FACE, STANDARD HIGHWAY DEPARTMENT, OR CITY STREET DEPARTMENT

GAUGE, LETTERS AND BORDERS ARE GREEN,

THE HANDICAP LOGO SQUARE IS BLUE AND


THE BACKGROUND IS WHITE, GALVANIZED U CHANNEL POST 9'-0" LONG, SET 3'-0" INTO GRADE, SET BOTTOM OF "FINE" SIGN 5'-0"


## STABILIZED CONSTRUCTION ENTRANCE/WASHDOWN AREA

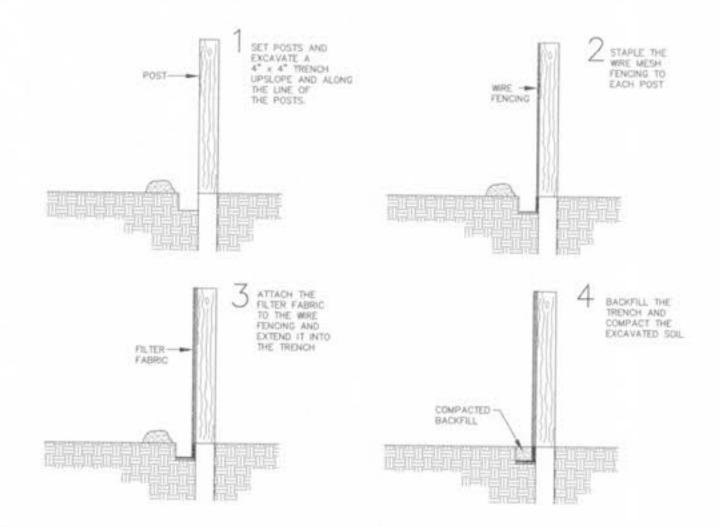

FILTER BARRIERS SHALL BE INSPECTED IMMEDIATELY AFTER EACH RAINFALL AND AT LEAST DAILY DURING PROLONGED RAINFALL.
ANY REQUIRED REPAIRS SHALL BE MADE IMMEDIATELY.
 SHOULD THE FABRIC DECOMPOSE OR BECOME INEFFECTIVE PRIDR TO THE END OF THE EXPECTED USABLE LIFE AND THE BARRIER
STILL BE NECESSARY, THE FABRIC SHALL BE REPLACED PROMPTLY.
 SEDIMENT DEPOSITS SHOULD BE REMOVED AFTER EACH STORM EVENT. THEY MUST BE REMOVED WHEN DEPOSITS REACH
APPROXIMATELY HALF THE HEIGHT OF THE BARRIER.
 ANY SEDIMENT DEPOSITS REMAINING IN PLACE AFTER THIE SLT FENCE OR FILTER BARRIER IS NO LONGER REQUIRED SHALL BE
DRESSED TO CONFORM WITH THE EXISTING GRADE, PREPARED AND SEEDED.




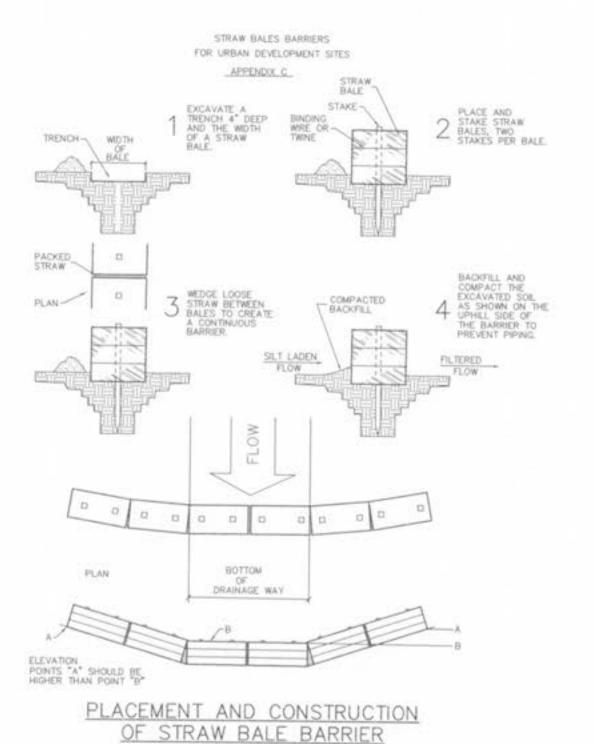

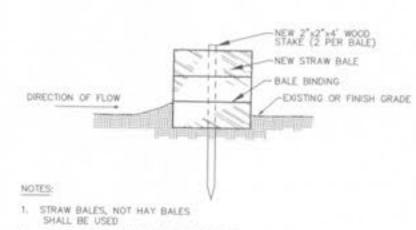

- Z. BUTT ENDS OF BALES TIGHTLY TOGETHER.
- INSTALL BALES WITH BINDING AROUND SIDES, NOT TOP AND BOTTOM.
- FILL ANY GAP BETWEEN BALES BY WEDGING LOOSE STRAW BETWEEN THEM.

NOT TO SCALE




HANDICAP PARKING SIGN (CITY OF O'FALLON)

ABOVE FINISHED GRADE.


RESERVED

PARKING


£



PAINTED HANDICAPPED PARKING SYMBOL

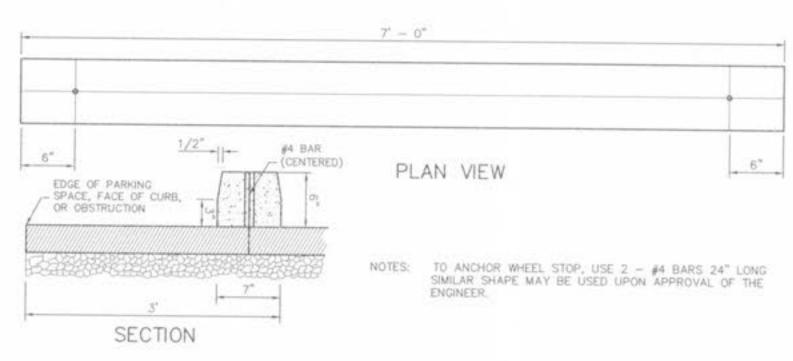


PRECAST CONCRETE WHEELSTOP

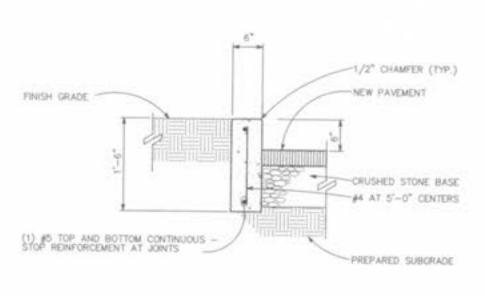

CONCRETE CURB DETAIL NOT TO SCALE

3" TYPE "C" ASPHALTIC CONCRETE -

8" COMPACTED TYPE I AGGREGATE BASE

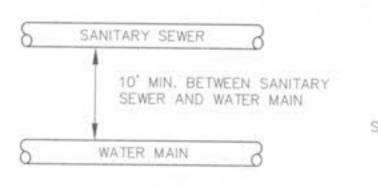

WATER MAIN 3' MIN. FROM TOP OF SANITARY SEWER TO BOTTOM OF WATER SANITARY SEWER () MAIN

HORIZONTAL DISTANCE

VERTICAL DISTANCE

TYPICAL WATER AND SEWER SEPARATION NOT TO SCALE

ASPHALT PAVEMENT DETAIL NOT TO SCALE