


**GLENMARO WATER PLAN**

AUGUST, 1995

95-059

REV. 9-1-95  
REV. 9-25-95 G.S.  
REV. 10-10-95 D.G.  
(LOOPED WATER LINES)

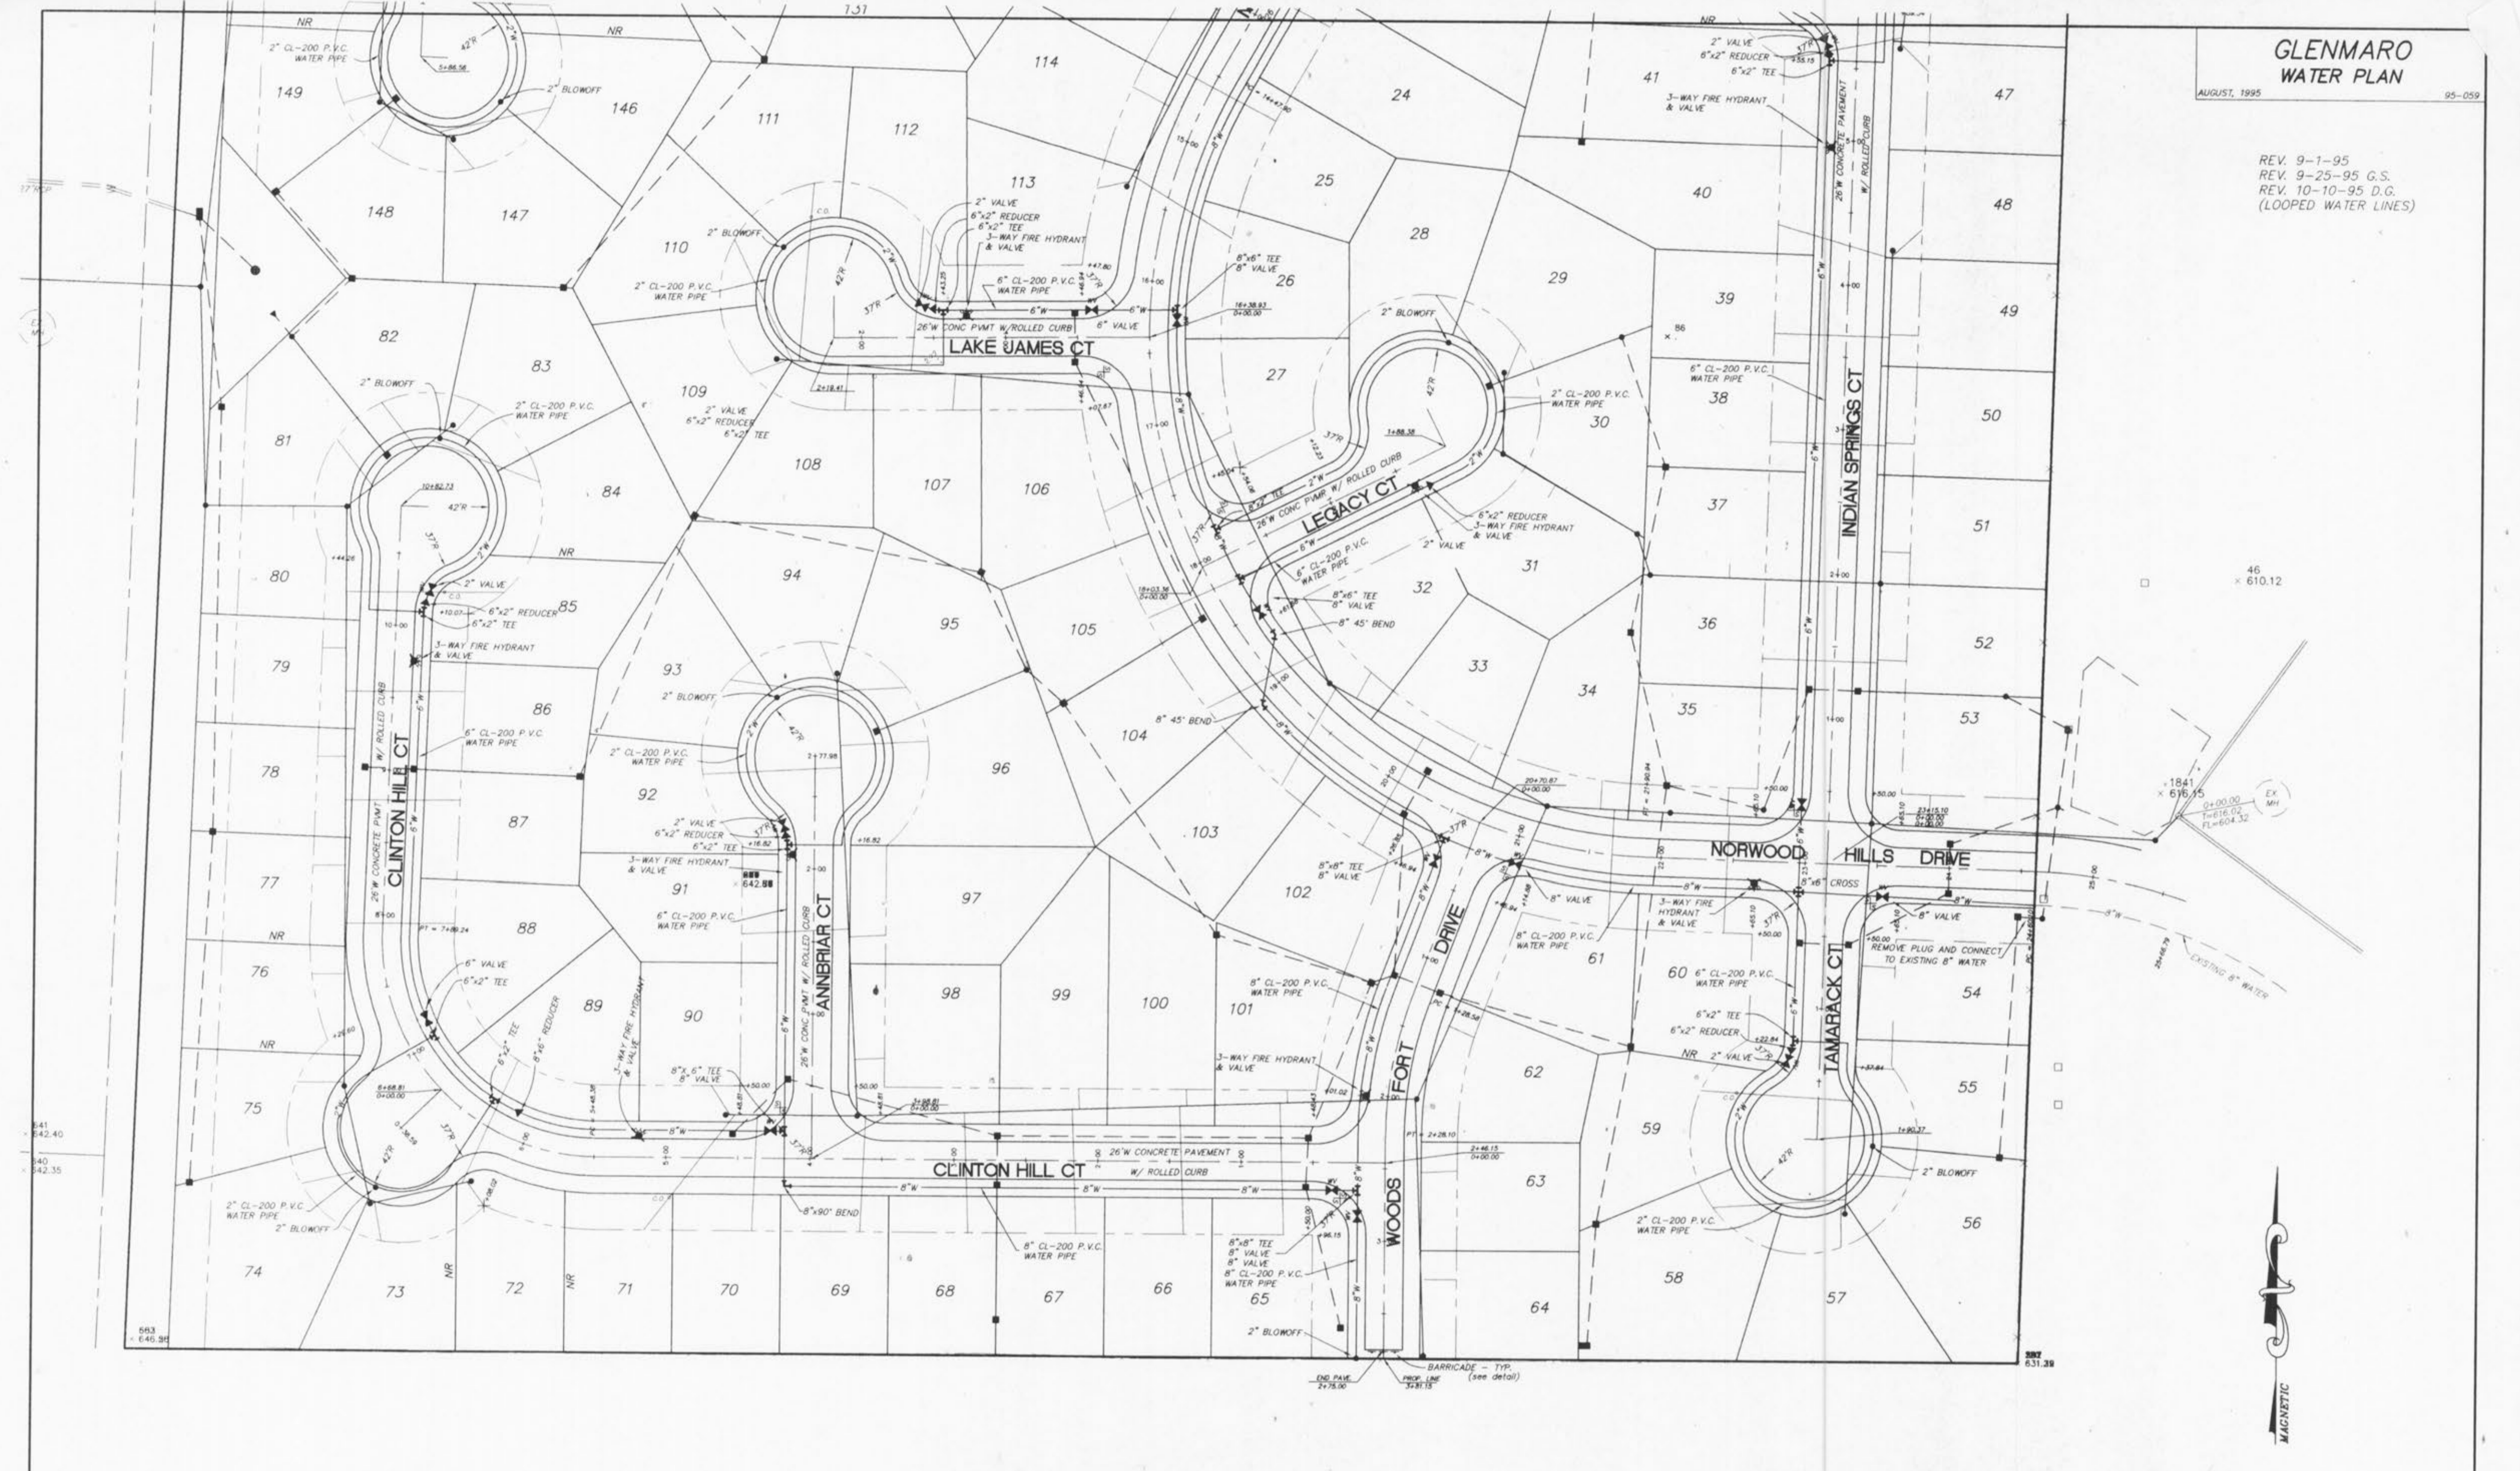

**CAUTION:**  
TO AVOID CONFLICT BETWEEN DRIVEWAY AND 2" BLOWOFF, VERIFY LOCATION OF BLOWOFF PRIOR TO DRIVEWAY CONSTRUCTION.

**NOTE**  
ALTERNATE PIPE CAN BE USED: "ULTRA-BLUE", PER PUBLIC WATER SUPPLY DISTRICT NO. 2

**UTILITY NOTE:**  
UNDERGROUND FACILITY STRUCTURES AND UTILITIES HAVE BEEN PLOTTED FROM AVAILABLE SURVEYS AND RECORDED INFORMATION AND, THEREFORE, THEIR LOCATIONS MUST BE CONSIDERED APPROXIMATE ONLY. VERIFICATION OF LOCATION OF ALL UNDERGROUND STRUCTURES AND FACILITIES EITHER SHOWN OR NOT SHOWN ON THESE PLANS, SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR.

