

FILE COPY

HIDDEN MEADOWS SANITARY SEWER PLAN AND PROFILE WATER LINE EXTENSION

DEC. 1995
REVISED 11/22/96 PER CITY OF O'FALLON COMMENTS
REVISED 3/05/96 EXISTING MH INSIDE DROPS
REVISED 3/28/96 NO DROP @ MH2 & LOWERED
RUN MH 1-24 TO MH 1-24B



95-175

APPROVED


Revised from original approval

J. H. 4/13/96


to be inserted into originally approved plans.

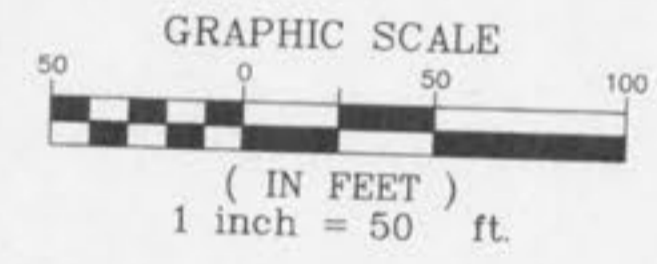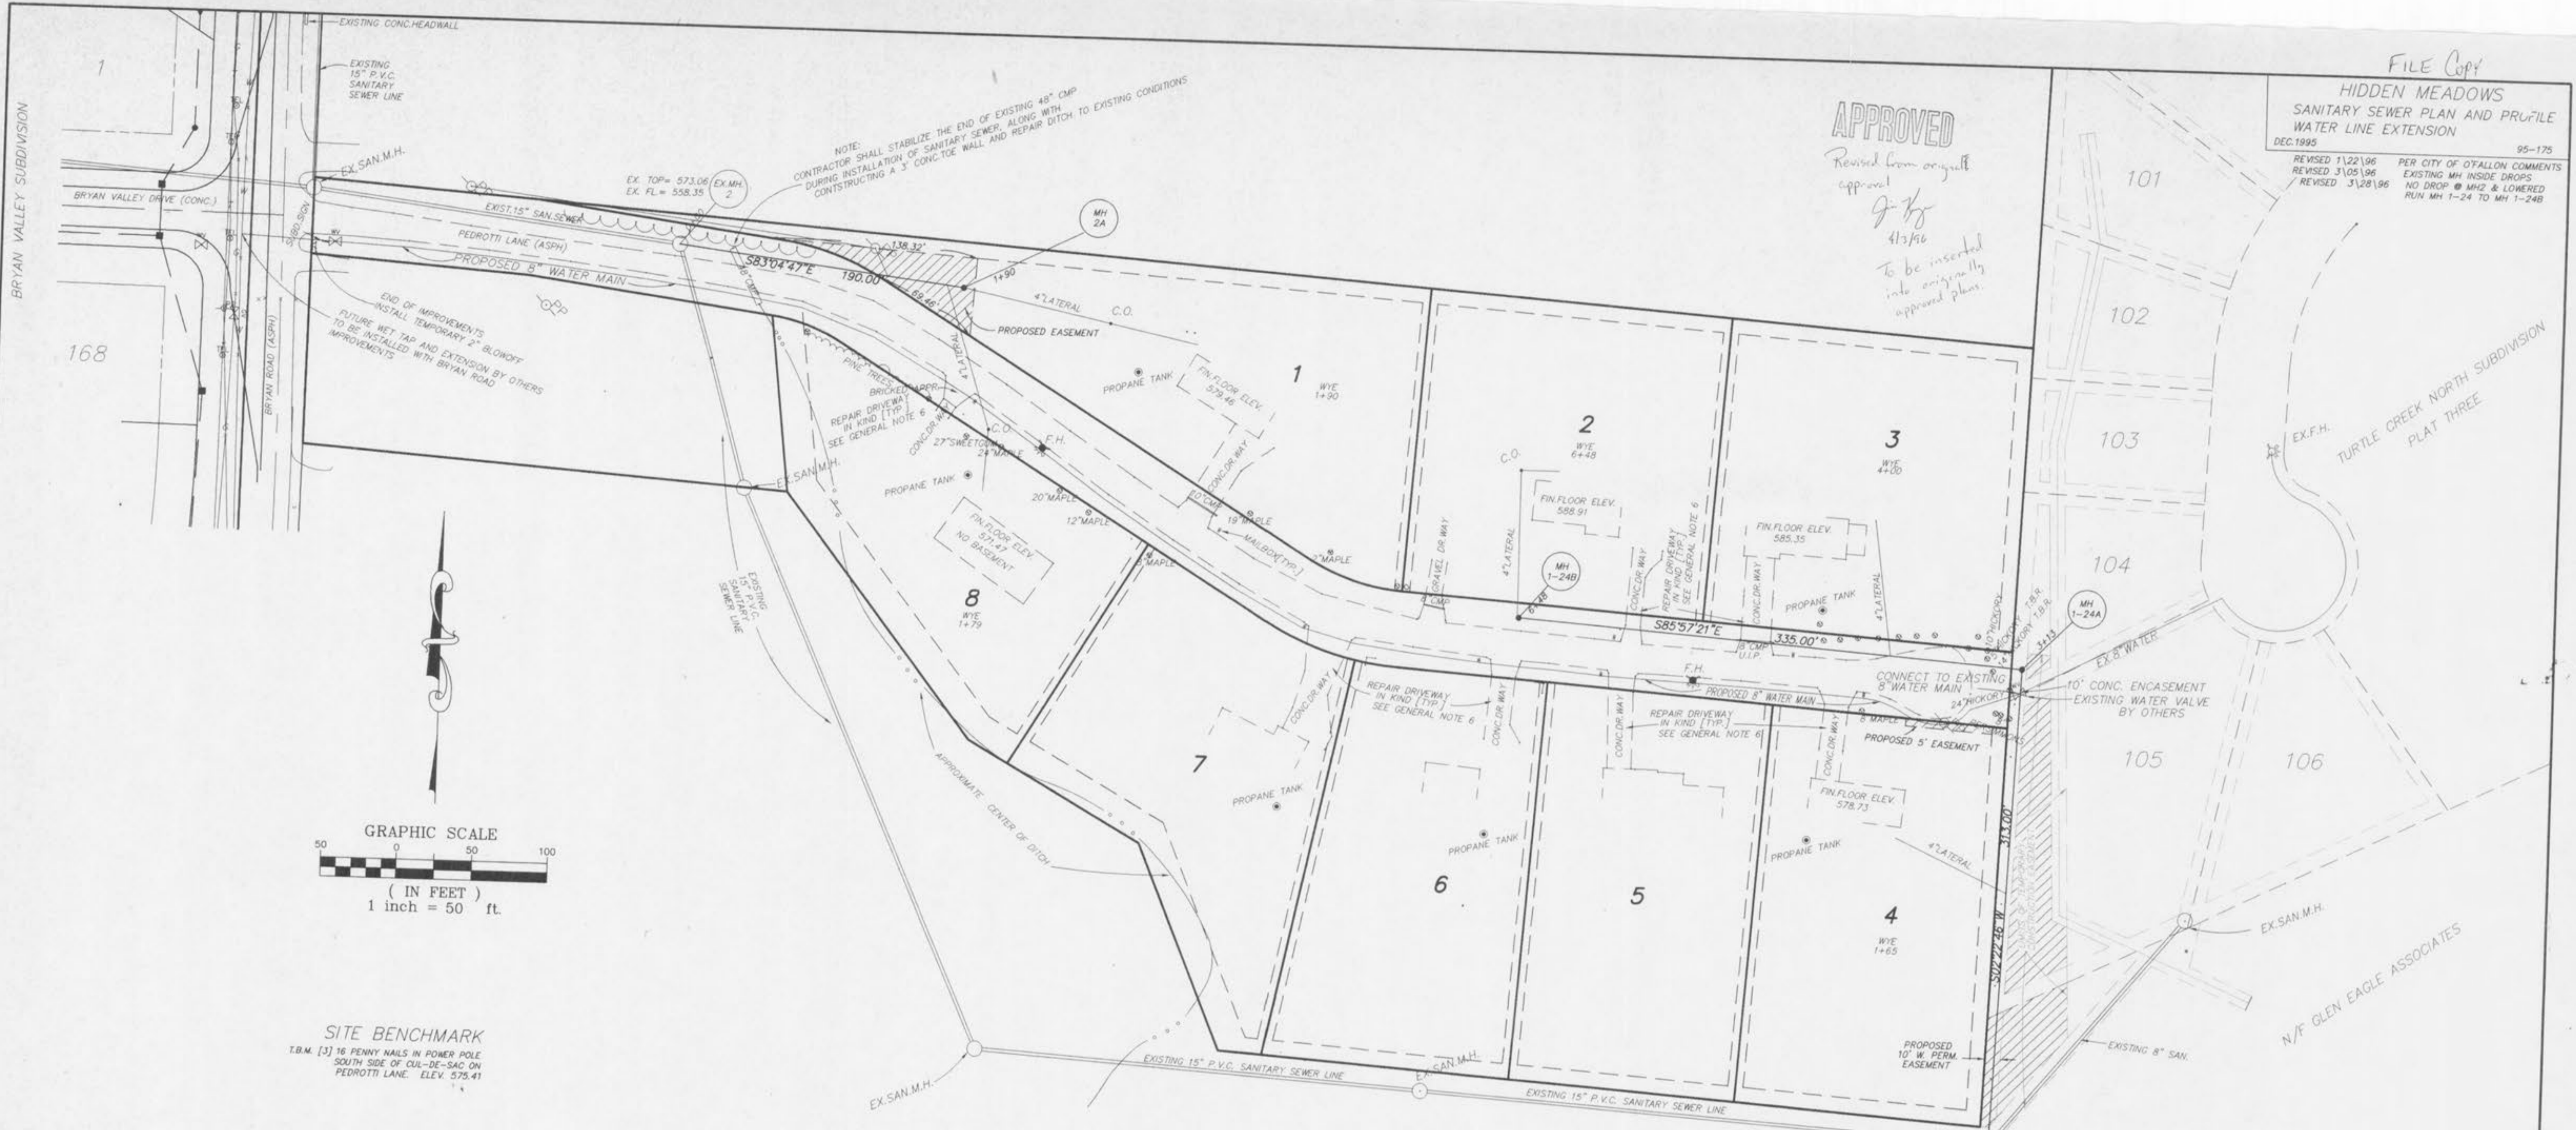

SITE BENCHMARK
T.B.M. [3] 16 PENNY NAILS IN POWER POLE
SOUTH SIDE OF CUL-DE-SAC ON
PEDROTTI LANE. ELEV. 575.41

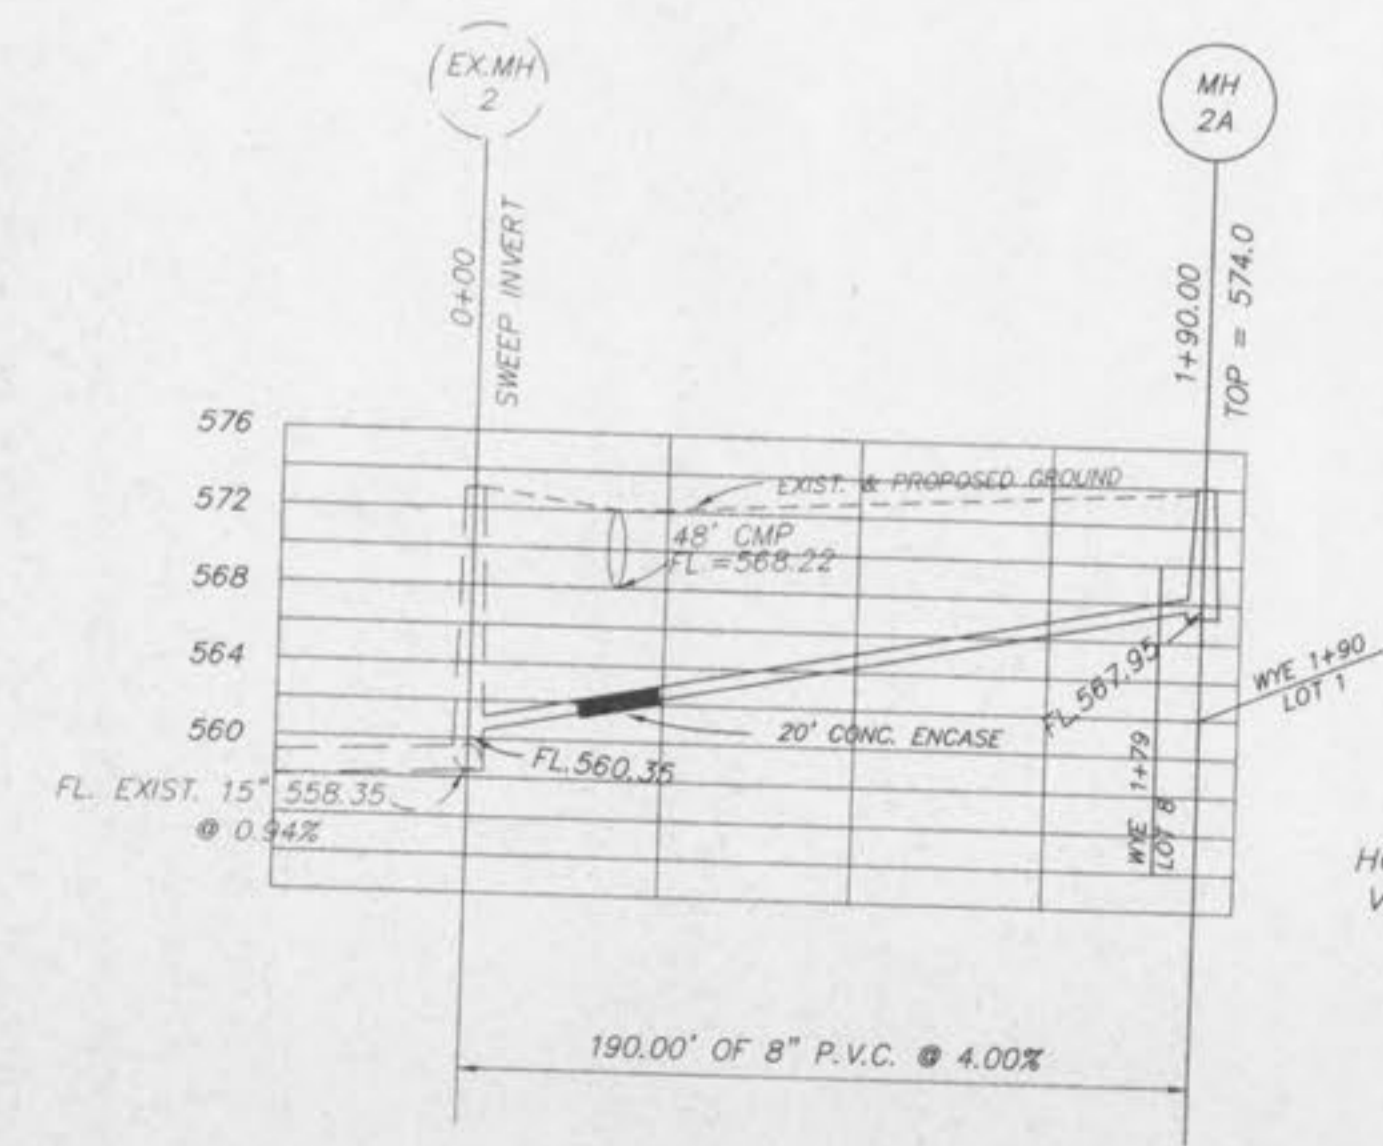

SCALE
HORIZ: 1" = 50'
VERT: 1" = 10'

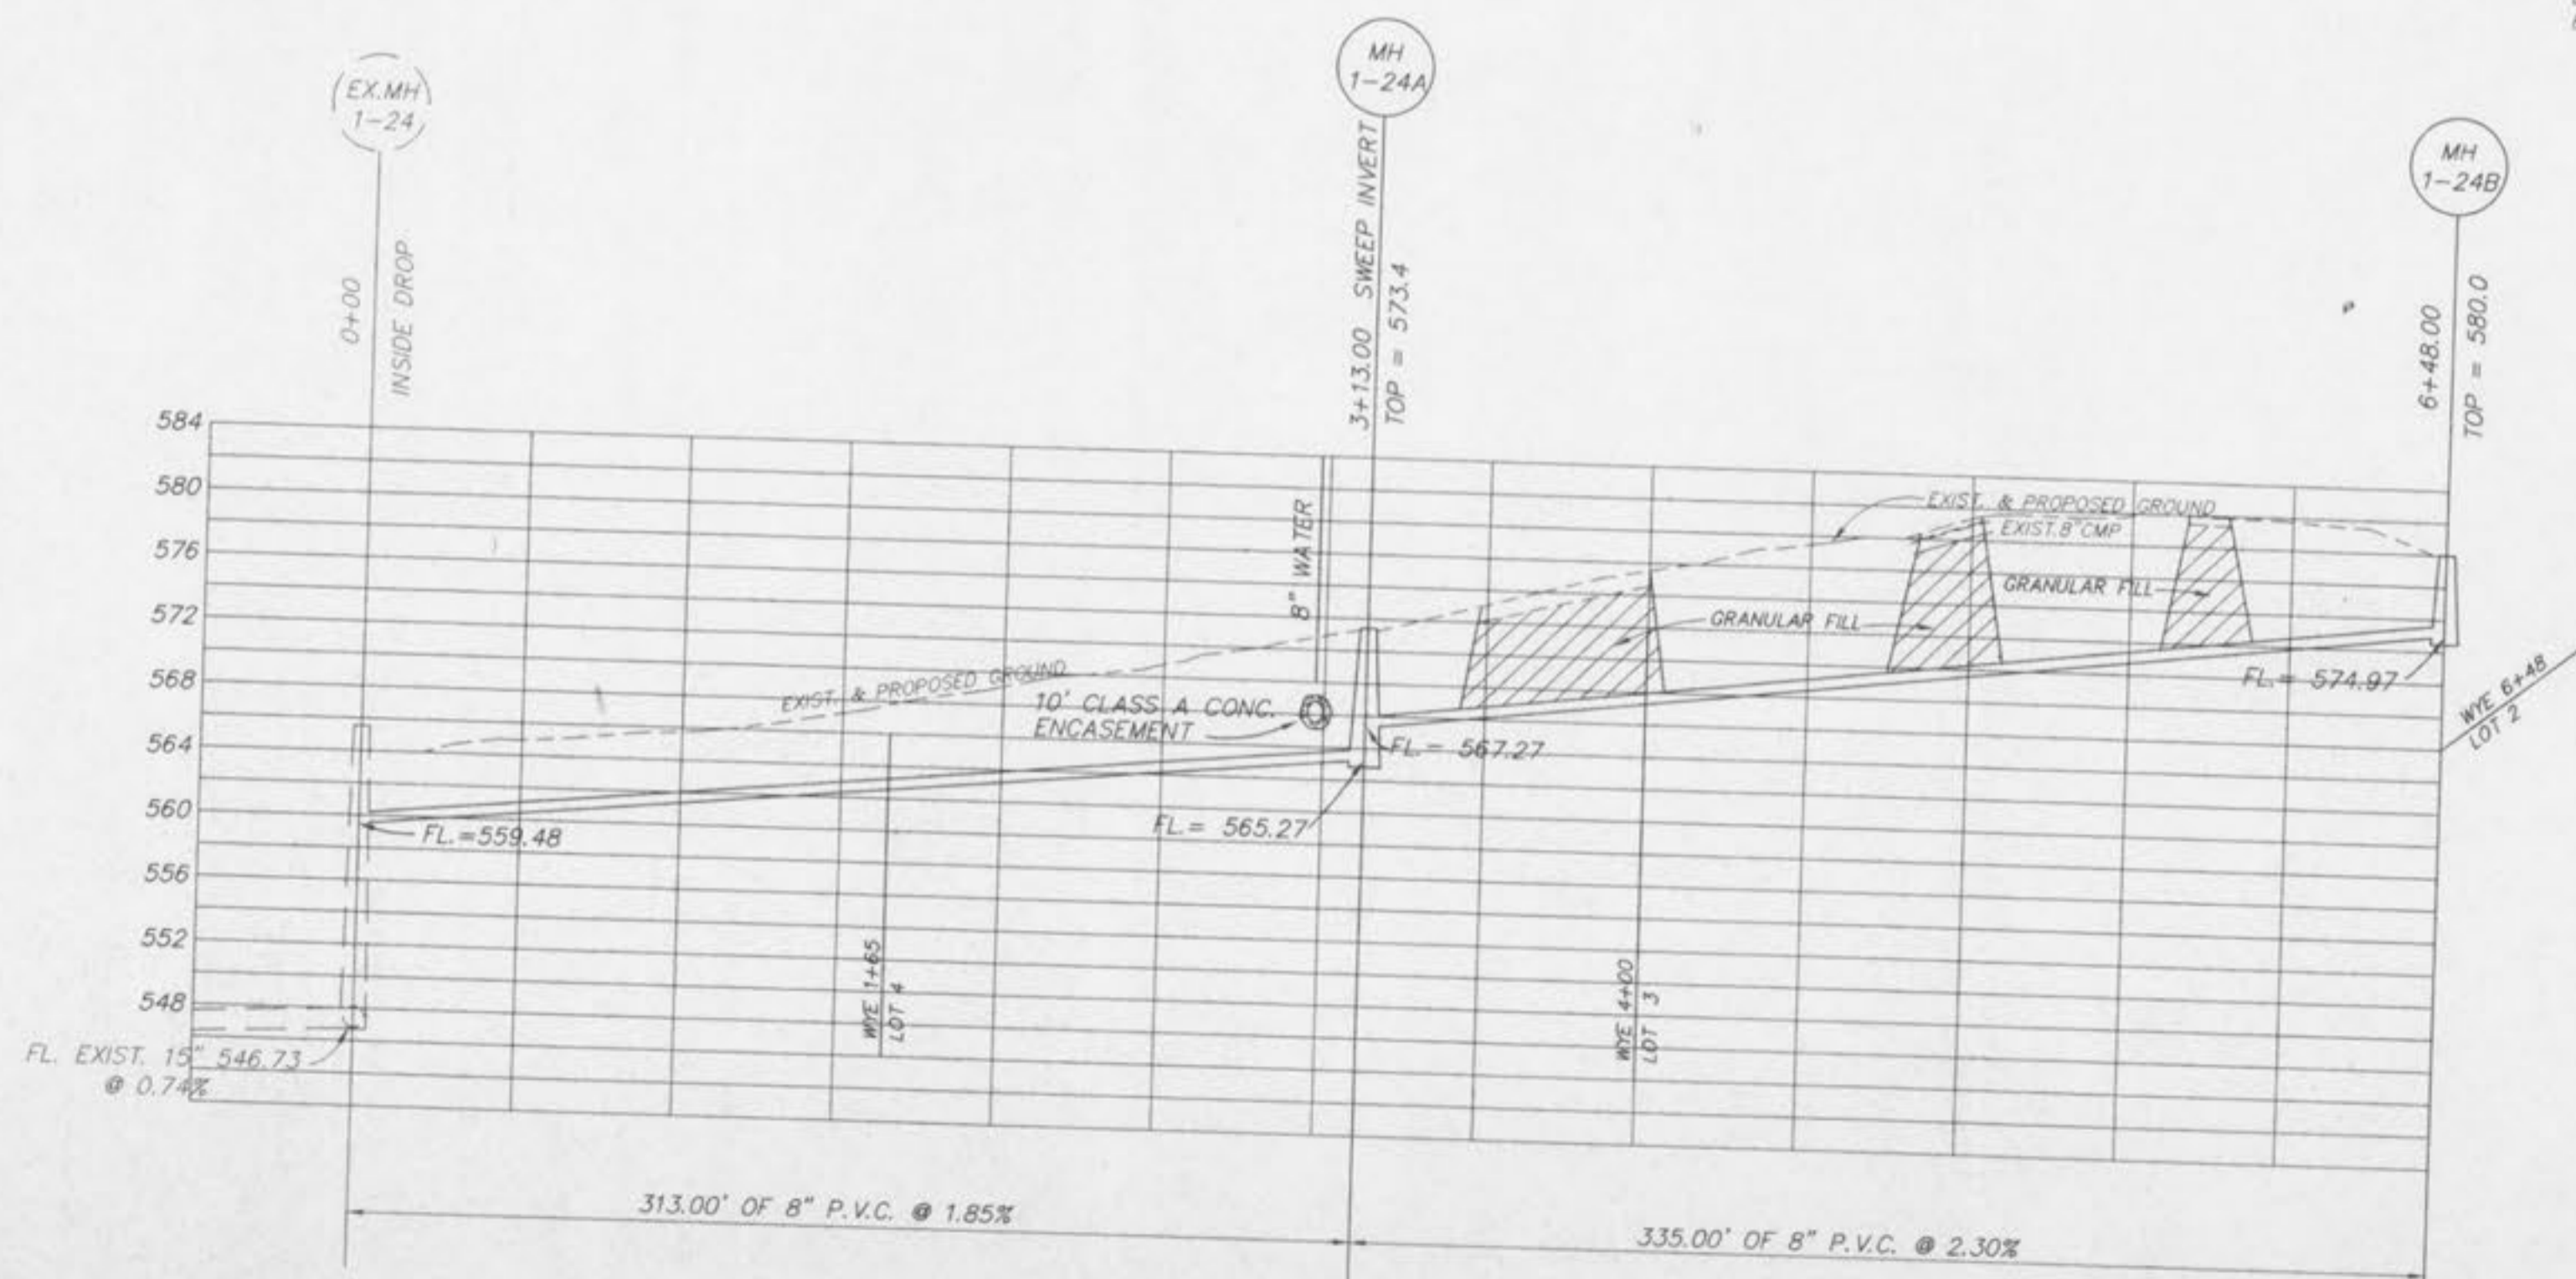

GENERAL NOTES:

1. LATERALS ARE SUBJECT TO RELOCATION DUE TO SEPTIC TANK AND FIELD LOCATIONS
2. ALL DISTURBED AREAS TO BE RESTORED BY CONTRACTOR WITH LIKE MATERIAL
3. WATER MAIN TO BE INSTALLED 4 FEET FROM EDGE OF PAVEMENT, WITH A MINIMUM OF 42" COVER TO TOP OF PIPE
4. EXHIBITS FOR ALL NECESSARY EASEMENTS SHALL BE PROVIDED CORRESPONDING TO EASEMENTS SHOWN ABOVE
5. ALL LANDOWNERS SHALL BE NOTIFIED PRIOR TO CONSTRUCTION
6. ALL DRIVEWAYS SHALL BE REPLACED FROM EXISTING CONSTRUCTION JOINT TO JOINT, OR TO THE R.O.W. LINE.

NOTE
Underground utilities and structures have been plotted from available information and therefore, their location must be considered approximate only. It is the responsibility of the individual contractor to notify the utility companies before actual construction.