



2-04-00 CITY COMMENTS
 3-15-00 CITY COMMENTS
 4-18-00 CITY COMMENTS
 5-05-00 CITY COMMENTS

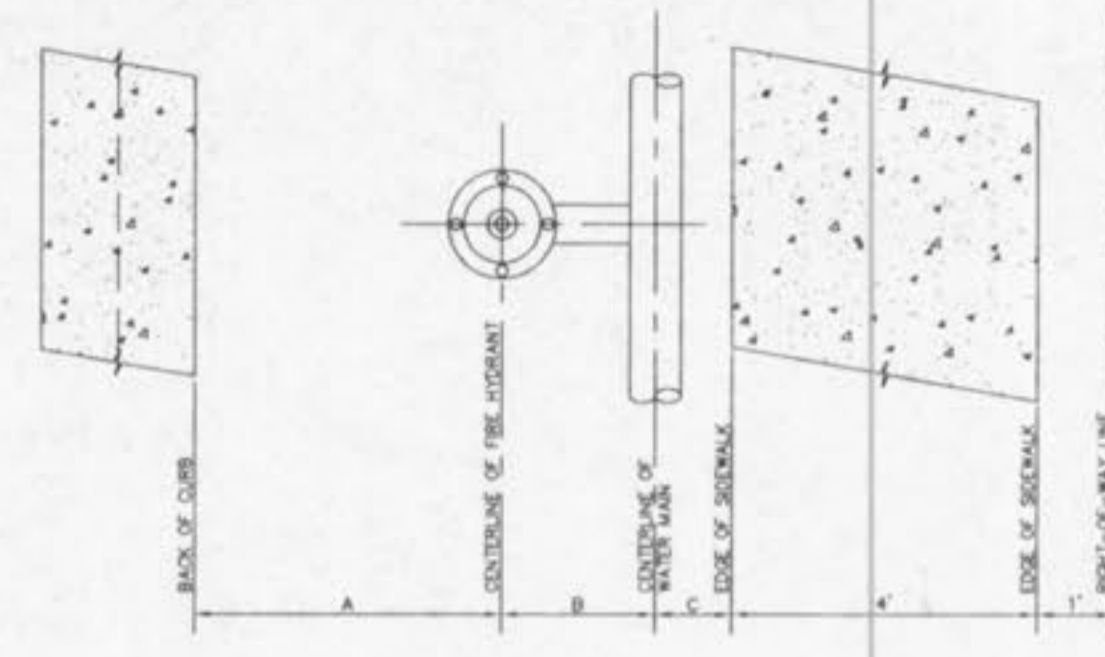


CONFIGURATION

50' RIGHT-OF-WAY/26" PAVEMENT/WITHOUT SIDEWALK	A	B	C
50' RIGHT-OF-WAY/26" PAVEMENT/WITH SIDEWALK	4'	2'	N/A
	4'	2'	1'


TYPICAL WATER MAIN AND FIRE HYDRANT LOCATIONS
 NOT TO SCALE

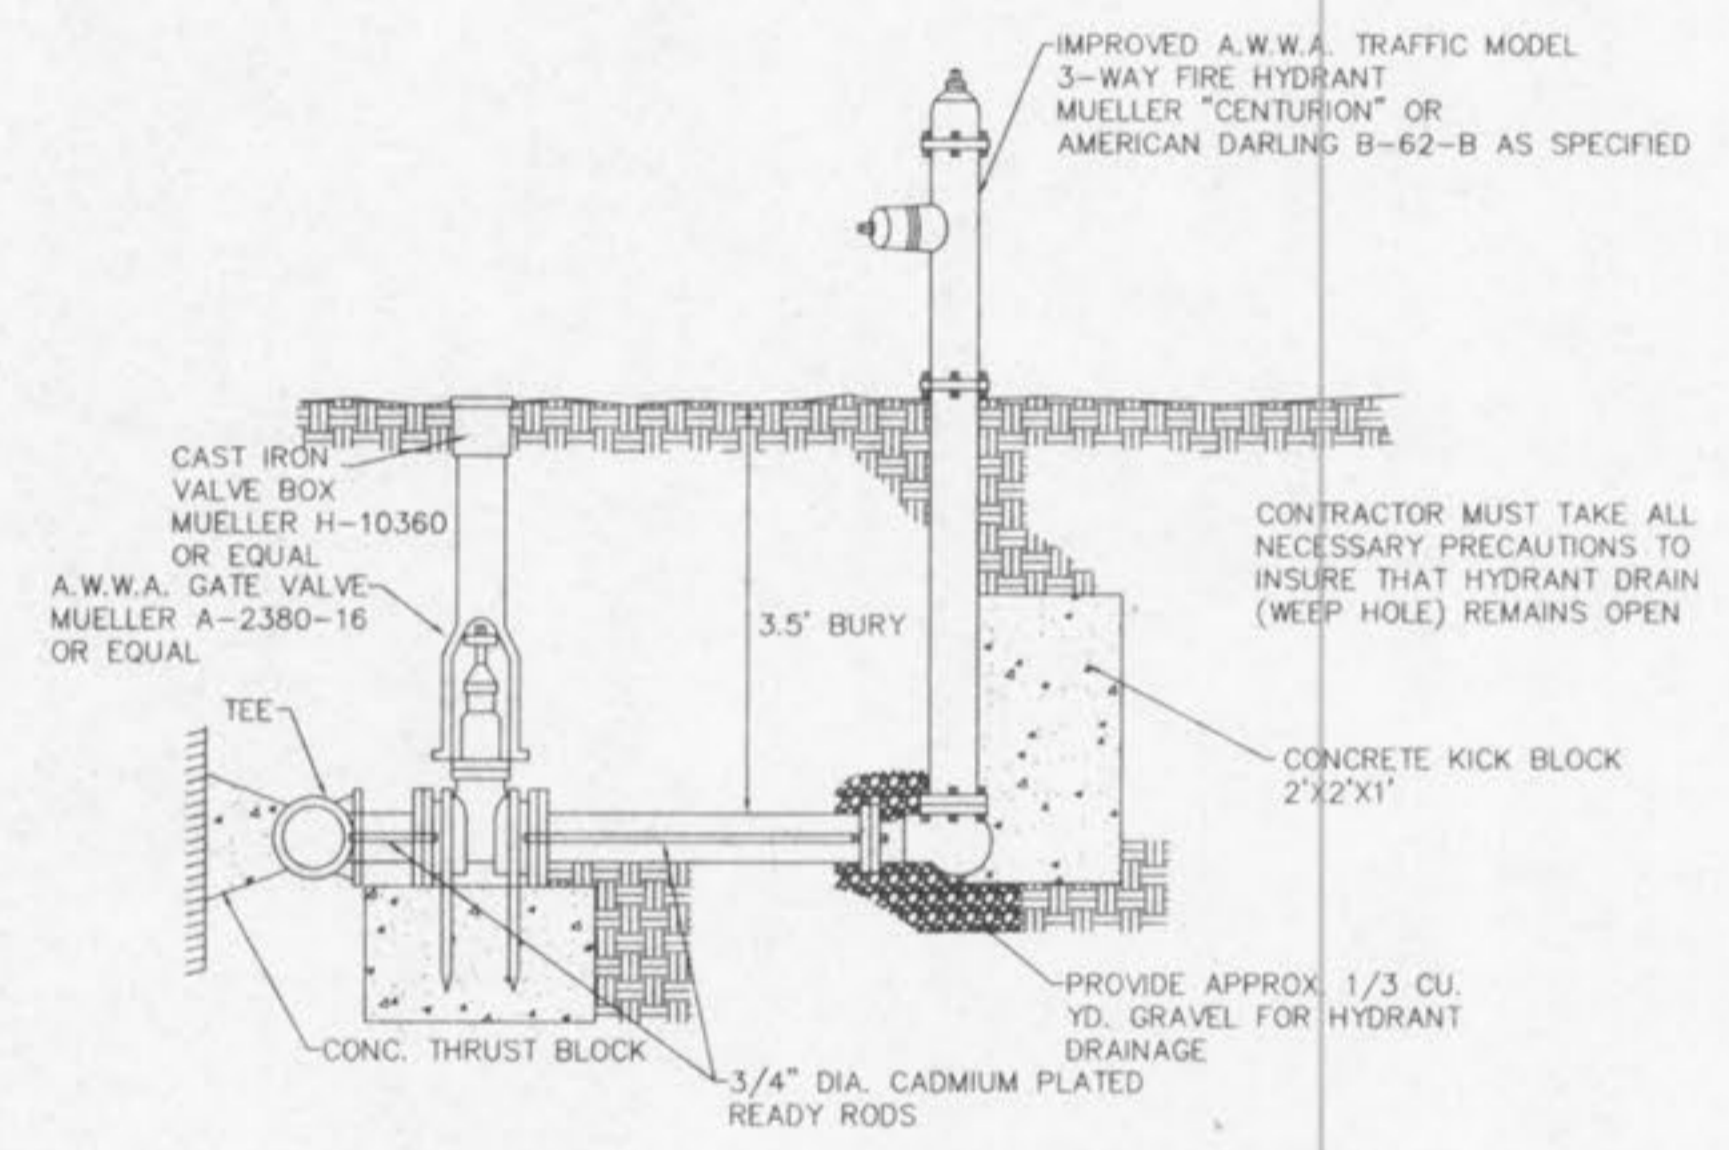


FIRE HYDRANT INSTALLATION DETAIL
 NOT TO SCALE

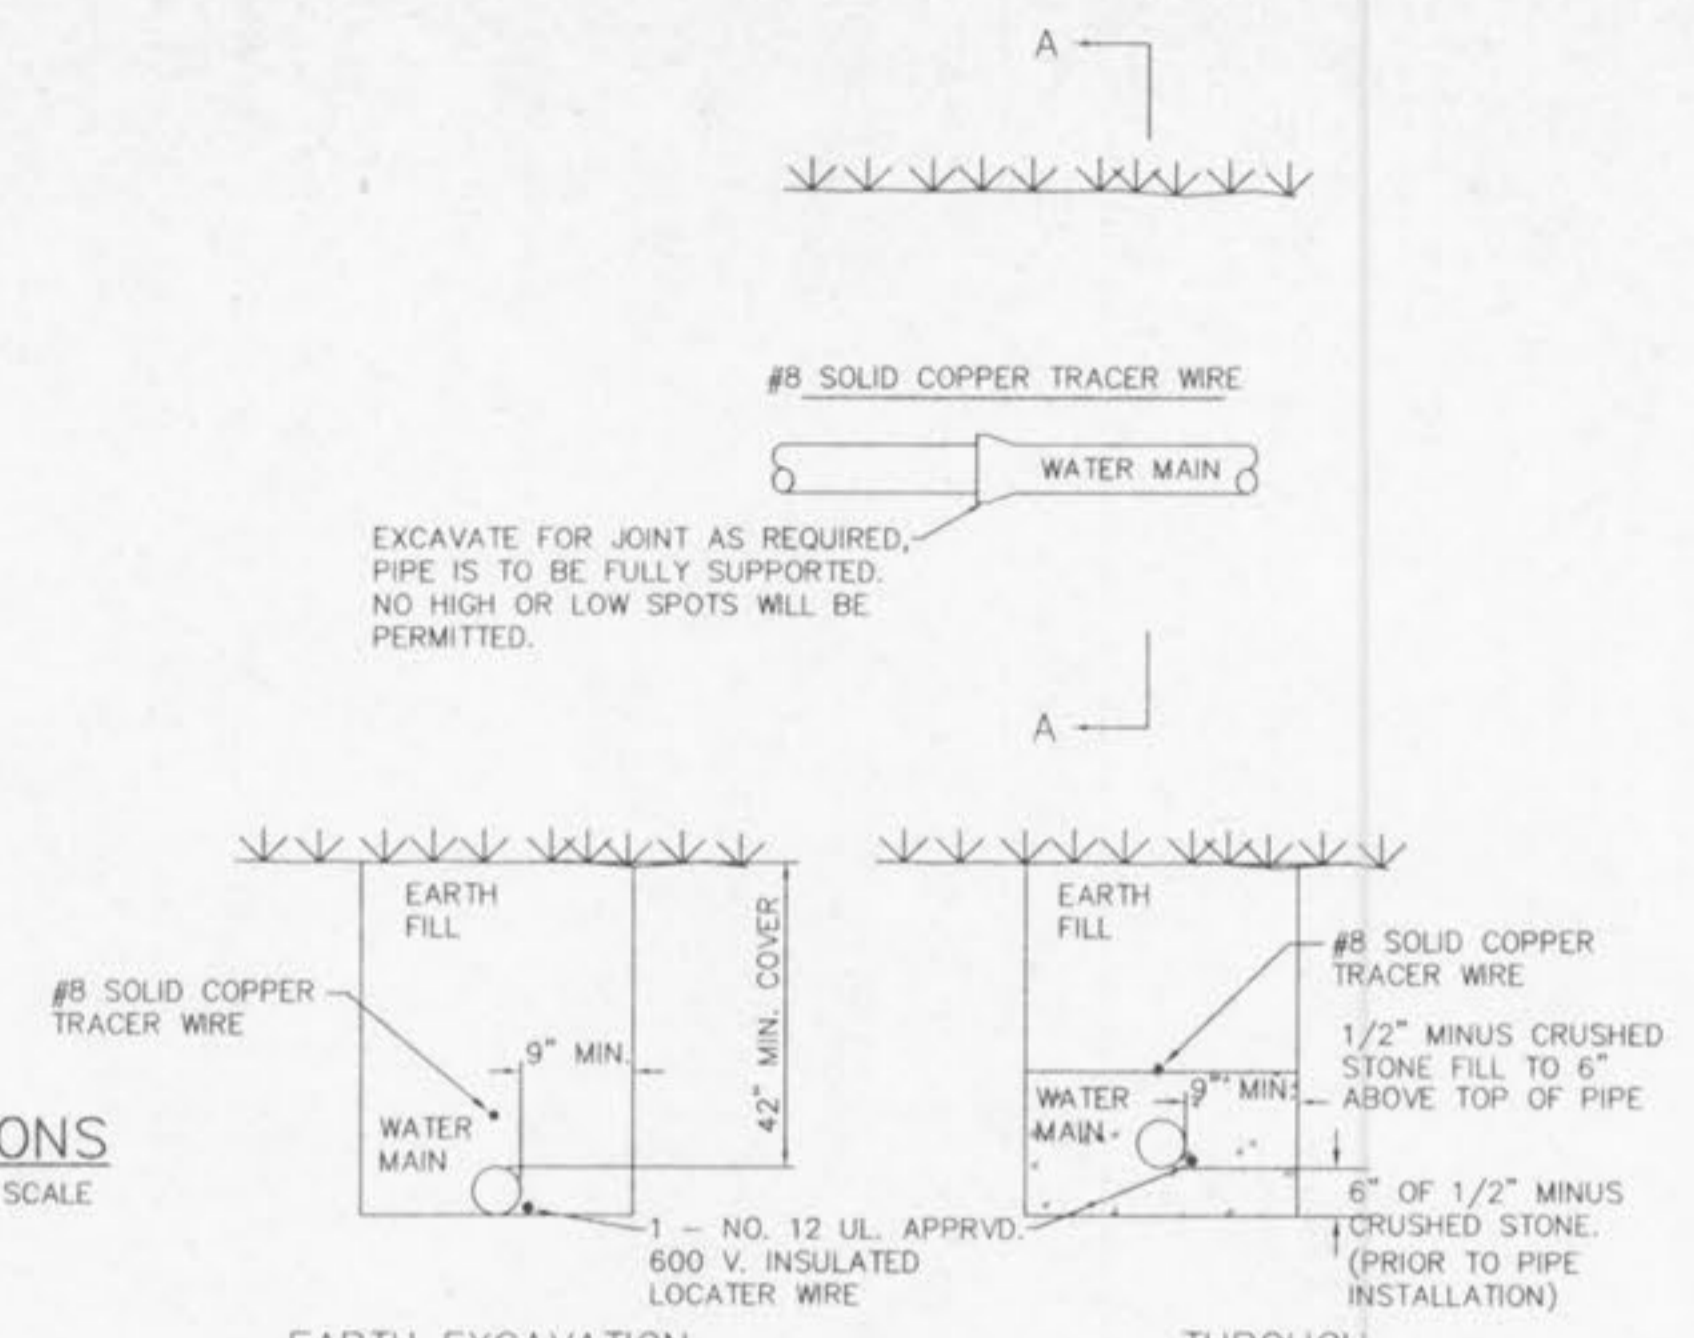


TYPICAL WATER MAIN INSTALLATION DETAILS
 NOT TO SCALE

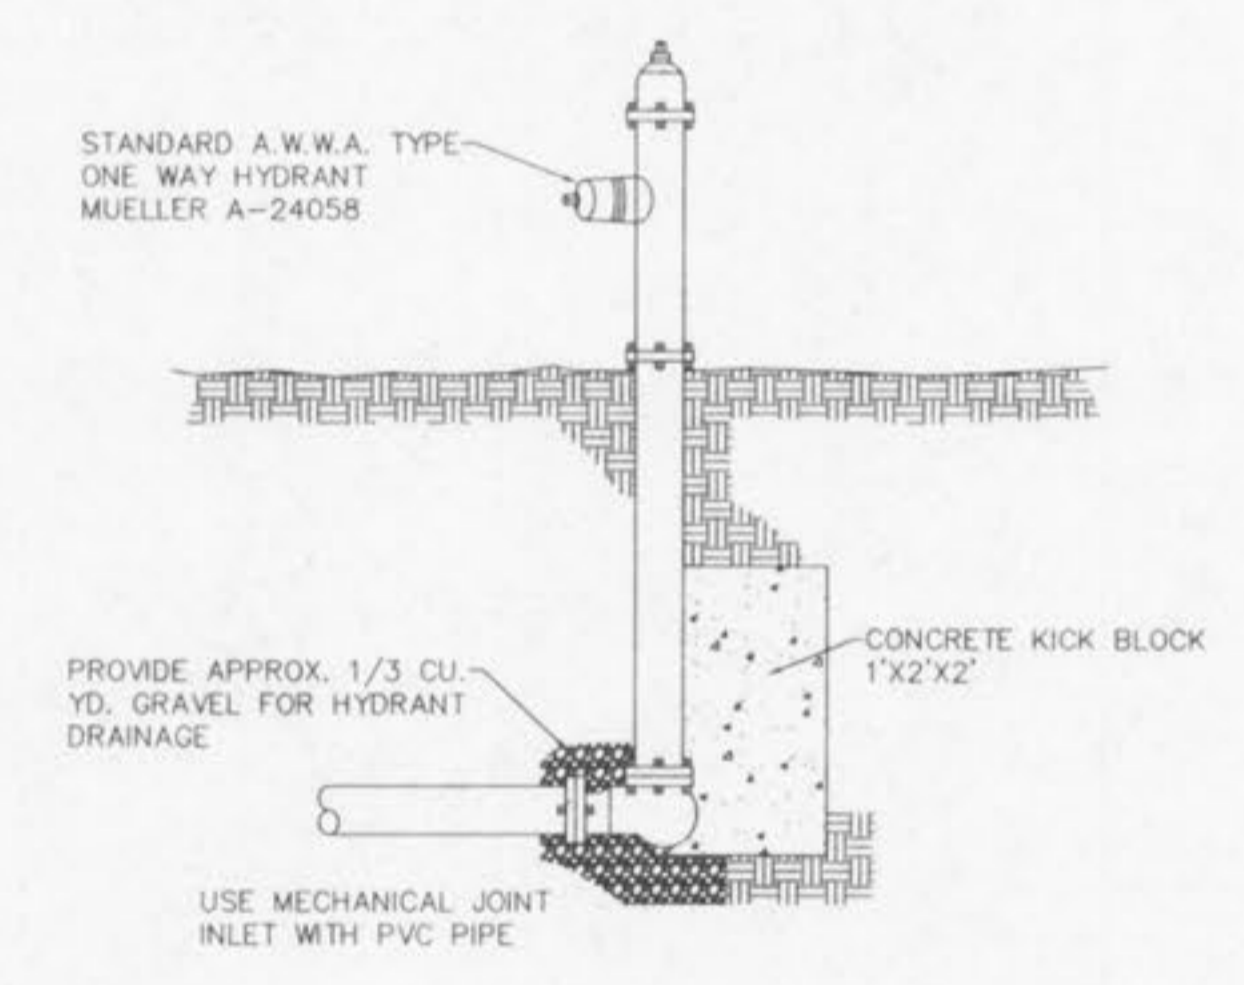


FLUSHING HYDRANT
 NOT TO SCALE

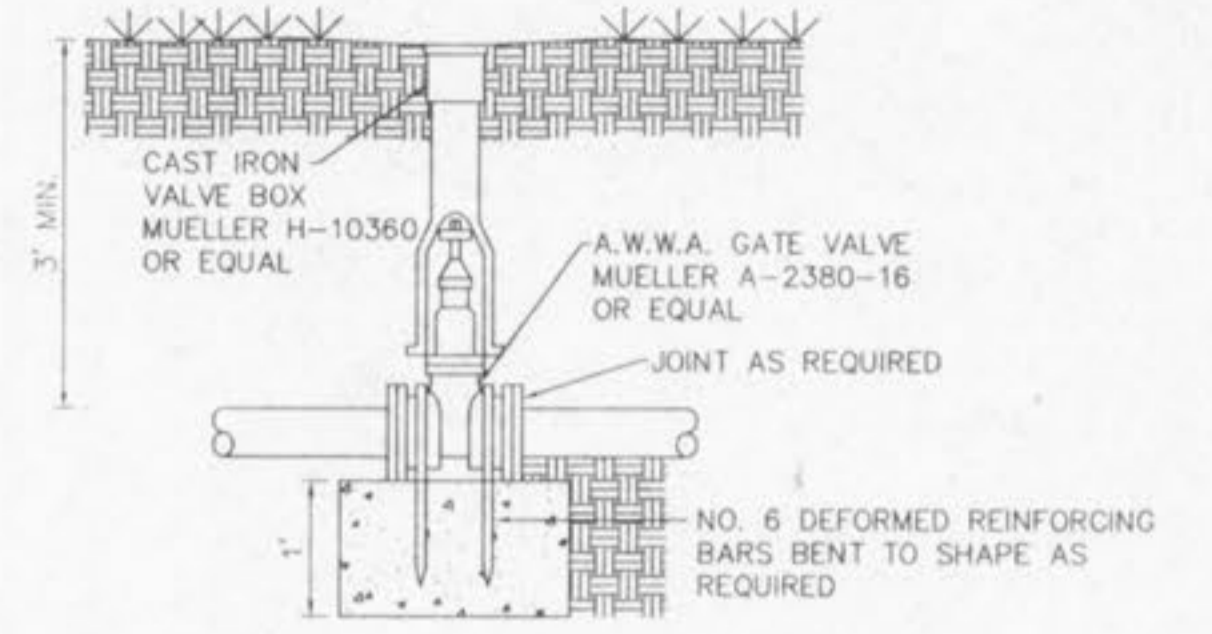

GATE VALVE W/THRUST BLOCK
 NOT TO SCALE

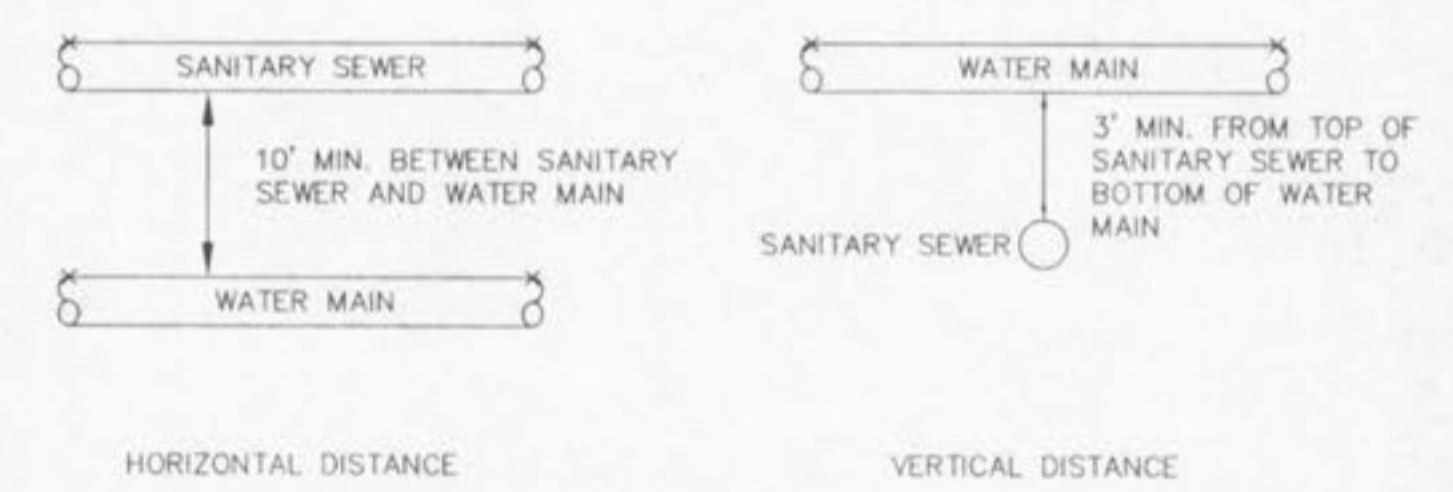

TYPICAL WATER AND SEWER SEPARATION
 NOT TO SCALE

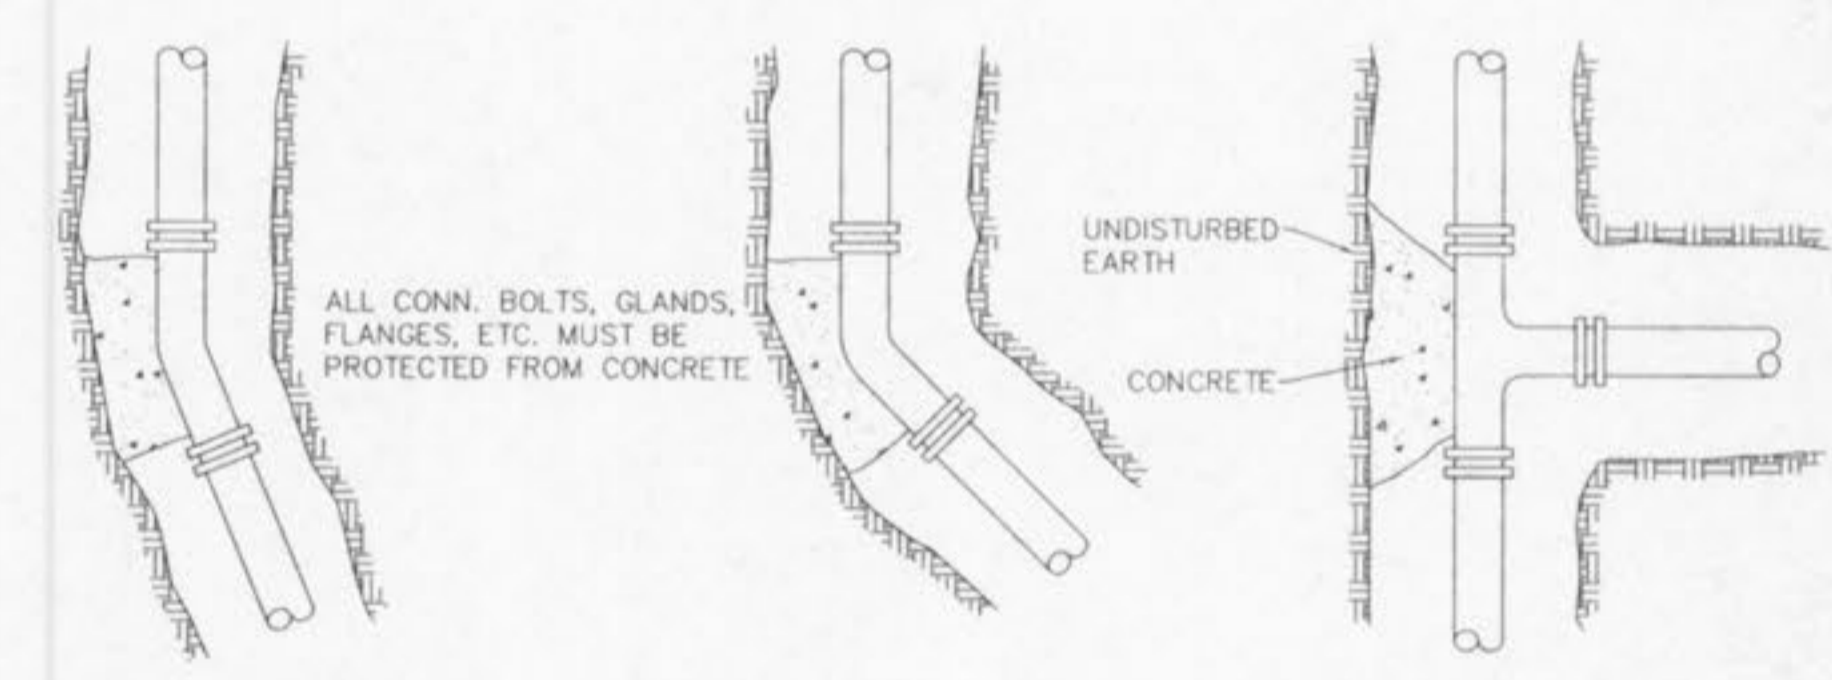

TYPICAL THRUST BLOCK DETAILS
 NOT TO SCALE

MAIN SIZE (I.D.)	MIN. THRUST BLOCK BEARING DIMENSIONS TO BEAR AGAINST UNDISTURBED EARTH				
	45° BEND	22 1/2° BEND	TEE	VALVE	CROSS
2"	.5' X 1'	.5' X 1'	.5' X 1'	.5' X 1'	.5' X 1'
4"	1' X 1'	1' X 1'	2' X 1'	2' X 1'	1' X 1'
6"	1.5' X 1'	1' X 1'	2' X 1'	2' X 1'	1' X 1'
8"	2' X 1'	1' X 1'	2' X 2.5'	2' X 2'	1' X 1.5'
10"	2' X 2.5'	1.5' X 2'	2' X 3.5'	2' X 3'	2' X 2'
12"	2' X 3.5'	1.5' X 2.5'	3' X 3.5'	3' X 3'	2' X 3'
16"	3' X 4'	2' X 3'	4' X 4.5'	3' X 4.5'	3' X 3.5'

E:\map\1000000\10001\10001.dwg Fri May 05 16:27:46 2000 RJA