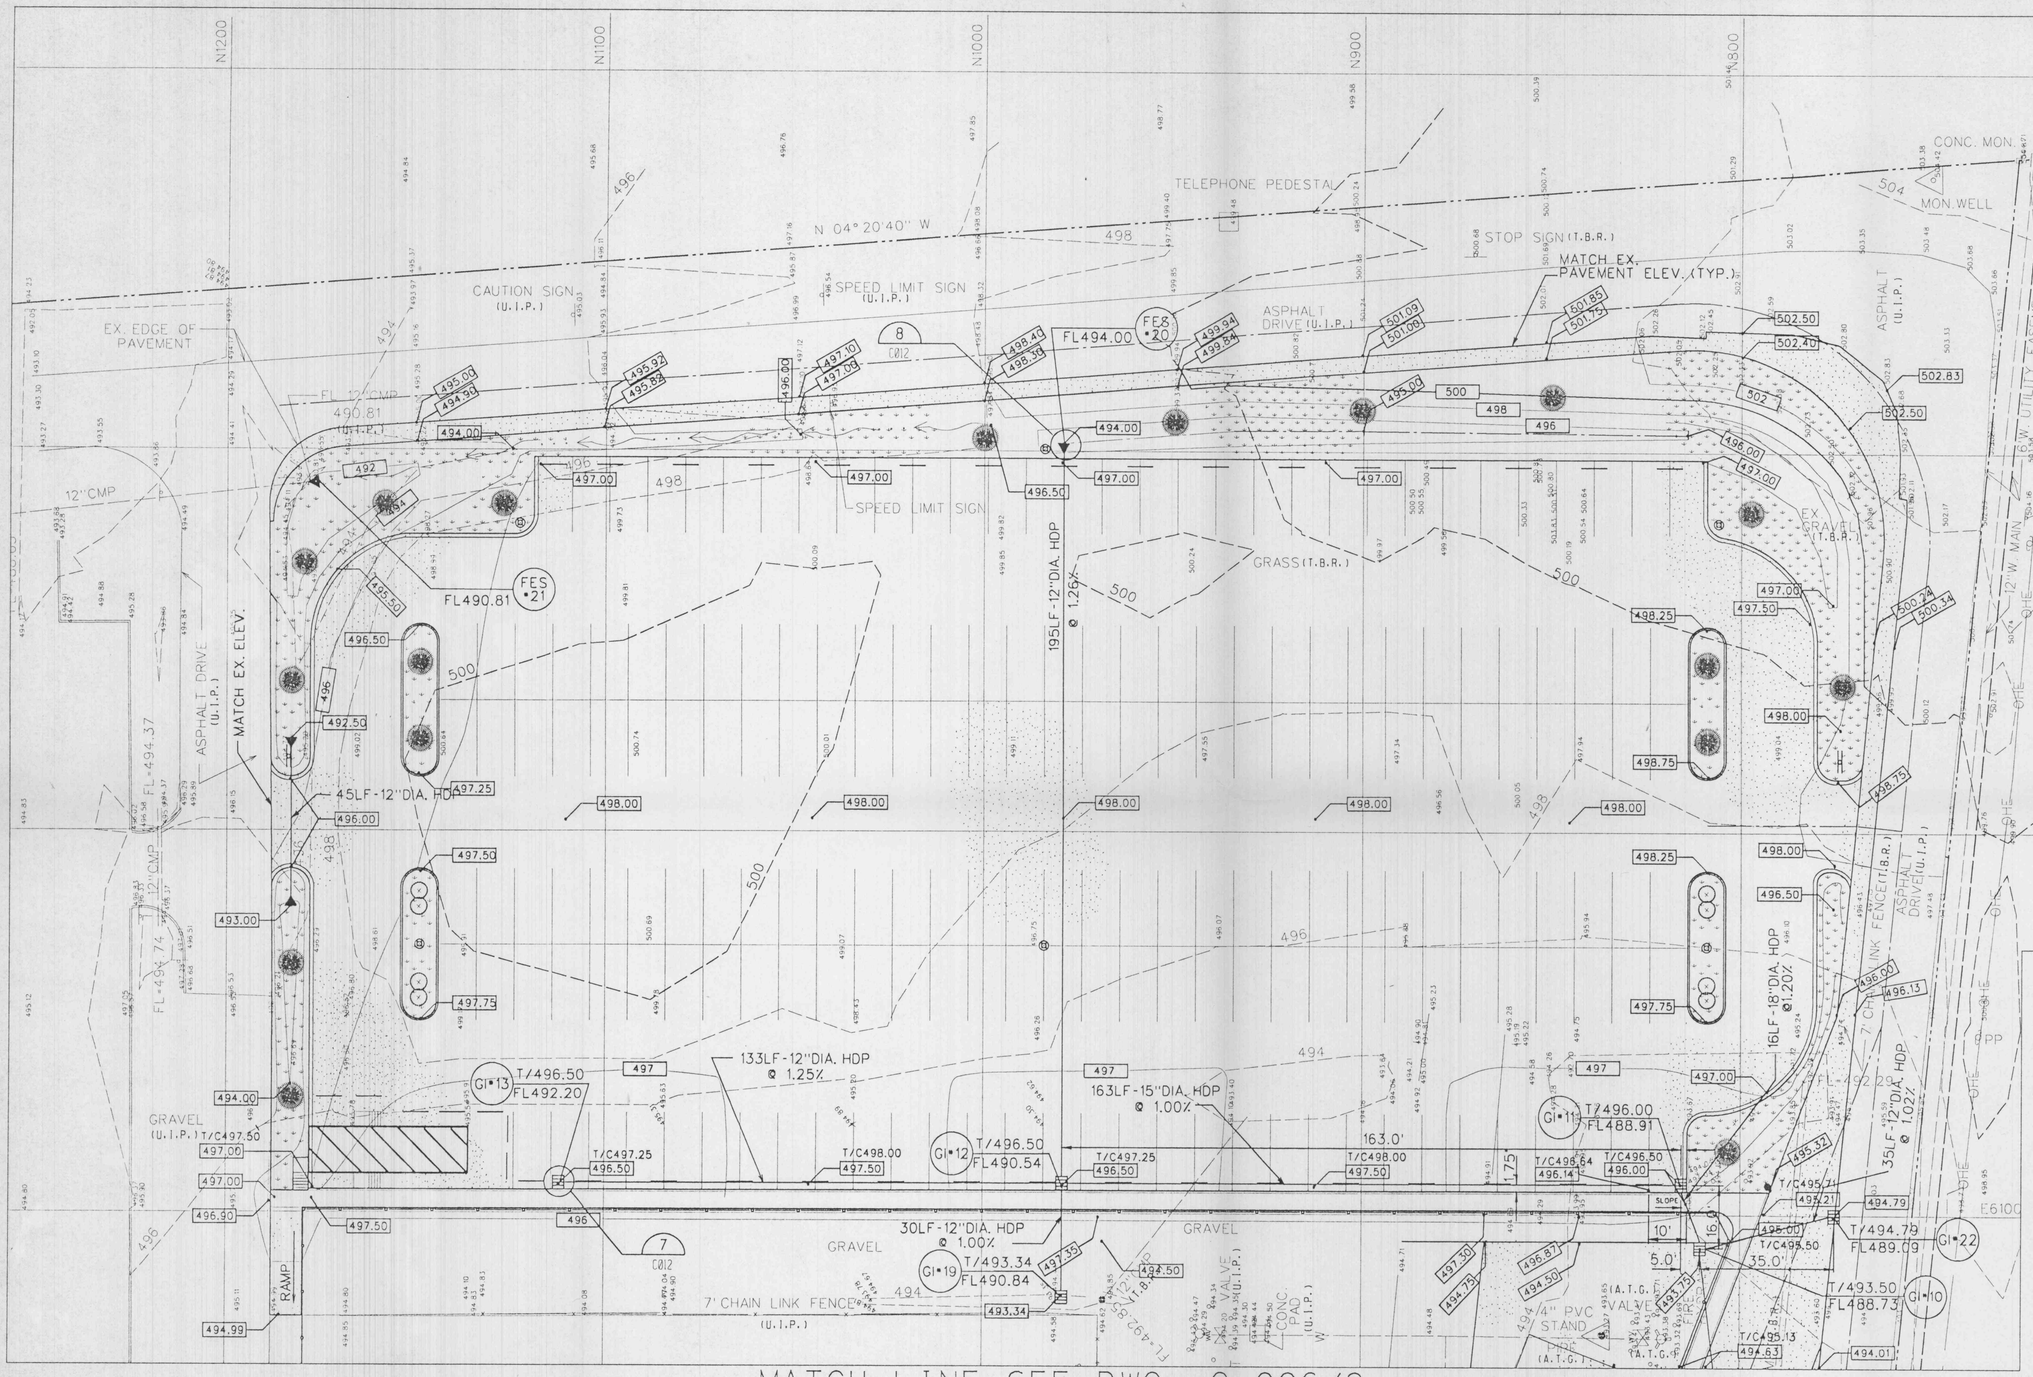

MATCH LINE-SEE DWG. C-006/9

GENERAL NOTES:

1.) CATHODIC PROTECTION-REQ.'D ON ALL U/G FIRE AND POTABLE WATER SYSTEMS AS FOLLOWS: BAG TYPE 32LBS MAGNESIUM ANODE AS MFG. BY HARCO CORPORATION, SCHAUMBURG, ILL. JUMPER ALL FLANGES. ANODE BAGS 20FT. ON CENTERS ON STRAIGHT RUNS AND FITTINGS. FLANGE ISOLATION KITS SHALL BE USED WHERE PIPE ENTERS BUILDING OR COMES OUT OF GROUND. ASPHALTIC COAT AFTER ASSEMBLY.

CADWELD CHARGE # CA15 20PER BOX
CADWELD TOOLKIT #CAT 343
CADWELD MOLD CAA

CATHODIC PROTECTION SINGLE TEST STATION REQ'D. (LOCATE AS DIRECTED BY OWNER) AS MFG. BY: COTT MFG. CO. LOS ANGELES CA. (213) 822-1000. COLOR:ORANGE-NO ALTERNATIVE VENDOR

2.) ALL UNDERGROUND STORM PIPE TO-BE-REMOVED AS REQUIRED FOR NEW SEWERS EXIST. PIPE ABANDONED IN PLACE SHALL HAVE THE ENDS CAPPED.

3.) CAP OFF FIRE AND DOMESTIC WATERLINE AT MAIN-LINE FITTING & COORDINATE PRODUCTION CHEM. ROOM CONNECTIONS W/BLDG. CONTRACTOR

4.)CONTRACTOR SHALL CLOSELY FOLLOW THE RECOMENDATIONS OF THE SUPPLIER FOR THE TRANSPORTATION, SOIL PREPARATION, PLANTING SCHEDULE, INSTALLATION AND PROTECTION OF TREES, SHRUBS AND SODDING COORDINATE BLDG. CONNECTIONS W/BLDG. CONTRACTOR

5.)SUBMIT TO OWNER TYPEWRITTEN MAINTENANCE INSTRUCTIONS FOR ALL PLANTINGS TO COVER ONE FULL GROWING SEASON

6.)CONTRACTOR SHALL WARRANTY FOR A PERIOD OF ONE FULL YEAR AFTER INSTALLATION, AGAINST DEFECTS INCLUDING DEATH AND UNSATISFACTORY GROWTH EXCEPT FOR DEFECTS RESULTING FROM NEGLECT OR ABUSE BY OWNER REMOVE AND REPLACE TREES OR SHRUBS FOUND TO BE DEAD OR IN AN UNHEALTHY CONDITION DURING OR AT THE END OF THE WARRANTY PERIOD

NOTE:
UNDERGROUND FACILITIES, STRUCTURES AND UTILITIES HAVE BEEN PLOTTED FROM AVAILABLE SURVEYS AND RECORDS, AND THEREFORE THERE LOCATIONS MUST BE CONSIDERED APPROXIMATE ONLY. THERE MAY BE OTHERS. THE EXISTENCE OF WHICH IS PRESENTLY NOT KNOWN

NOTE: "THIS SEAL APPLIES ONLY TO THIS DOCUMENT. I DISCLAIM ANY RESPONSIBILITY FOR ALL OTHER DOCUMENTS OR INSTRUMENTS RELATING TO OR INTENDED TO BE USED FOR ANY PART OR PARTS OF THIS PROJECT OR ANY OTHER PROJECT."

STATE OF MISSOURI
RAY WILLIAM WOLFF
NUMBER E-16193
REGISTERED PROFESSIONAL ENGINEER
Oct. 9/91

FRU-CON
ST. LOUIS COUNTY, BALLWIN, MISSOURI
FRU-CON ENGINEERING, INC

DESIGNER	D.E.PLUTH
DRAFTER	D. FISHER
CHECKER	D.P./D.F.
PROJECT NO.	201012-01

REV.	BY	DESCRIPTION	DATE
2	D. PLUTH	ADDED LANDSCAPING NOTES/GENERL REV.	10/7/91
1	D. PLUTH	ISSUED FOR APPROVAL 90%	9/20/91
0	D. PLUTH	ISSUED FOR CONSTRUCTION	8/12/91
C	D. PLUTH	ISSUED FOR APPROVAL 90%	8/2/91
B	D. PLUTH	ISSUED FOR APPROVAL 90%	6/25/91
A	D. PLUTH	ISSUED FOR REVIEW	6/4/91

MEMC ELECTRONIC MATERIALS, INC.
ST. PETERS, MISSOURI 63376

MEMC ELECTRONIC MATERIALS, INC. CONFIDENTIAL

- THIS DRAWING IS THE CONFIDENTIAL PROPERTY OF MEMC ELECTRONIC MATERIALS, INC. ("MEMC") AND IS TO BE USED ONLY BY AUTHORIZED PERSONNEL. AND IN THE INTEREST OF MEMC IT MUST BE ACCOUNTED FOR. IT SHALL NOT BE REPRODUCED IN WHOLE OR IN PART WITHOUT PRIOR WRITTEN PERMISSION FROM MEMC. IT MUST BE RETURNED TO MEMC AT ANY TIME UPON REQUEST BUT IN ANY EVENT AT COMPLETION OF THE WORK OR JOB. THE RECIPIENT AGREES TO KEEP CONFIDENTIAL AND TO REQUIRE HIS (ITS)EMPLOYEES TO KEEP CONFIDENTIAL THE INFORMATION CONTAINED HEREON. DISCLOSURE OF THE INFORMATION HEREON SHALL BE MADE ONLY TO THOSE PERSONS WHO REQUIRE SUCH INFORMATION FOR THEIR WORK ON MEMC'S PROJECTS.

PARKING LOT GRADING/UNDERGROUND UTILITIES BLDG. 65 EXPANSION

DRAWN BY		DATE	SCALE	DATE
CHECKED BY		DATE	1"=20.0'	

PROJECT NO.	PLANT	SIZE	ZONE	TYPE	NUMBER	REV.
9123	16	D	65.015	C	002	2