
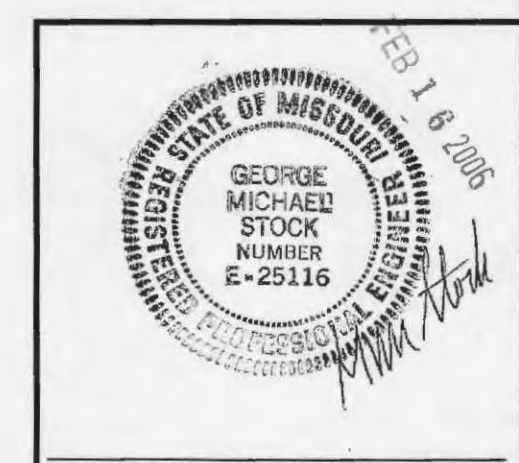


- TYPICAL MANHOLE STEPS**  
SCALE: N.T.S.
- CORRUGATED METAL PIPE SHALL BE INSTALLED ON A 6" LOOSE GRANULAR BEDDING LAYER WITH GRANULAR FILL MATERIAL (1" CLEAN) PLACED ALTERNATELY IN LAYERS WITH A MAXIMUM THICKNESS OF 8" ON BOTH SIDES OF THE PIPES AND COMPACTED TO 95% OF "AASHTO T-99" DENSITY. PARTICULAR CARE SHALL BE GIVEN TO PLACE BACKFILL MATERIAL AROUND THE PIPE HAUNCHES AND COMPACT THE BACKFILL MATERIAL BY HAND TAMPING. BACKFILL MATERIAL SHALL NOT BE DUMPED INTO PILES AND COMPACTION ATTEMPTED WITHOUT SPREADING.
  - PIPE CONNECTORS TO BE CORRUGATED TYPE WITH SLEEVE TYPE GASKET.
  - MAINTAIN 0.10% SLOPE IN ALL 72" C.M. STORAGE PIPES.

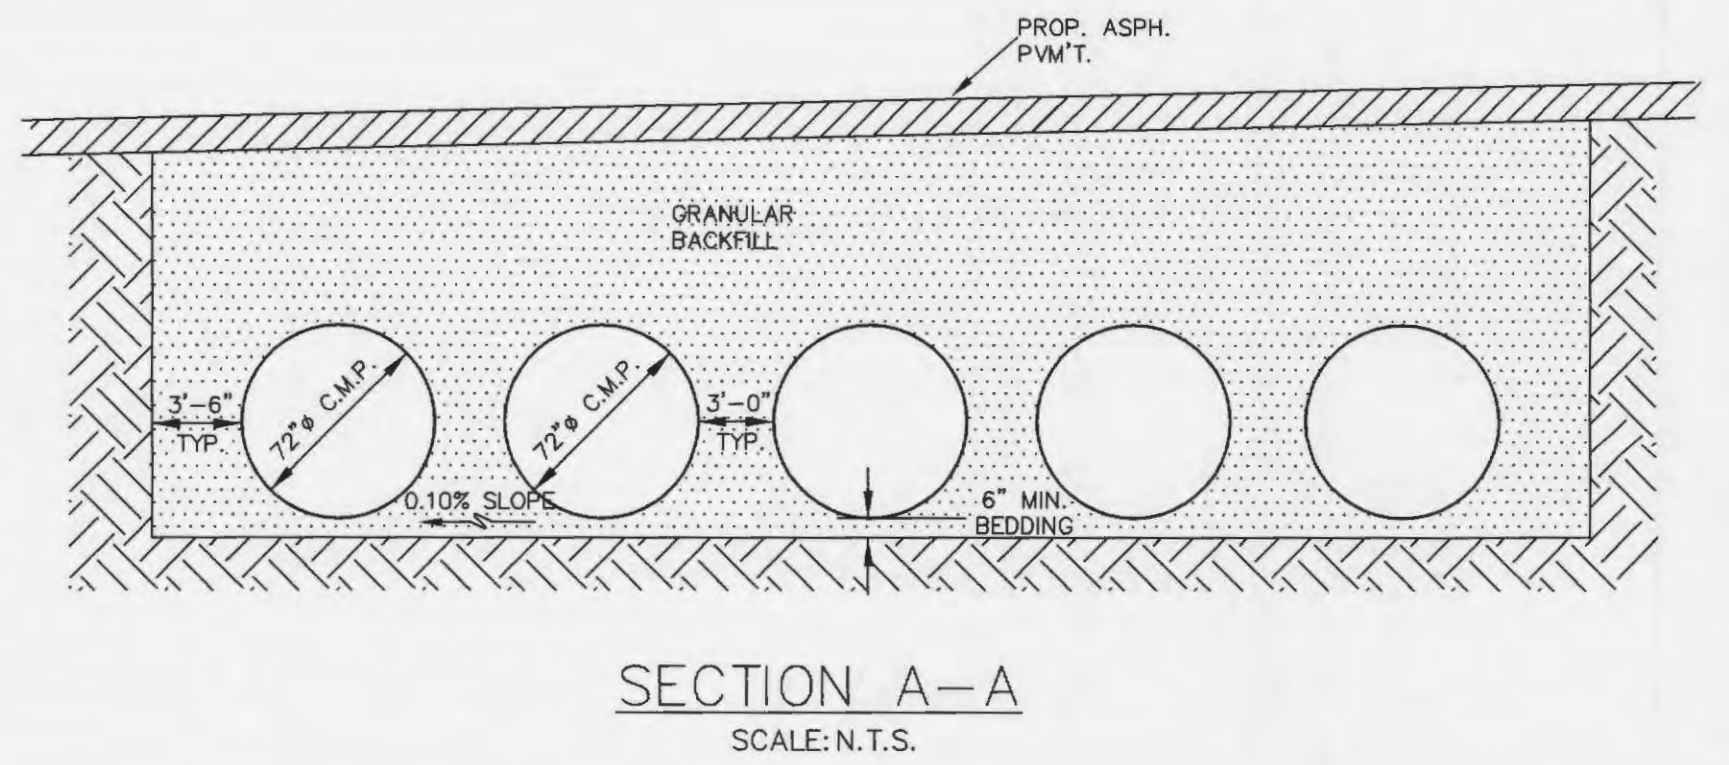

REVISED PER PUBLIC WATER SUPPLY DISTRICT #2 COMMENTS 02/16/06

**MEDICAL OFFICE BUILDINGS**  
**DETENTION DETAILS**

**Stock & Associates**  
Consulting Engineers, Inc.

257 Chesterfield Business Parkway  
St. Louis, MO 63005  
PH. (636) 530-9100  
FAX (636) 530-9130  
e-mail: general@stockassoc.com  
Web: www.stockassoc.com

DRAWN BY: R.E.S. DATE: 11/10/05 CHECKED BY: G.M.S. DATE: 11/10/05 JOB NUMBER: 204-3380.4 SHEET: C8 of 13