

GENERAL NOTES

- GN # 1 Driveway locations shall not interfere with the sidewalk handicap ramps, or curb inlet ramps
GN # 2 Sidewalks, curb ramps, ramps and accessible parking spaces shall be constructed in accordance with the current approved "American with Disabilities Act Accessibility Guidelines" (ADAAG) along with the required grades, construction materials, specifications and signage.
GN # 3 Truncated domes for curb ramps located in public right of way shall meet ADA requirements and shall be constructed using red pre cast truncated domes per pavement details.
GN # 4 Any proposed pavilions or playground areas will need a separate permit from the Building Division.
GN # 5 The Contractor is responsible to call Missouri One Call and The City of O'Fallon for the location of utilities.
GN # 6 All proposed utilities and/or utility relocations shall be located underground.
GN # 7 All proposed fencing requires a separate permit through the Building Safety Division.
GN # 8 All construction operations and work zone traffic control within the right of way will follow MoDOT or M.U.T.C.D. standards whichever is more stringent.
GN # 9 All free standing signs shall be located a minimum of ten (10) feet away from any right of way line and/or property line and a minimum of three (3) feet from the back of curbing or sidewalk.
GN # 10 All subdivision identification or directional sign(s) must have the locations and sizes approved and permitted separately through the Planning and Development Division.
GN # 11 Materials such as trees, organic debris, rubble, foundations, and other deleterious material shall be removed from the site and disposed of in compliance with all applicable laws and regulations.
GN # 12 Twenty-four (24) hours prior to starting any of the work covered by the above plans and after approval thereof, the developer shall make arrangements with the Construction Inspection Office to provide for inspection of the work, sufficient in the opinion of the City Engineer, to assure compliance with the plans and specifications as approved.
GN # 13 The City Engineer or their duly authorized representative shall make all necessary inspections of City infrastructure, escrow items or infrastructure located on the approved plans.
GN # 14 All installations and construction shall conform to the approved engineering drawings.
GN # 15 City approval of the construction site plans does not mean that any building can be constructed on the lots without meeting the building setbacks as required by the zoning code.

Erosion Control Notes

- EN # 1 The Permittee shall assume complete responsibility for controlling all siltation and erosion of the project area.
EN # 2 All erosion control systems are to be inspected and corrected weekly, especially within 48 hours of any rain storm resulting in one-quarter inch of rain or more.
EN # 3 Erosion control devices (silt fence, sediment basin, etc.) shall be in accordance with St. Charles County Soil and Water Conservation District Erosion and Sediment Control guidelines.
EN # 4 This development is required to provide long term post construction BMP's such as; low impact design, source control and treatment controls that protects water quality and controls run off to maximum extent practical in compliance with Phase II Illicit Storm Water Discharge Guidelines.
EN # 5 Graded areas shall be seeded and mulched (strawed) within 14 days of stopping land disturbance activities.

Grading Notes

- GRN #1 Developer must supply City Construction Inspectors with an Engineer's soil reports prior to and during site grading.
GRN #2 All fill placed in areas other than proposed storm sewers, sanitary sewers, proposed roads, and paved areas shall be compacted from the bottom of the fill up in 8" lifts and compacted to 90% maximum density as determined by Modified AASHTO T-180 compaction test.
GRN #3 The surface of the fill shall be finished so it will not impound water.
GRN #4 All sediment and detention basins are to be constructed during the initial phase of the grading operation or in accordance with the approved SWPPP.
GRN #5 When grading operations are complete or suspended for more than 14 days, permanent grass must be established at sufficient density to provide erosion control on site.
GRN #6 No slopes shall exceed 3 (horizontal) to 1 (vertical) unless otherwise approved by the soils report and specifically located on the plans and approved by the City Engineer.
GRN #7 All low places whether on site or off shall be graded to provide drainage with temporary ditches.
GRN #8 Any existing wells and/or springs which may exist on the property must be sealed in a manner acceptable to the City of O'Fallon Construction Inspection Department and following Missouri Department of Natural Resources standards and specifications.
GRN #9 (intentionally left blank)
GRN #10 All trench back fills under paved areas shall be granular back fill, and compacted mechanically.
GRN #11 Site grading.
GRN #12 Access to the site from any other location other than the proposed construction entrance is strictly prohibited!
GRN #13 All fill placed under proposed storm and sanitary sewers, proposed roads and/or paved areas shall be compacted to 90% of maximum density as determined by the Modified AASHTO T-180 Compaction Test or 95% of maximum density as determined by the Standard Proctor Test AASHTO T-99.

Storm Sewer Notes

- STM # 1 All Storm Sewer installation is to be in accordance with M.S.D. current standards and specifications except as modified by the City of O'Fallon ordinances.
STM # 2 Brick shall not be used in the construction of storm sewer structures.
STM # 3 A 5/8" trash bar shall be installed horizontally in the center of the opening(s) in all curb inlets and area inlets.
STM # 4 HDPE pipe is to be N-12WT or equal and to meet ASTM F1417 water tight field test.
STM # 5 Encase with concrete both sanitary and storm sewer at crossing when storm sewer is within 18 inches above sanitary sewer.
STM # 6 The storm sewers should run diagonally through the side yards to minimize any additional utility easements required.
STM # 7 All concrete pipes will be installed with O-ring rubber type gaskets.
STM # 8 Connections at all storm structures are to be made with A-lock joint or equal.
STM # 9 Pre cast concrete inlet covers are not to be used.
STM # 10 The swale in the detention basins shall have a minimum 1% longitudinal slope and be lined with a permanent erosion control blanket that will allow infiltration of storm water.
STM # 11 All storm sewer shall be reinforced concrete pipe or H.D.P.E. pipe.
STM # 12 The discharge point of all flared end sections shall be protected by rip rap or other approved means.
STM # 13 Rip rap shown at flared end sections will be evaluated in the field by the Engineer, Contractor, and City Inspectors after installation for effectiveness and field modified, if necessary, to reduce erosion on and off site.
STM # 14 Add 1" minus rock back fill to all storm sewer that lie within the 1:1 shear plane of the road.
STM # 15 The City will allow the following markers and adhesive procedures only as shown in the table below or an approved equal.

Table with 6 columns: Manufacturer, Size, Adhesive, Style, Message (Part #), Website. Rows include ACP International and DAS Manufacturing, Inc.

Roadway Notes

- RN # 1 All paving (public and private) to be in accordance with St. Louis County Transportation Standard Specifications for Road and Bridge Construction, Dated October 1, 2015.
RN # 2 If the intersecting road does not have a curb, then the curb on the new entrance shall begin 10' from the edge of the existing road.
RN # 3 Provide 6" of concrete over 4" of MoDot type 1 or type 5 aggregate rock or asphalt equivalent for minor residential streets per City Code 405.370.
RN # 4 Multi-use trail (when required) Shall have a minimum of 3" Type "C" Asphalt over 4" aggregate base per City requirements.
RN # 5 Type C (BP-1) Compaction requirements shall be 98% minimum density according to St. Charles Co. Standard Specifications.
RN # 6 Provide pavement striping at any point where the multi-use trail crosses existing or proposed pavement.
RN # 7 All street stub-outs over 250' in length will require a temporary turnaround.
RN # 8 All sub grade in cut or fill will need to conform to the City of O'Fallon Compaction requirements
RN # 9 Material Testing And Frequency. Materials for construction shall be tested and inspected per the appropriate ASTM code or at the City Engineer's discretion.
RN # 10 Approval Of Sub grade And Base (Sub base) The City Engineer or representative shall approve the sub grade before any base is placed thereon and shall approve the base before concrete or surface course is placed.
RN # 11 In all fill areas in the roadways, soil tests shall be submitted and approved by the City Engineer for each foot of fill and at least one (1) test and an average of one (1) test within every two hundred fifty (250) feet.
RN # 12 No traffic will be allowed on new concrete pavement until it has cured for seven (7) days and it reaches three thousand five hundred (3,500) psi within 28 days.
RN # 13 Prior to placement of aggregate base material on sub grade and prior to placement of pavement on base material, the sub grade and base must be proof-rolled with a fully loaded (ten (10) ton load) tandem truck or equivalent tire vehicle with one (1) pass down each driving lane no faster than three (3) miles per hour.
RN # 14 Sub grade and base beneath pavements shall be compacted to St. Charles County Highway Department specifications.
RN # 15 The entire width and length will conform to line, grade and cross section shown on the plans or as established by the engineer.
RN # 16 Utility Work Prior To Base Construction. No base course work may proceed on any street until all utility excavations (storm and sanitary sewers, water, gas, electric, etc.) have been properly back filled with granular material, crushed stone or gravel mechanically tamped in ten (10) inch lifts.
RN # 17 Equipment calibration. The developer's contractors and subcontractors must have their equipment calibrated by the following minimum standards.
RN # 18 All permanent traffic control will be per M.U.T.E.D. or MoDot standards.
RN # 19 All traffic signs, street signs, sign post, backs and bracket arms shall be painted black using Carboline Rust Bond Penetrating Sealer SG and Carboline 133 HB paint (or equivalent as approved by City of O'Fallon and MoDOT).

Flood plain Information

FP #1 A flood plan development application from the City is required for any work within the flood plain limits.

By graphic plotting only, this property does not lie within any special flood zone areas according to the flood insurance rate map panel number 29183C0430G which bears an effective date of January 20, 2016. The property lies within unshaded Zone X (areas determined to be outside the 0.2% annual chance floodplain).



800 South Vandeventer St. St. Louis, Missouri 63110
p: (314) 534-1030
f: (314) 534-1053


David Mason and Associates, Inc. Missouri Certificate of Authority Number: Engineer: 001103 Architect: 000620 Survey: 000336

Consultants: Consultants Title and Discipline Certificate of Authority ### Street Address: City, State, Zip Code P: (000) XXX-XXXX F: (000) XXX-XXXX

Consultants Title and Discipline Certificate of Authority ### Street Address: City, State, Zip Code P: (000) XXX-XXXX F: (000) XXX-XXXX

MASTERCARD PARKING LOT "E"
2200 MASTERCARD BOULEVARD
O'FALLON, MISSOURI 63368

Professional Seal

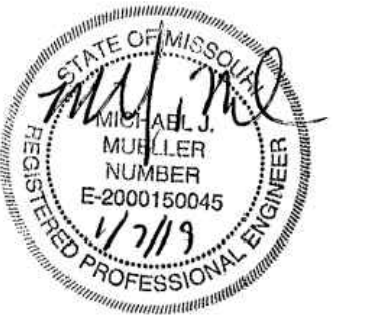

MICHAEL J. MUELLER, P.E. CIVIL ENGINEER E-2000150045

This document is only part of the total contract and/or construction document package. Other documents could contain information that may not be depicted here. The general contractor is responsible to provide all bidders with all information and documents pertaining to the complete scope of work.

The seals and signatures apply only to the document to which they are affixed, and expressly disclaim any responsibility for all other plans, specifications, estimates, reports or other documents or instruments relating to or parts of the Architectural or Engineering project.

Table with 3 columns: No., Description, Date. Rows include City Submittal, City Comments, City Comments.

Sheet Title: CIVIL GENERAL NOTES

Date: 10/01/2018
Project Number: 2018364-00
Designed By: MJM
Drawn By: TJR
Checked By: MJM

Sheet Number:

C1.0