

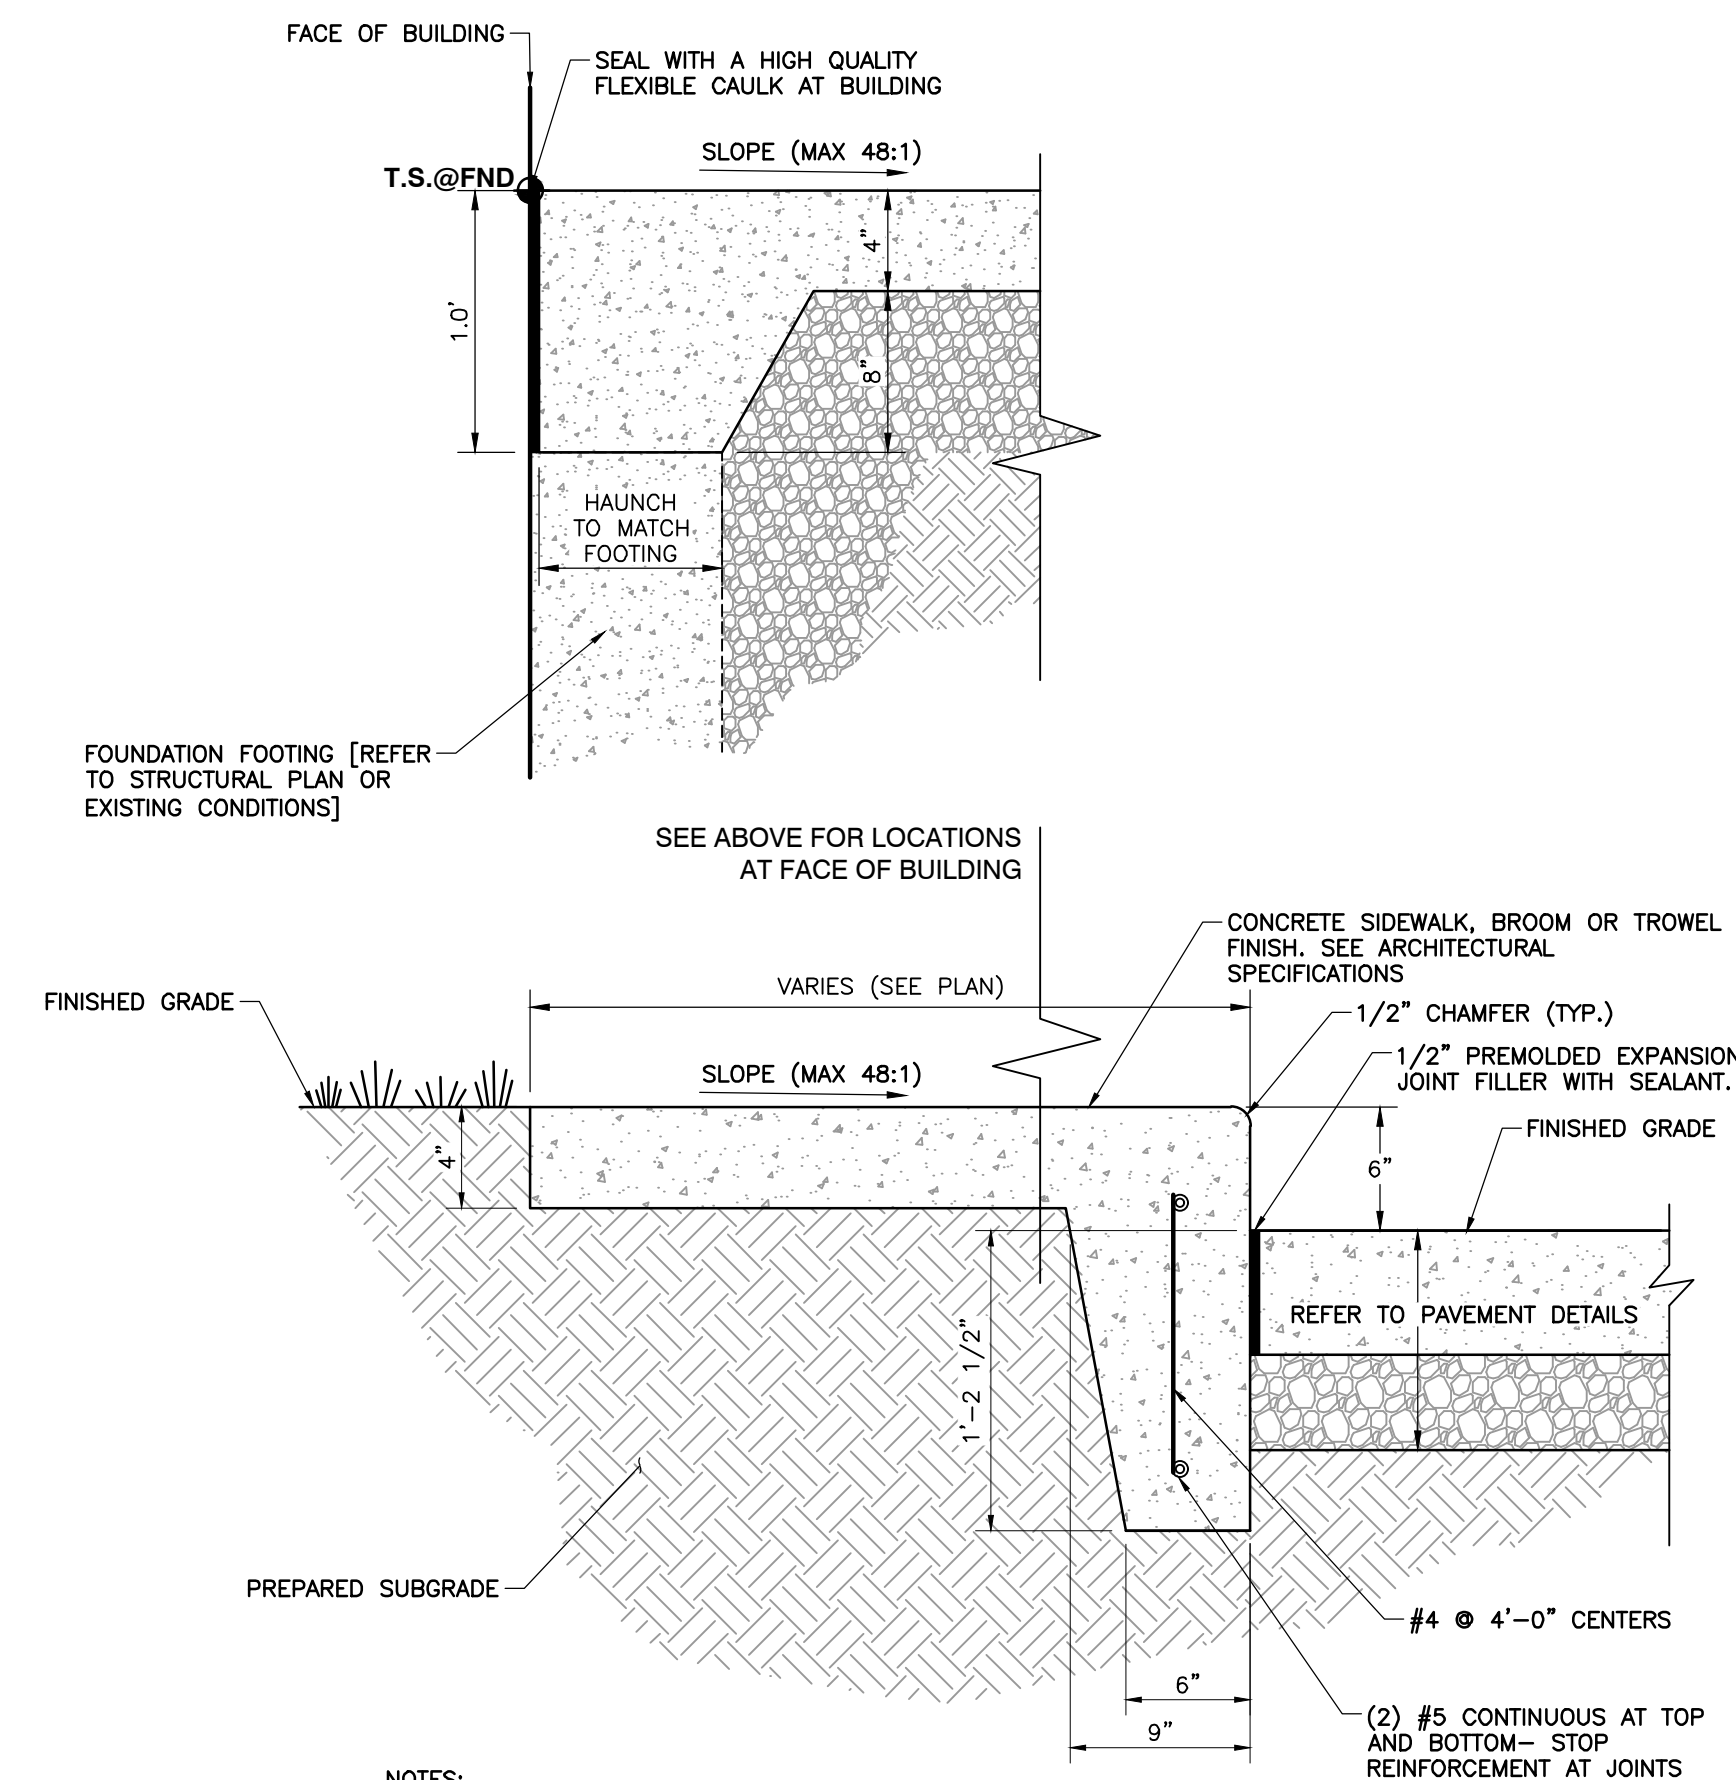


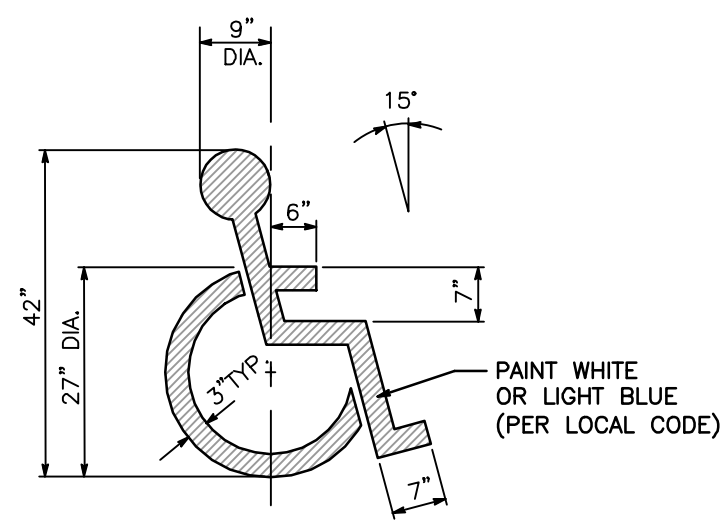


- NOTES:
1. PROVIDE 1/2" PREMOLDED EXPANSION JOINT @ 25' ON CENTER.
 2. PROVIDE TOOLED CONTRACTION JOINTS AT 5' ON CENTER.

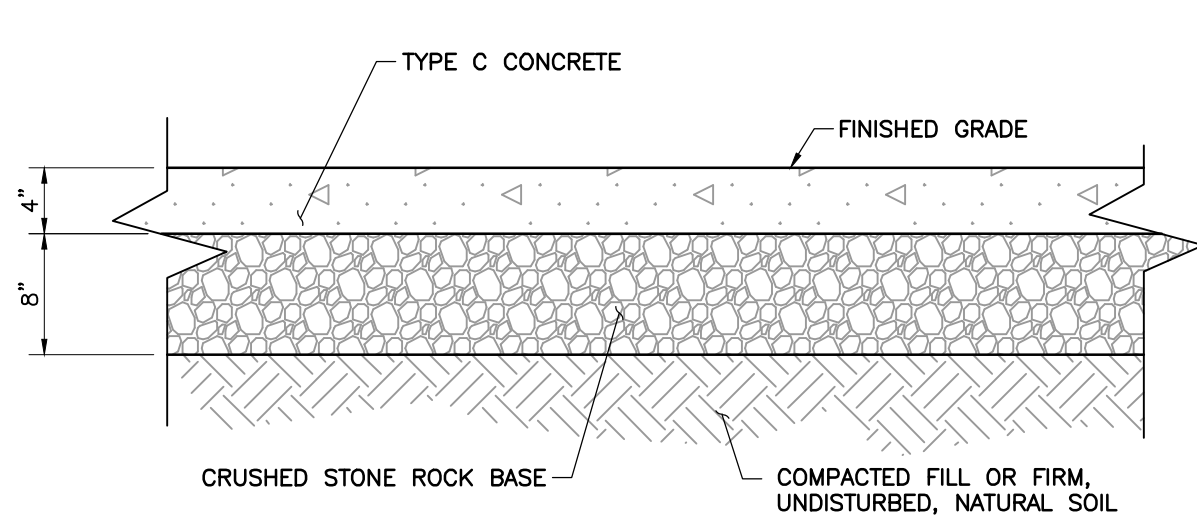



- NOTES:**
1. EXPANSION AND CONTROL JOINTS SHALL BE PER JOINT DETAILS
 2. CONCRETE SHALL BE TYPE C UNLESS OTHERWISE NOTED.
 2. REFER TO GEOTECHNICAL REPORT (IF AVAILABLE) FOR FURTHER SPECIFICATIONS AND/OR RECOMMENDATIONS.

DETAIL #02
CONCRETE PAVEMENT
N.T.S.



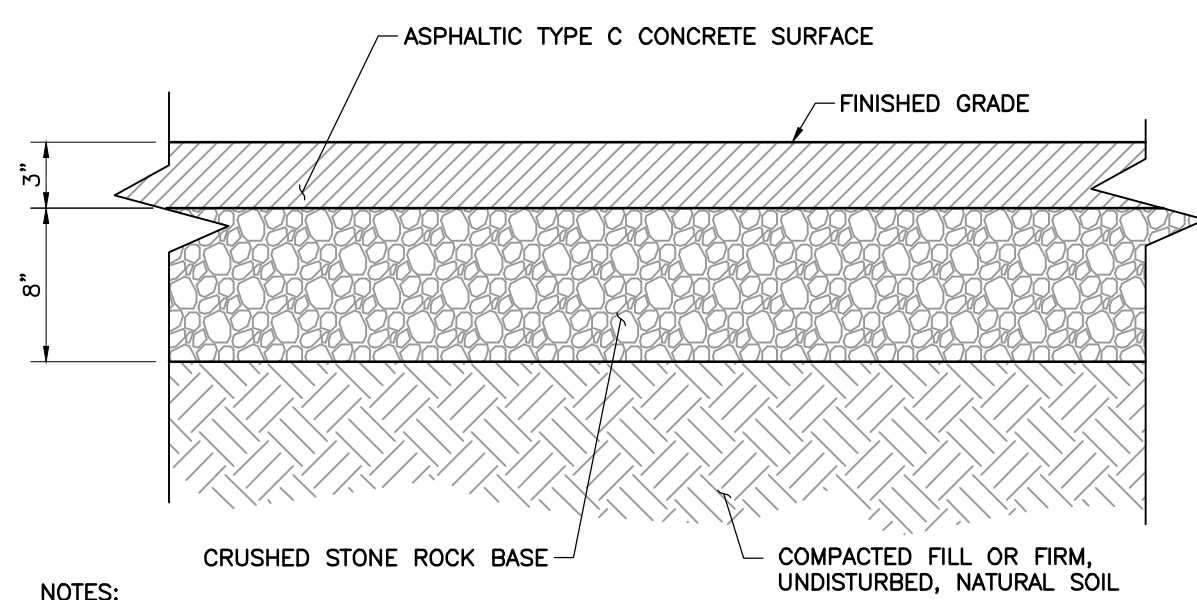


- NOTES:**
1. REFER TO GEOTECHNICAL REPORT (IF AVAILABLE) FOR FURTHER SPECIFICATIONS AND/OR RECOMMENDATIONS.


DETAIL #03
ASPHALTIC CONCRETE PAVEMENT
N.T.S.

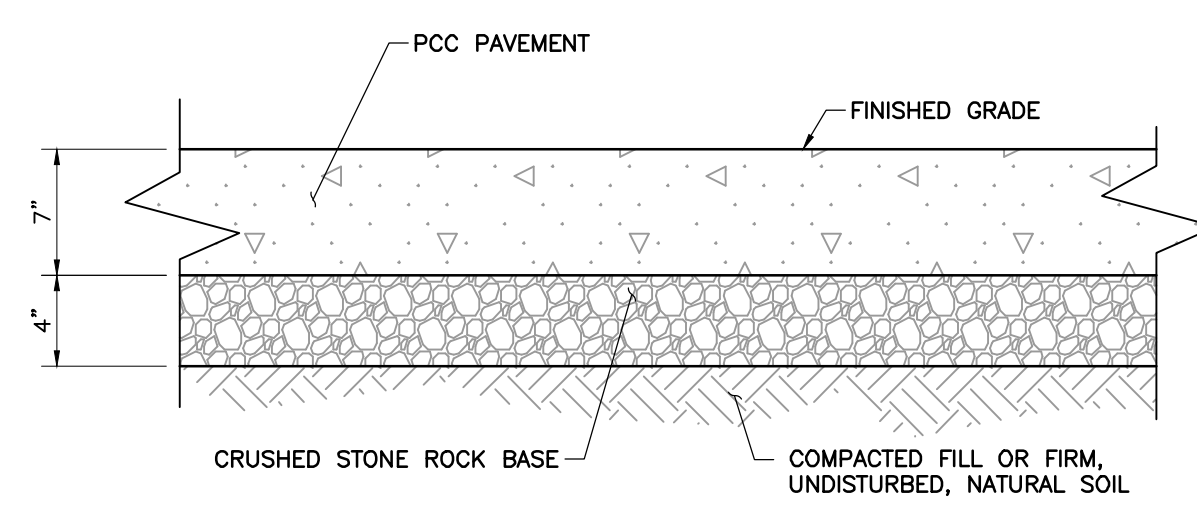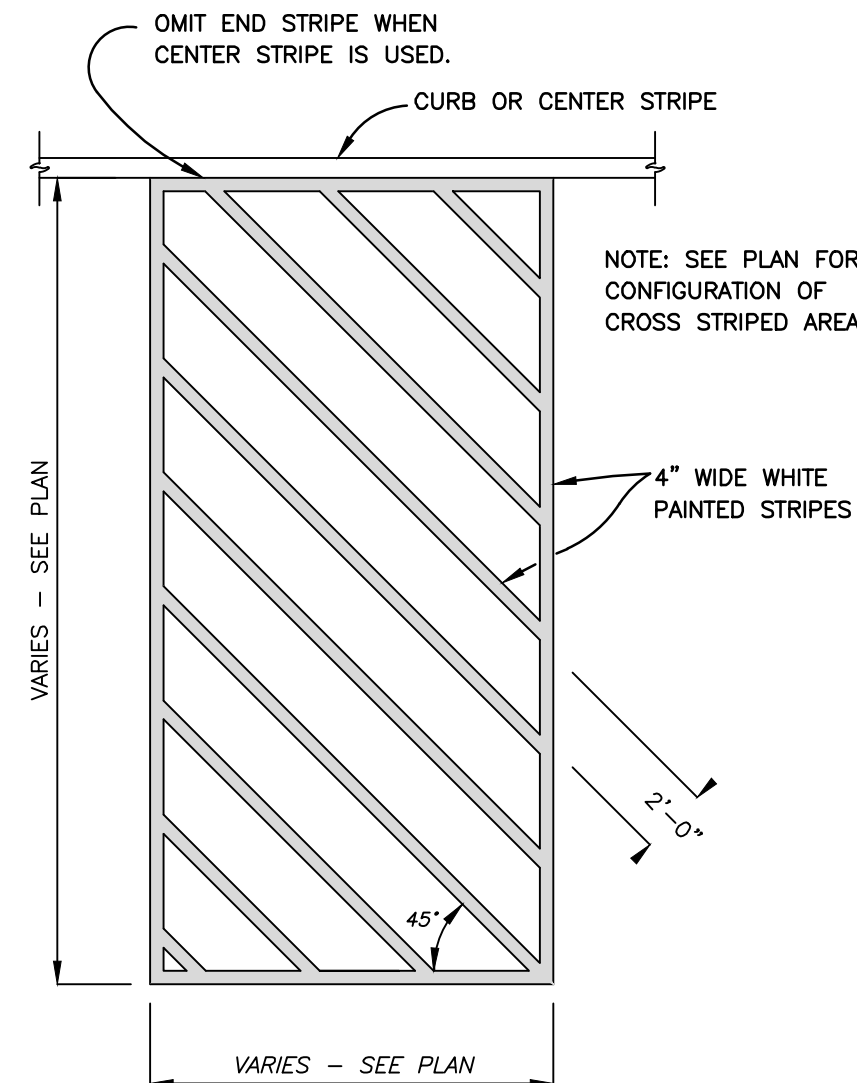


- NOTES:
1. EXPANSION AND CONTROL JOINTS SHALL BE PER JOINT DETAILS
 2. CONCRETE SHALL BE TYPE "C" UNLESS OTHERWISE NOTED.
 3. REFER TO GEOTECHNICAL REPORT (IF AVAILABLE) FOR FURTHER SPECIFICATIONS AND/OR RECOMMENDATIONS.

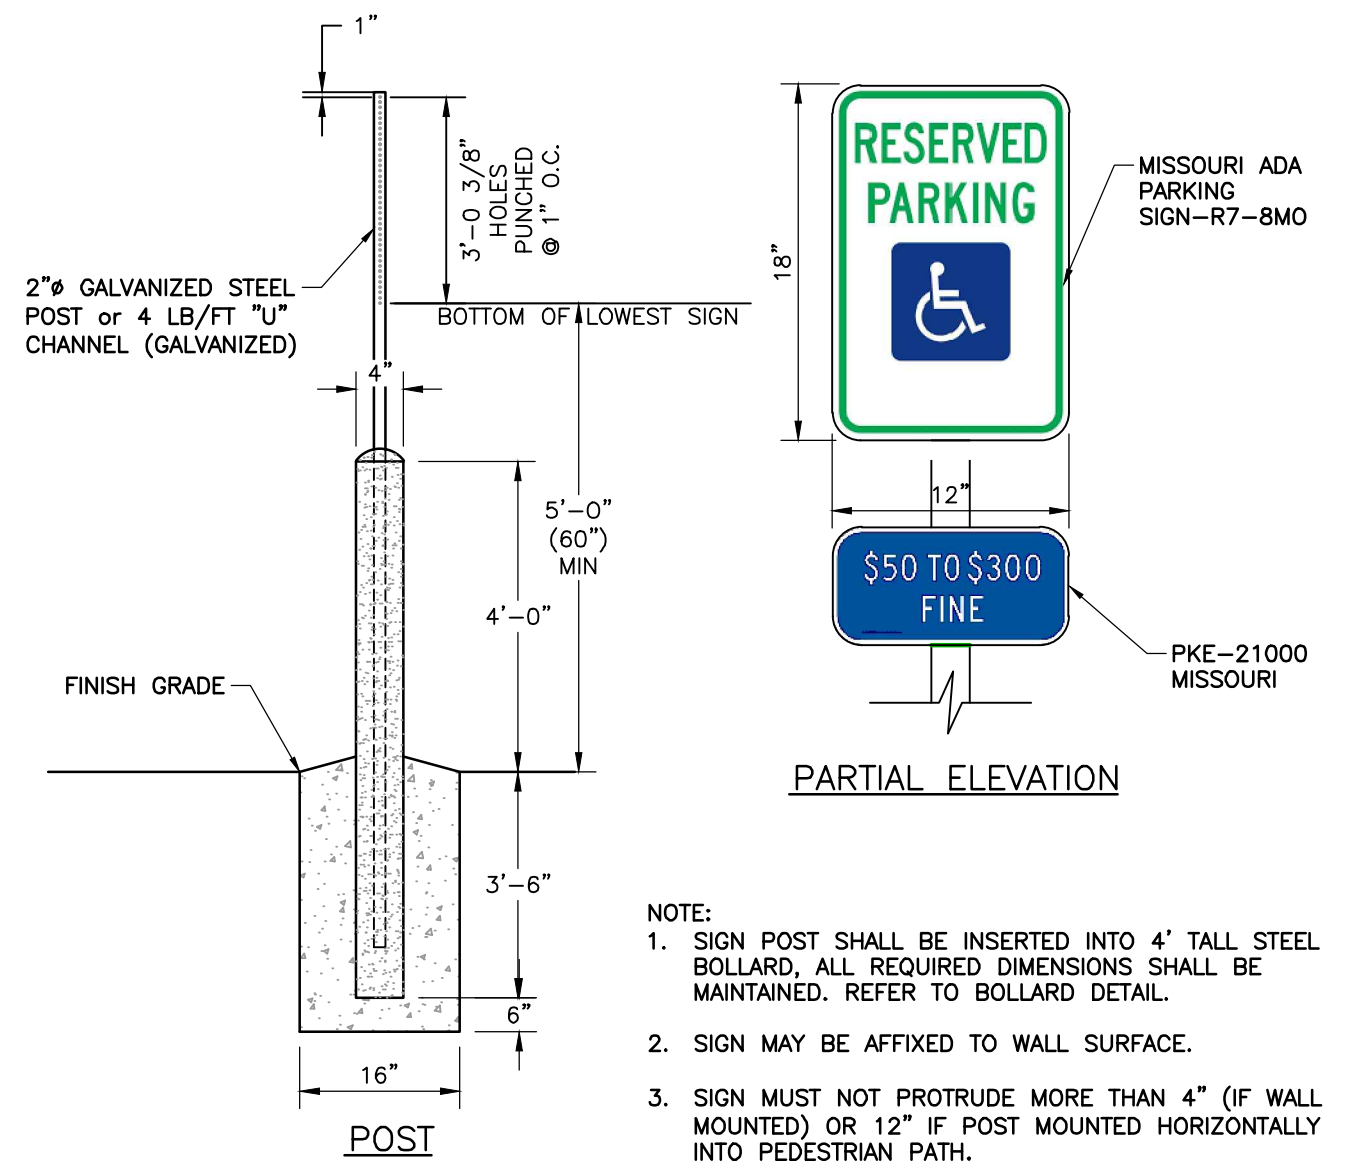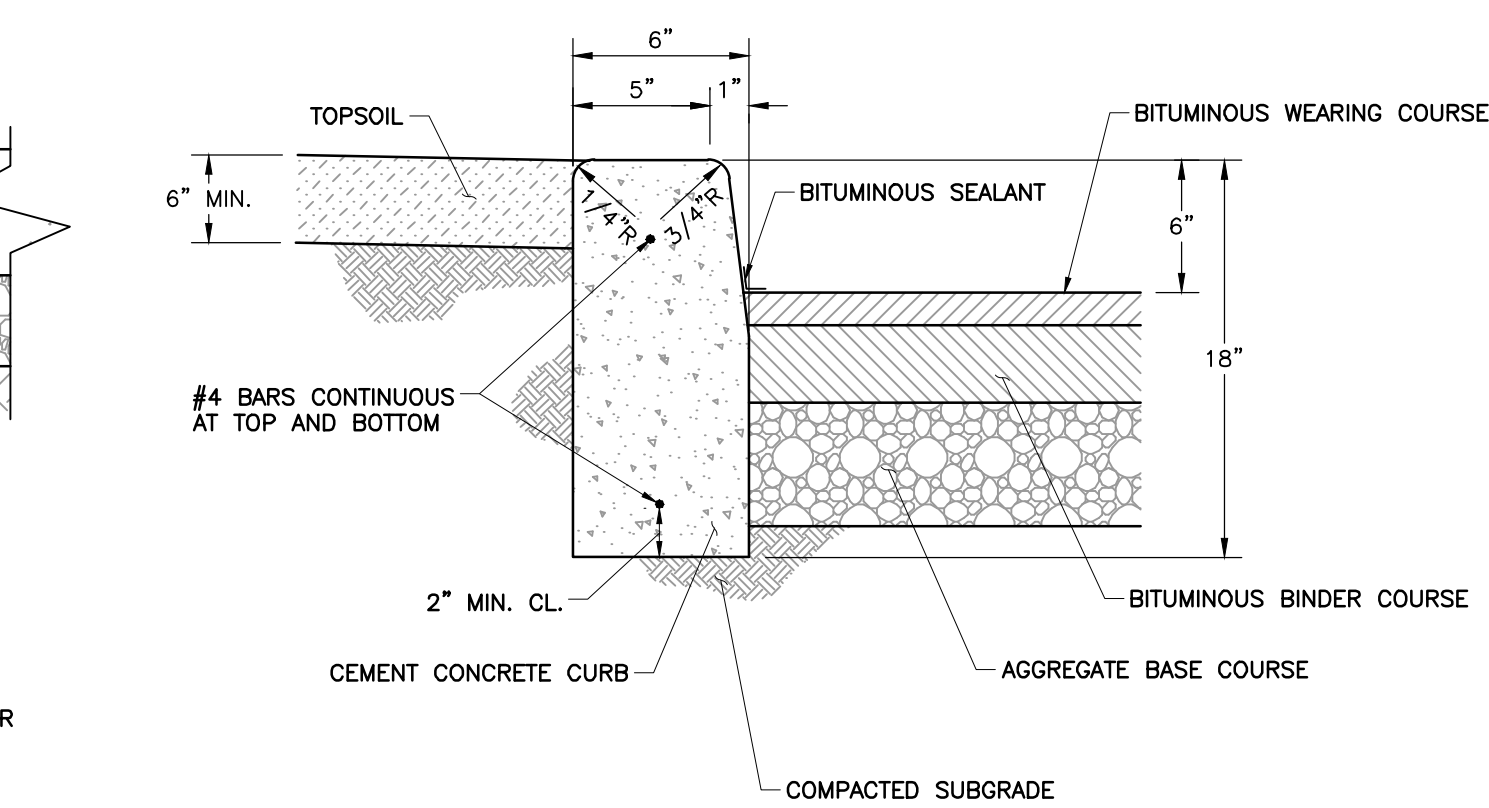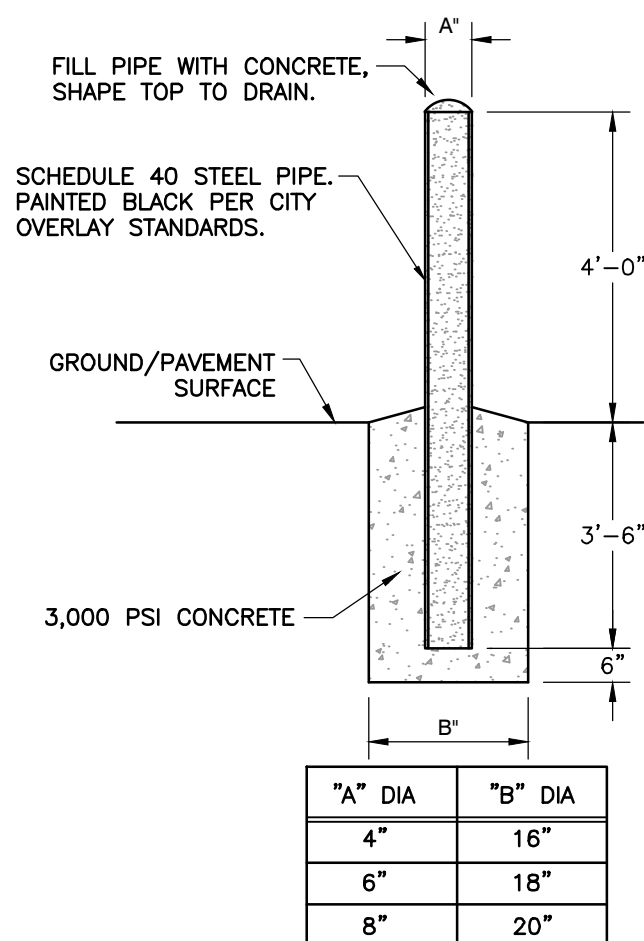


- NOTE:
1. SIGN POST SHALL BE INSERTED INTO 4' TALL STEEL BOLLARD, ALL REQUIRED DIMENSIONS SHALL BE MAINTAINED. REFER TO BOLLARD DETAIL.
 2. SIGN MAY BE AFFIXED TO WALL SURFACE.
 3. SIGN MUST NOT PROTRUDE MORE THAN 4" (IF WALL MOUNTED) OR 12" IF POST MOUNTED HORIZONTALLY INTO PEDESTRIAN PATH.
 4. NOTE: SIGNS MAY VARY ALTHOUGH THE FINE AND "LIFT VAN ACCESSIBLE ONLY" LANGUAGE MUST BE RETAINED.

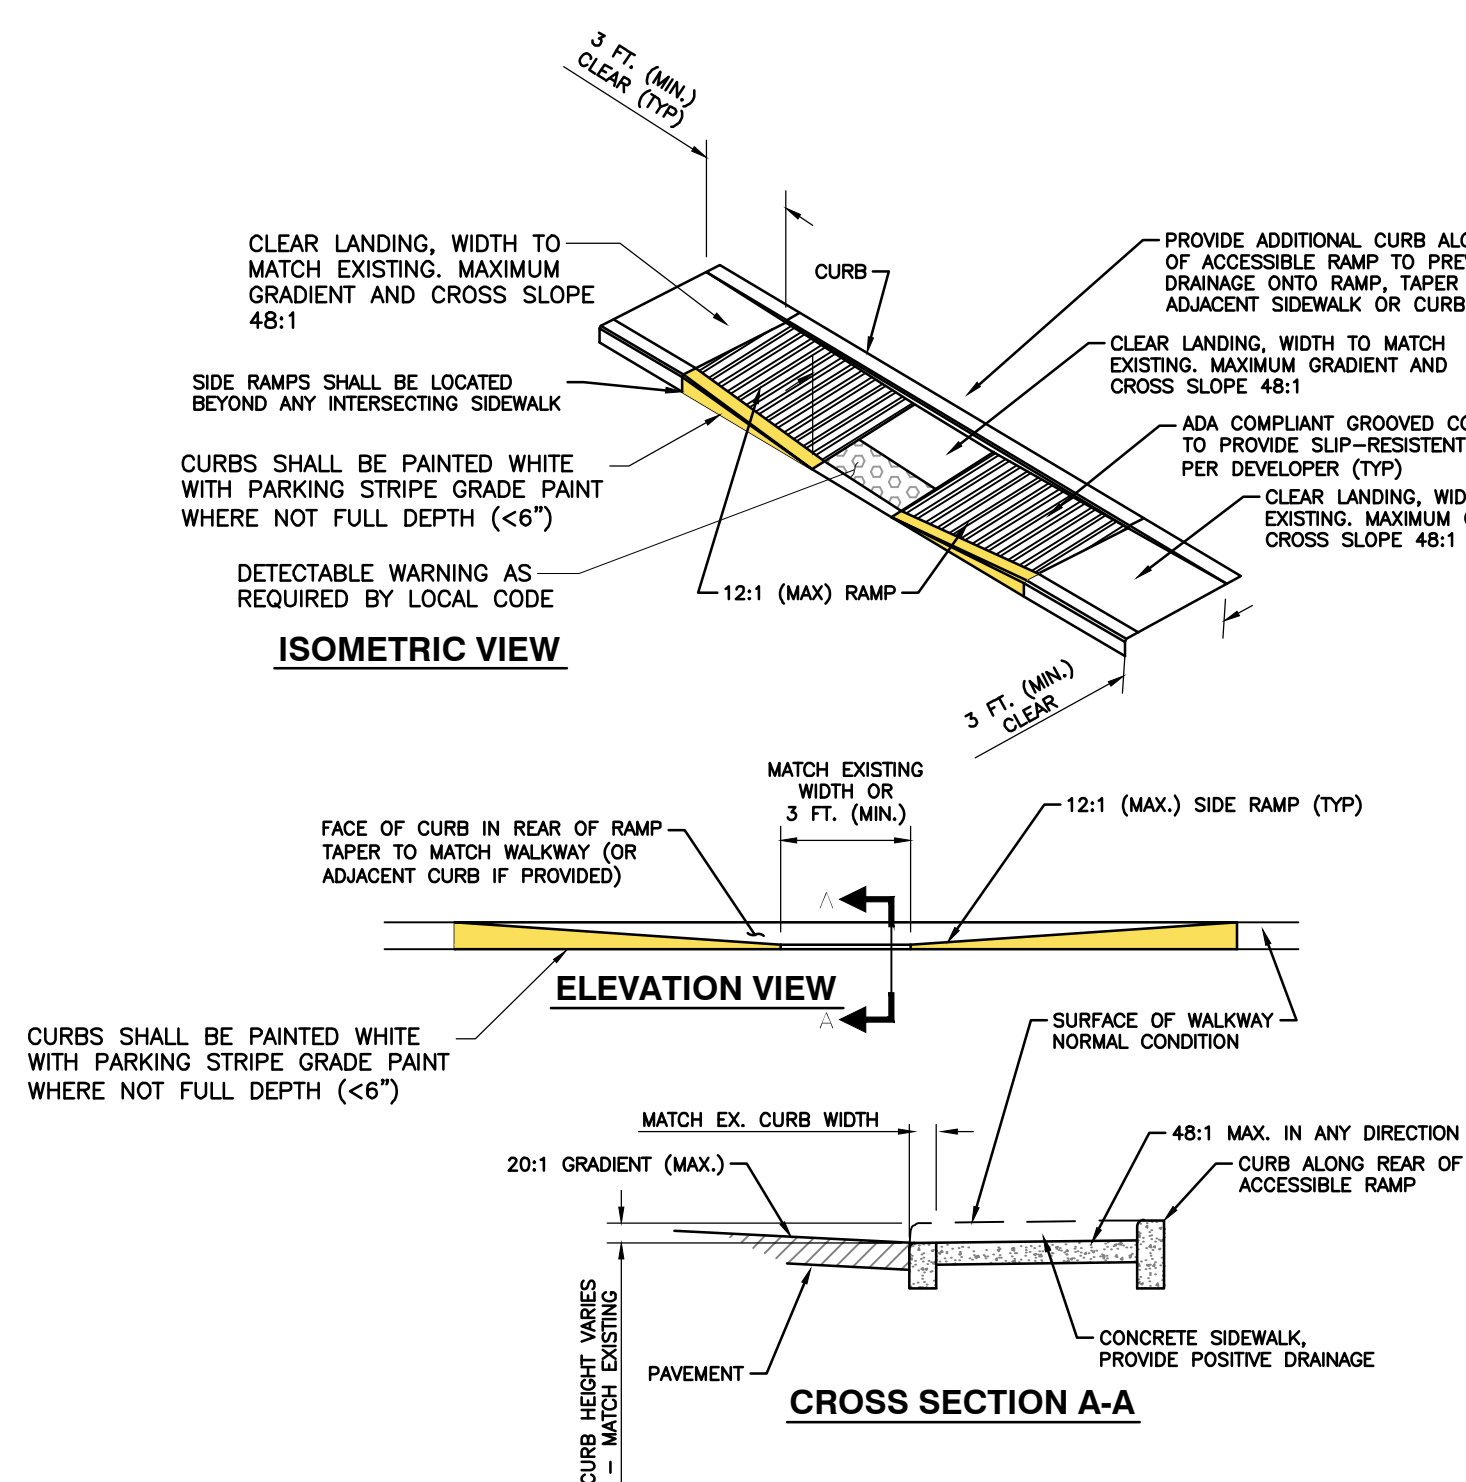

- NOTES:**
1. ACCESSIBLE SPACE / LOADING AREA: MAXIMUM 48:1 SLOPE IN ANY DIRECTION.
 2. RAMP & PAVEMENT TRANSITION TO BE COMPLETELY FLUSH, NO LIP.
 2. WHEN RAMP OCCURS ON RADII, MINIMUM CLEAR LANDING WIDTH MUST BE MAINTAINED ON SHORTEST SIDE ALONG CURVE.
 3. CONSTRUCT PER A.D.A. & LOCAL STANDARDS.

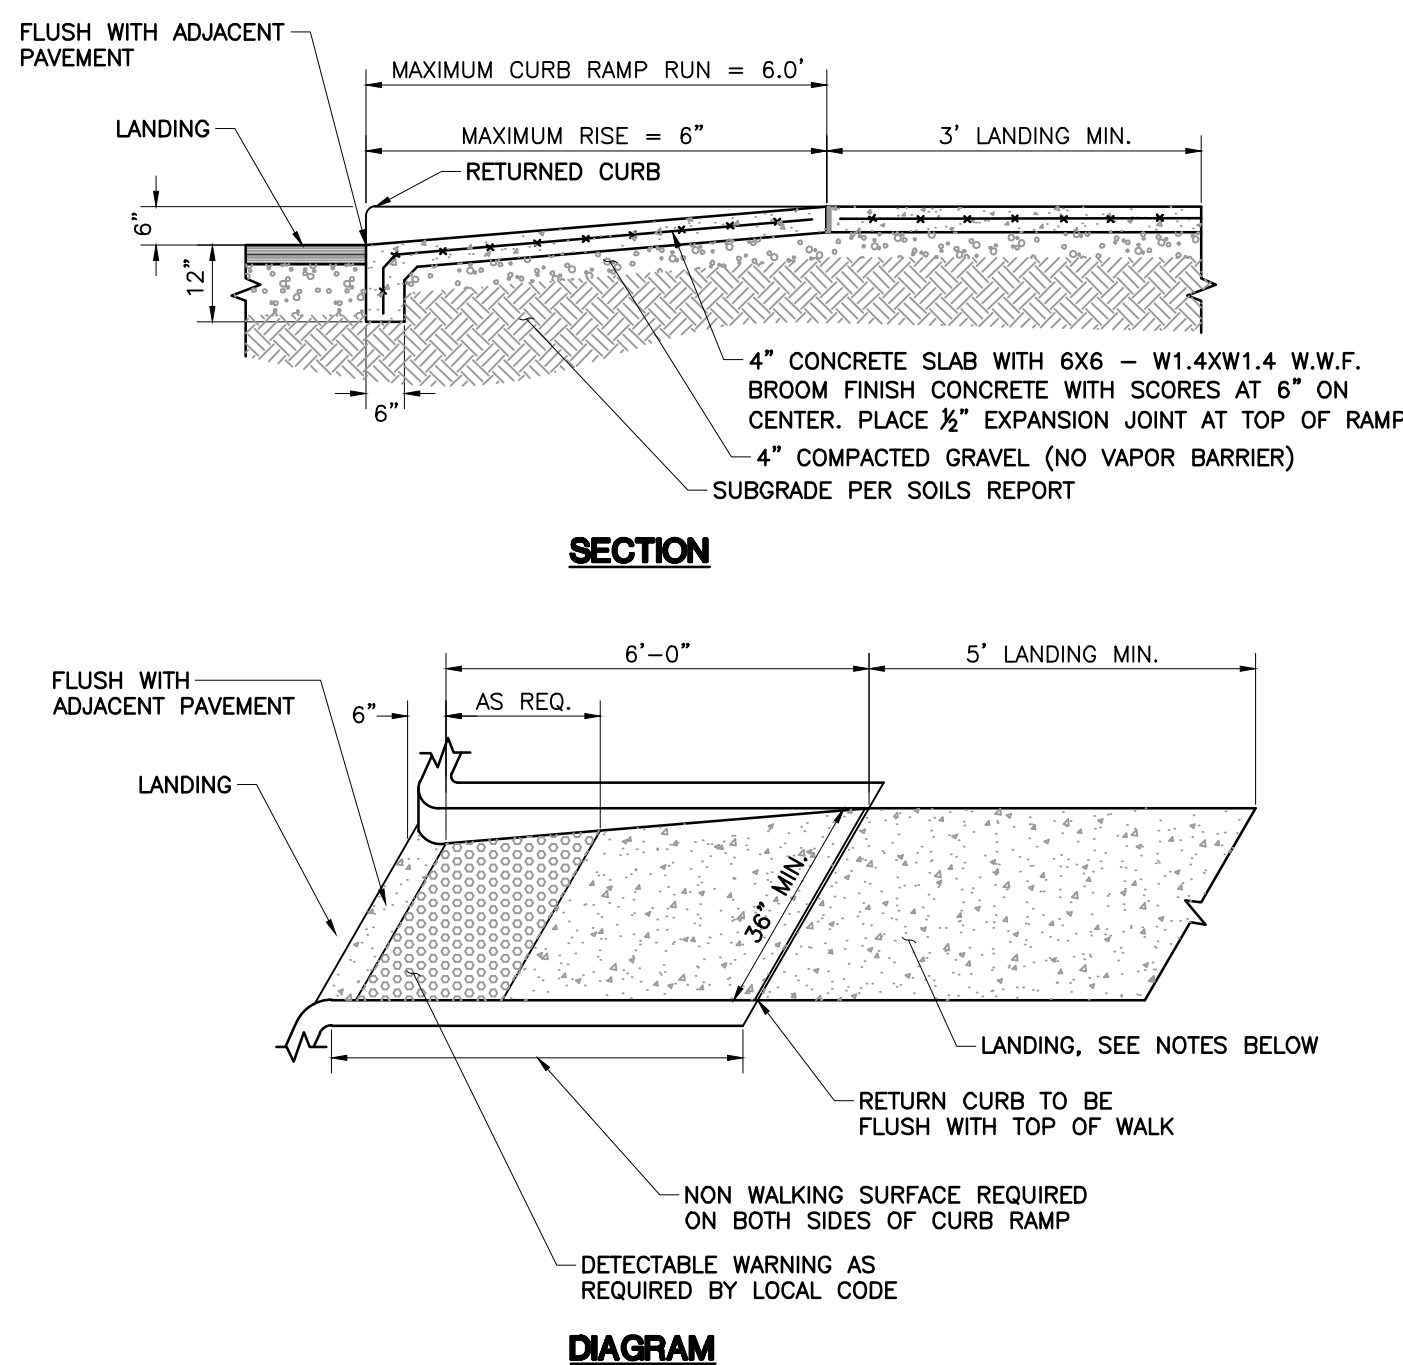

- NOTES:**
1. LANDINGS SHALL BE LEVEL (LESS THAN 2% SLOPE IN ALL DIRECTIONS) AND PROVIDED AT THE TOP AND BOTTOM OF ALL ACCESSIBLE RAMPS.
 2. LANDING CLEAR WIDTH SHALL BE AT LEAST AS WIDE AS THE WIDEST RAMP RUN LEADING TO THE LANDING.
 3. LANDING CLEAR LENGTH SHALL BE 5' LONG MINIMUM.
 4. LANDINGS THAT REQUIRE A CHANGE IN DIRECTION BETWEEN RAMP RUNS SHALL HAVE A CLEAR LANDING 60" MINIMUM BY 60" MINIMUM.

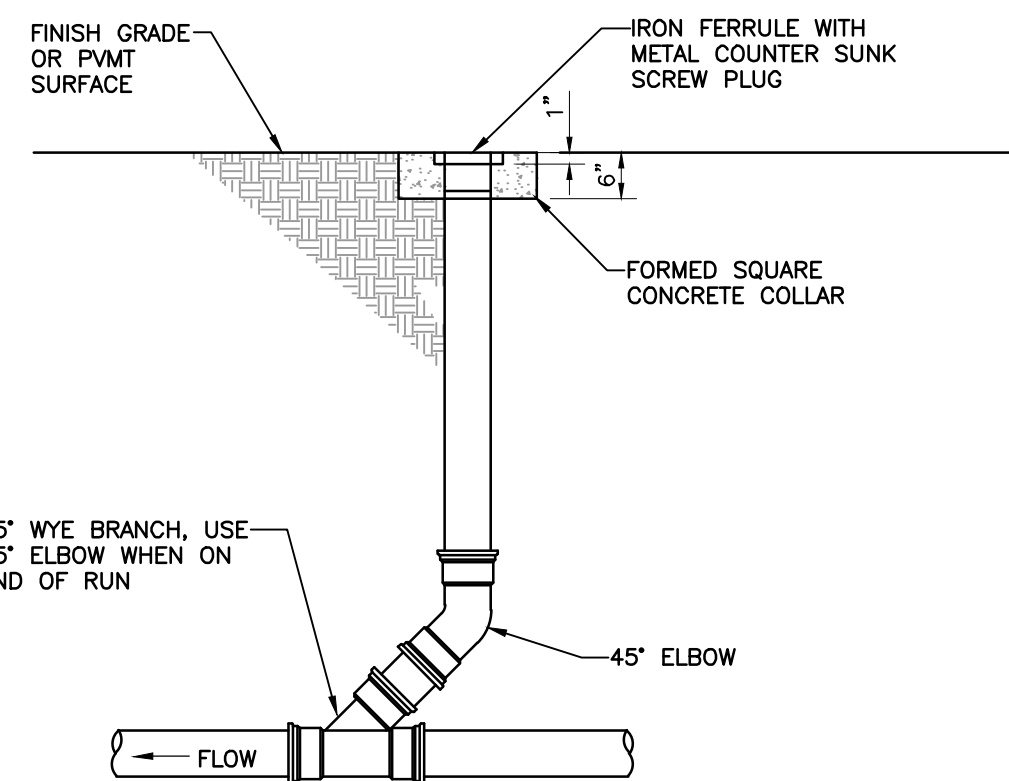

- NOTE:
1. CLEANOUT PVC SIZE TO MATCH THE PIPE SIZE OF THE SEWER TO WHICH IT IS CONNECTED.
 2. ALL PVC PIPE AND FITTINGS SHALL BE SDR 35 WITH RUBBER GASKETED JOINTS.