

MILL POND APARTMENTS OF FALLON, MISSOURI

PINNACLE
Civil Engineering, L.L.C.


Seven Oaks Center
302 Capital 200
Columbia, MO 65201
Phone: 573/256-7200
Fax: 573/256-8947

COPYRIGHT © 2006

1ST ISSUE
09 NOVEMBER 2005




REVISIONS
 ▲ 23 JANUARY 2006
 ▲ 09 FEBRUARY 2006
 ▲ 02 JUNE 2006
 ▲ 07 SEPT 2006 THHinc

SHEET NO.
C3.1
 JOB NO. 2324 SHEET 07 OF 17

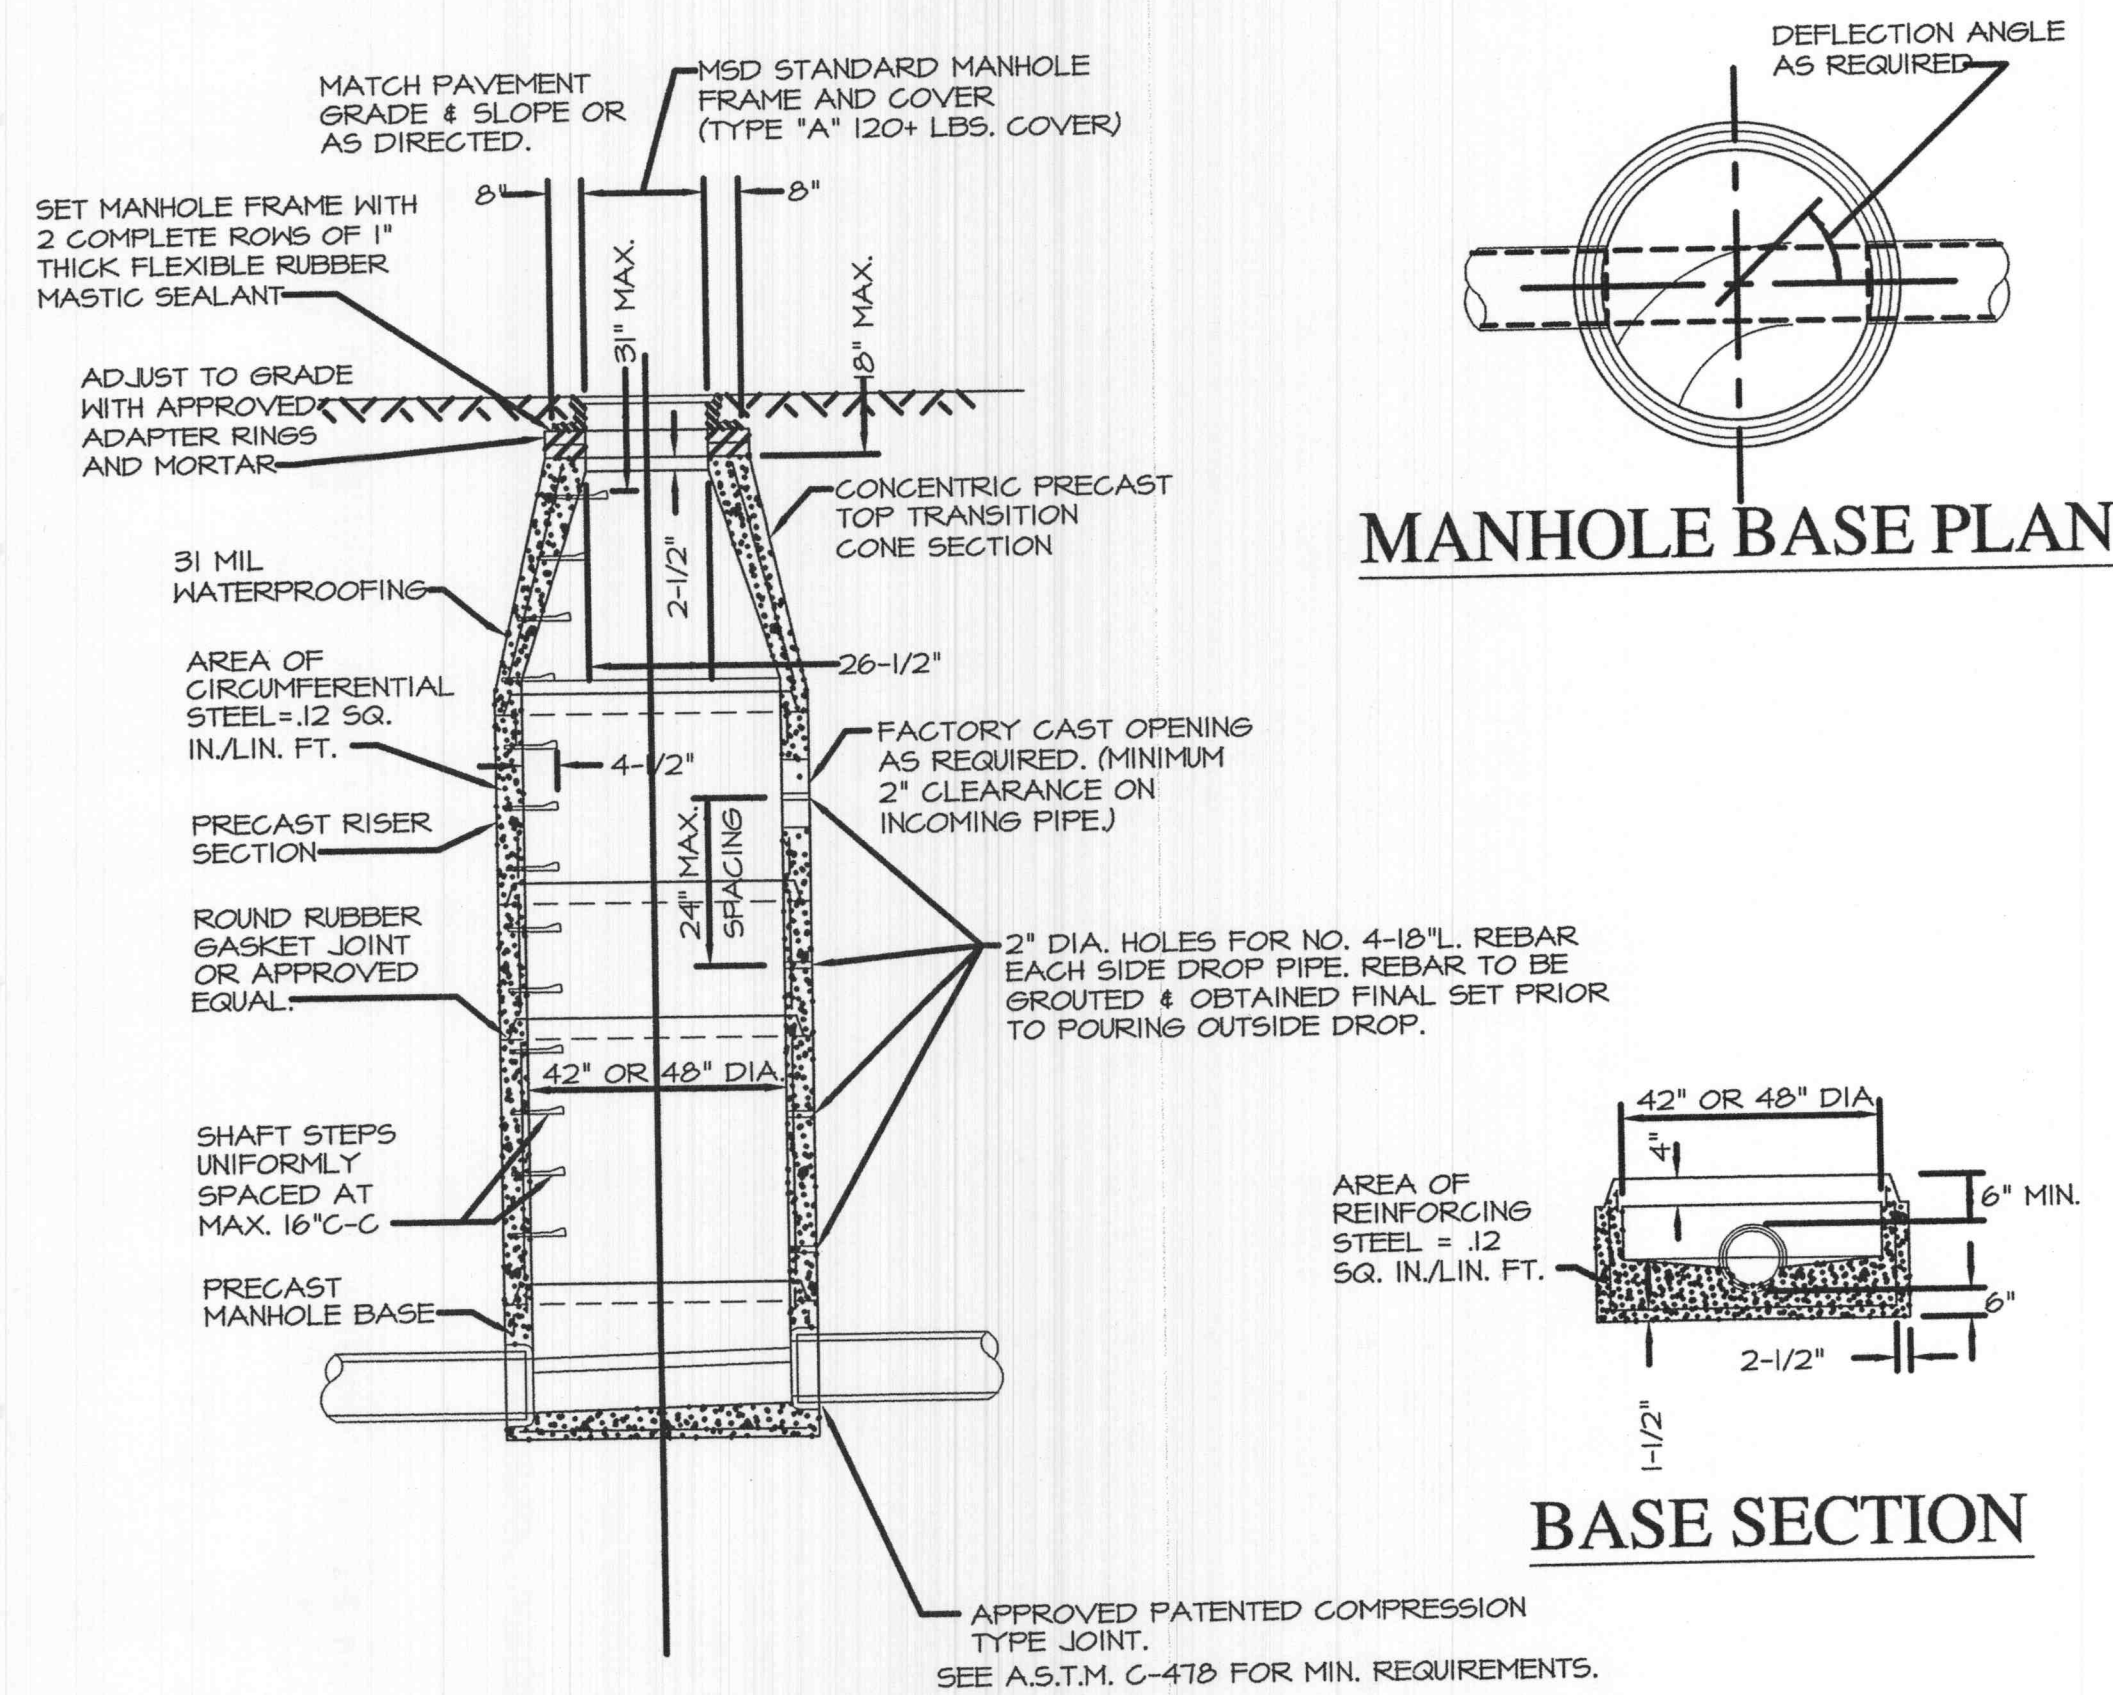


- NOTES:
1. THE MINIMUM INSIDE DIAMETER FOR THE BASE AND RISER SECTIONS SHALL BE 42 INCHES FOR 8 INCH DIAMETER PIPE. THE MINIMUM INSIDE DIAMETER FOR PIPES LARGER THAN 8 INCHES SHALL BE 48 INCHES. MANHOLE SHALL MEET ASTM C-470 REQUIREMENTS.
 2. FLOWLINE ELEVATION OF INCOMING PIPES SHALL BE 0.2 FEET HIGHER THAN THAT OF OUTGOING PIPE.
 3. PIPE SIZES LARGER THAN 24 INCHES MAY REQUIRE MANHOLE DIAMETERS OF 60 INCHES OR LARGER AS DETERMINED BY OUTSIDE DIAMETERS AND ORIENTATIONS OF CONNECTING PIPES.

① PRE-CAST CONCRETE MANHOLE FOR SEWERS 8" THROUGH 12"

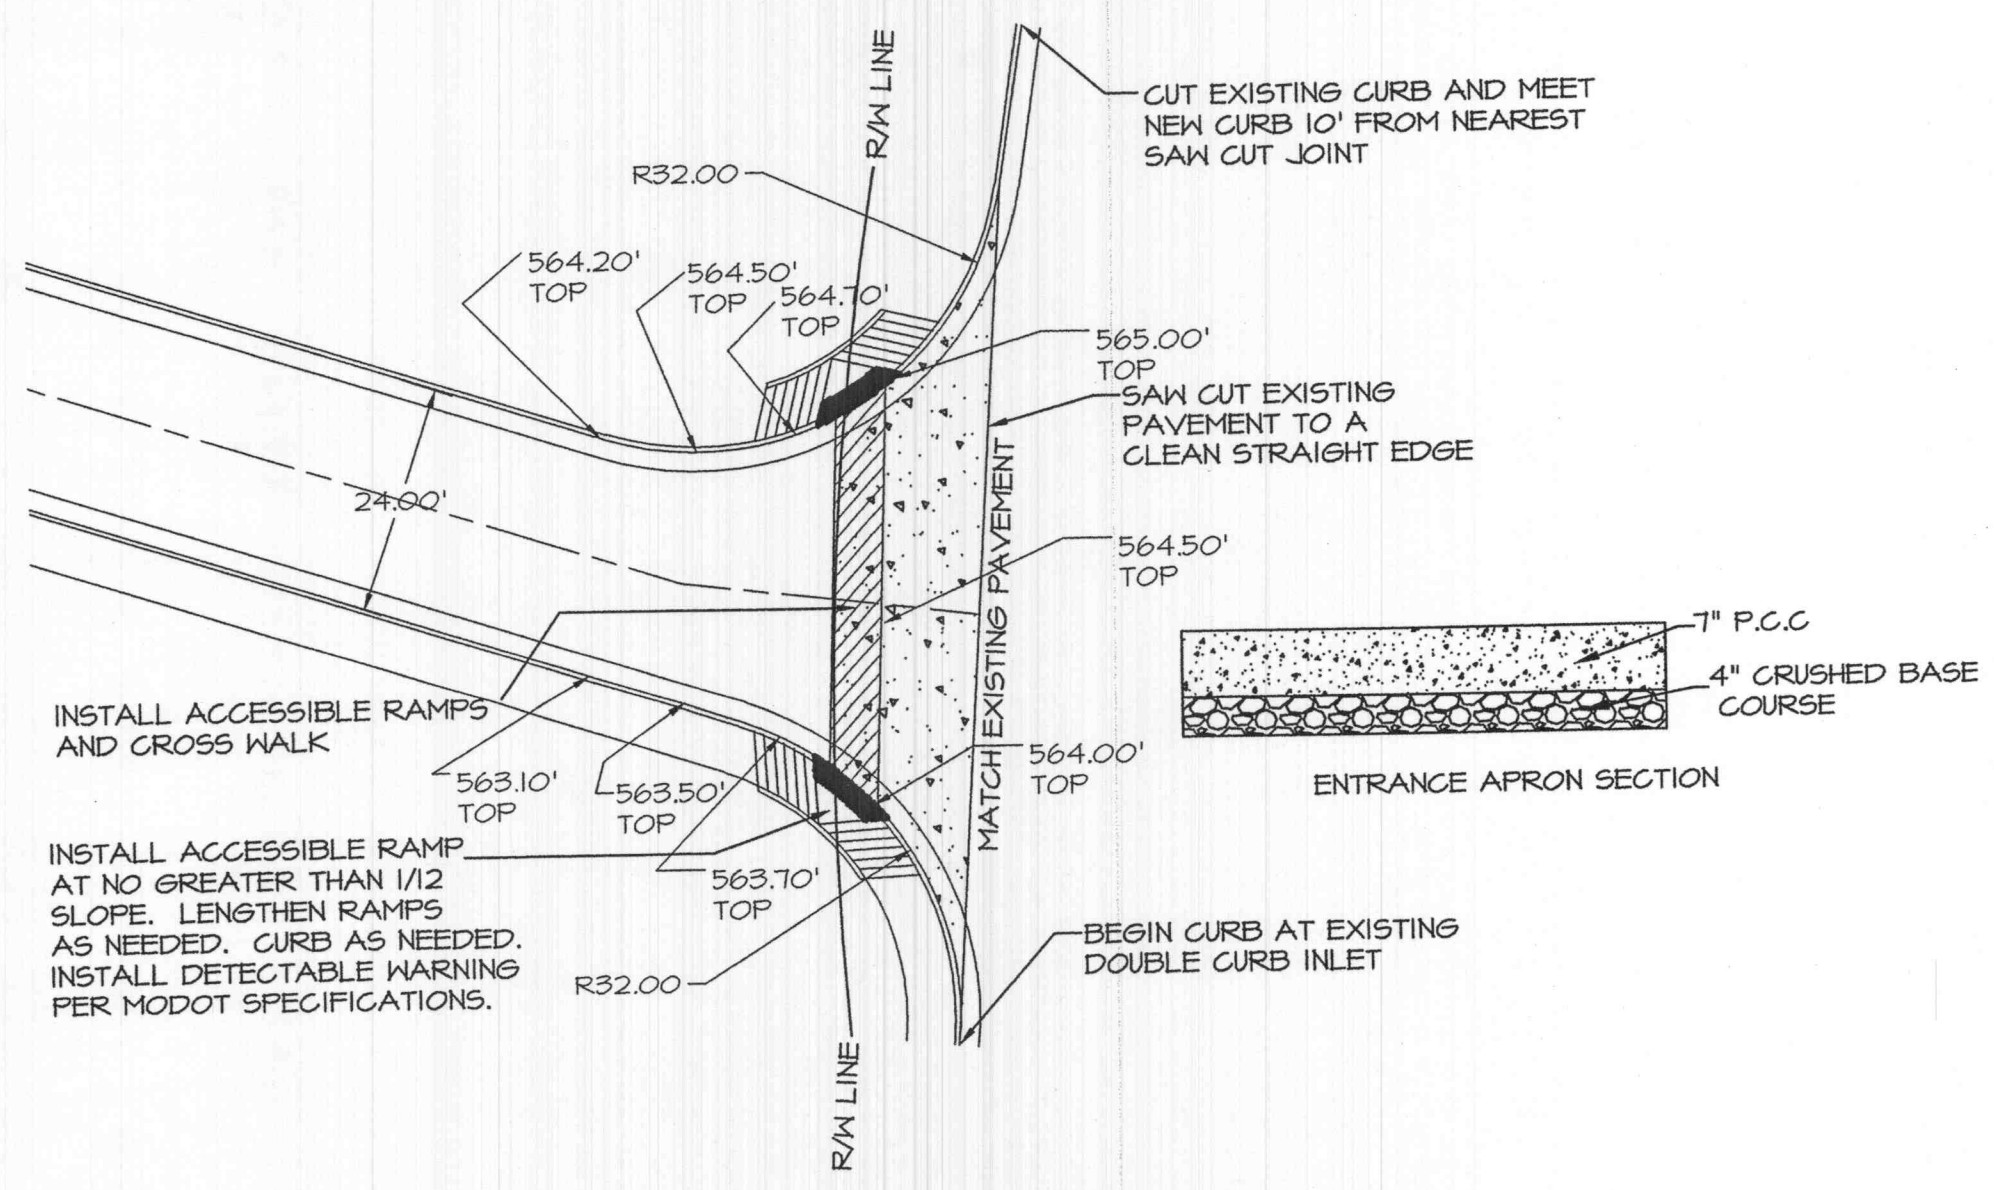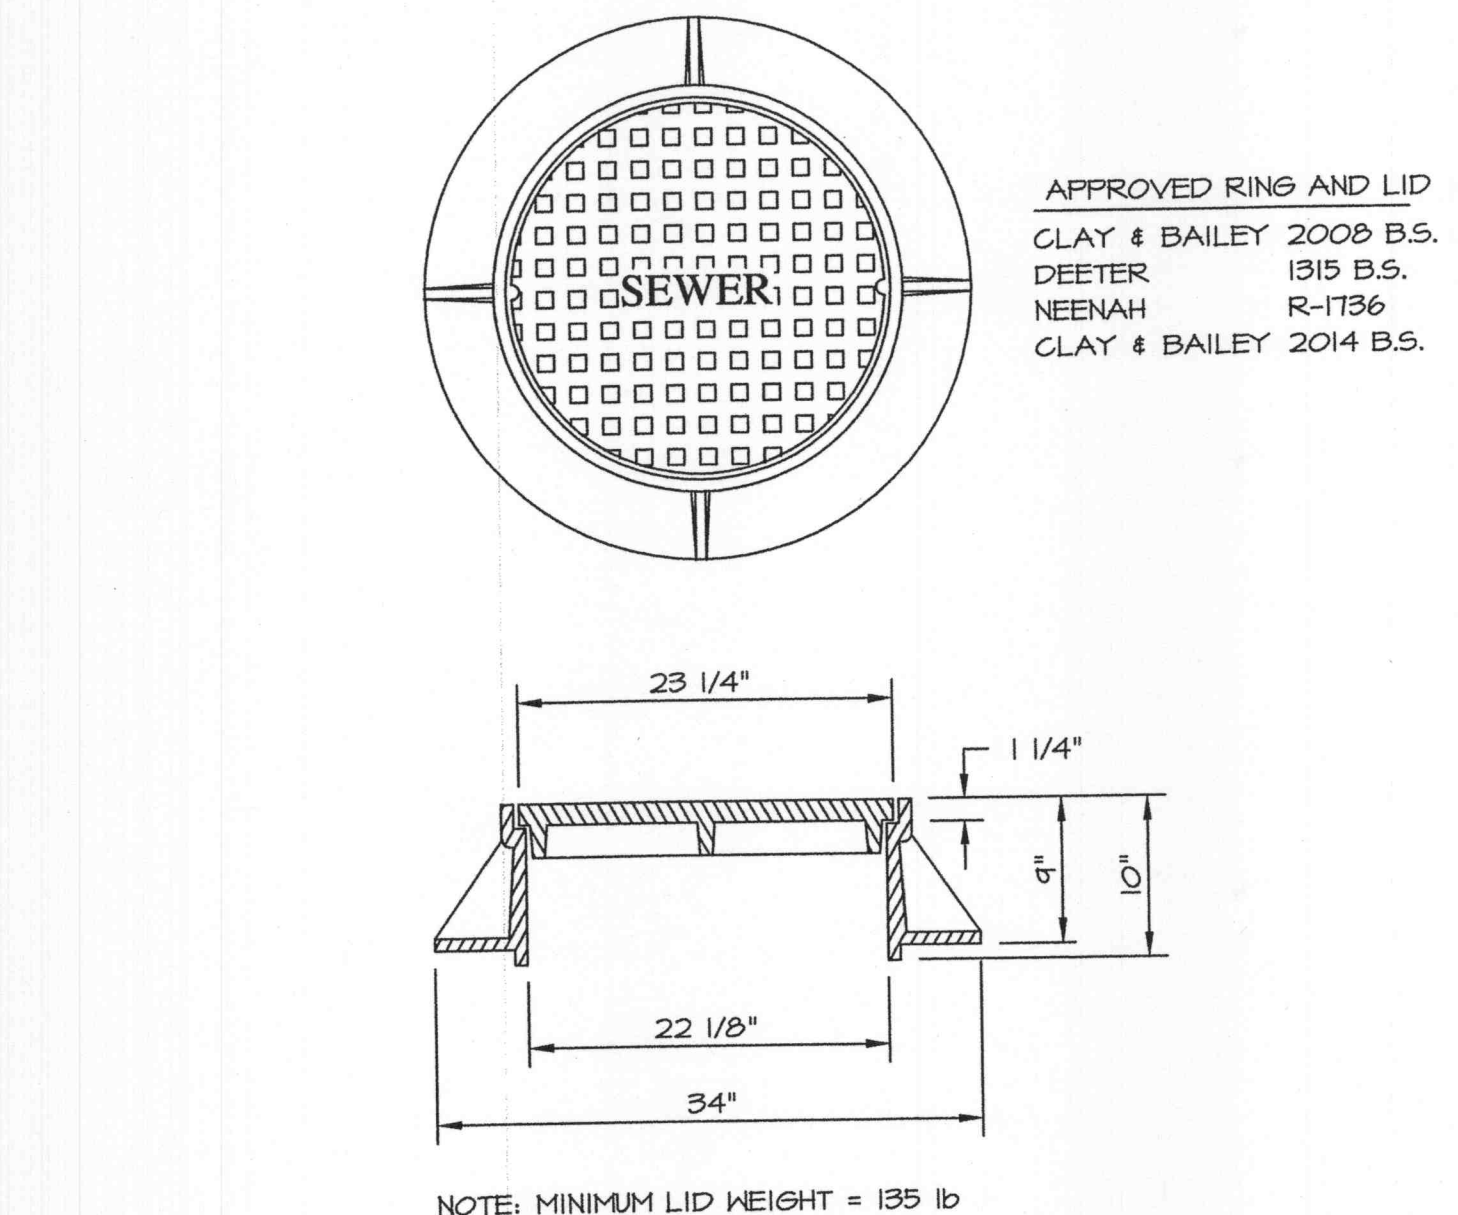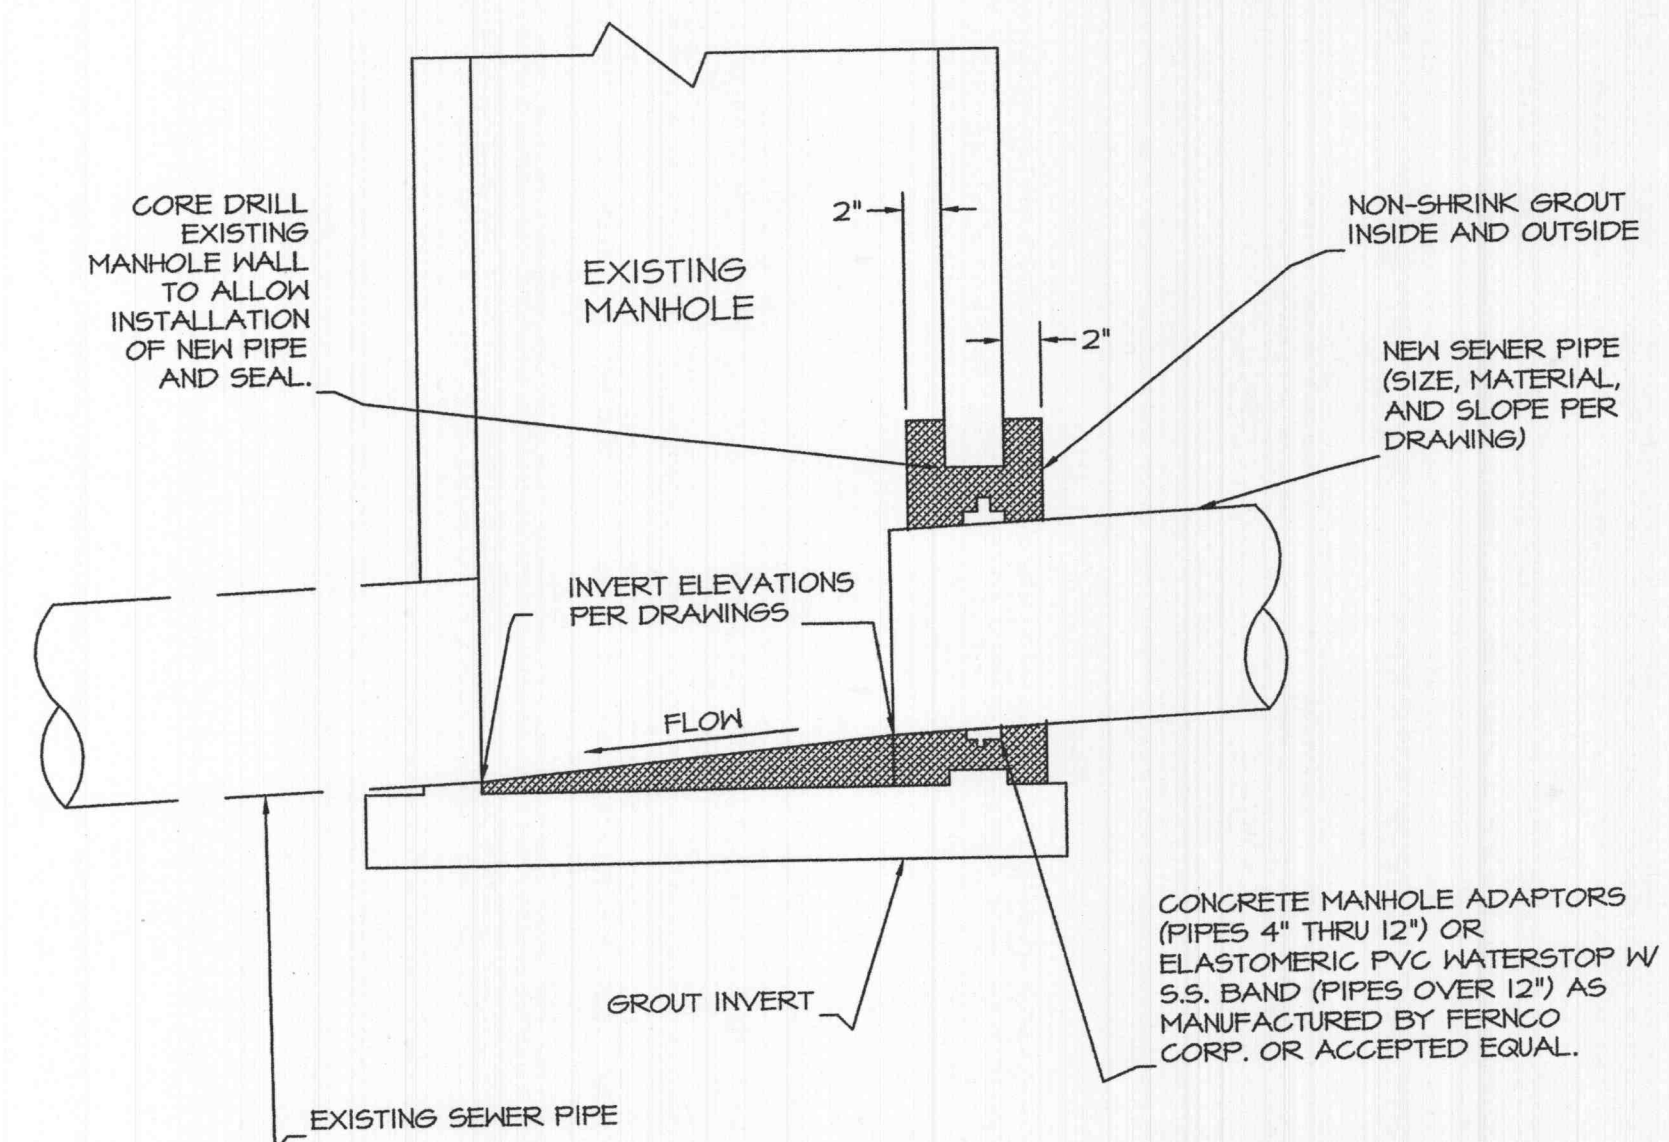


④ ENTRANCE APRON DETAIL

SCALE: 1"=20'

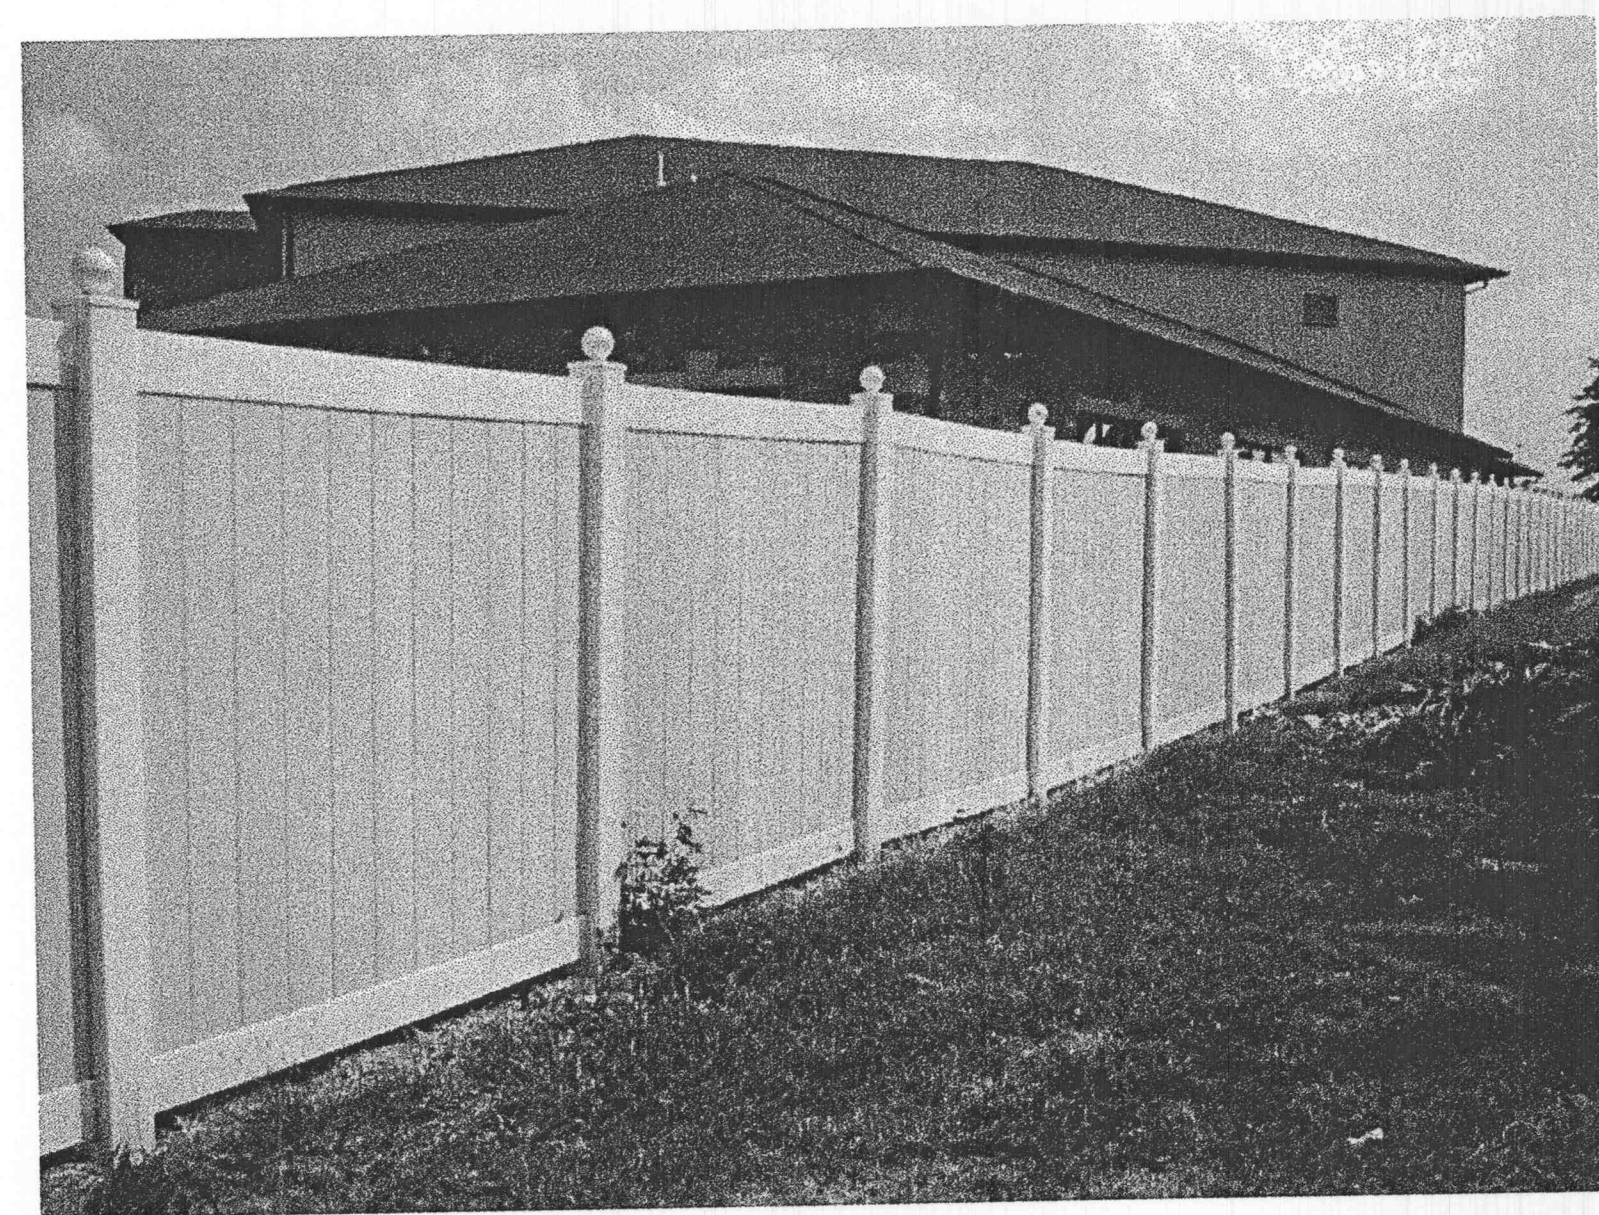

⑤ SIGHT PROOF FENCE DETAIL

NOT TO SCALE
 RETAINING WALL FENCE FOR SHEET C 3.0 DETAIL 12

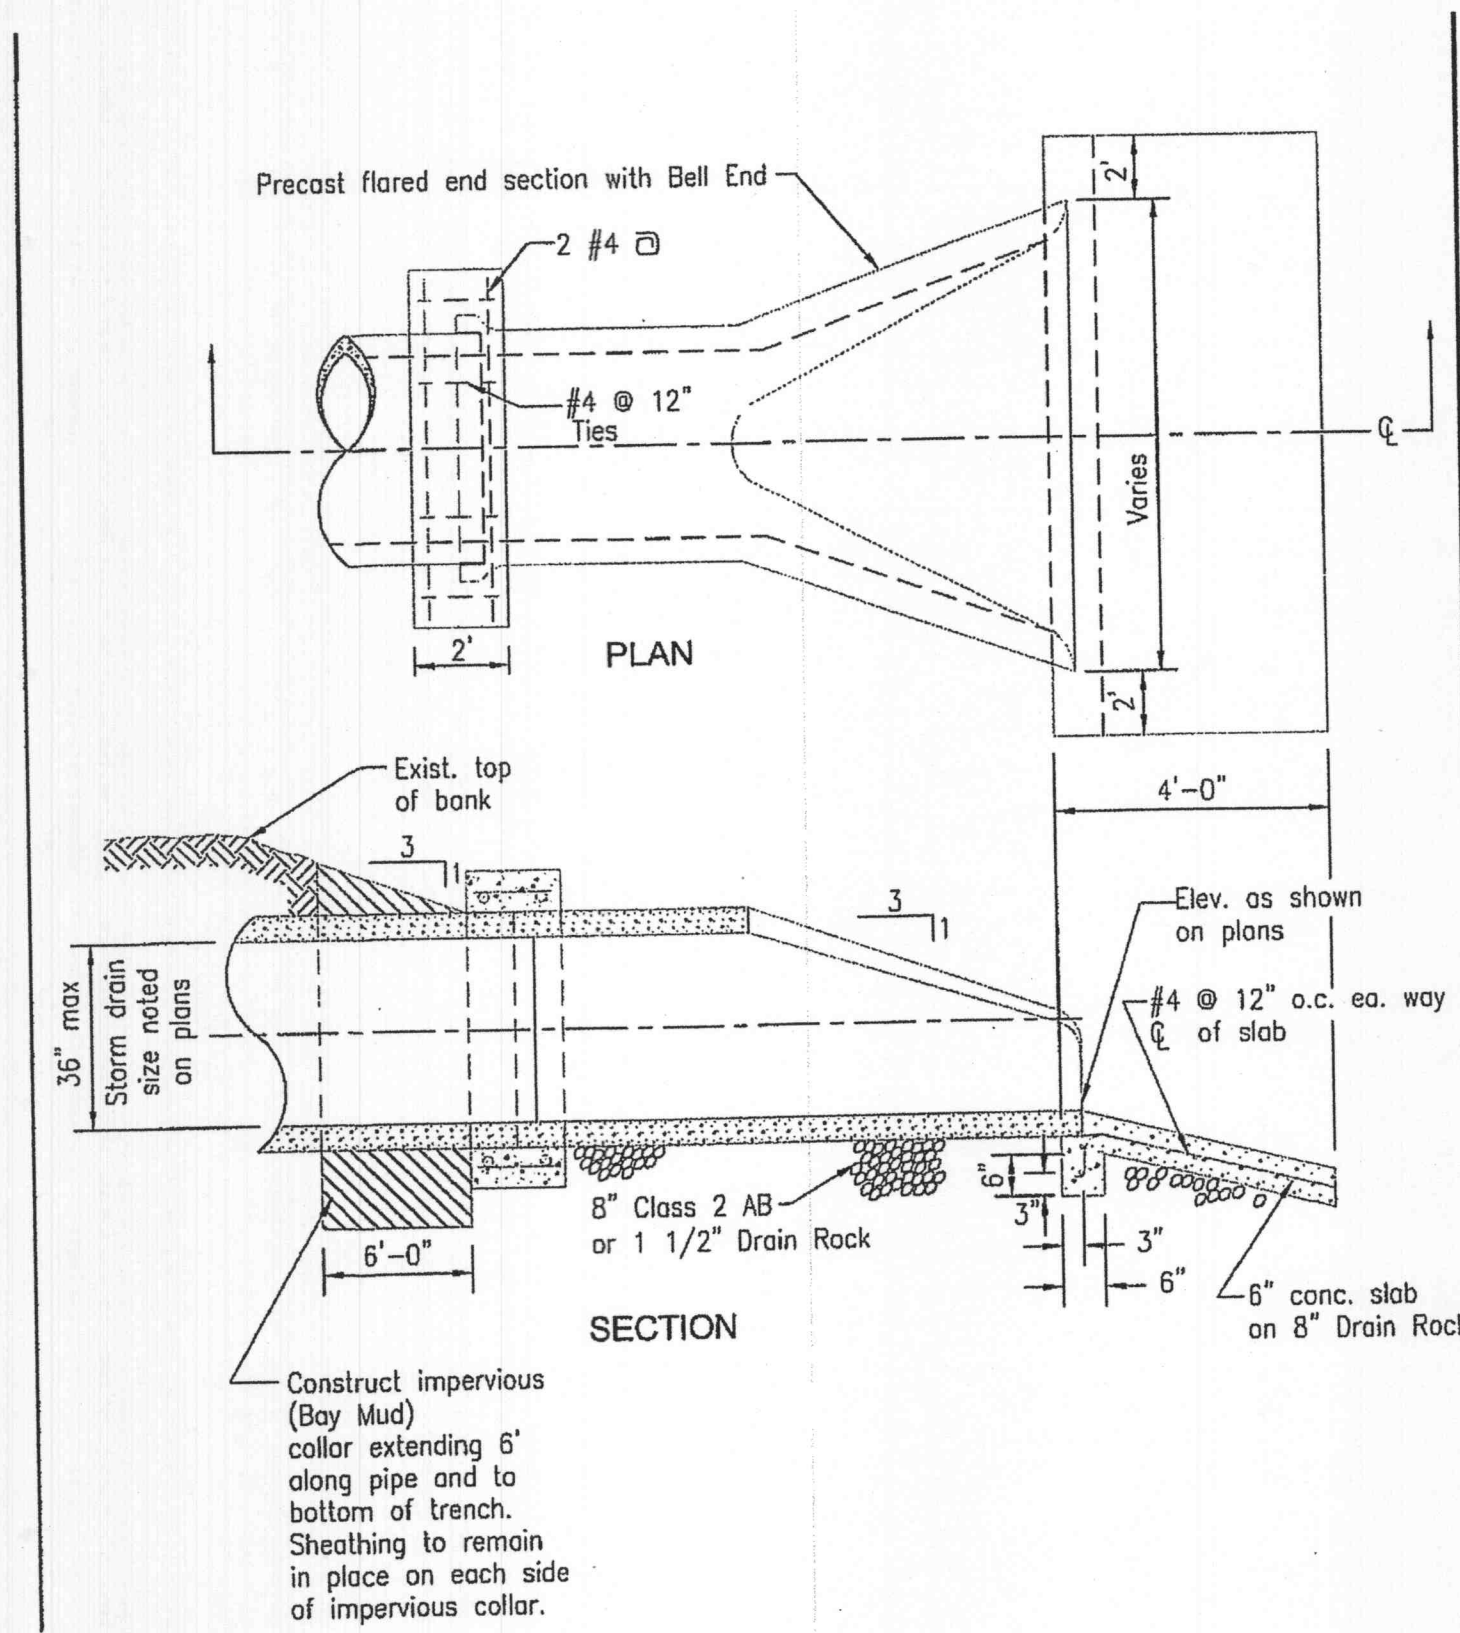

⑥ FLARED END SECTION DETAIL

NOT TO SCALE