


GENERAL NOTES

1. Water lines are to be located 2 feet inside right-of-way line.
2. Fire hydrants are to be located 2 feet from back of curb (10 feet inside of right-of-way line).
3. See Sheet 15/19 for construction details and specifications.

SCALE: 1" = 50'

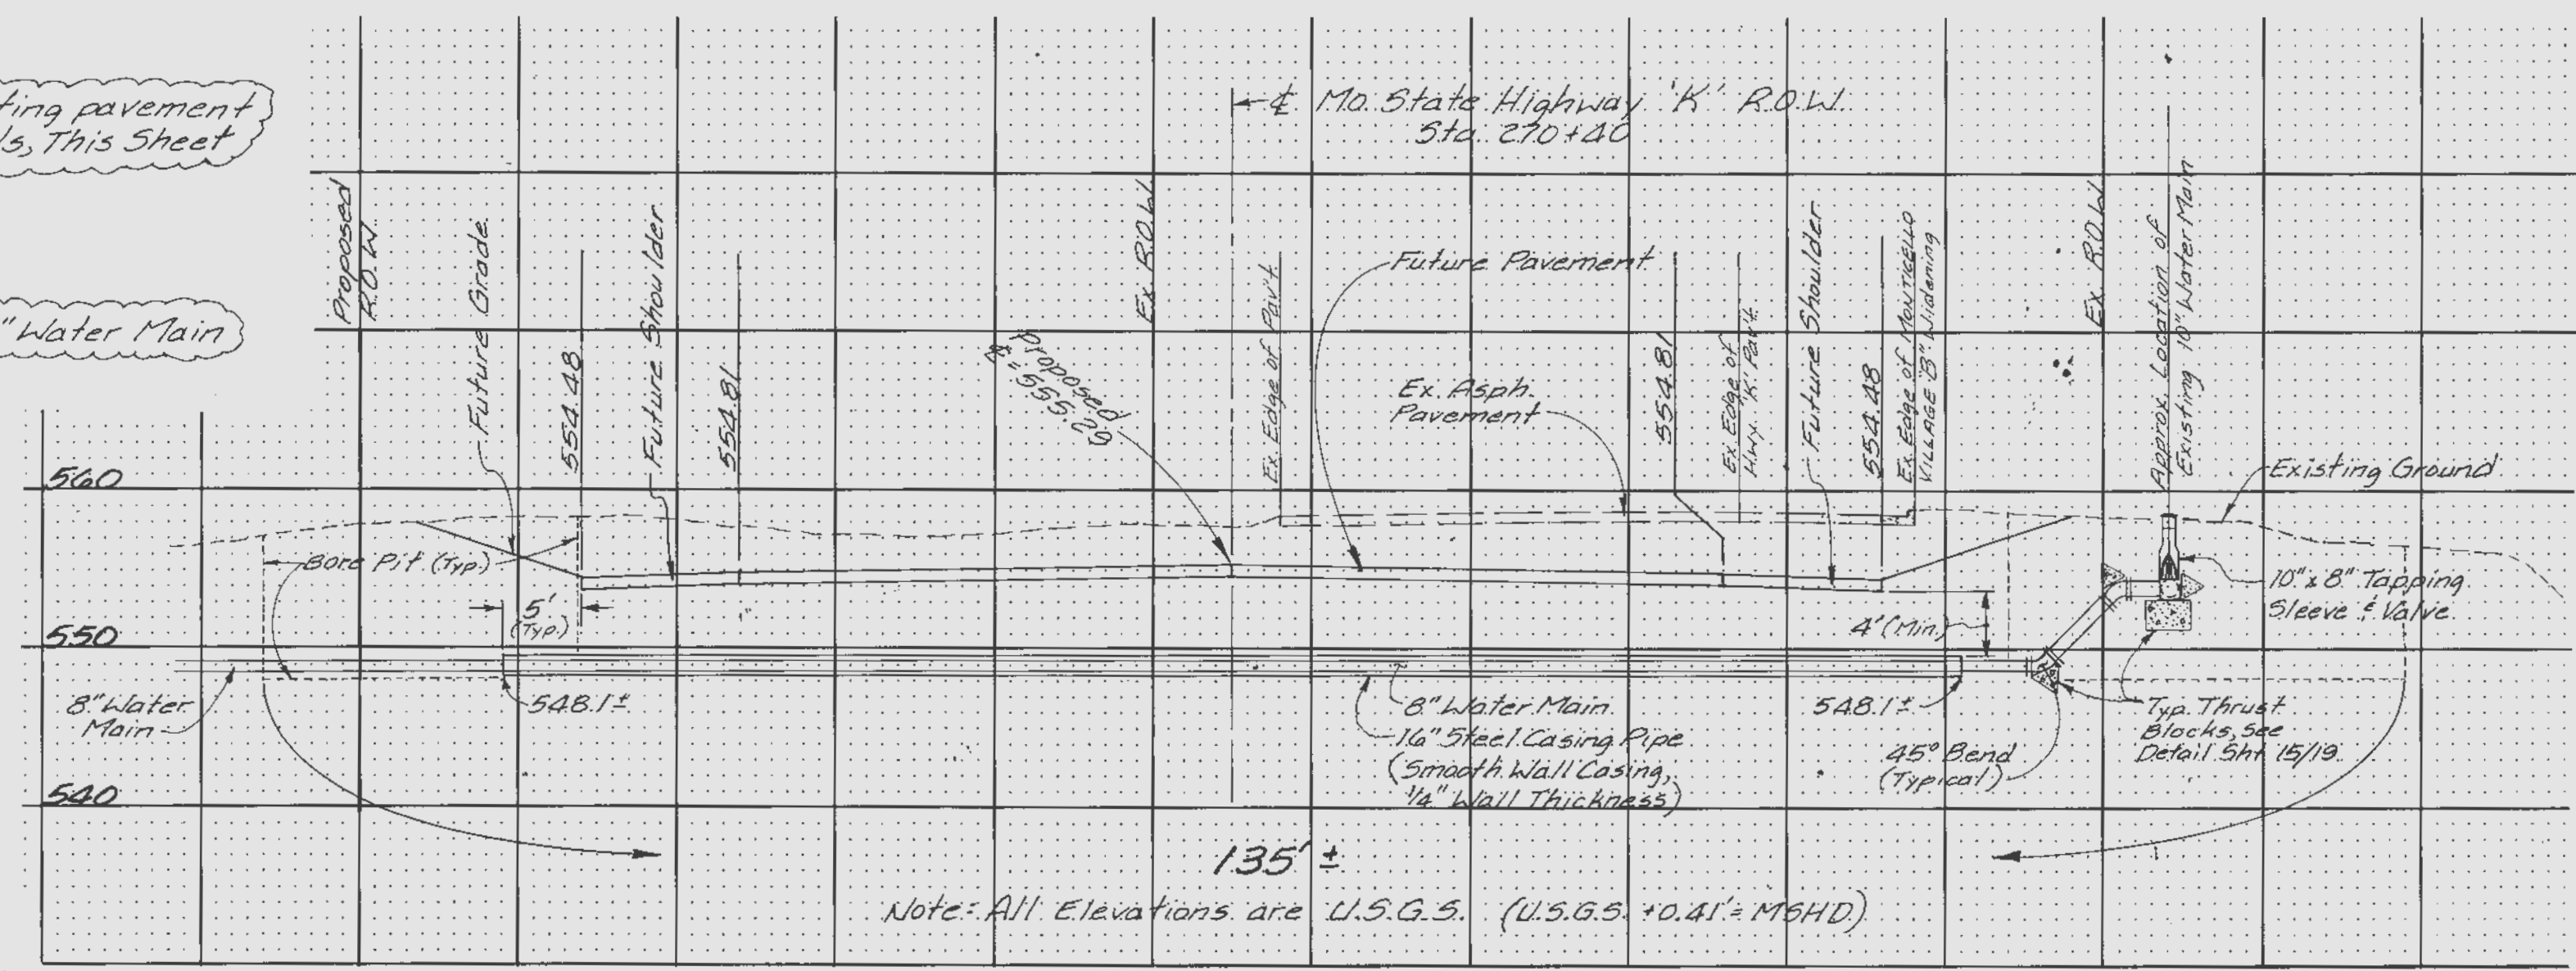

GENERAL NOTES

1. Any areas within the State right-of-way disturbed during construction shall be replaced to the original condition by the Contractor.
2. Any right-of-way markers destroyed during construction shall be replaced on the Contractor's expense.
3. The Contractor shall give officials of Missouri State Highway Department adequate notice of the anticipated time and duration of the crossing.
4. Exterior of steel casing pipe shall have 2 coats of heavy coal tar base at 15 mils dry thickness per coat. Interior of pipe shall have coal tar lining AWWA C203.
5. Steel casing pipe shall be ASTM A139, Grade A pipe. All joints shall be welded.

SEE SHEET 14 OF 19

FOR WATER MAIN CONSTRUCTION ONLY