



ROUND PIPE				HORIZONTAL ELLIPTICAL PIPE			
Inside Diameter of Pipe (Inches)	"w" Payline Width of Trench (Inches)	"w" Payline Width of Trench (Feet)	Payline Volume cu. ft. per ft. of Trench Encasement	Inside Dimension of Pipe (Inches)	"w" Payline Width of Trench (Inches)	"w" Payline Width of Trench (Feet)	Payline Volume cu. ft. per ft. of Trench Encasement
4	28	2.33	3.20				
6	28	2.33	3.46				
8	28	2.33	3.70				
10	28	2.33	3.86				
12	28	2.33	3.98				
15	32	2.67	4.89				
18	35	2.92	5.63	14 x 23	41	3.42	5.94
21	39	3.25	6.61				
24	42	3.50	7.39	19 x 30	49	4.08	7.88
27	45	3.75	8.18	22 x 34	53	4.42	8.81
30	49	4.08	9.30	24 x 38	58	4.83	9.70
33	53	4.42	10.53	27 x 42	62	5.17	10.71
36	56	4.67	11.43	29 x 45	66	5.50	11.72
39		DISCONTINUED		32 x 49	71	5.92	13.14
42	63	5.25	13.36	34 x 53	75	6.25	14.06
48	70	5.83	15.67	38 x 60	83	6.92	16.18
54	77	6.42	18.15	43 x 68	92	7.67	18.81
60	84	7.00	20.73	48 x 76	101	8.42	21.98
66	91	7.58	23.45	53 x 83	109	9.08	24.38
72	98	8.17	26.37	58 x 91	118	9.83	27.48
78	105	8.75	29.39	63 x 98	126	10.50	30.80
84	112	9.33	32.37	68 x 106	135	11.25	33.91
90	119	9.92	35.90	72 x 113	143	11.92	36.99
96	126	10.50	39.57	77 x 121	152	12.67	40.89
102	133	11.08	42.99	82 x 128	160	13.33	44.48
108	140	11.67	46.75	87 x 136	168	14.00	47.79
114	147	12.25	50.66	92 x 143	176	14.67	51.70
120	154	12.83	54.72	97 x 151	185	15.42	56.01
126	161	13.42	58.92				
132	168	14.00	63.27	106 x 168	202	16.83	64.48
144	182	15.17	72.40	116 x 180	218	18.17	73.58


TABLE NO. 1  
PAYLINE WIDTHS OF TRENCH AND PAY-QUANTITIES OF CONCRETE

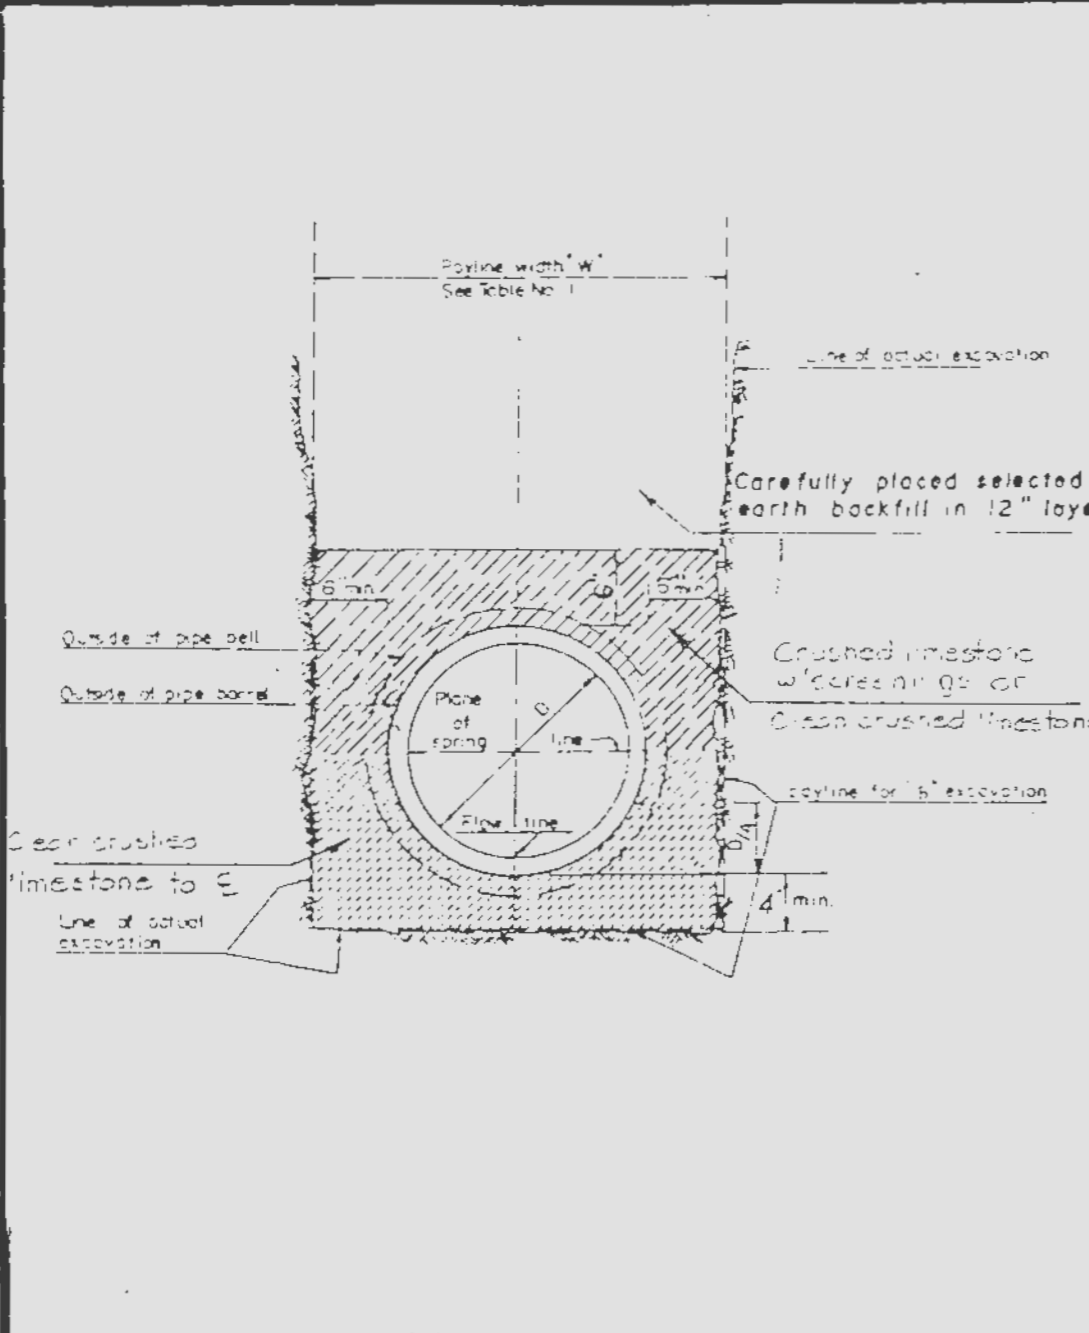


PIPE BEDDING CLASS "C" (FOR ALL PIPE EXCEPT REINFORCED CONCRETE PIPE) DETAIL 2

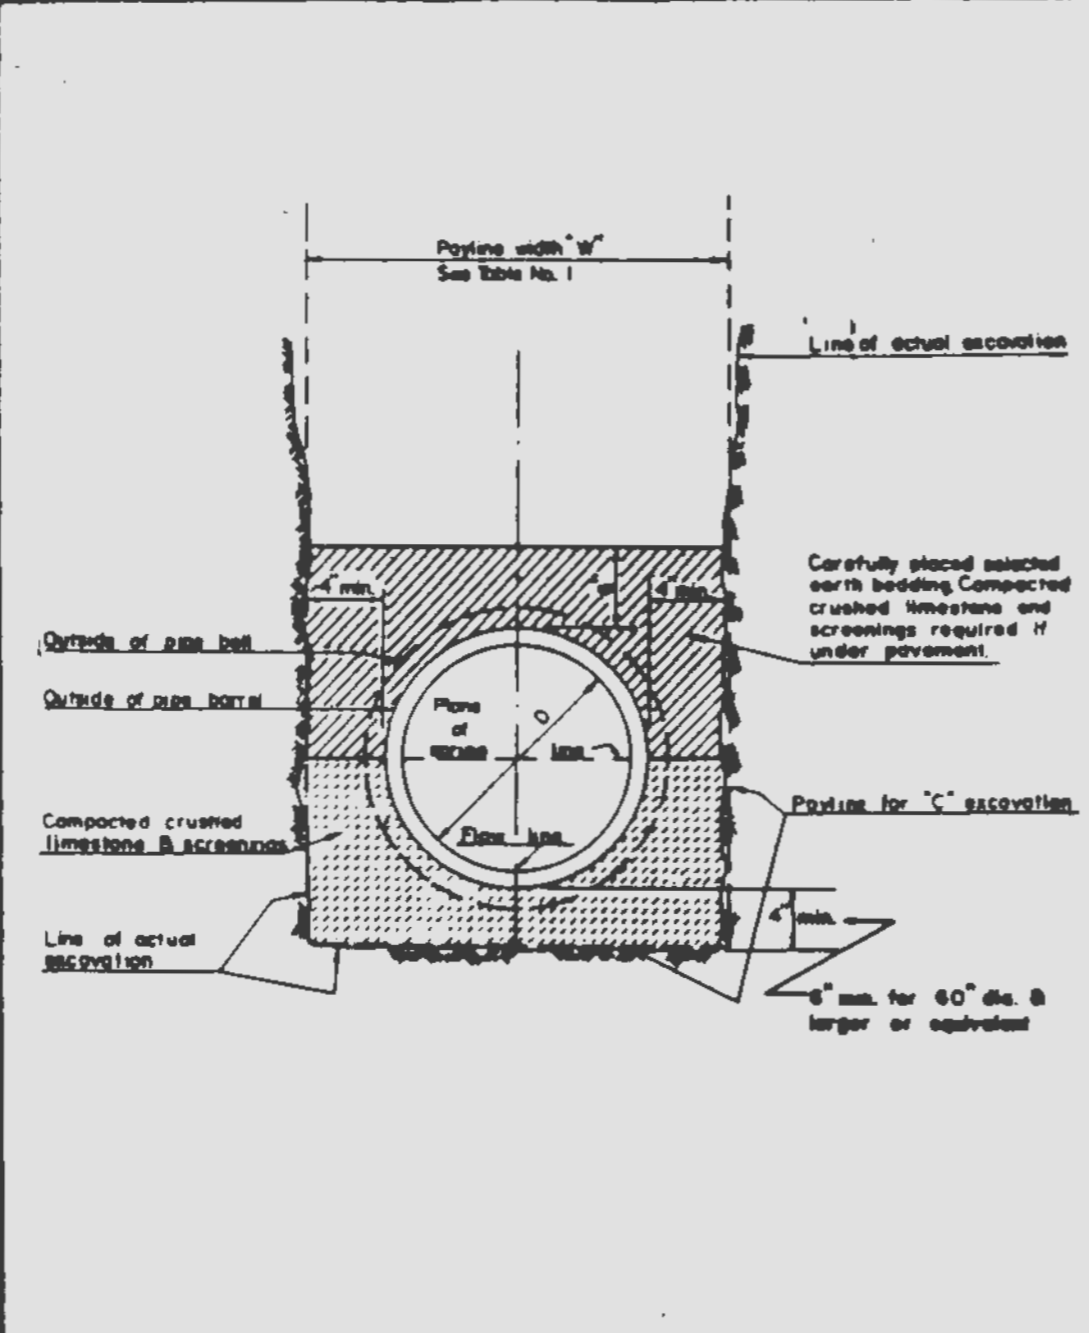

PIPE BEDDING CLASS "C" (MODIFIED FOR REINFORCED CONCRETE PIPE) DETAIL 3

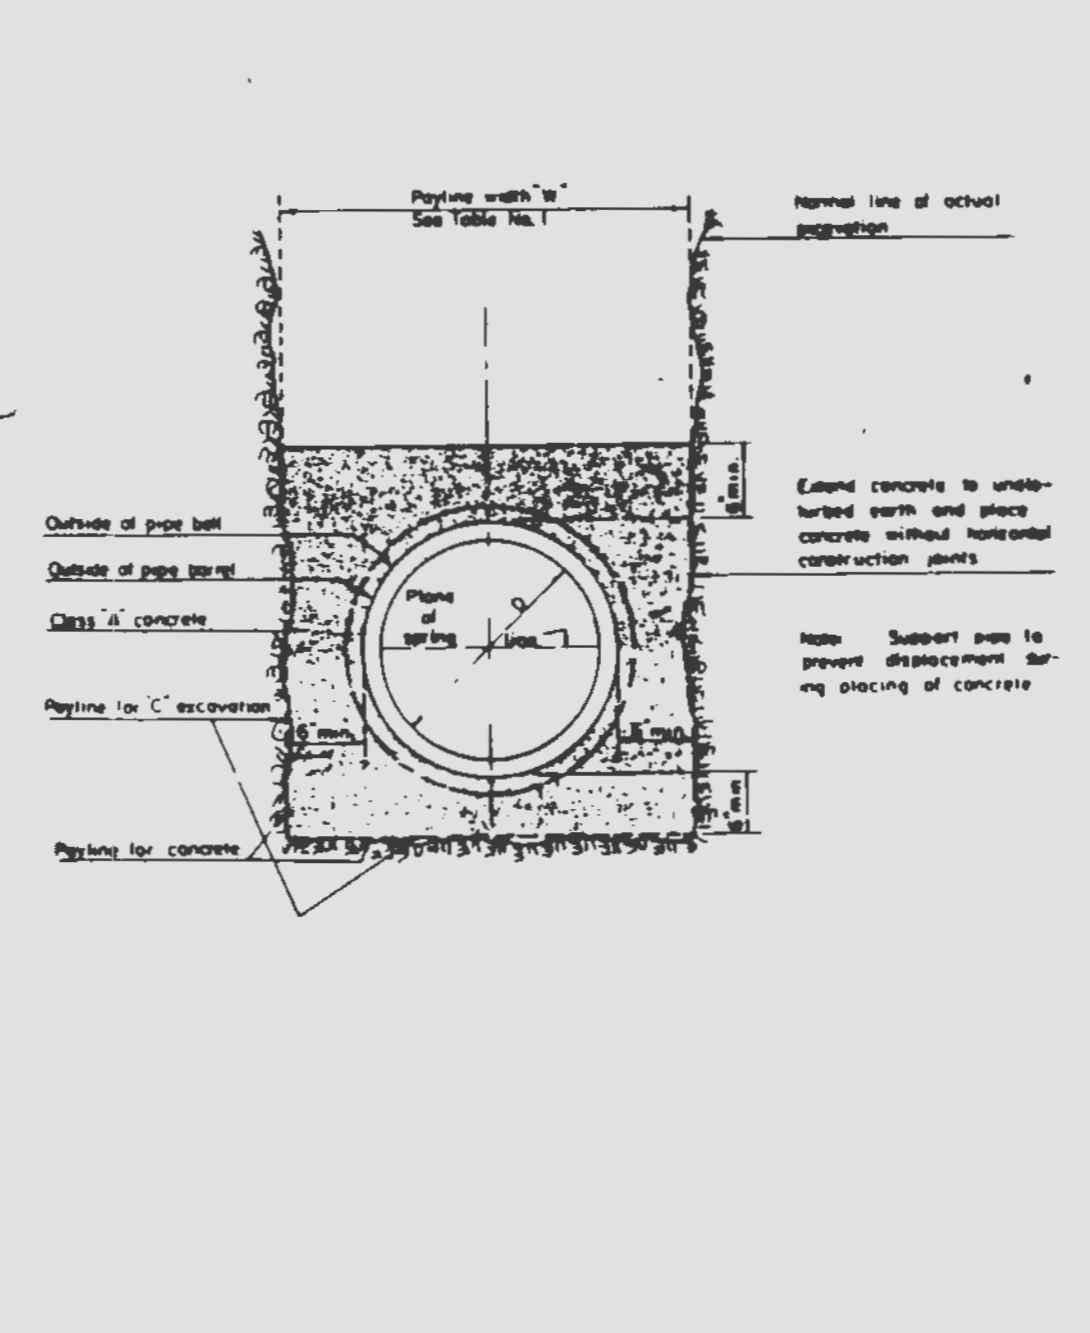

CONCRETE ENCASEMENT DETAIL 4

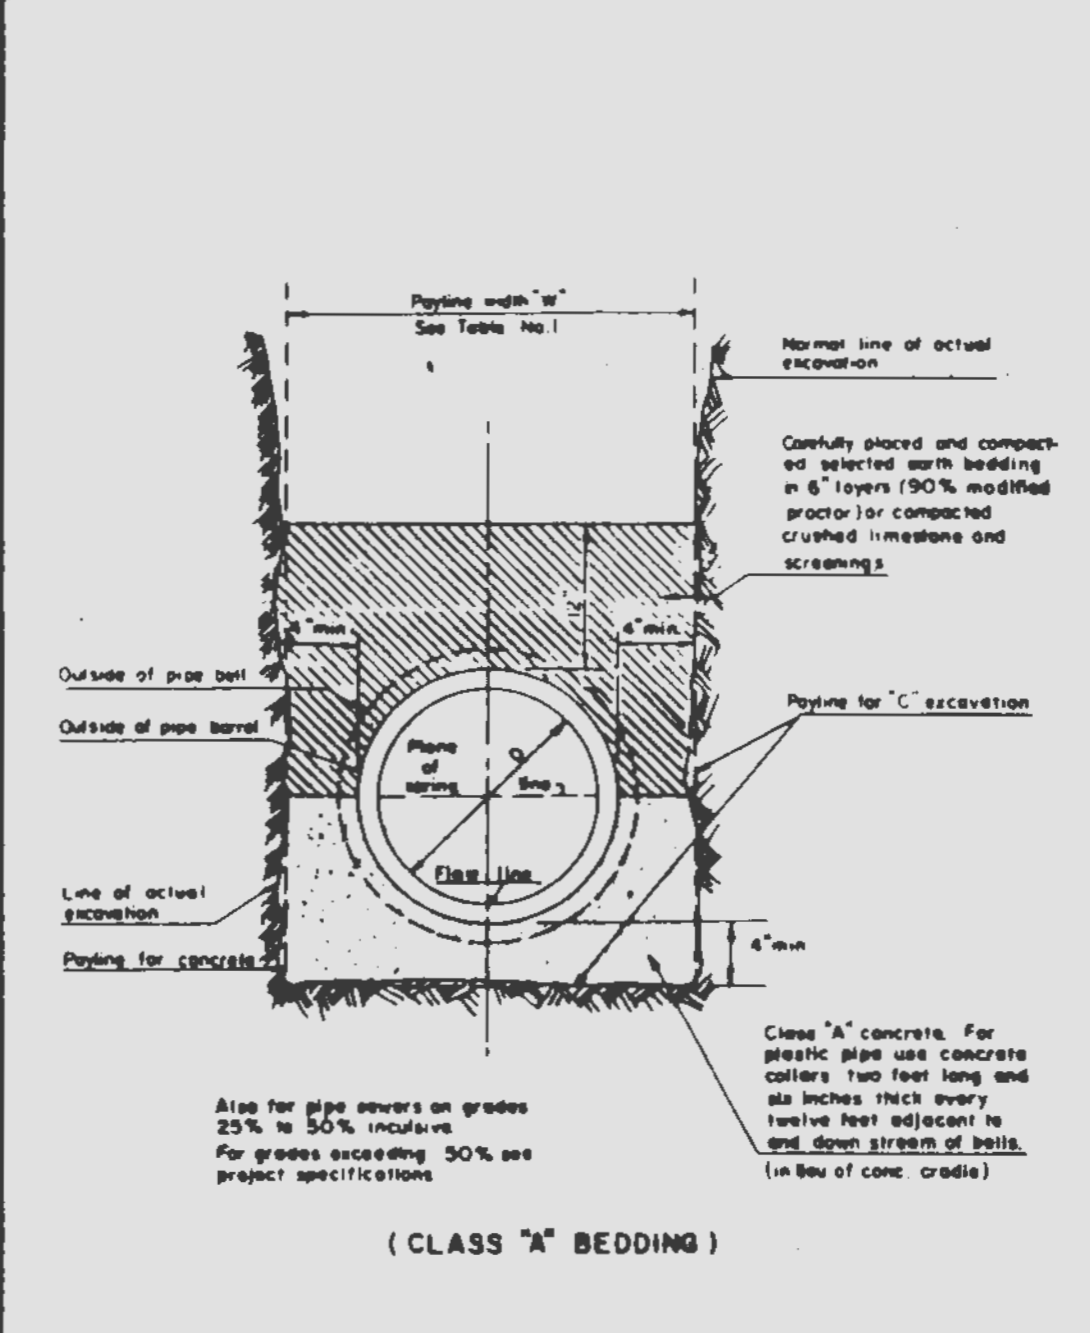


CONCRETE CRADLE DETAIL 5


MONTICELLO-VILLAGE A  
CONSTRUCTION DETAILS  
February, 1992 85-064U  
Rev. 3/5/92 per Duckett Creek-DWD

Section of Manhole	Dimension
Top	Upper 2'-2 1/2" Dia.
Transition	Lower 3'-6" Dia.
Bottom Section	6" thru 24" Dia. Pipe 3'-6" Dia.
Bottom Section	27" thru 36" Dia. Pipe 3'-6" Square


TABLE NO. 2  
STANDARD MANHOLE DIMENSIONS DETAIL 6

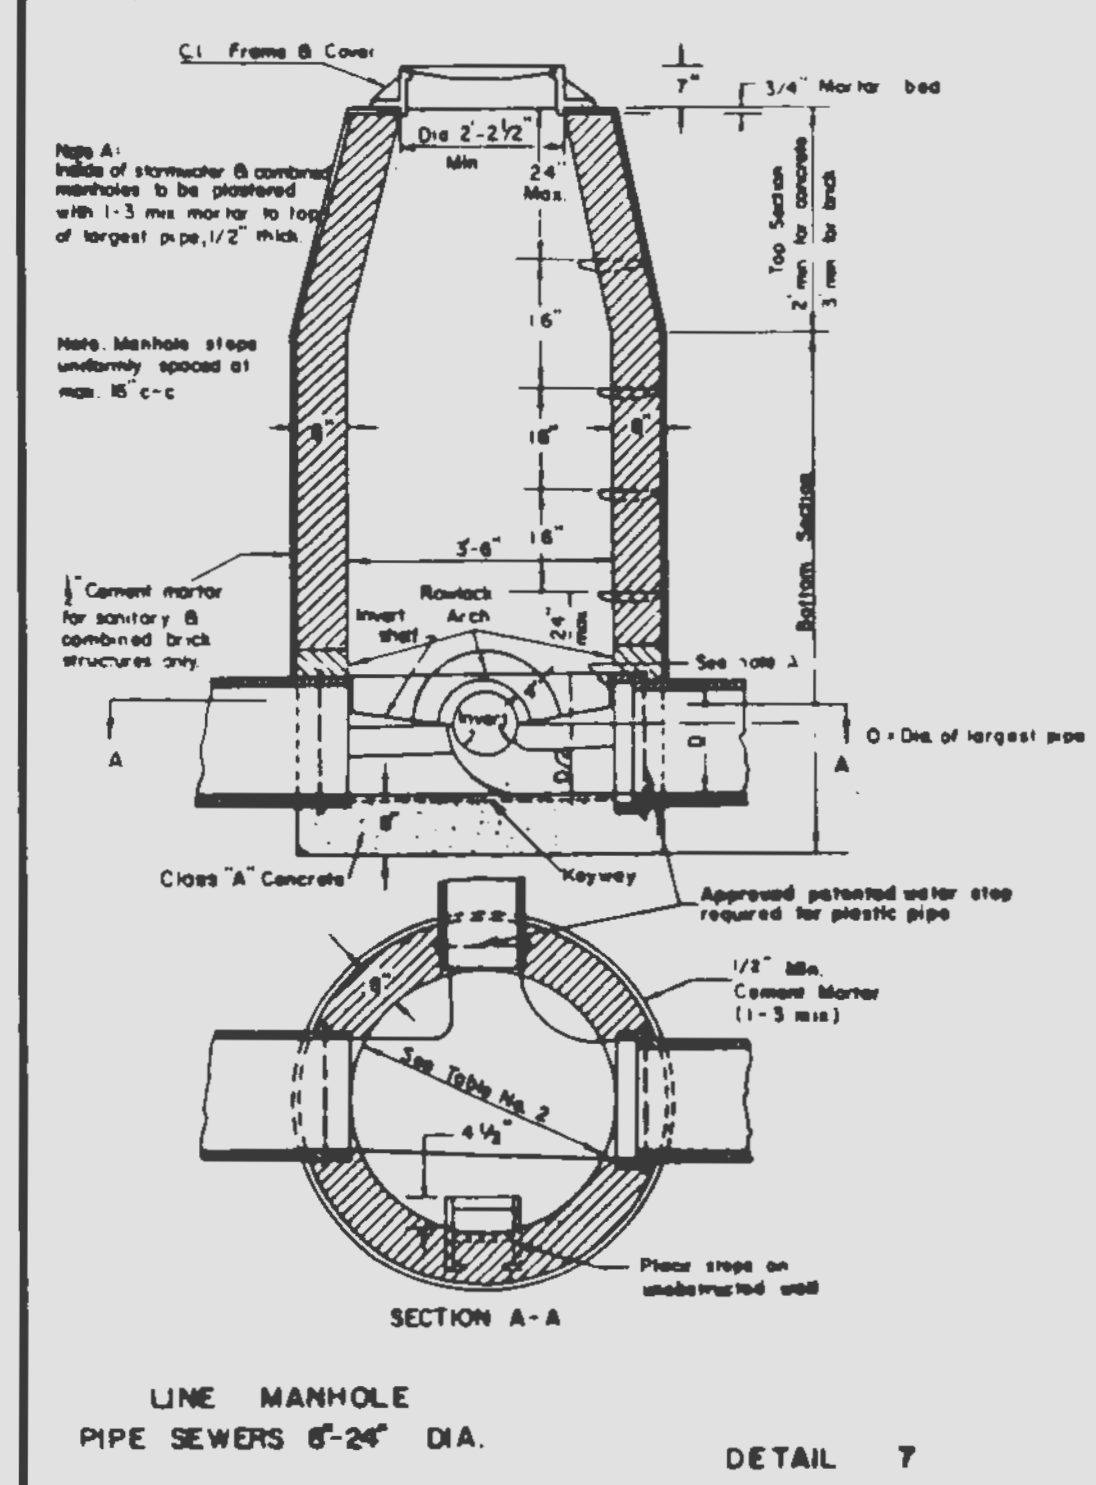


LINE MANHOLE PIPE SEWERS 6"-24" DIA. DETAIL 7

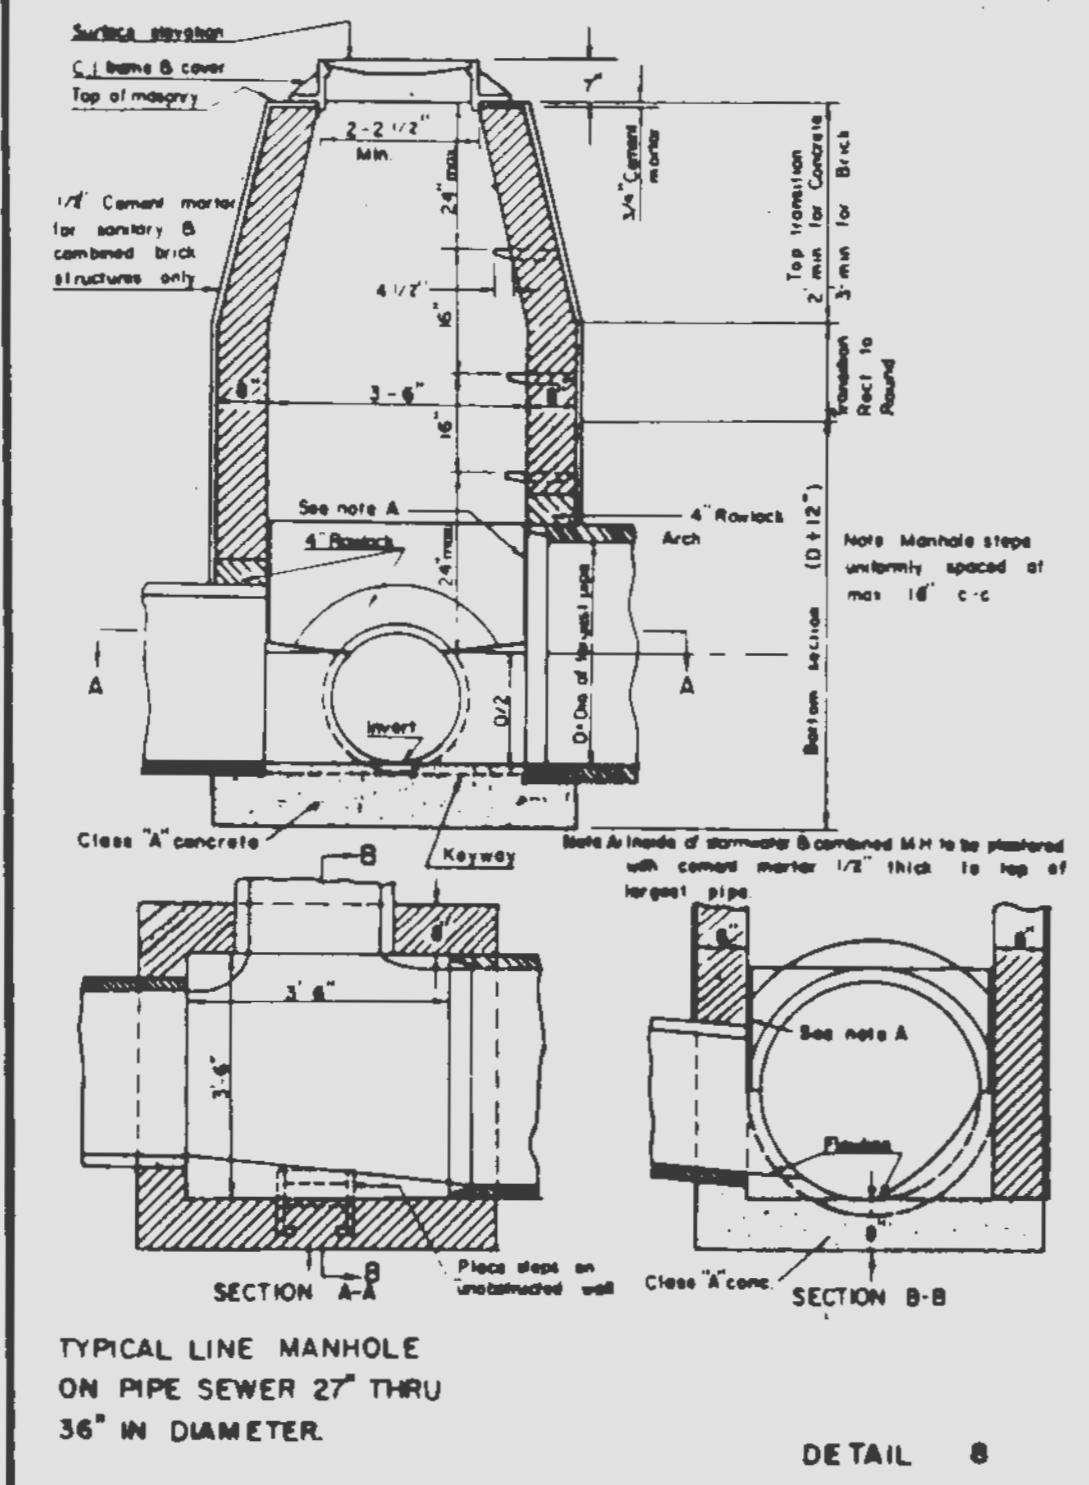


TYPICAL LINE MANHOLE ON PIPE SEWER 27" THRU 36" IN DIAMETER DETAIL 8

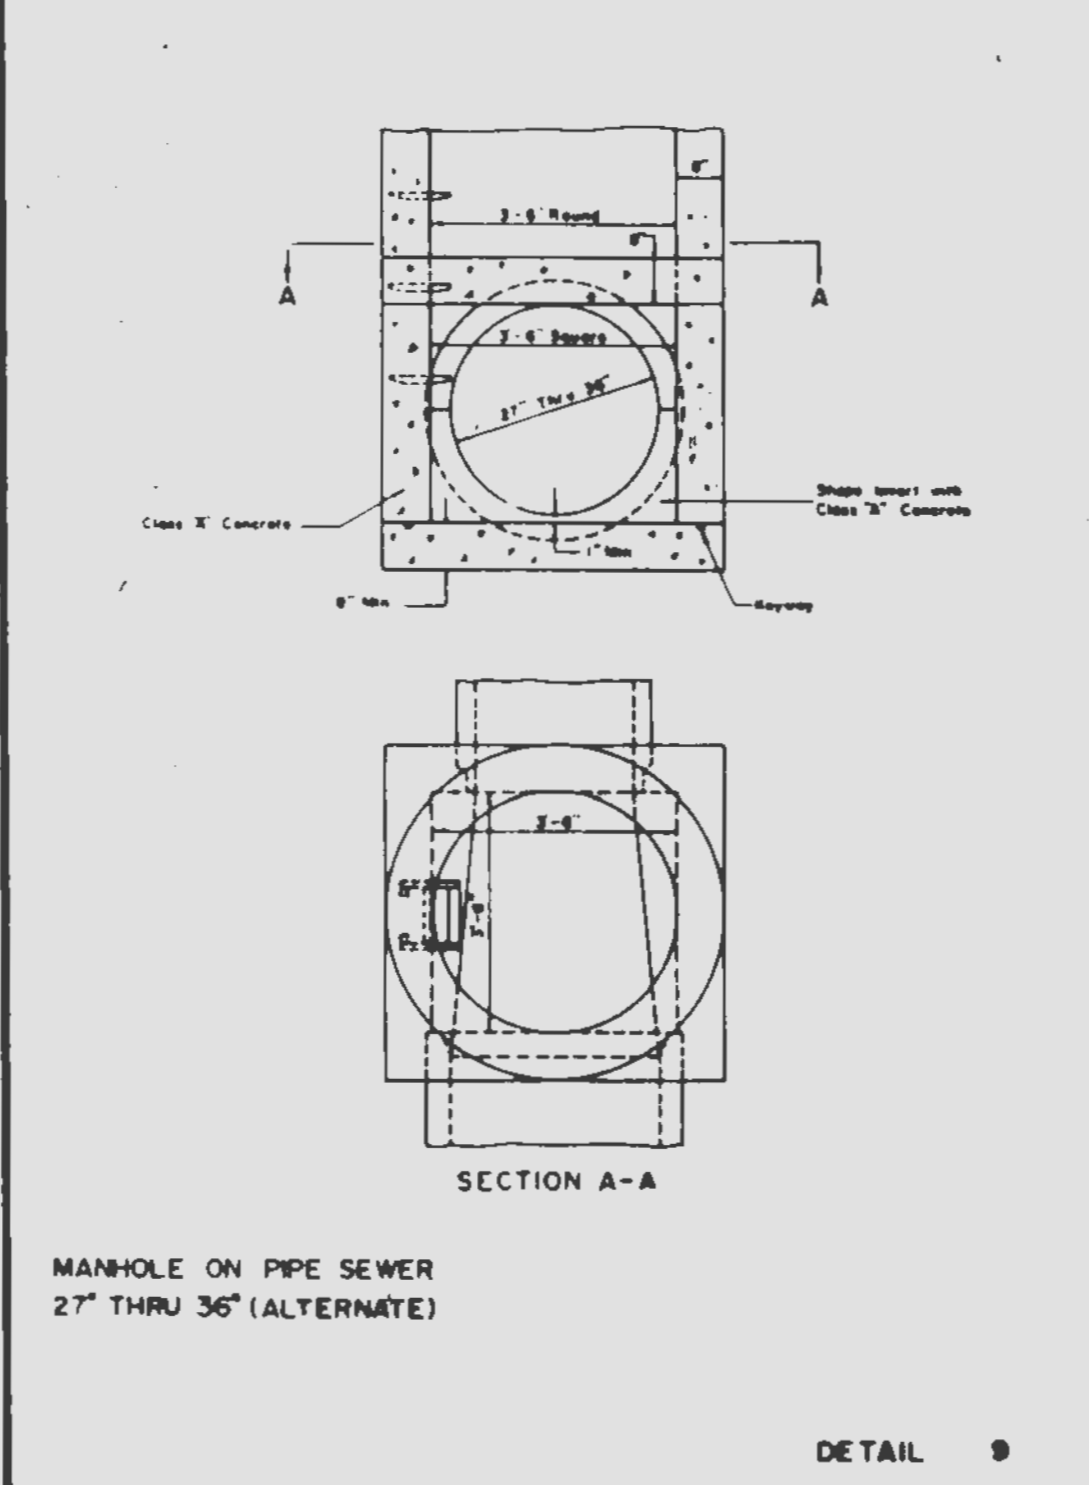


MANHOLE ON PIPE SEWER 27" THRU 36" (ALTERNATE) DETAIL 9

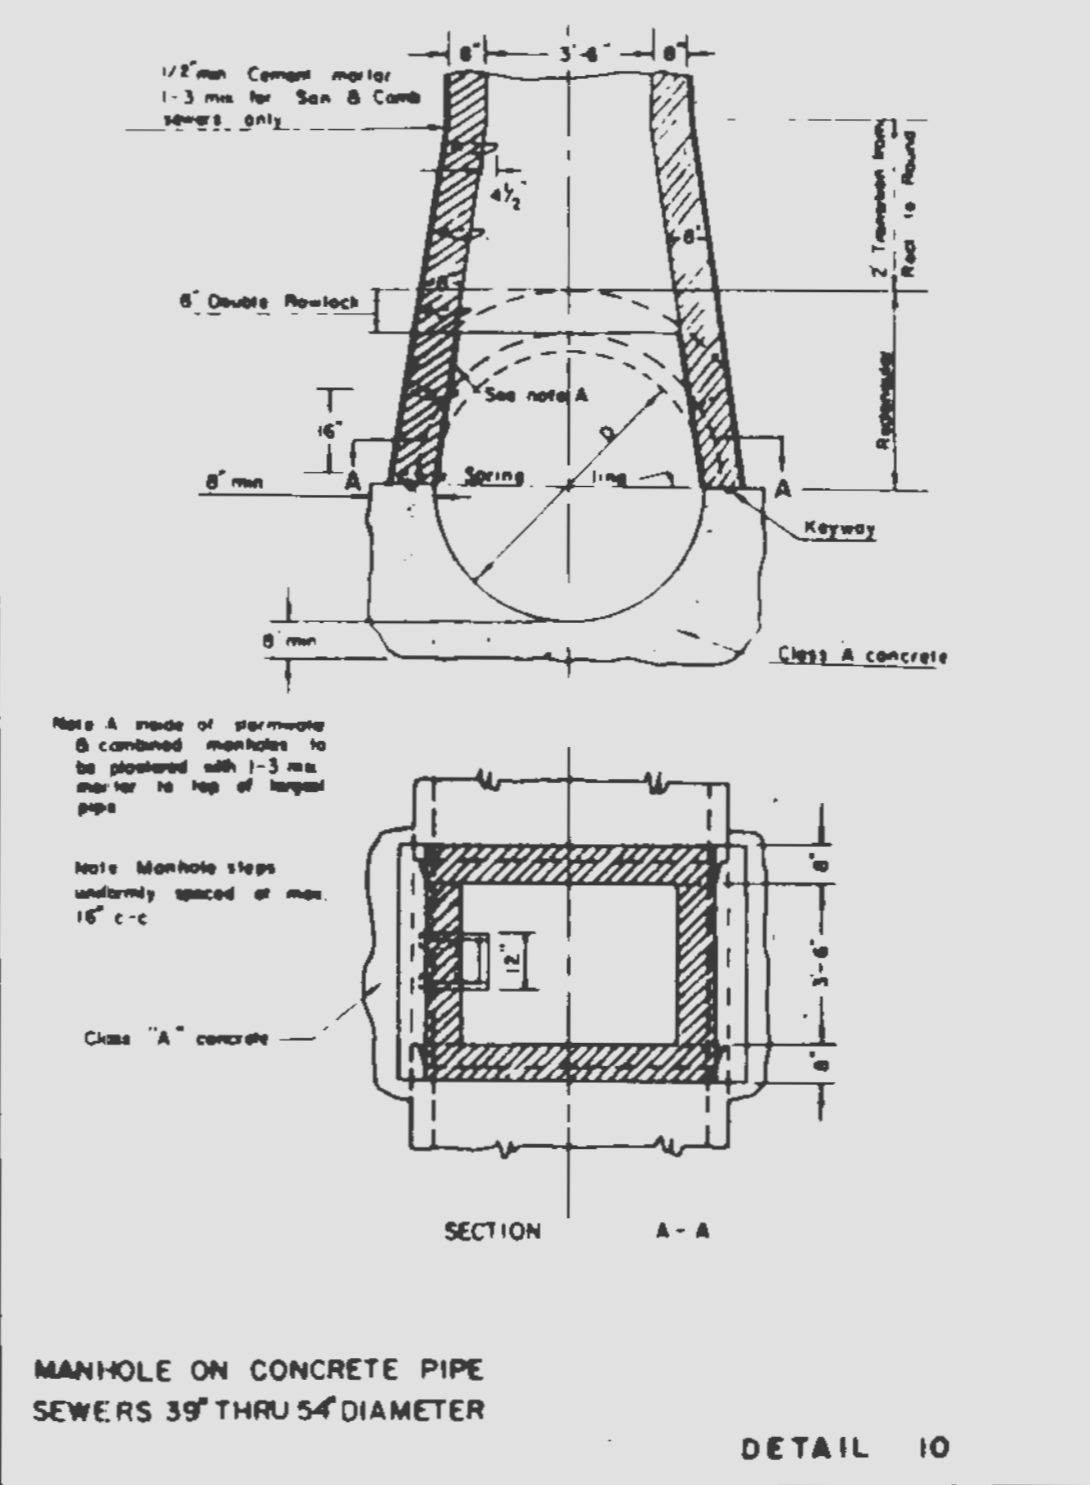


MANHOLE ON CONCRETE PIPE SEWERS 39" THRU 54" DIAMETER DETAIL 10

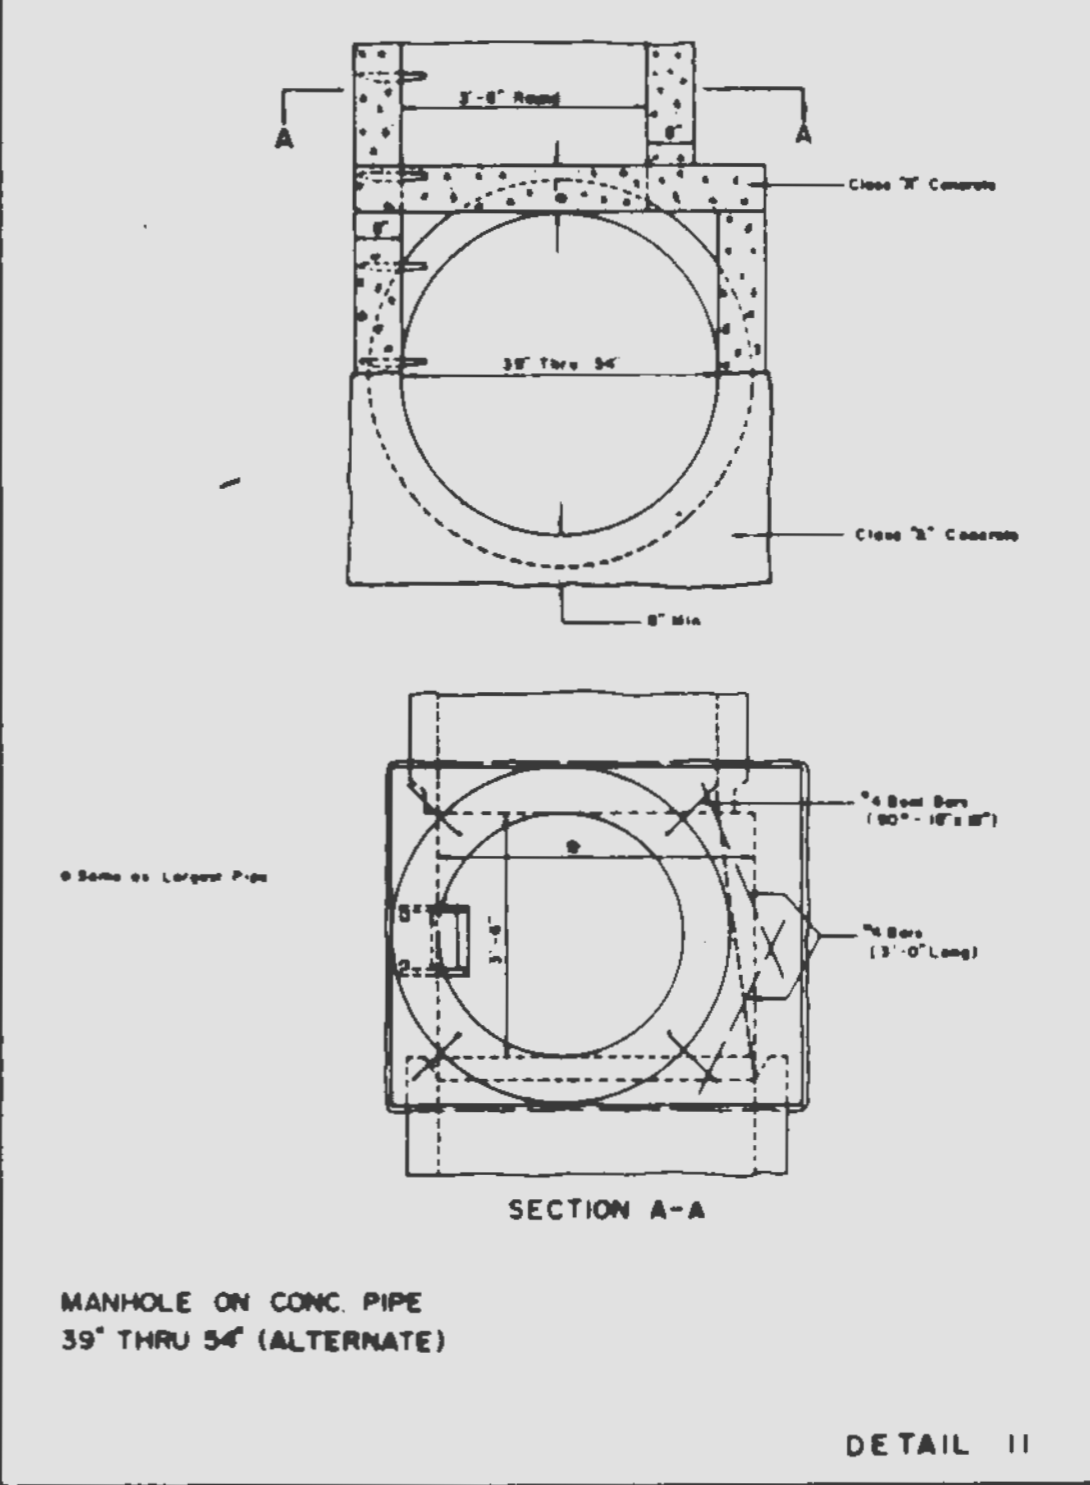


MANHOLE ON CONC PIPE 39" THRU 54" (ALTERNATE) DETAIL 11

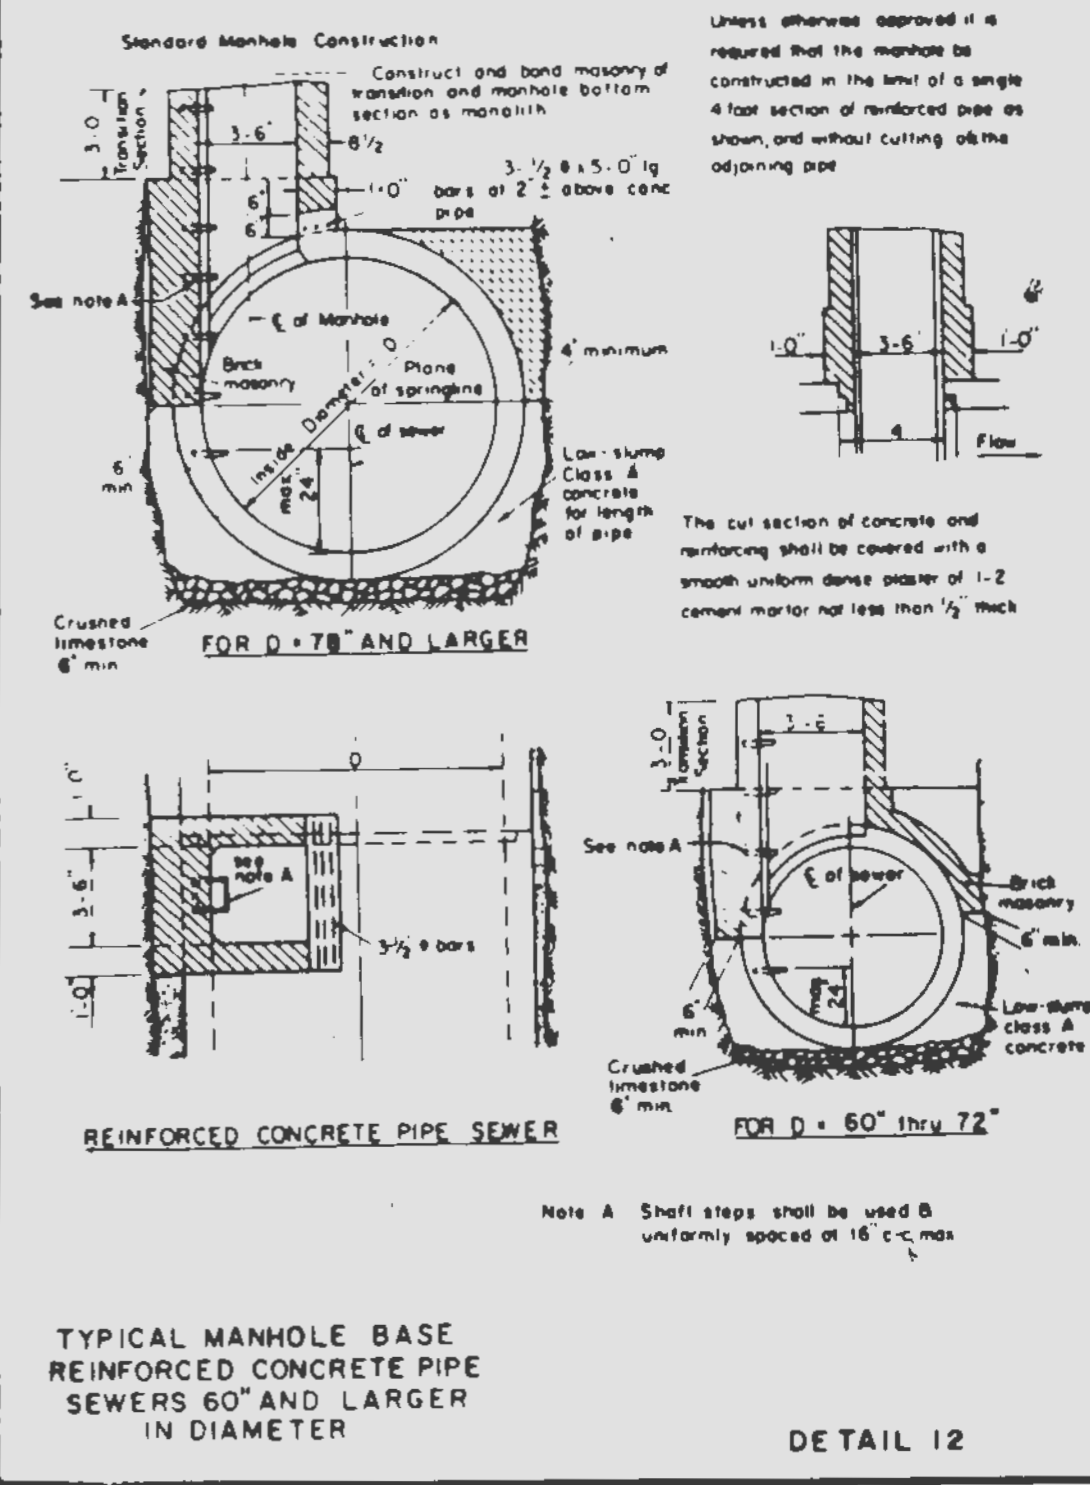


TYPICAL MANHOLE BASE REINFORCED CONCRETE PIPE SEWERS 60" AND LARGER IN DIAMETER DETAIL 12

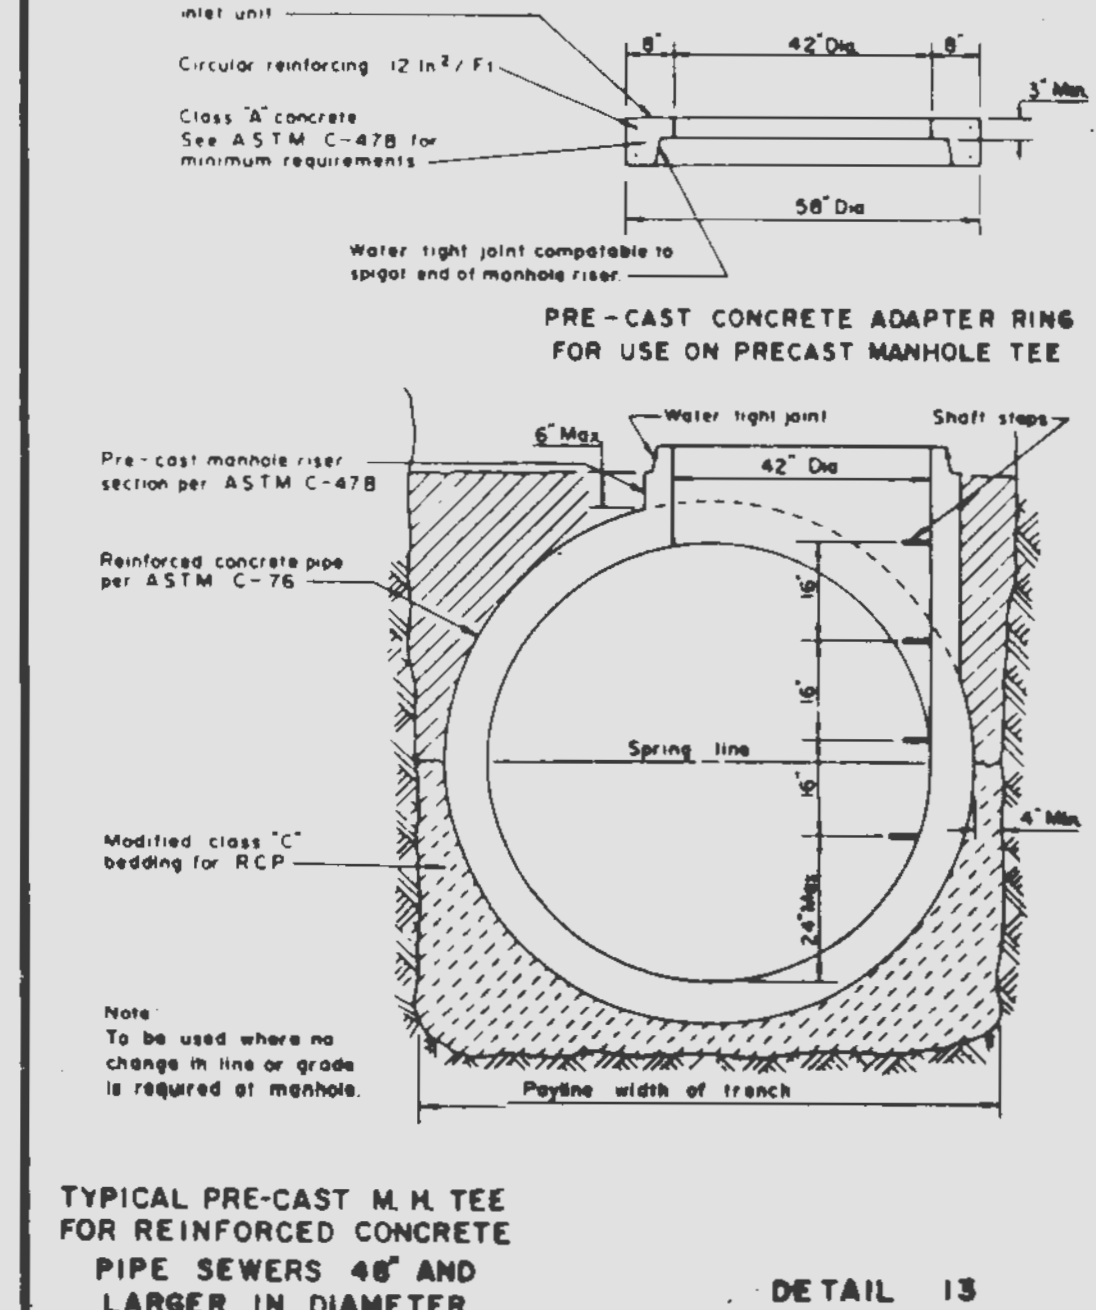


TYPICAL PRE-CAST M.H. TEE FOR REINFORCED CONCRETE PIPE SEWERS 48" AND LARGER IN DIAMETER DETAIL 13

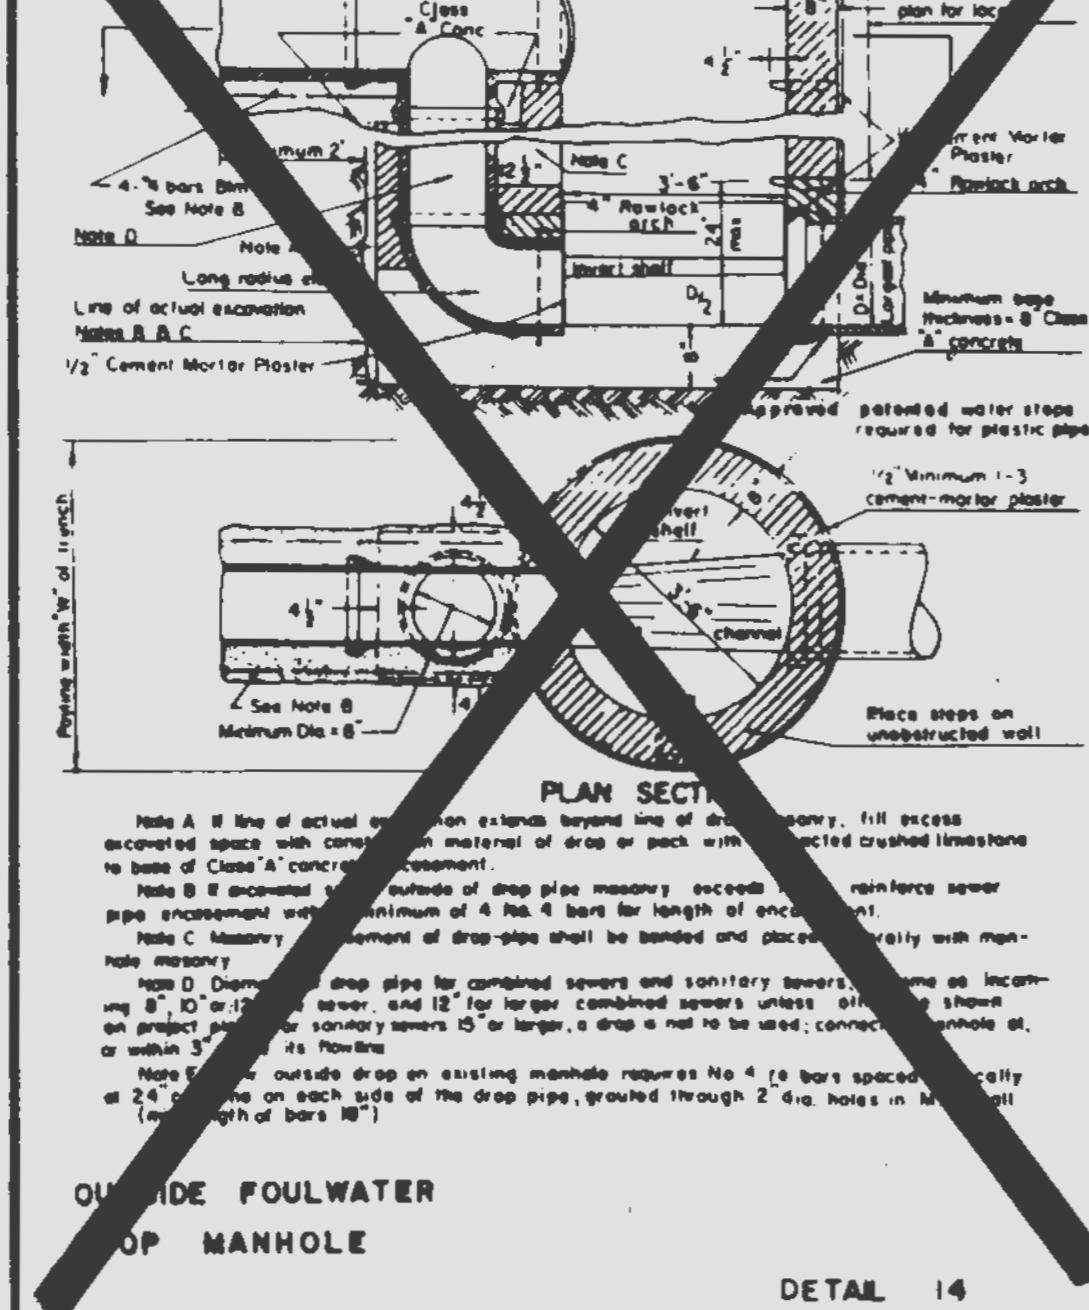


QUINCE FOULWATER DROP MANHOLE DETAIL 14

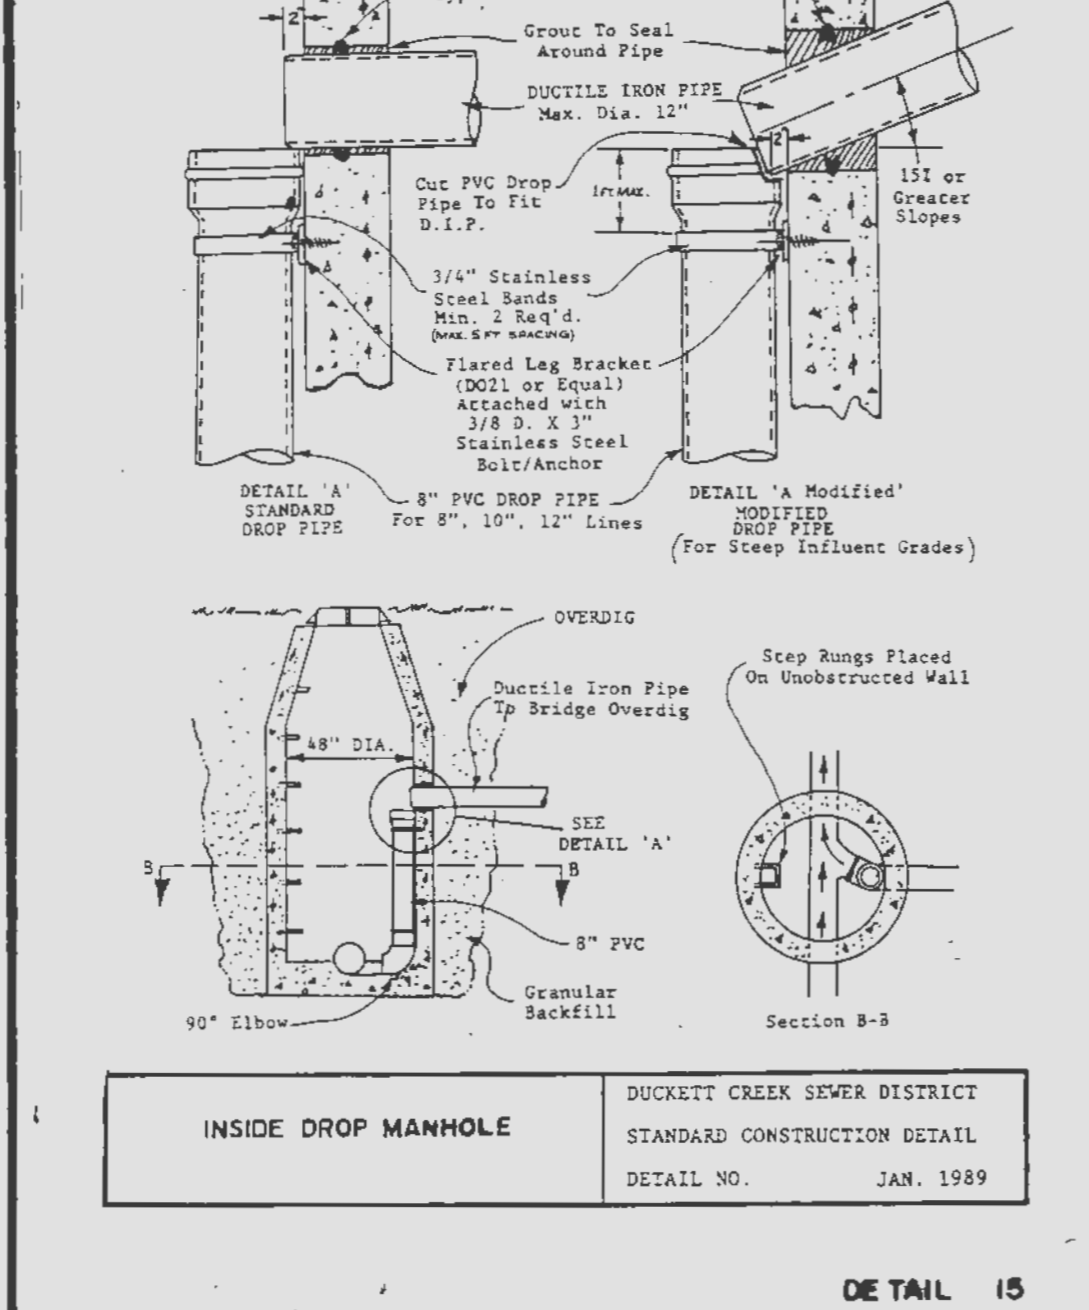


INSIDE DROP MANHOLE DETAIL 15

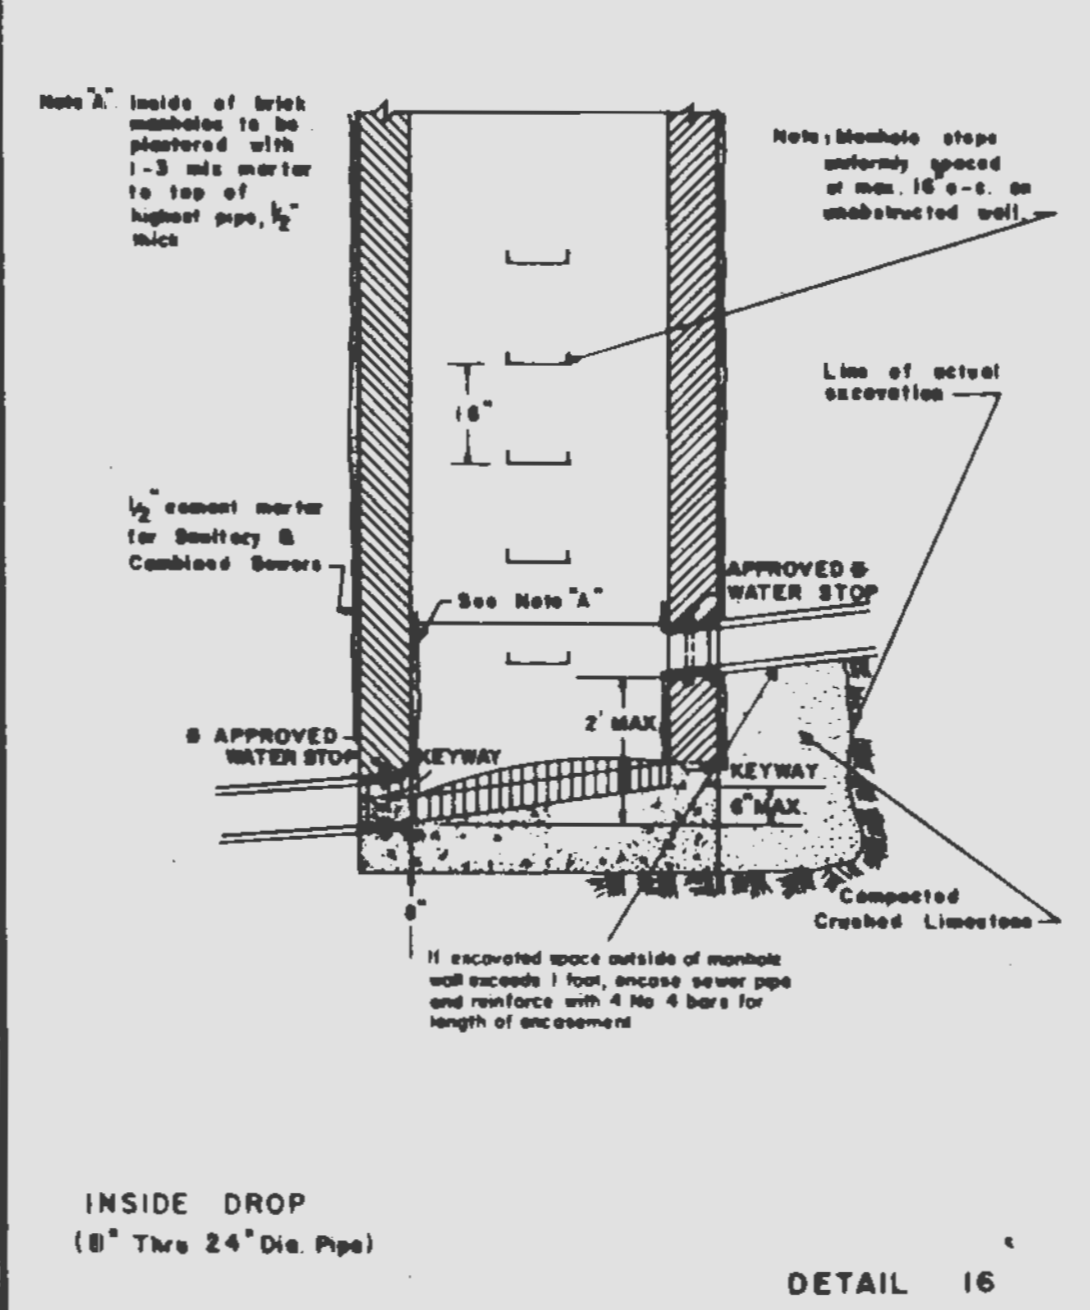

INSIDE DROP (8" THRU 24" DIA. PIPE) DETAIL 16

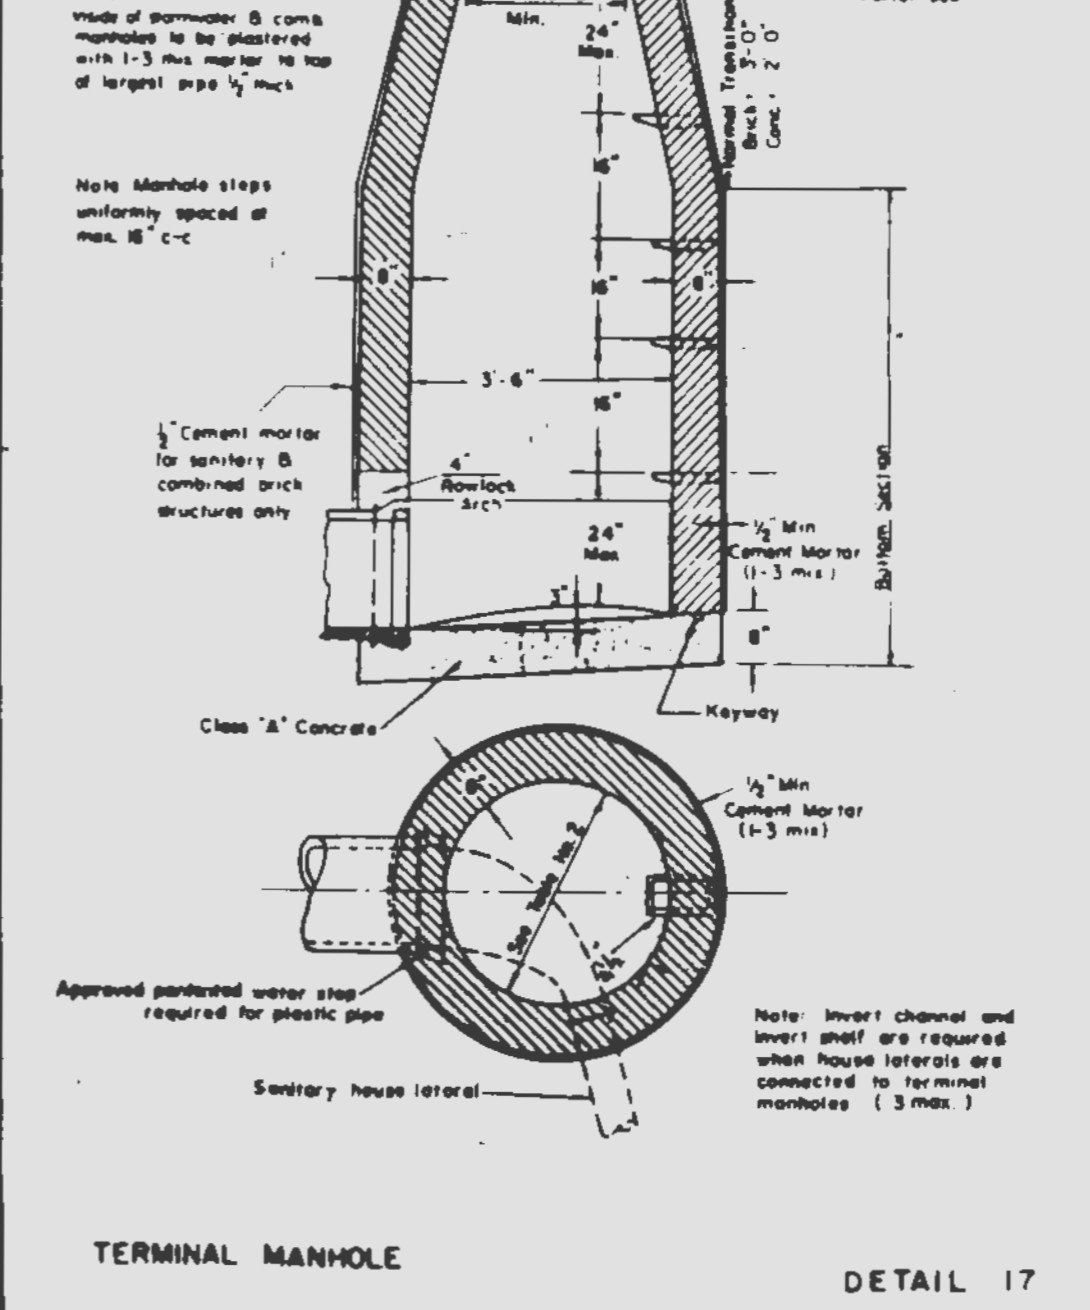

TERMINAL MANHOLE DETAIL 17

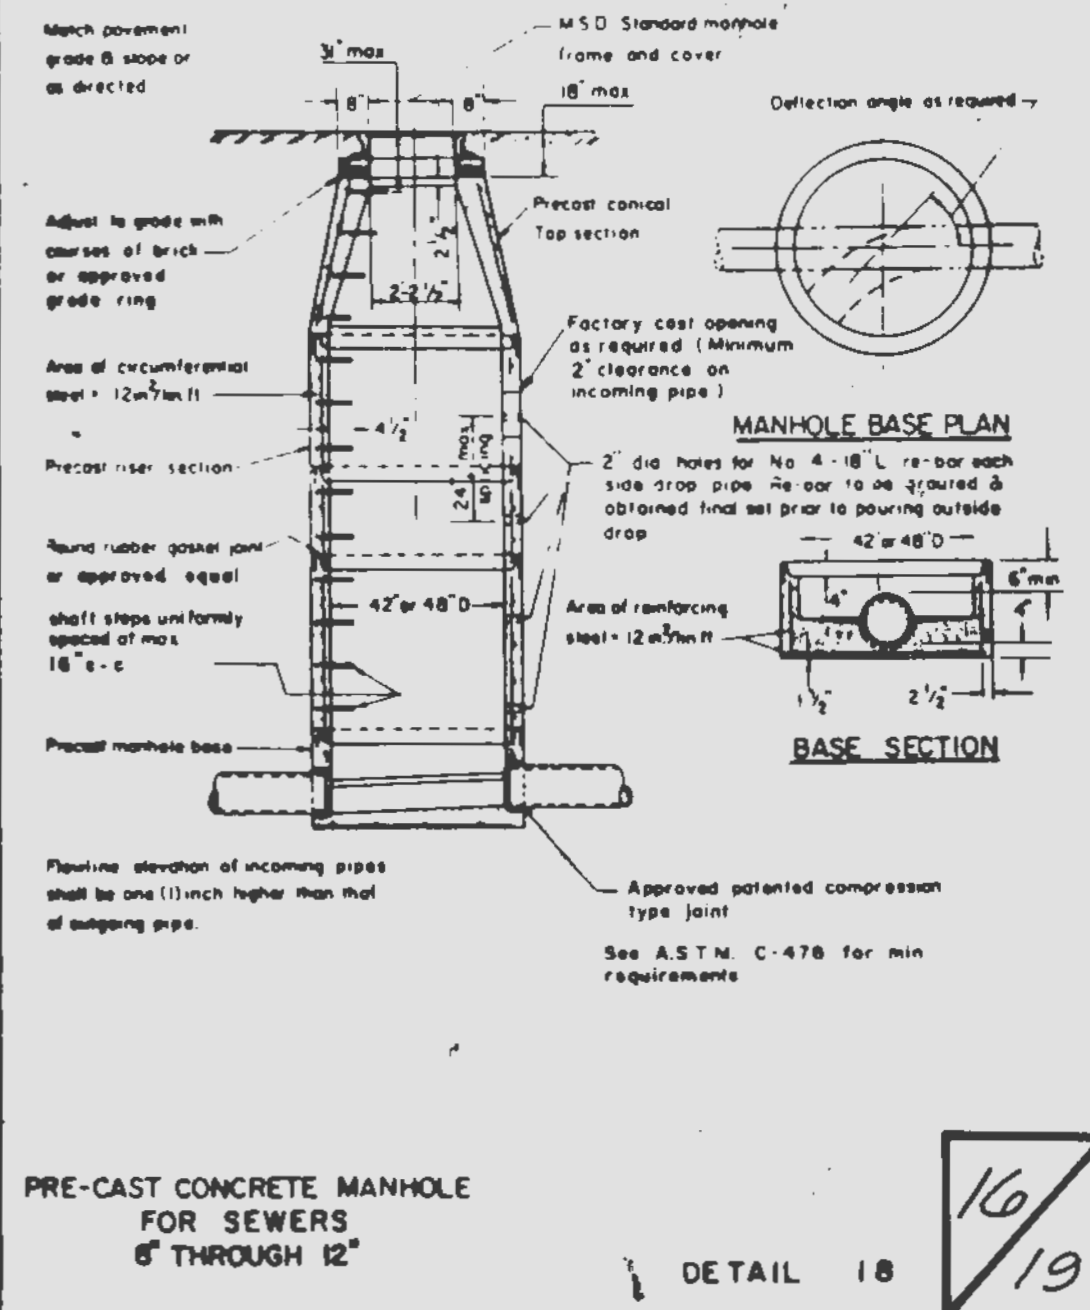

PRE-CAST CONCRETE MANHOLE FOR SEWERS 6" THROUGH 12" DETAIL 18