


Revisions		
Rev.	Date	By
1	5/10/00	PAUL

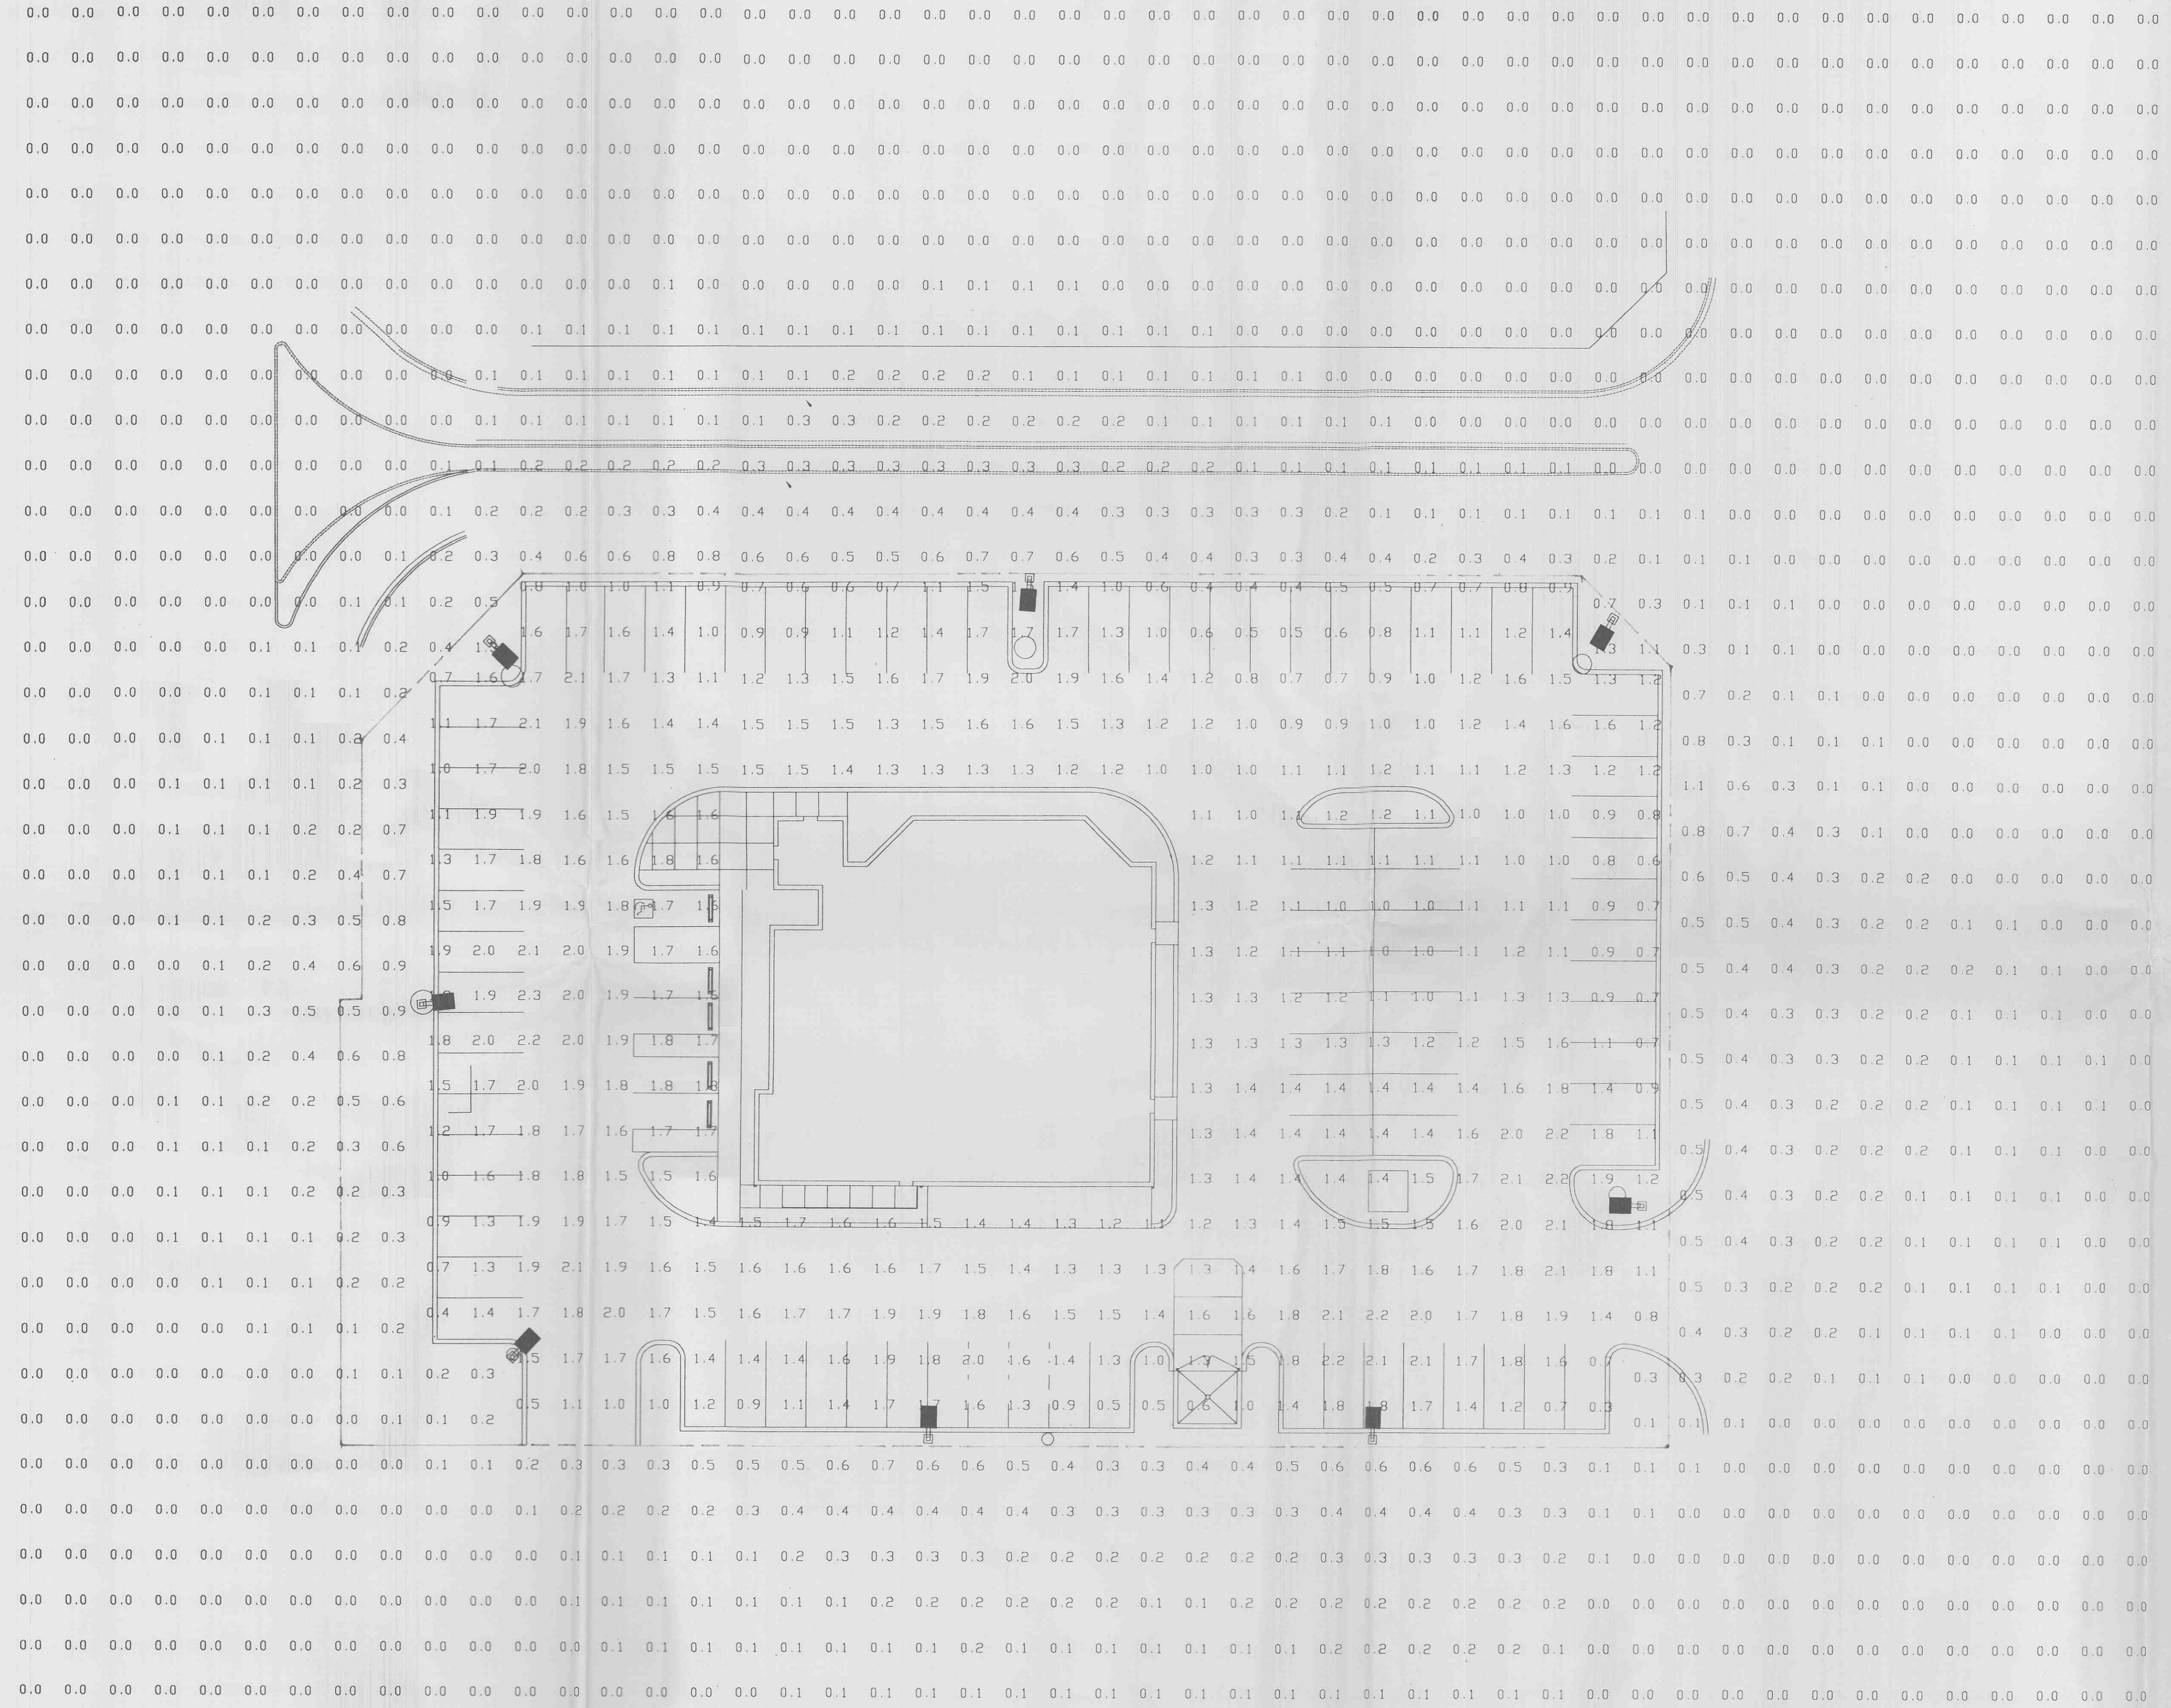

MAINTAINED FOOTCANDLE VALUES AT GRADE,
USING A .75 MAINTENANCE FACTOR.

Summary	
# POINTS	428
AVERAGE	1.4
MAXIMUM	2.3
MINIMUM	0.3
AVG/MIN	5.00
MAX/MIN	8.17

Based on the information provided, all dimensions and luminaire locations shown represent recommended positions. The engineer and/or architect must determine applicability of the layout to existing or future field conditions.

NOTE: ALL 40' POLES TO BE MOUNTED ON CONCRETE PEDESTALS 3' ABOVE GRADE, FOR A TOTAL MOUNTING HEIGHT OF 43'.

This lighting pattern represents illumination levels calculated from laboratory data taken under controlled conditions in accordance with Illuminating Engineering Society approved methods. Actual performance of any manufacturer's luminaire may vary due to variation in electrical voltage, tolerance in lamps, and other variable field conditions.

										WLS LIGHTING SYSTEMS PO BOX 100519 FORT WORTH, TEXAS 76185 1-800-633-8711 FAX 817-735-4824				
										LIGHTING PROPOSAL FOR <i>o' charley's</i>				
A	8	40' POLE	1							WLS-VFP-400-SMV-HSS	1	458		
TYPE QTY		POLE	QTY	BRACKET QTY		OTHER QTY		FIXTURE QTY		WATTS/ASSEMBLY		SCALE: 1"=20'		
ASSEMBLY		ASSEMBLIES EACH CONSISTING OF:										3664	4/25/00	WL-41433
										TOTAL WATTS BY: PAUL		SHEET 1 OF 1		