



PLAN AT TRASH ENCLOSURE GATE

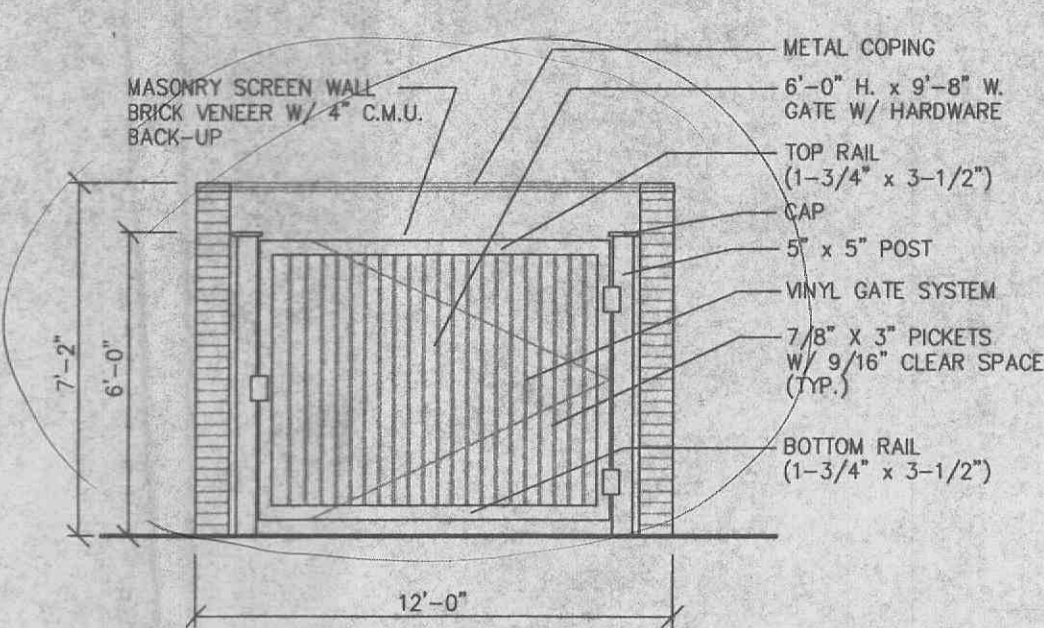


ELEVATION AT TRASH ENCLOSURE GATE

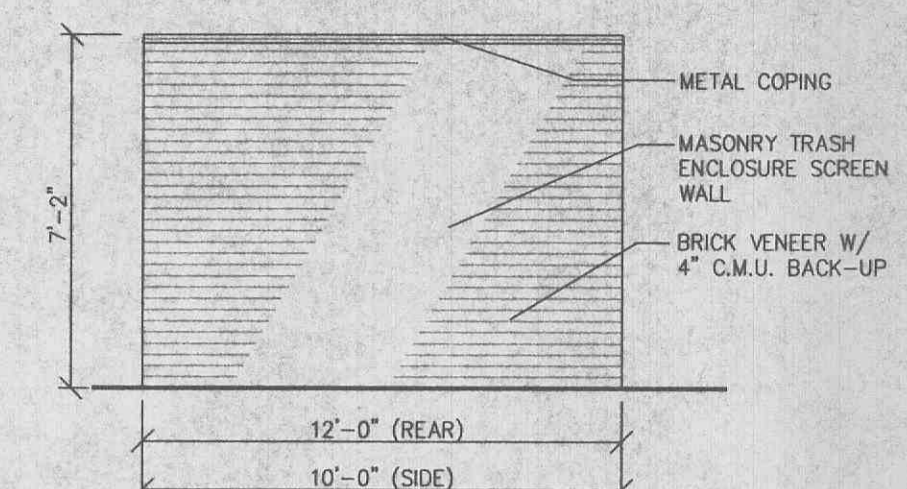


REAR AND SIDE VIEW OF TRASH ENCLOSURE


MASONRY TRASH ENCLOSURE
NOT TO SCALE

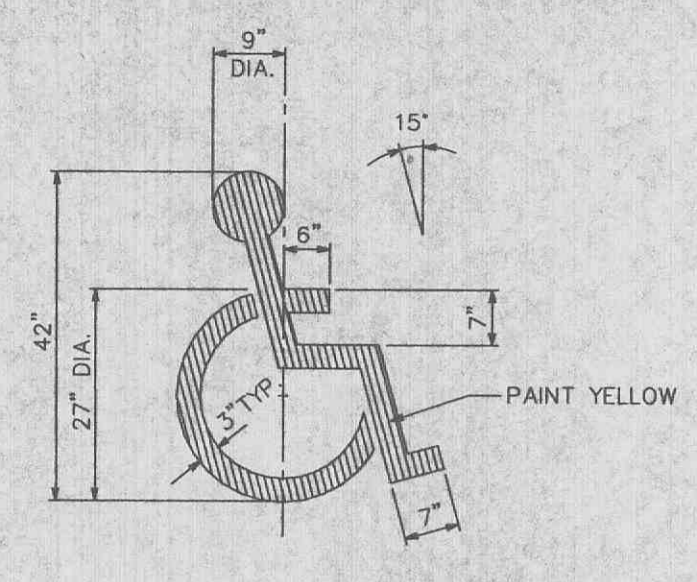


PAINTED HANDICAPPED PARKING SYMBOL
NOT TO SCALE

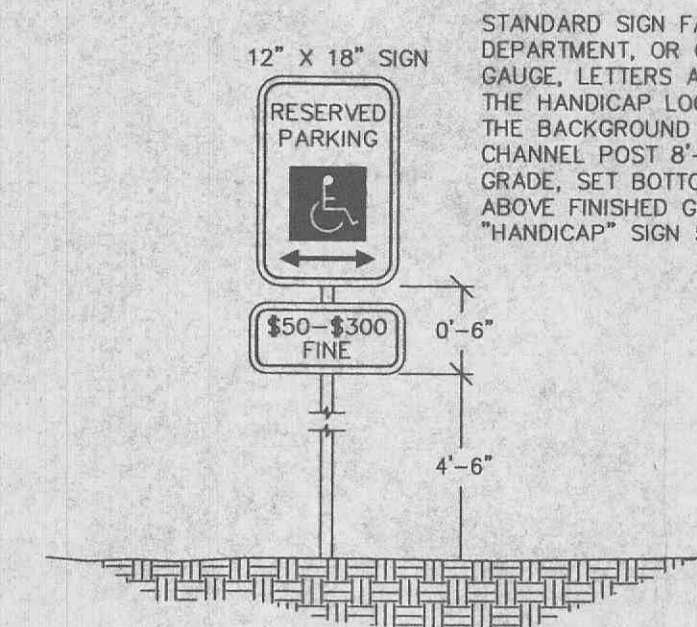


HANDICAP PARKING SIGN (ST. CHARLES CITY)
NOT TO SCALE

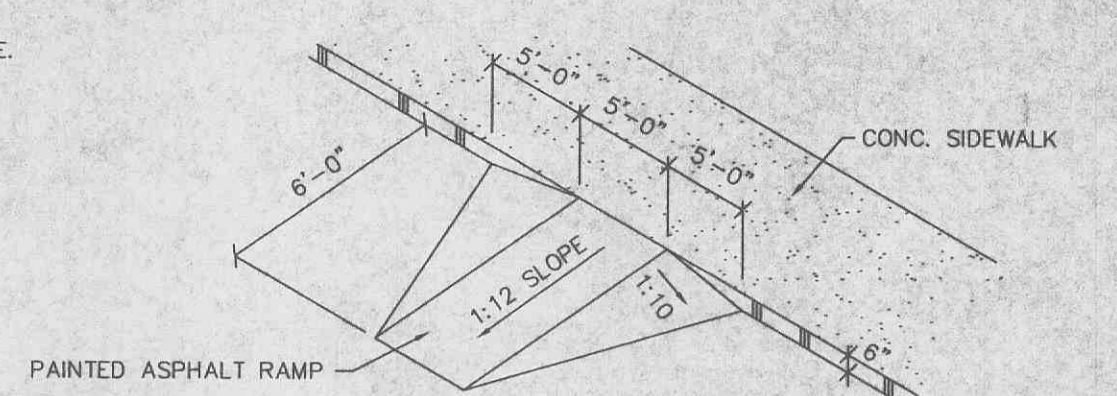


HANDICAPPED RAMP DETAIL
NOT TO SCALE

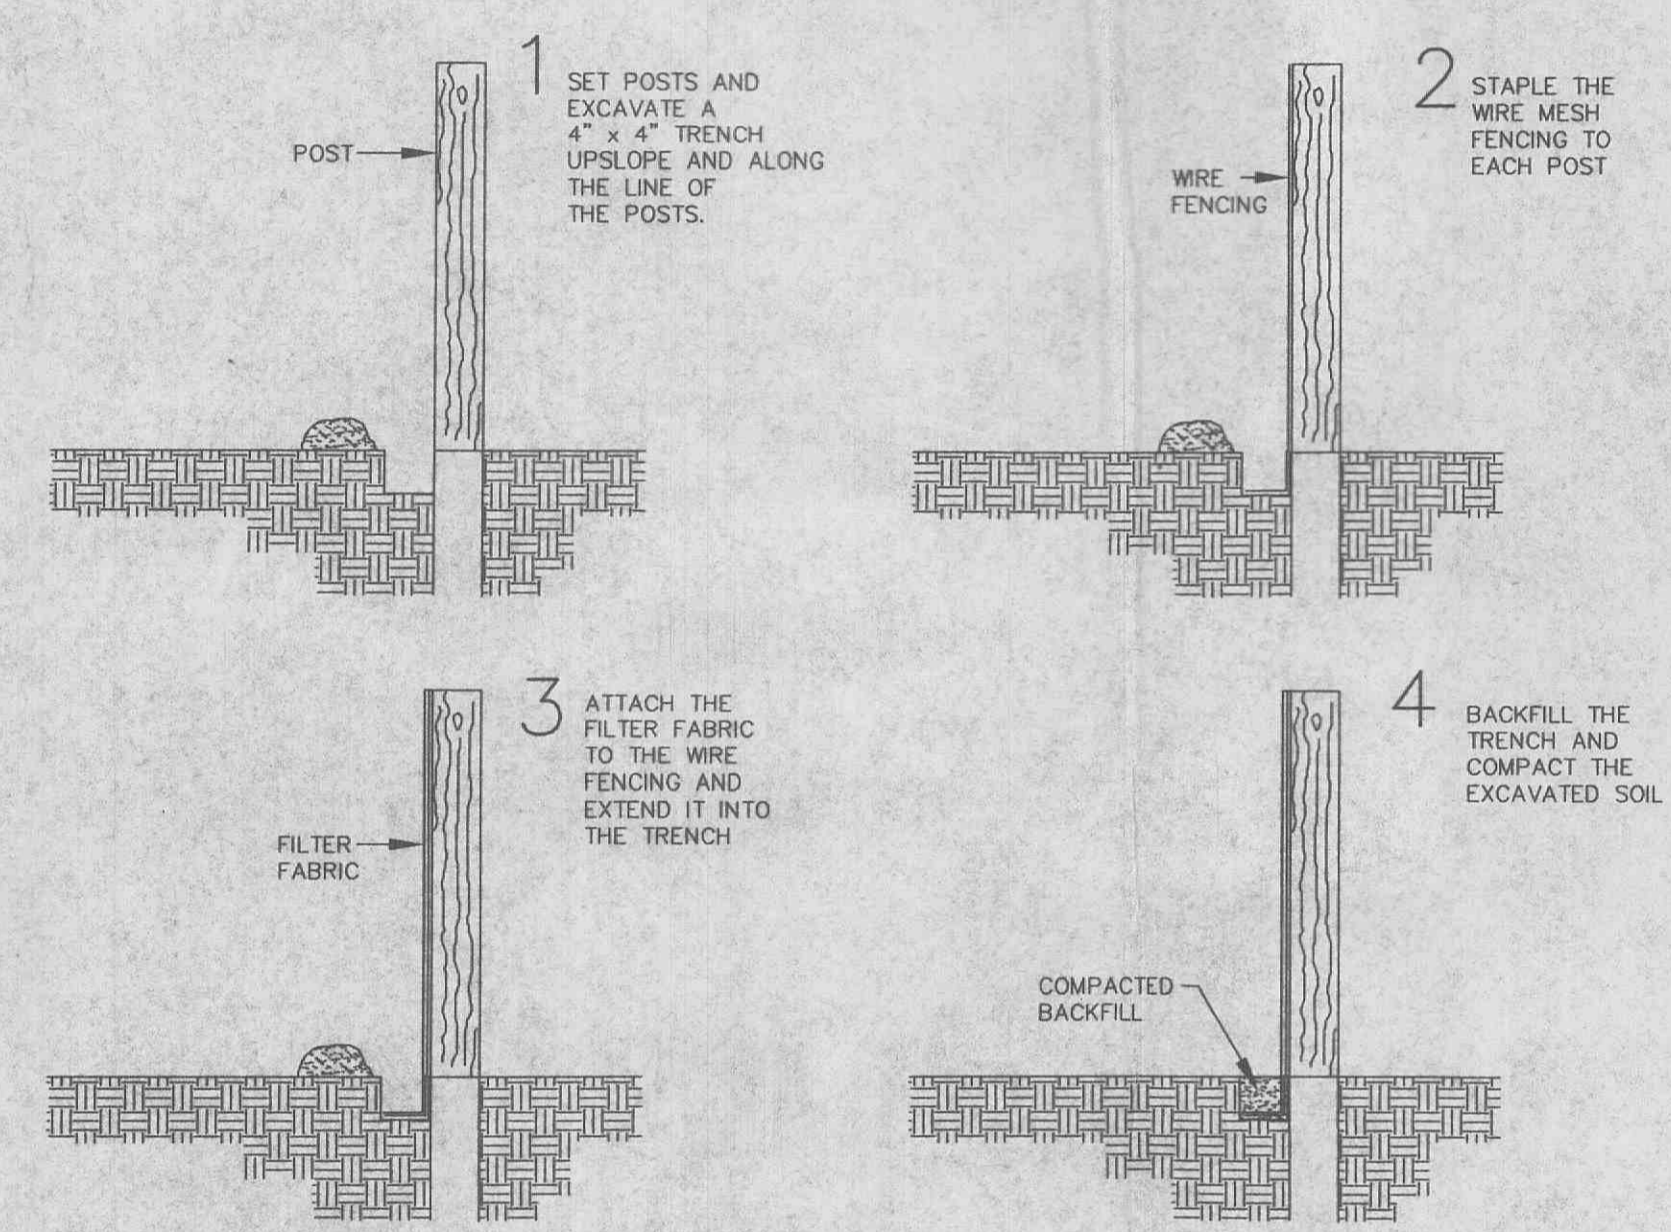


1. FILTER BARRIERS SHALL BE INSPECTED IMMEDIATELY AFTER EACH RAINFALL AND AT LEAST DAILY DURING PROLONGED RAINFALL. ANY REQUIRED REPAIRS SHALL BE MADE IMMEDIATELY.
2. SHOULD THE FABRIC DECOMPOSE OR BECOME INEFFECTIVE PRIOR TO THE END OF THE EXPECTED USABLE LIFE AND THE BARRIER STILL BE NECESSARY, THE FABRIC SHALL BE REPLACED PROMPTLY.
3. SEDIMENT DEPOSITS SHOULD BE REMOVED AFTER EACH STORM EVENT. THEY MUST BE REMOVED WHEN DEPOSITS REACH APPROXIMATELY HALF THE HEIGHT OF THE BARRIER.
4. ANY SEDIMENT DEPOSITS REMAINING IN PLACE AFTER THE SILT FENCE OR FILTER BARRIER IS NO LONGER REQUIRED SHALL BE DRESSED TO CONFORM WITH THE EXISTING GRADE, PREPARED AND SEEDED.

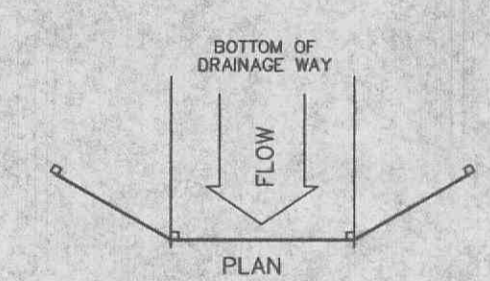

SILTATION FENCE DETAIL

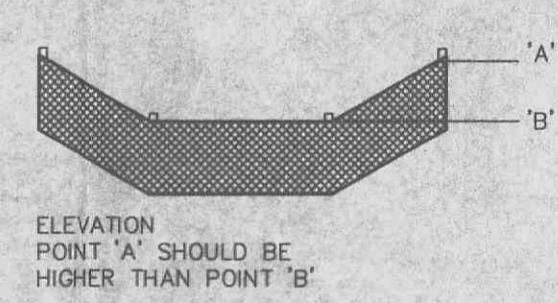


ELEVATION POINT 'A' SHOULD BE HIGHER THAN POINT 'B'

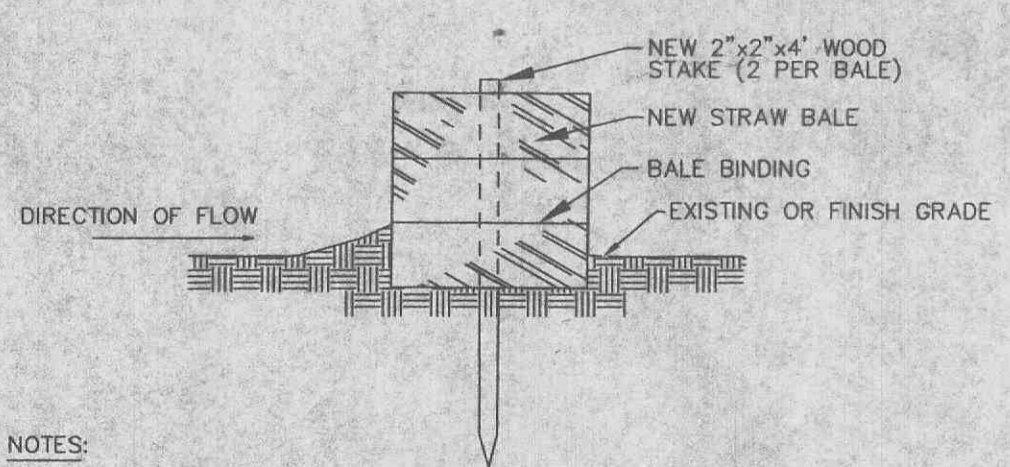


- NOTES:
1. STRAW BALES, NOT HAY BALES SHALL BE USED.
 2. BUTT ENDS OF BALES TIGHTLY TOGETHER.
 3. INSTALL BALES WITH BINDING AROUND SIDES, NOT TOP AND BOTTOM.
 4. FILL ANY GAP BETWEEN BALES BY WEDGING LOOSE STRAW BETWEEN THEM.

SEDIMENT BARRIER
NOT TO SCALE

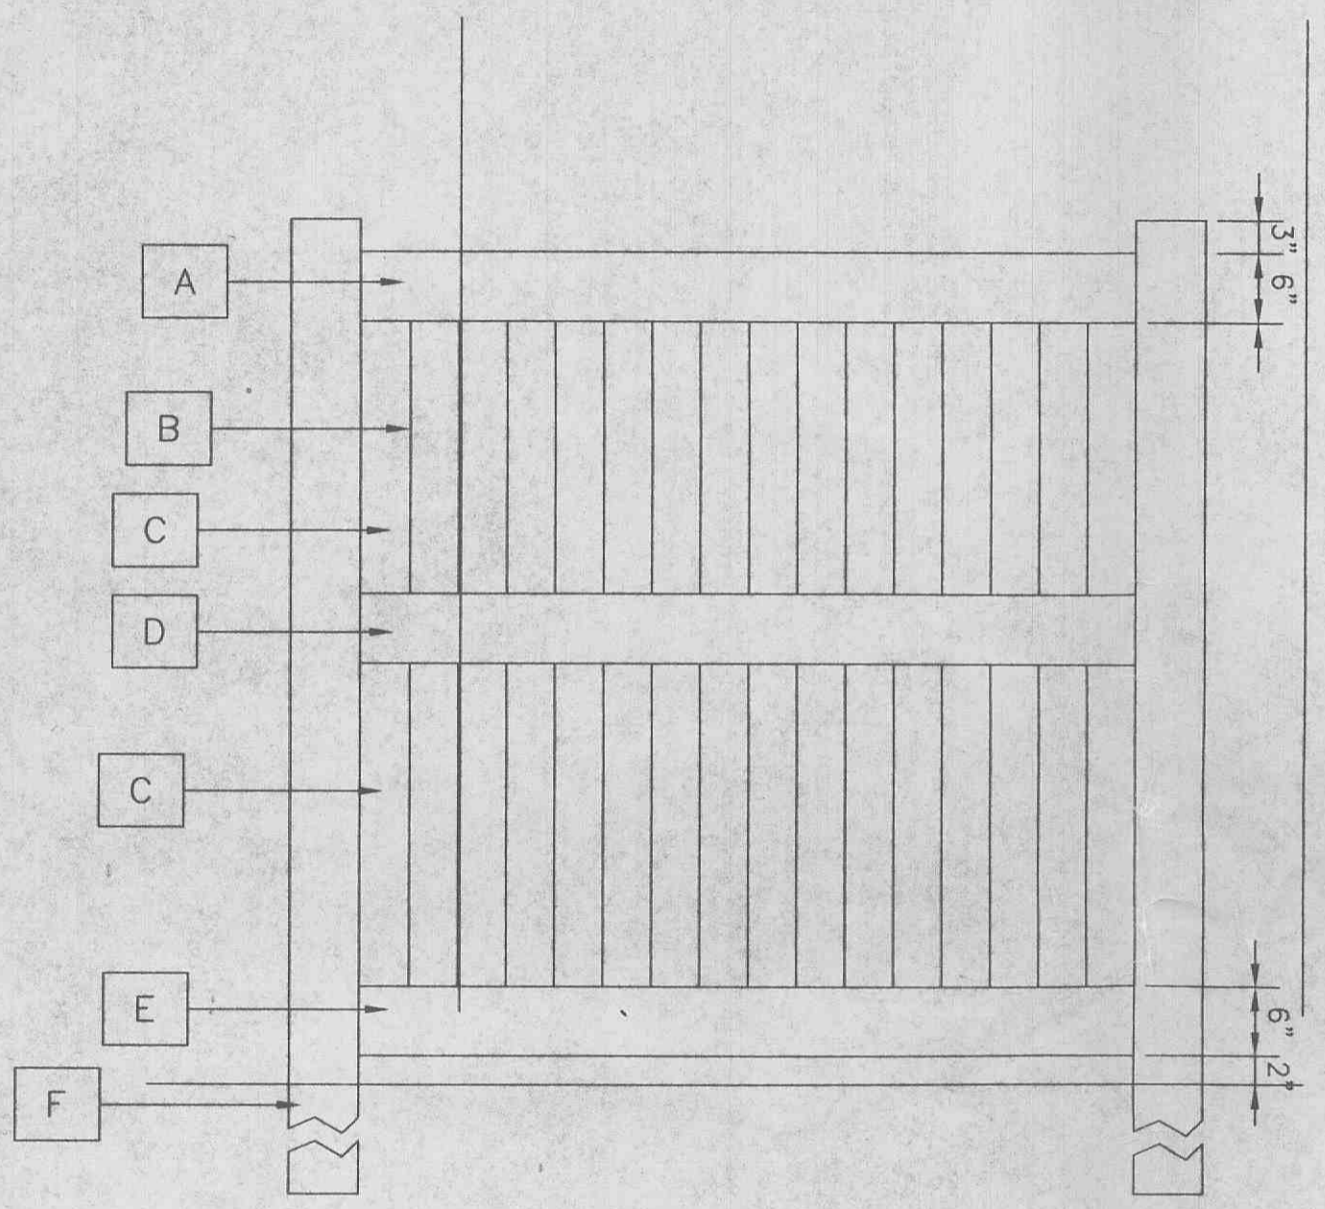


6' HIGH VINYL PRIVACY FENCE
NOT TO SCALE

- A TOP RAIL
2" X 6" X 88" RIBBED CHANNELLED TO ACCEPT PICKETS INCLUDES REINFORCING CHANNEL
- B PICKET SPACING
NONE
- C PICKETS
28 PIECES OF 7/8" X 6" X 30-1/2"
- D MIDDLE RAIL
2" X 6" X 88" RIBBED CHANNELLED TO ACCEPT PICKETS INCLUDES REINFORCING CHANNEL
- E BOTTOM RAIL
2" X 6" X 88" RIBBED CHANNELLED TO ACCEPT PICKETS INCLUDES REINFORCING CHANNEL
- F POST
6" X 6" X 120" FOR IN GROUND INSTALLATION
6" X 6" X 84" FOR ABOVE GROUND INSTALLATION

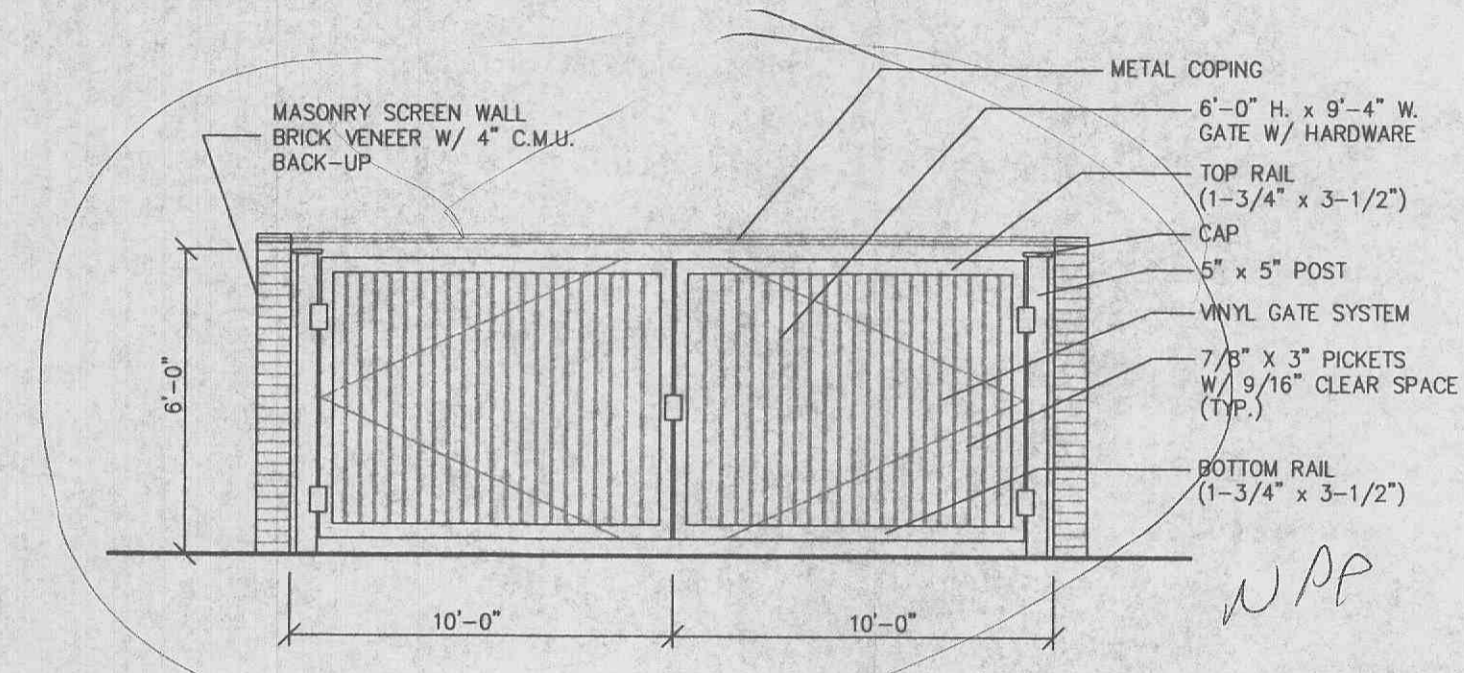


MECHANICAL AREA GATE DETAIL
NOT TO SCALE

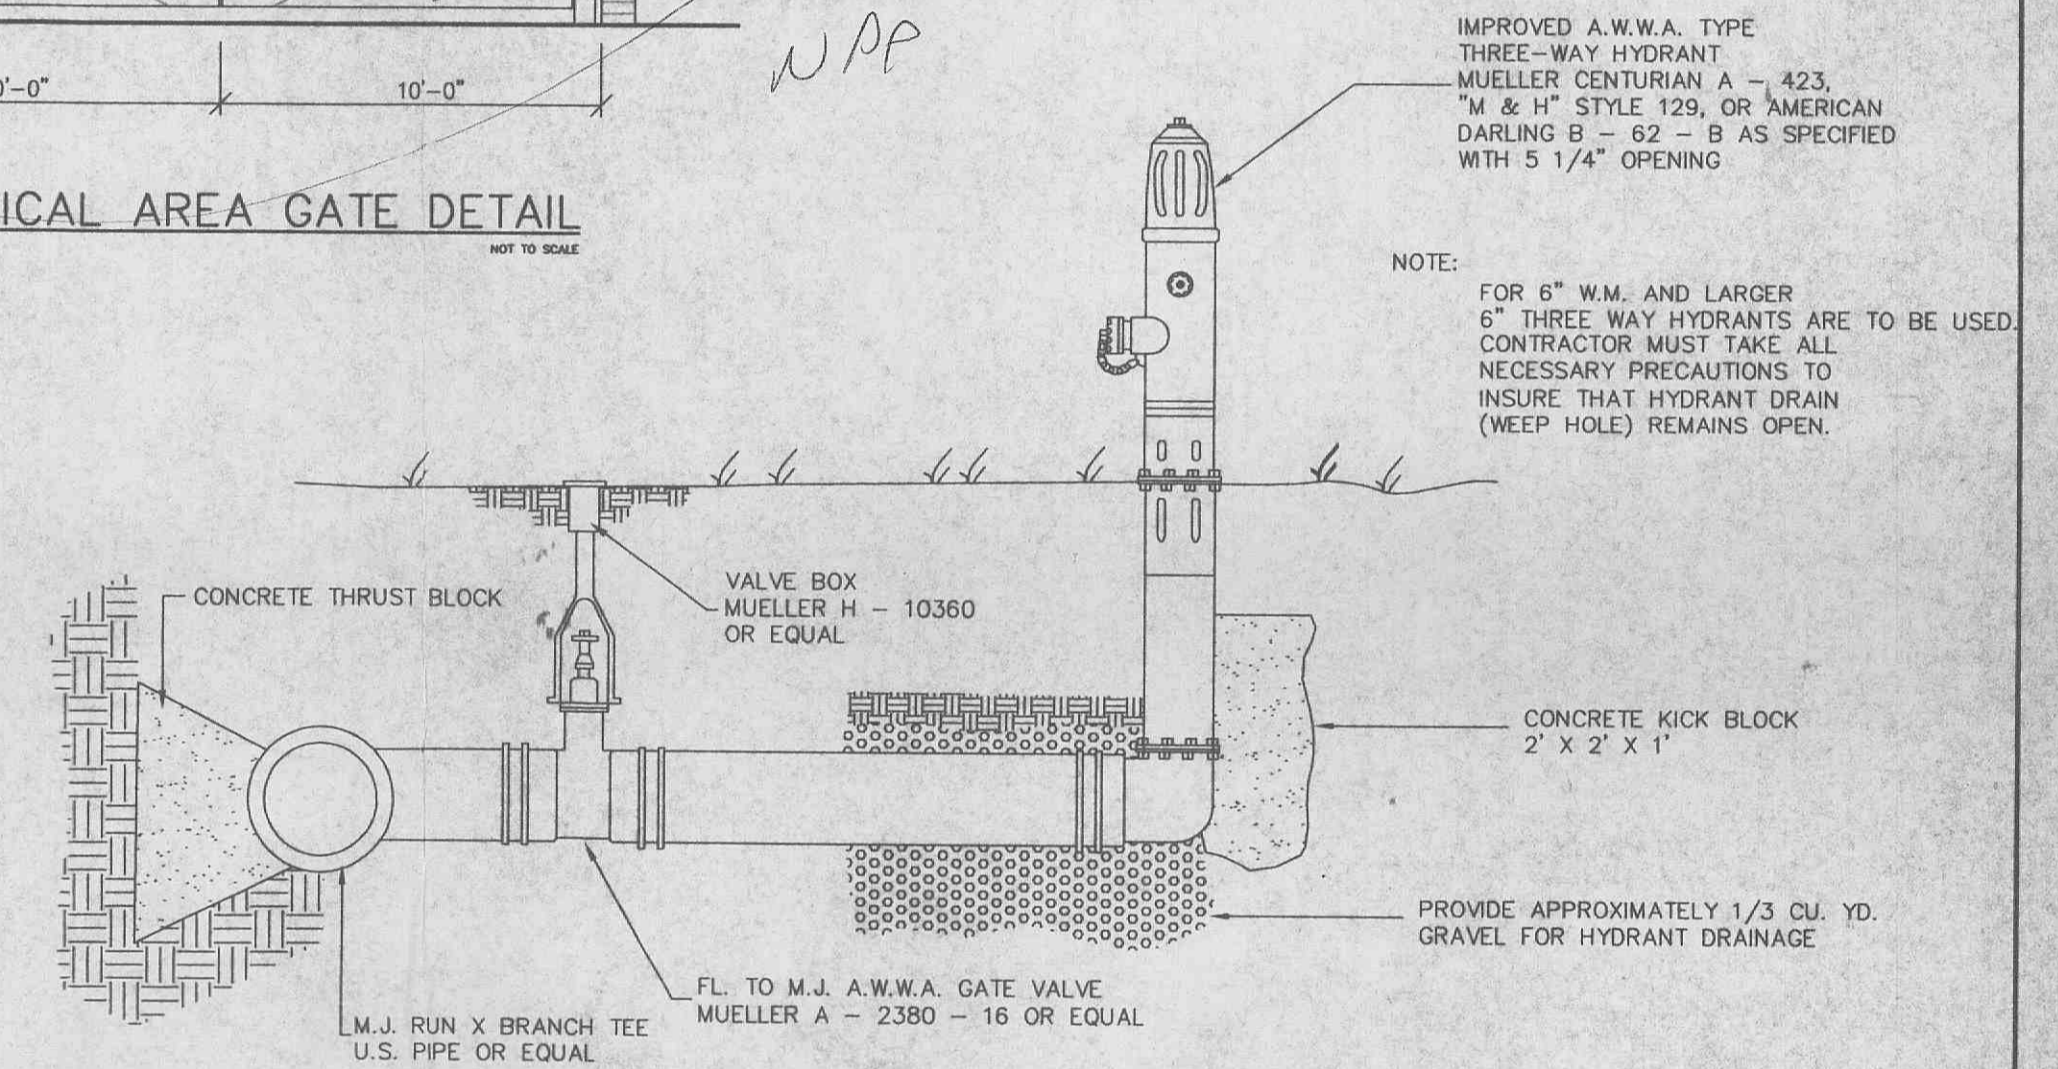


FIRE HYDRANT INSTALLATION DETAIL
NOT TO SCALE

Inside Diameter of Pipe (Inches)	ROUND PIPE			HORIZONTAL ELLIPTICAL PIPE			
	Payline Width of Trench (Inches)	Payline Width of Trench (Feet)	Pay-volumes cu. ft. per ft. Concrete Encasement	Inside Diameter of Trench (Inches)	Payline Width of Trench (Inches)	Payline Width of Trench (Feet)	Pay-volumes cu. ft. per ft. Concrete Encasement
4	28	2.33	3.20				
6	28	2.33	3.46				
8	28	2.33	3.70				
10	28	2.33	3.86				
12	28	2.33	3.98				
15	32	2.67	4.89				
18	35	2.92	5.63	14 X 23	41	3.42	5.94
21	39	3.25	6.61				
24	42	3.50	7.39	19 X 30	49	4.08	7.68

TABLE NO. 1
PAYLINE WIDTHS OF TRENCH AND
PAY-QUANTITIES OF CONCRETE

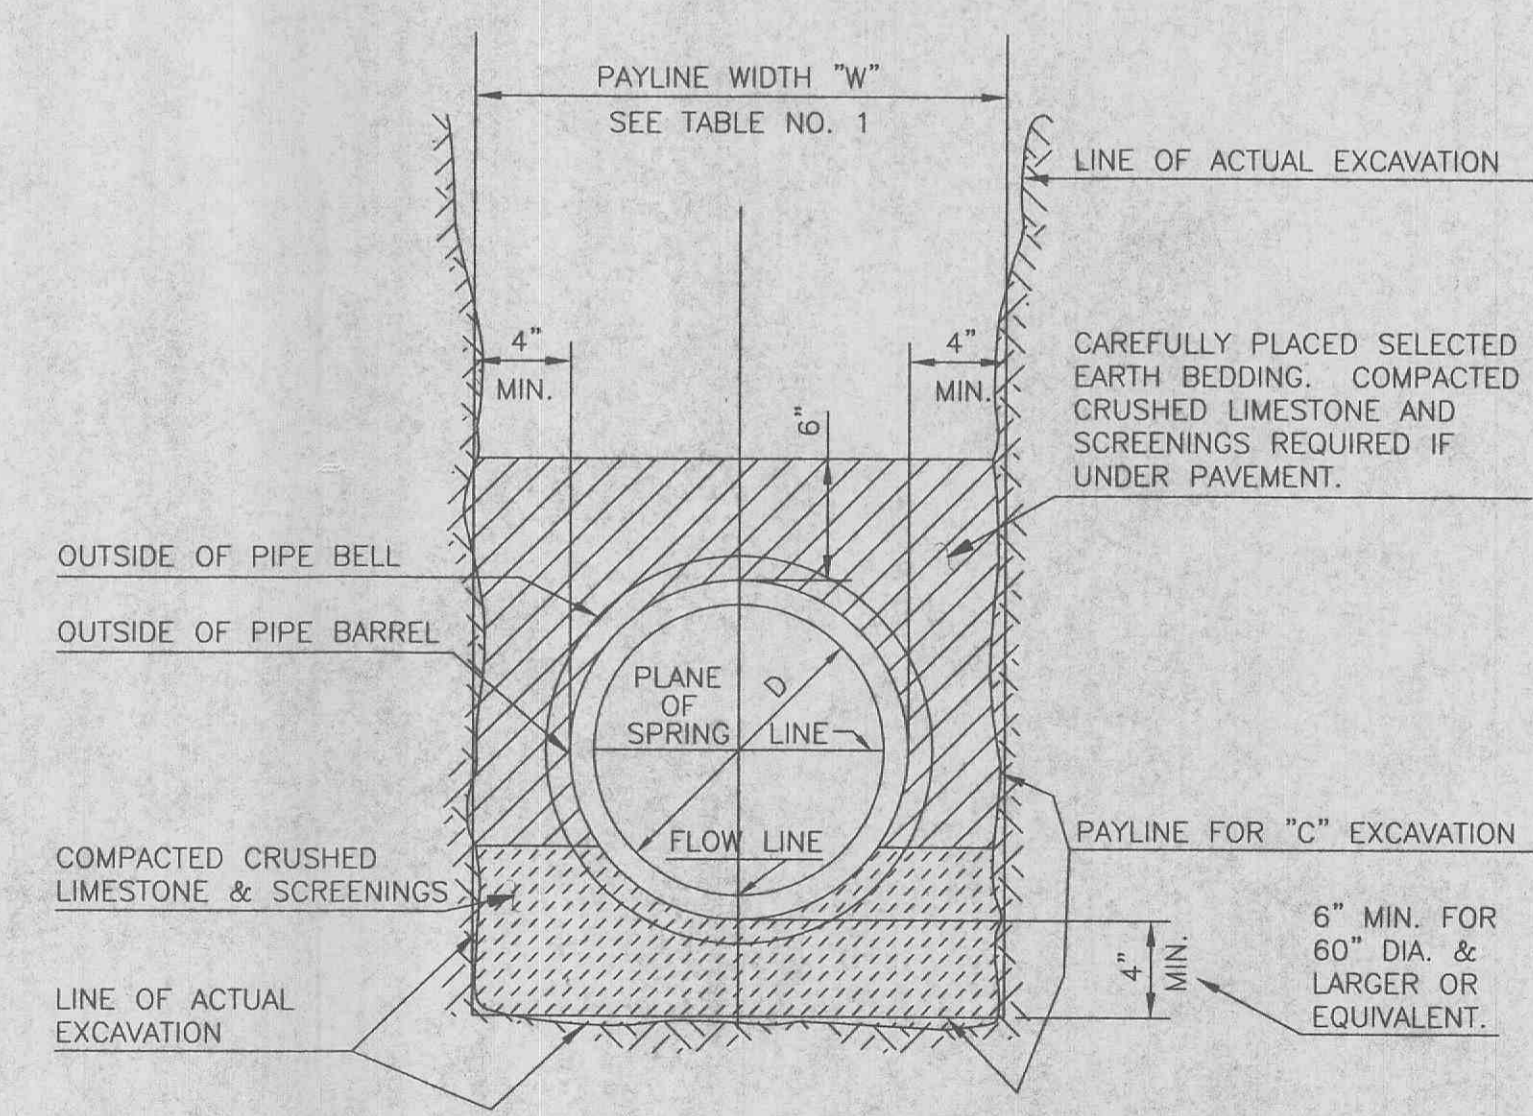

PIPE BEDDING CLASS "C"
(MODIFIED FOR REINFORCED
CONCRETE PIPE)

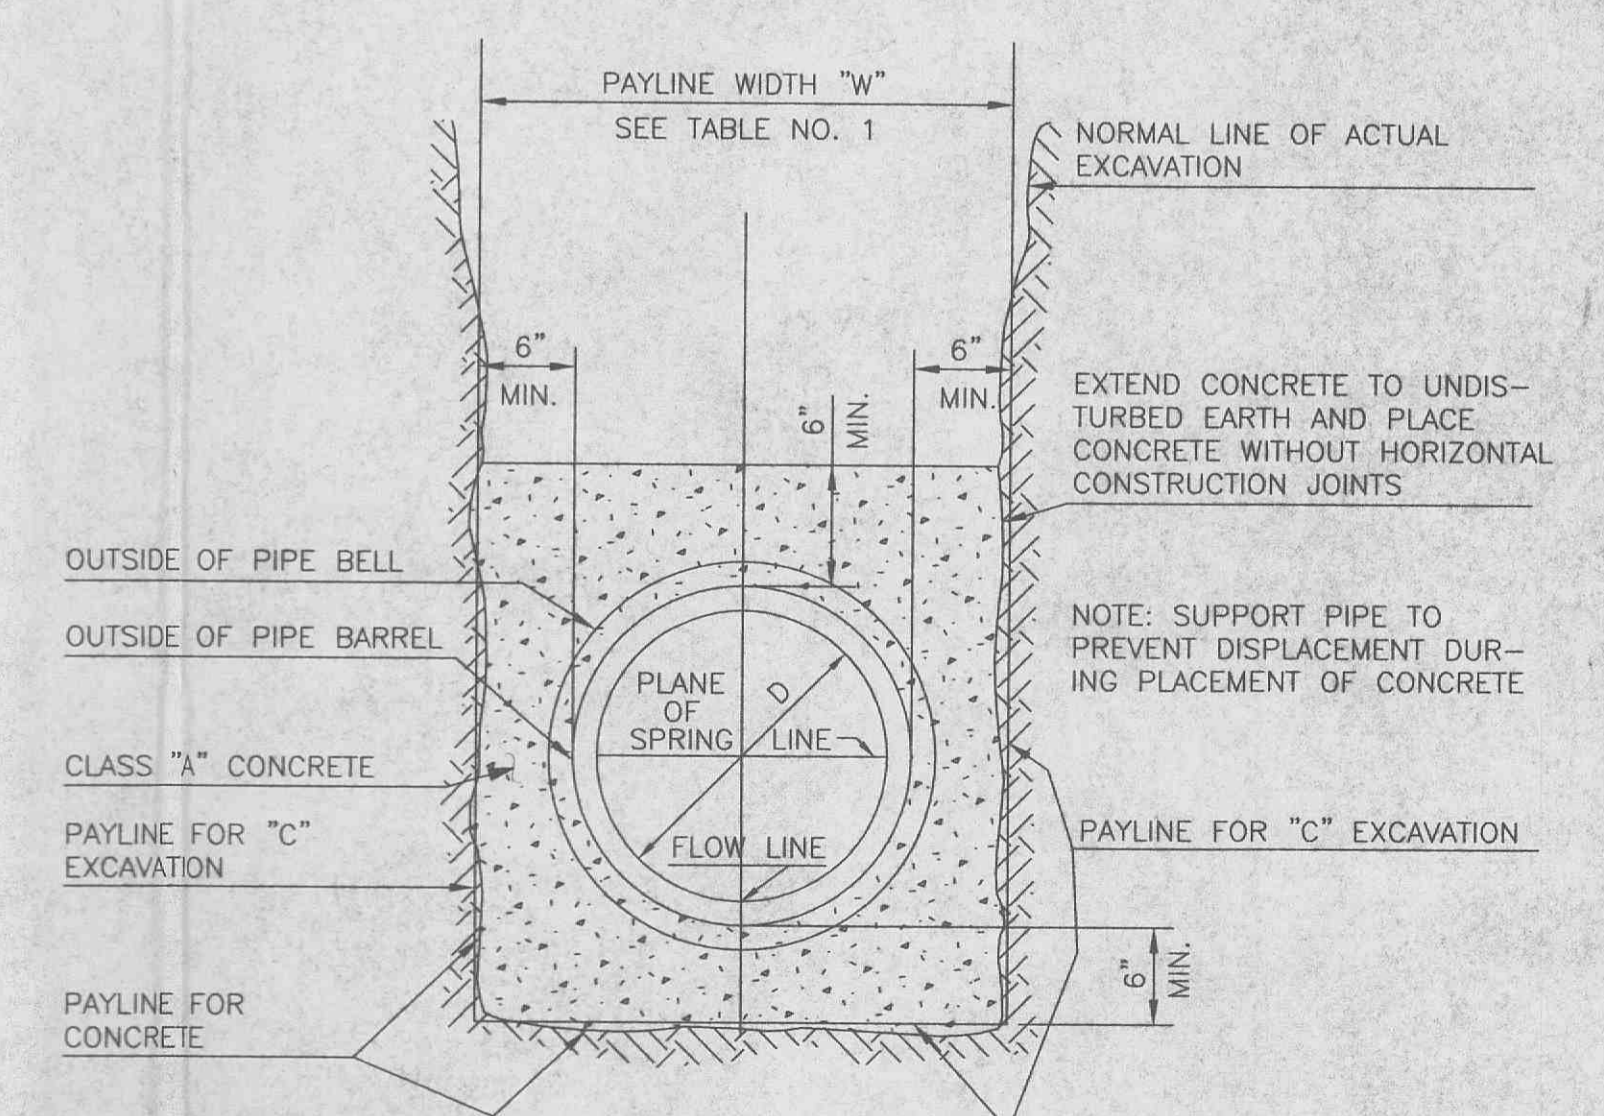

CONCRETE ENCASEMENT