
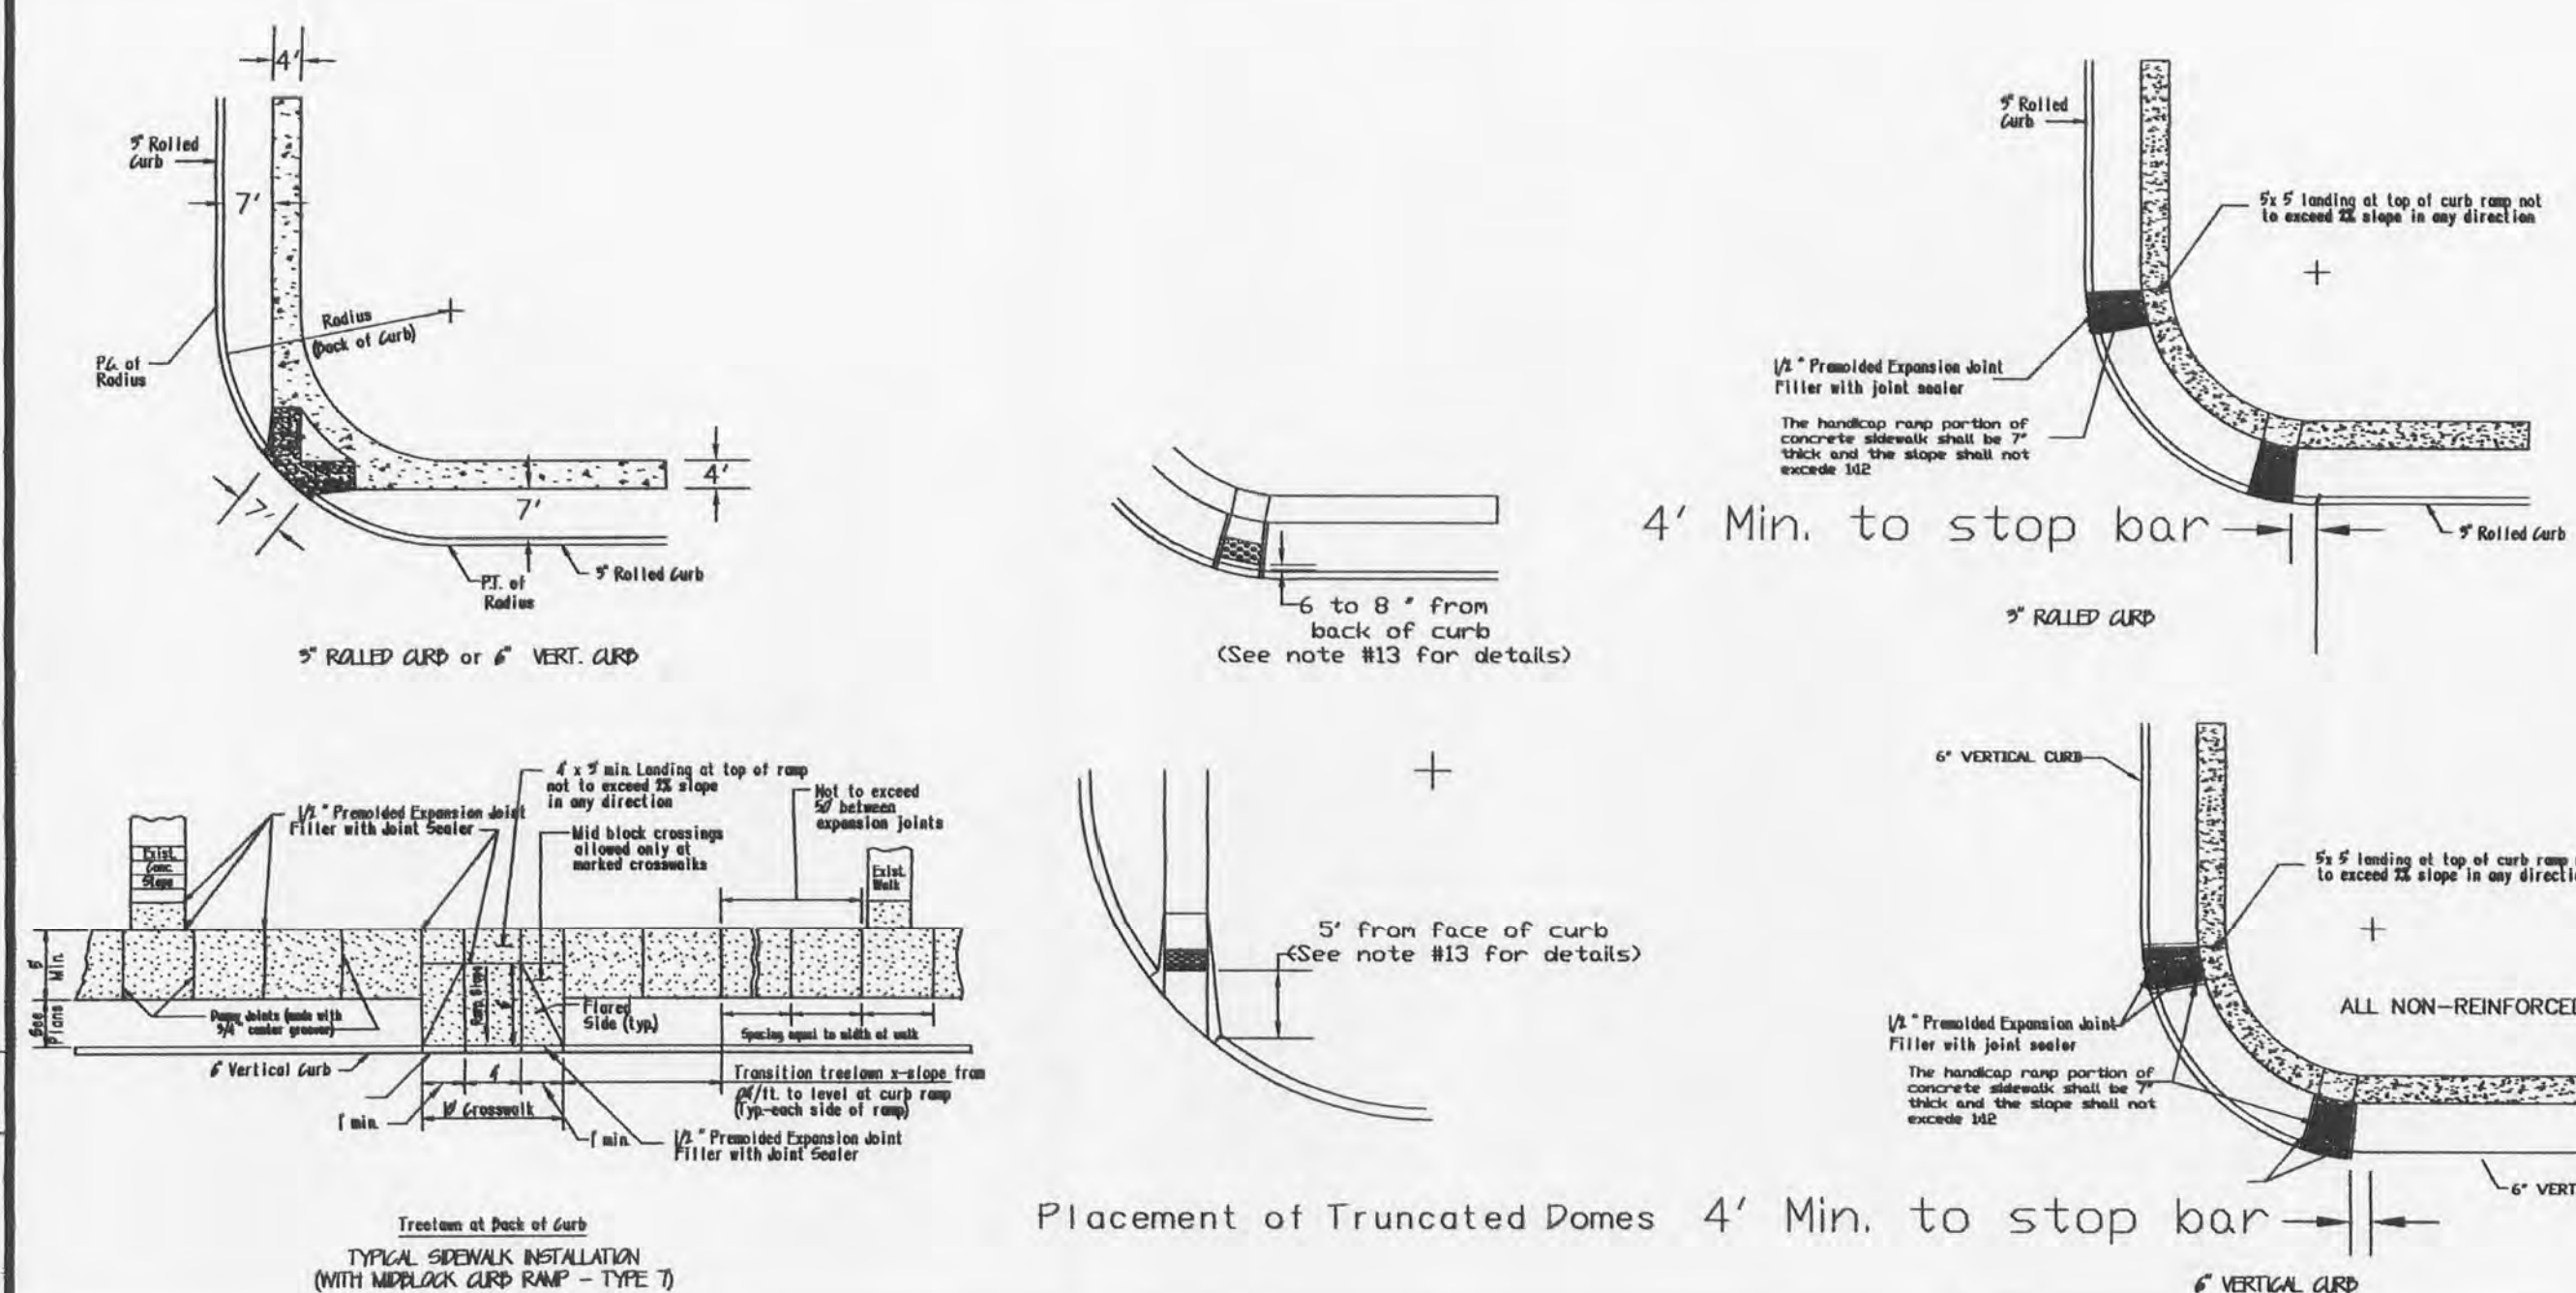


* Provide a marking on the storm sewer inlets. The City will allow the following markers and adhesive procedures only as shown in the table or equal to the table below. There does exist certain 'peel and stick' adhesive pads, but these will not be allowed.

Manufacturer	Size	Style	Adhesive	Message (Part #)	Web site
ACP International	3 7/8	Epoxy	Crystal Cap	No dumping Drains to waterway (sd-w-cc)	www.acpinternational.com
DAS Manufacturing	4"	Epoxy	Standard Style	No Dumping Drains to stream (#sds)	www.dasmanufacturing.com

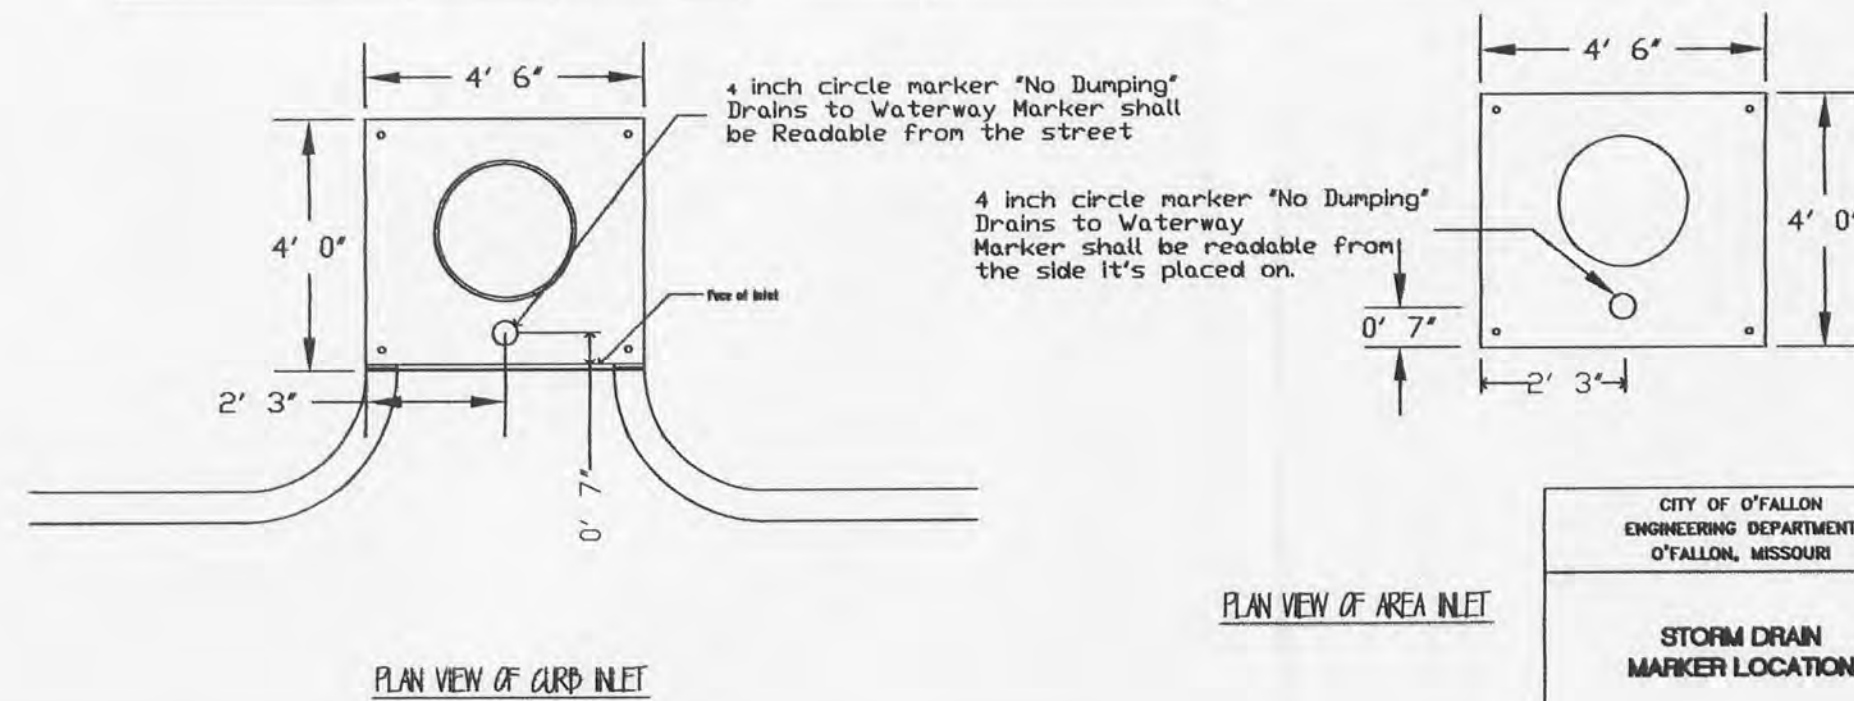

- GENERAL NOTES**
- Do not scale drawing. Follow dimensions.
 - Sidewalk and sidewalk curb ramps shall be constructed in accordance with these details and the current approved Americans with Disabilities Act Accessibility Guidelines (AWG).
 - Minimum sidewalk width along 6" vertical curb shall be 5 feet. Minimum sidewalk width along 5" rolled curb shall be 4 feet.
 - Maximum sidewalk cross slope 0.2%/ft.
 - All sidewalk sections shall be 4" thick, except where indicated as 7" thick by aboved portions shown on details.
 - Where curb ramp meets pavement, fullness will not be permitted.
 - If integral concrete curb is constructed, strike a dummy joint across bottom of ramp of curb line. If concrete curb is overlaid on black out pavement to provide full depth curb across ramp from outer point of curb taper to outer point of curb taper.
 - For pavement longitudinal and transverse joints and dowel and tie bar requirements and dimensions, refer to the Payment Construction Details for joints and darts.
 - For roadway cross slopes, pavement types, and thicknesses, refer to Standard Typical Sections.
 - The intersection of two sidewalks or the intersection of a sidewalk and a driveway may serve as a wheelchair passing space on sidewalks less than 5 feet wide.
 - All curb ramps shall have a detectable warning complying with Americans with Disabilities Act Accessibility Guidelines (AWG).
 - All ramps must line up with the curb on the other side of the street or pavement.
 - All truncated domes shall run parallel to the curb.
 - Truncated domes shall not be stamped and will be a ADA approved product.
- ALL NON-REINFORCED CONCRETE SHALL BE 4,000 PSI AT 28 DAYS

PROJECT TITLE:
O'FALLON
DERMATOLOGY





DETAILS

MUSLER ENGINEERING COMPANY
CIVIL ENGINEERING - PLANNING - LAND SURVEYING
32 Portwest Court, St. Charles, Missouri 63303
Telephone: (636) 916-0444
Fax: (636) 916-3444

CITY OF FALLON ENGINEERING DEPARTMENT O'FALLON, MISSOURI
PAYMENT CONSTRUCTION DETAILS CONCRETE SIDEWALK AND CURB RAMPS

DISCLAIMER OF RESPONSIBILITY
I hereby specify that the documents intended to be authorized by my seal are limited to this sheet, and I hereby disclaim any responsibility for all other drawings, specifications, estimates, reports or other documents or instruments relating to or intended to be used for any part or parts of the architectural or engineering project or survey.

JEFFREY R. SMITH, P.E.
MO. P.E. # E-2001004672

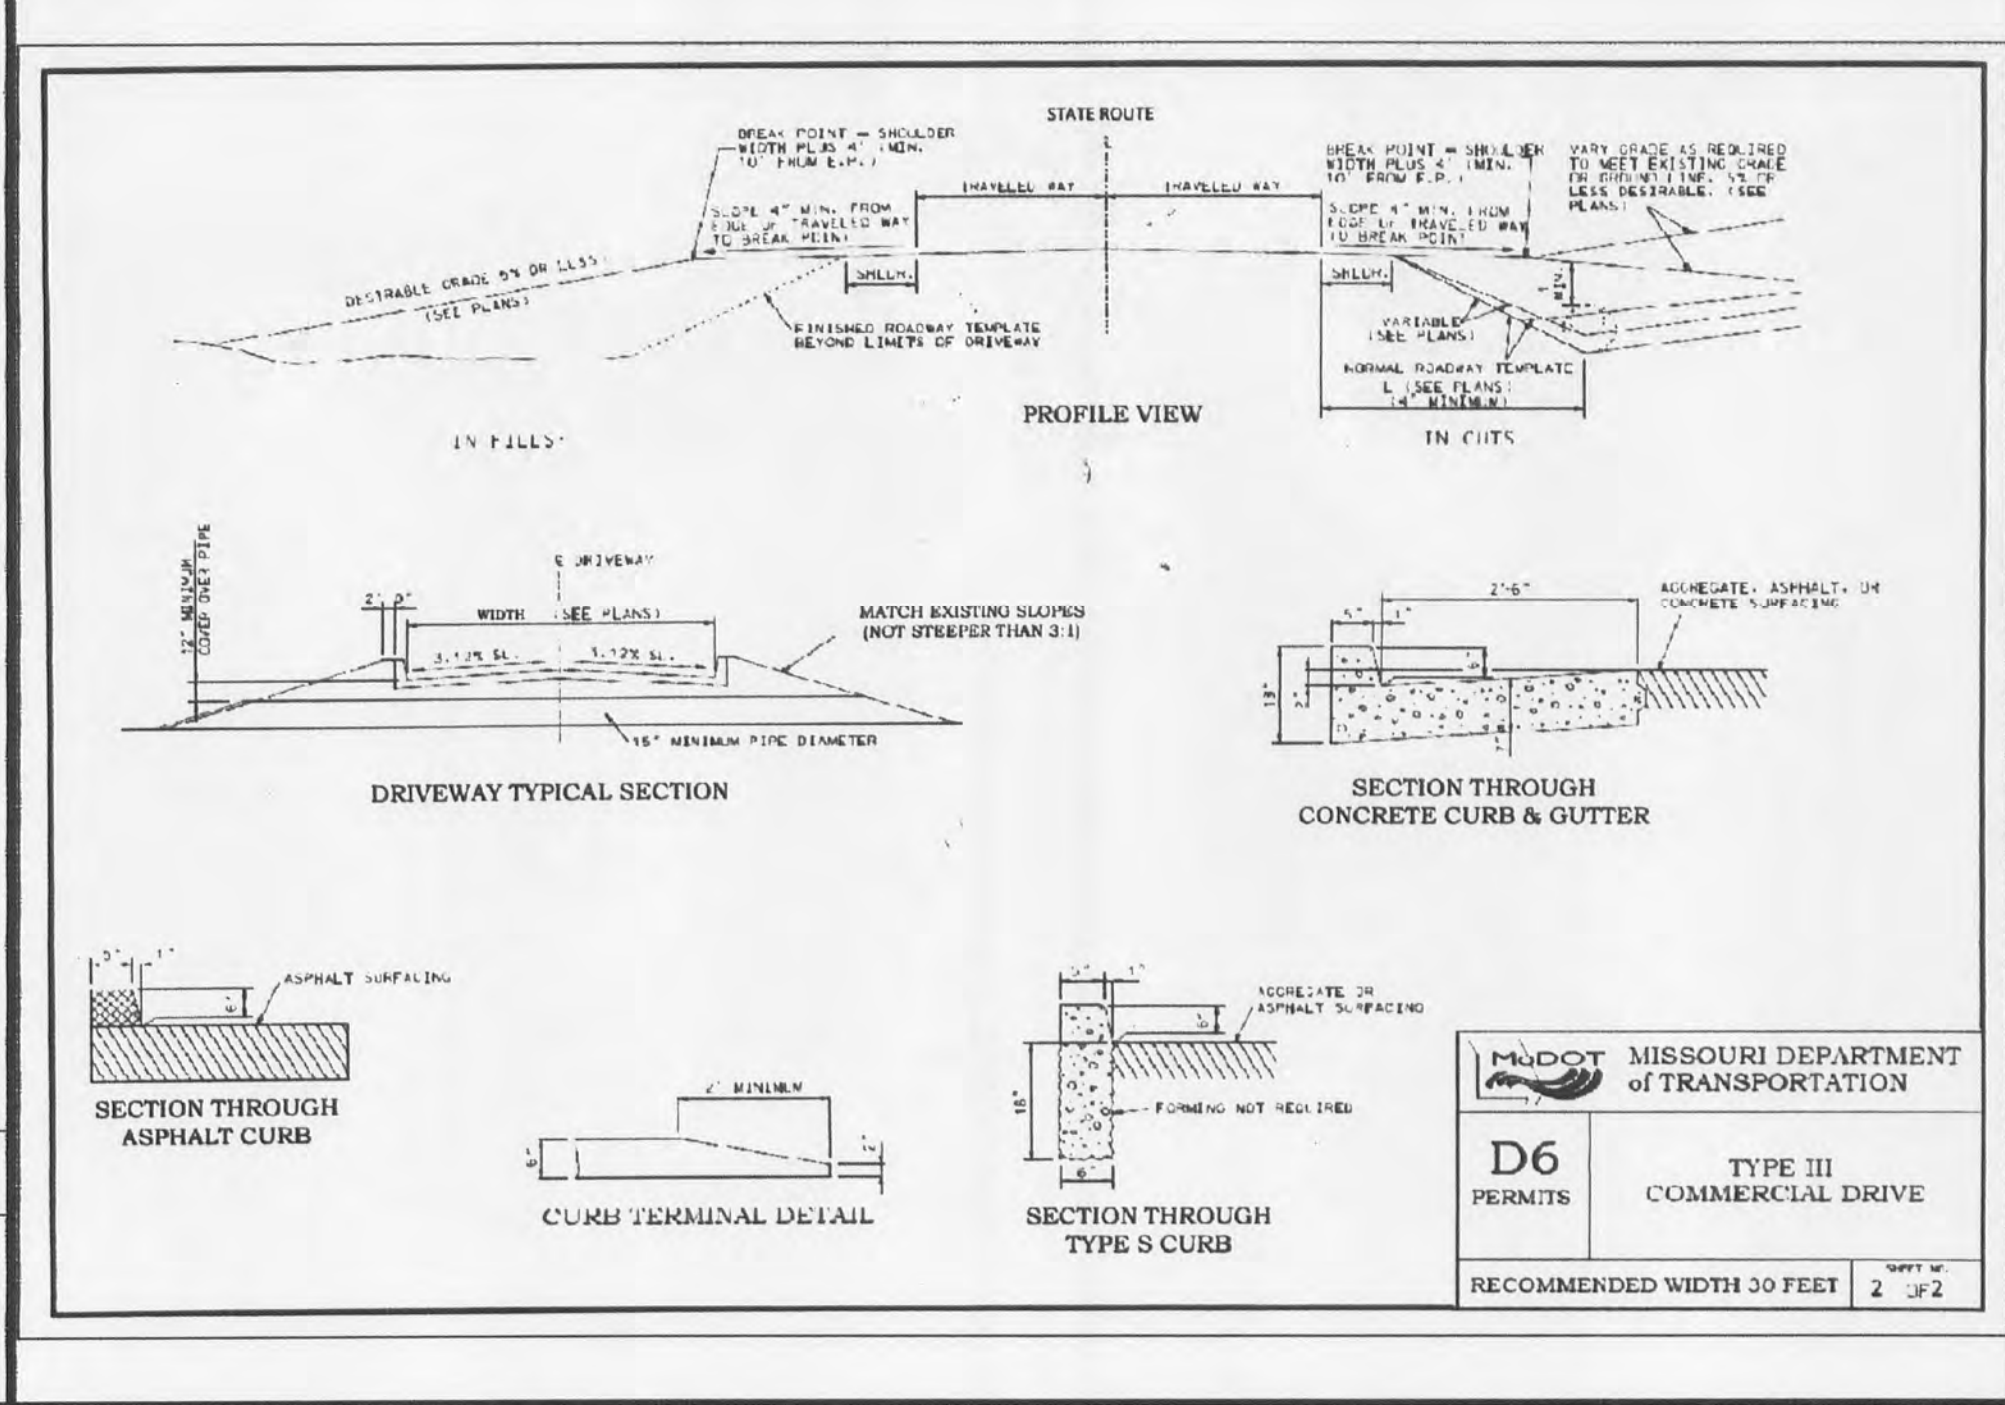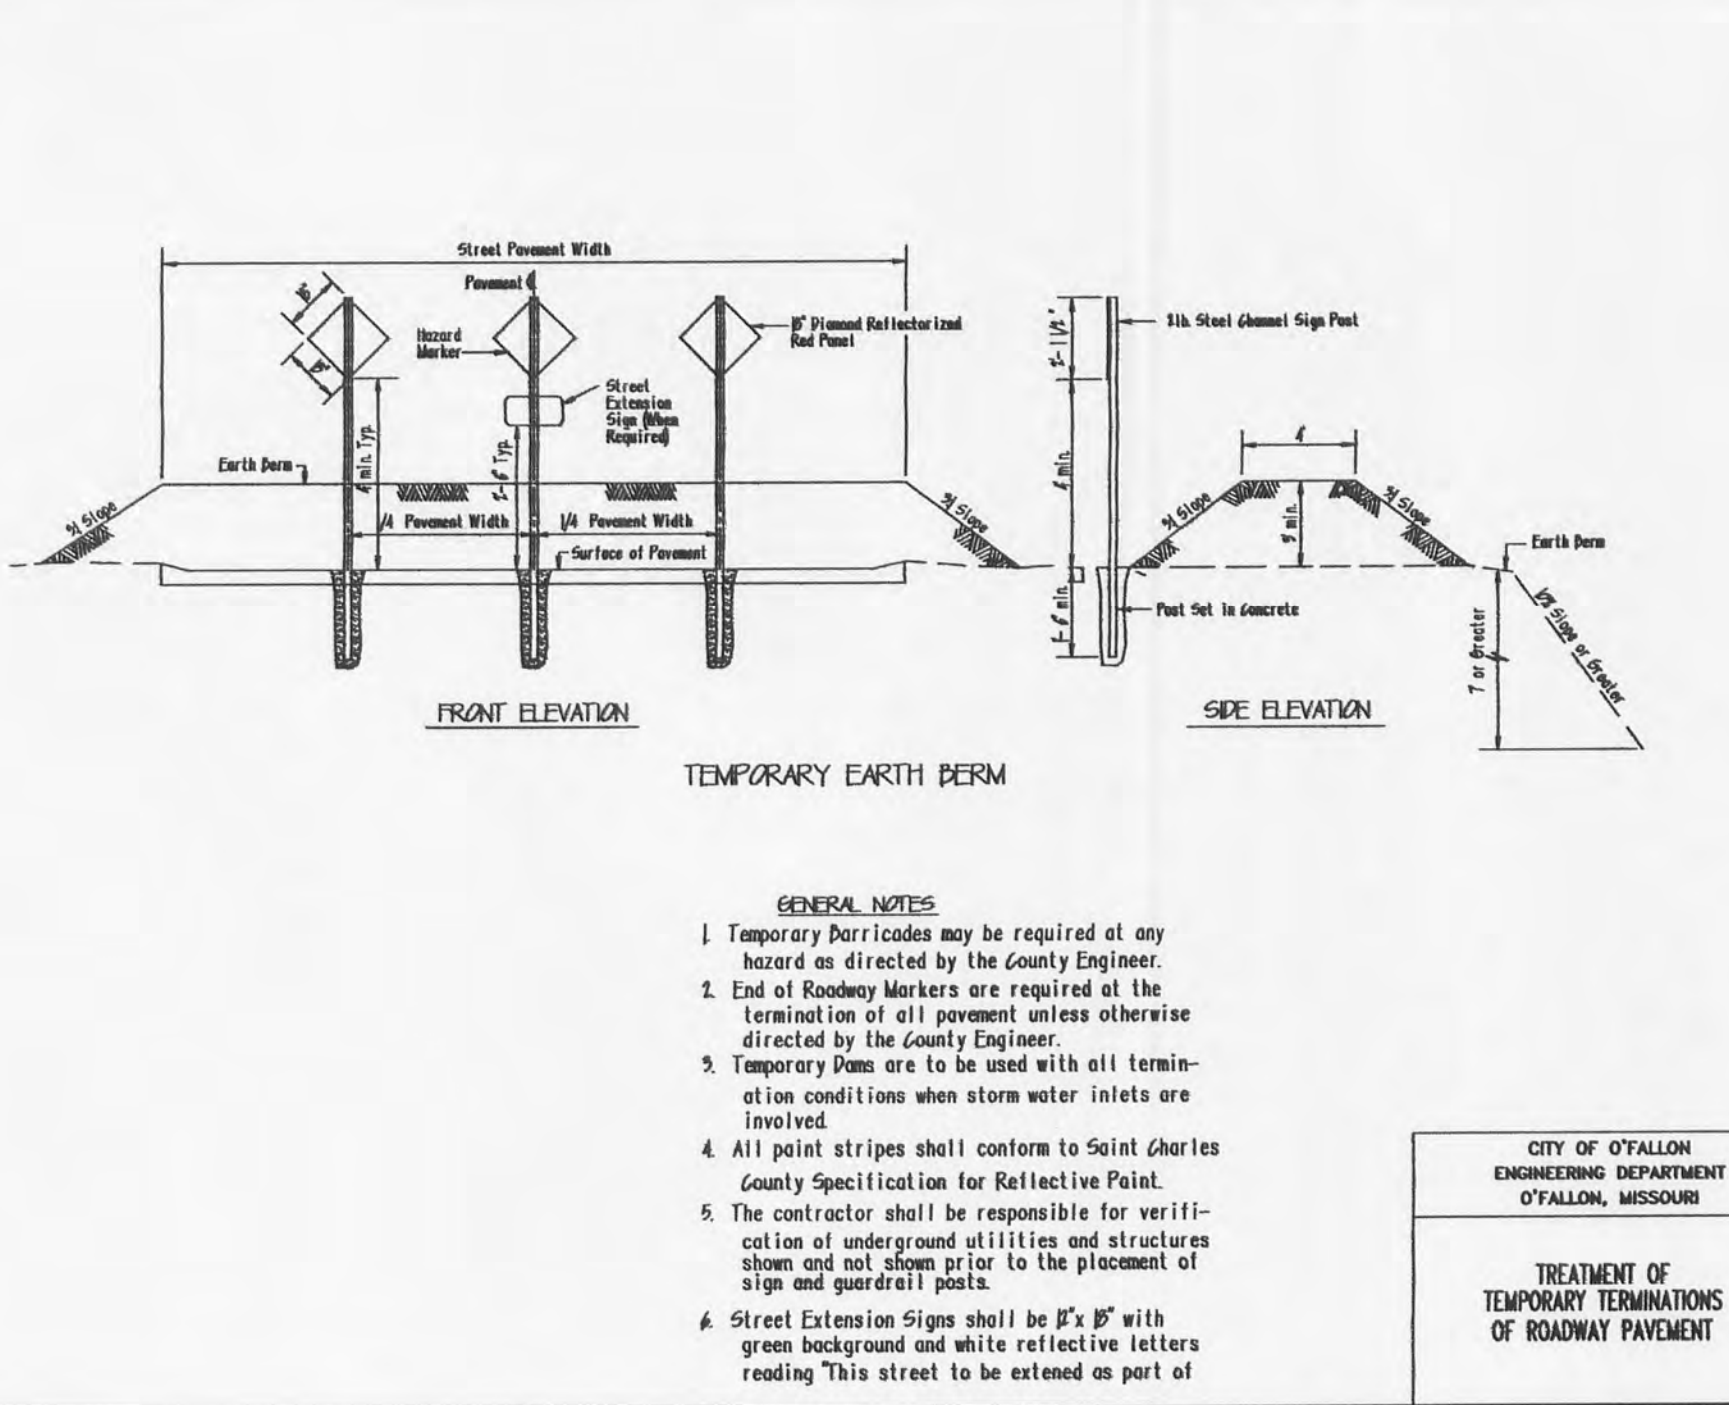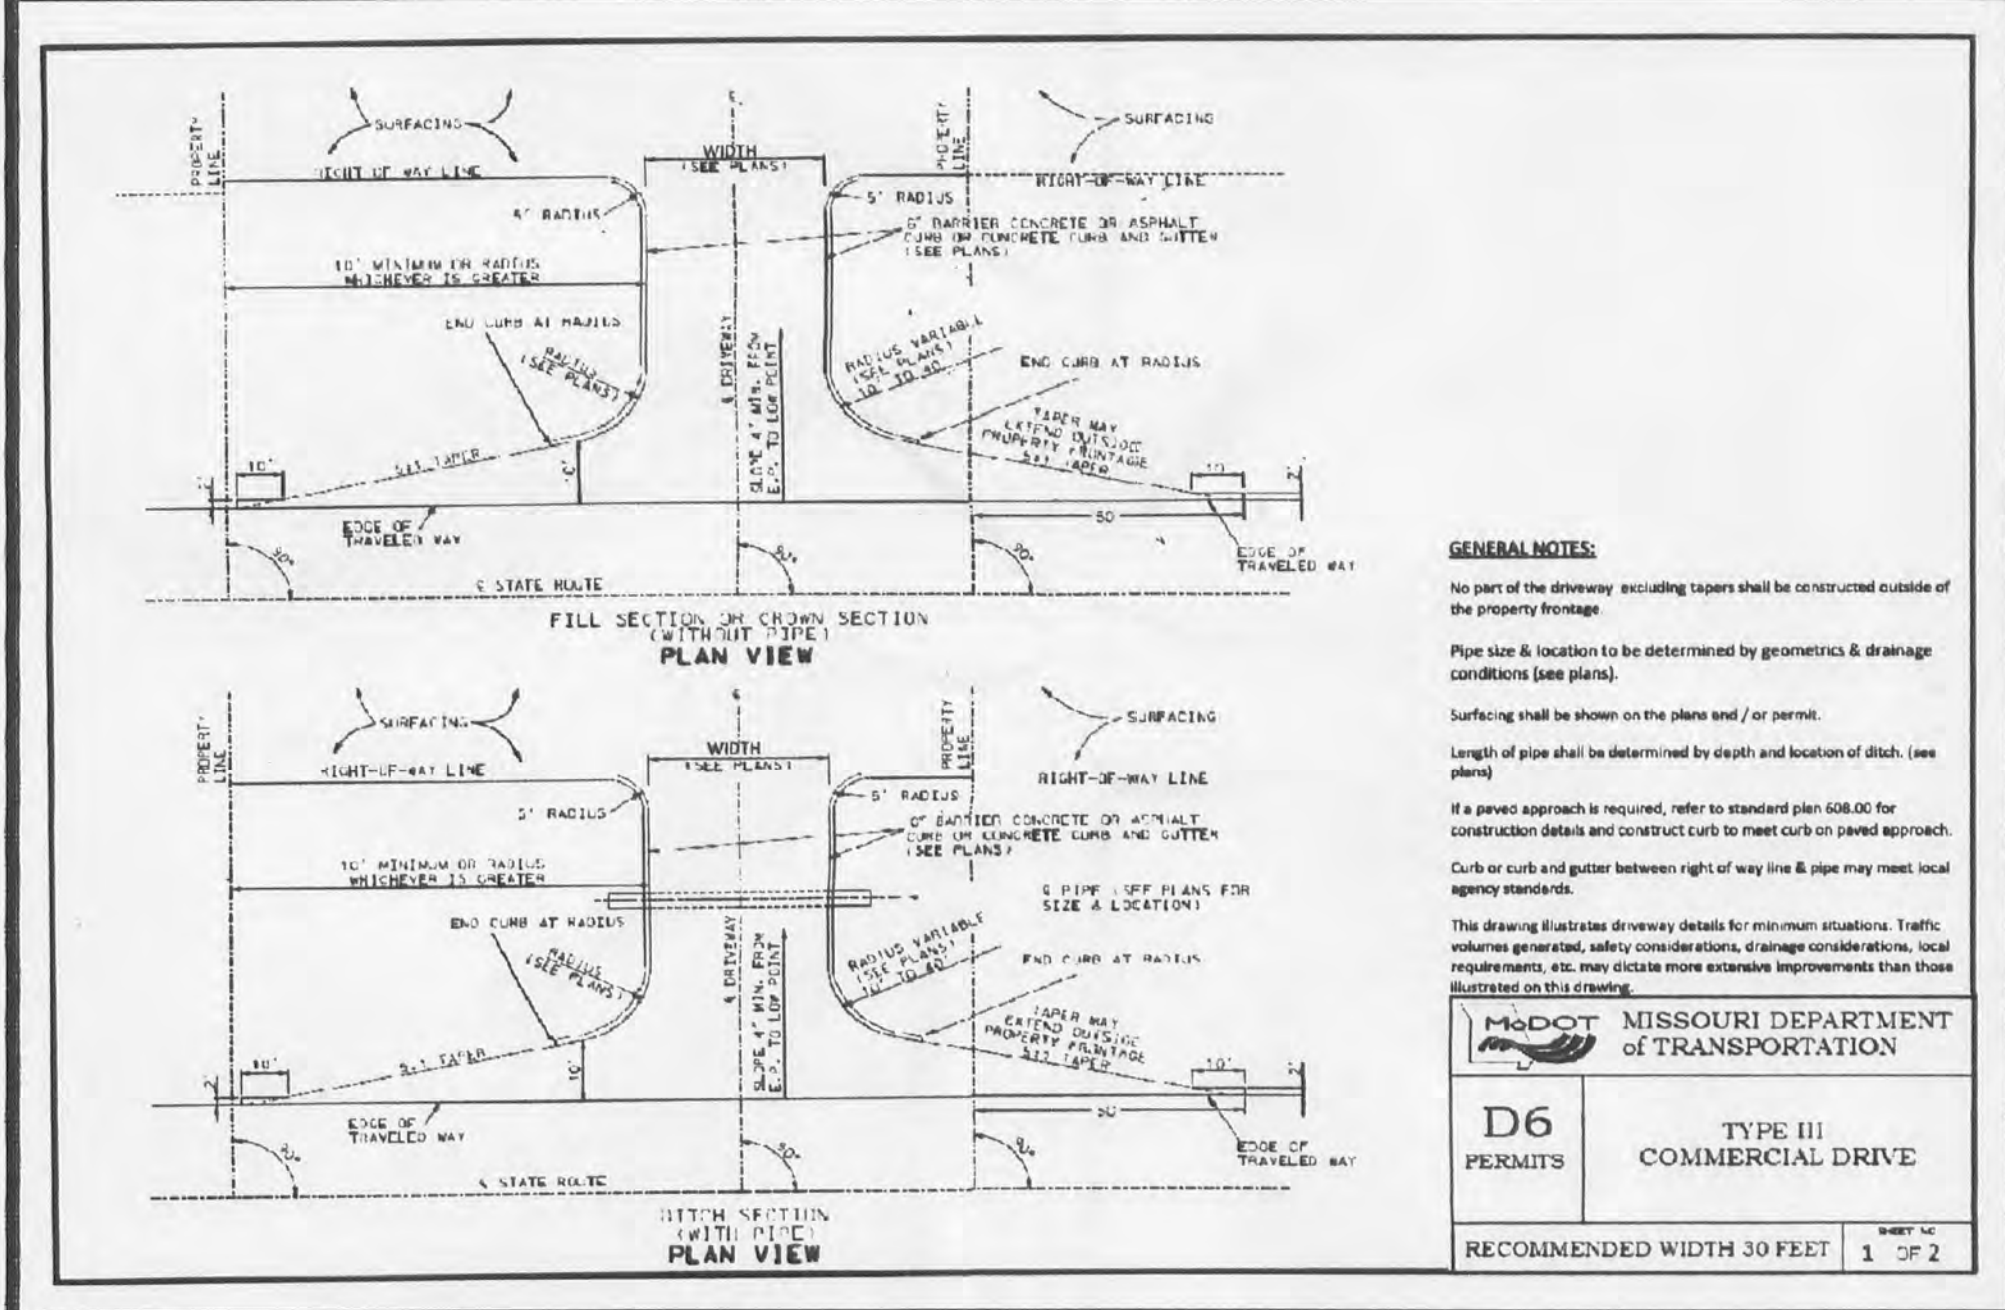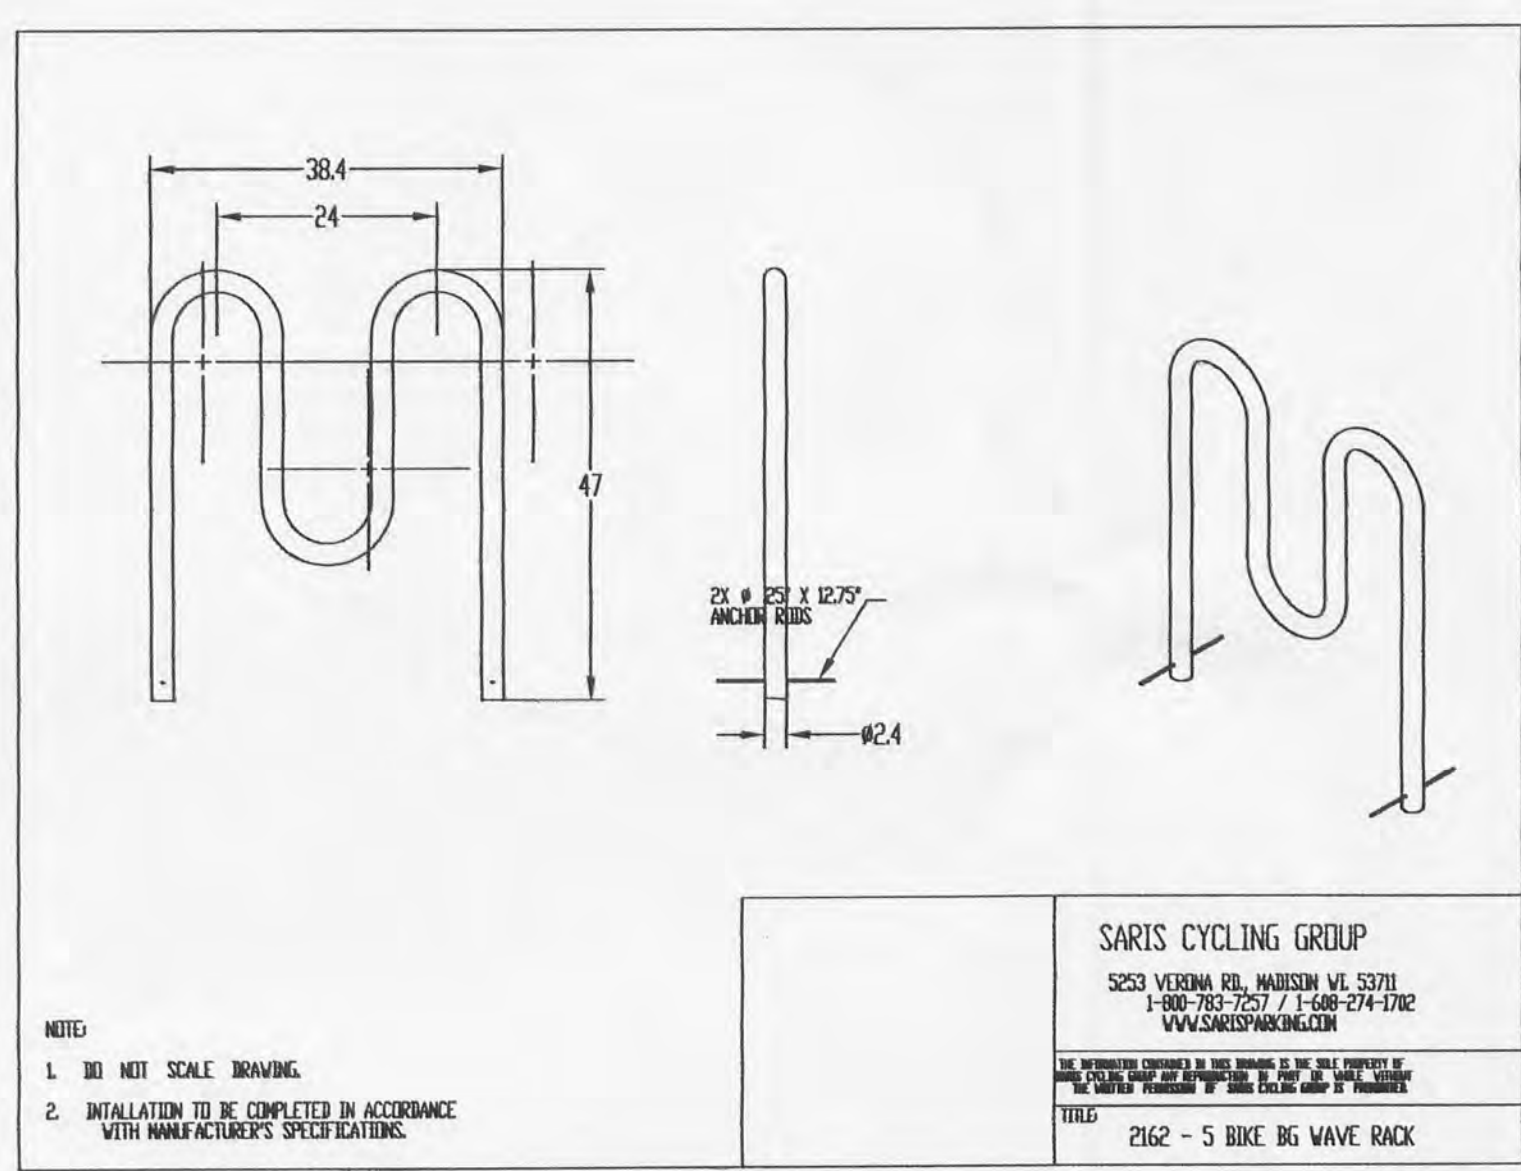

DISCLAIMER OF RESPONSIBILITY
I hereby specify that the documents intended to be authorized by my seal are limited to this sheet, and I hereby disclaim any responsibility for all other drawings, specifications, estimates, reports or other documents or instruments relating to or intended to be used for any part or parts of the architectural or engineering project or survey.

JEFFREY R. SMITH, P.E.
MO. P.E. # E-2001004672

PREPARED FOR:
ODERM, LLC
MR. TIM SPRAY
835 STRAWBERRY RIDGE DRIVE
O'FALLON, MISSOURI 63366
TELEPHONE: 314-378-2087
FAX: 636-240-1768
E-mail: taspray@yahoo.com

P & Z No.
00-27.17.02
City No.