

CITY OF O'FALLON, MO - COMMERCIAL CONSTRUCTION GENERAL NOTES

GENERAL NOTES:

- ACCESSIBLE PARKING SPACES SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE CURRENT APPROVED "AMERICAN WITH DISABILITIES ACT ACCESSIBILITY GUIDELINES" (ADAAG) ALONG WITH THE REQUIRED GRADES, CONSTRUCTION MATERIALS, SPECIFICATIONS AND SIGNAGE. IF ANY CONFLICT OCCURS BETWEEN THE ABOVE INFORMATION AND THE PLANS, THE ADAAG GUIDELINES SHALL TAKE PRECEDENCE AND THE CONTRACTOR PRIOR TO ANY CONSTRUCTION SHALL NOTIFY THE PROJECT ENGINEER.
- THE CONTRACTOR IS RESPONSIBLE TO CALL MISSOURI ONE CALL AND THE CITY OF O'FALLON FOR THE LOCATION OF UTILITIES. CONTACT THE CITY OF O'FALLON AT (636) 281-2858 FOR WATER MAIN, SANITARY SEWER AND STORM SEWER LOCATES. CALL MISSOURI ONE CALL AT 1-800-DIG-RITE (1-800-344-7483) FOR ALL OTHER UTILITIES. CONTACT THE CITY OF O'FALLON ENGINEERING DIVISION AT (636) 379-5556 AND THE CONSTRUCTION INSPECTION DIVISION AT (636) 379-5596.
- ALL PROPOSED FENCING REQUIRES A SEPARATE PERMIT THROUGH THE CITY OF O'FALLON PLANNING & DEVELOPMENT DIVISION.
- ALL CONSTRUCTION OPERATIONS AND WORK ZONE TRAFFIC CONTROL WITHIN THE RIGHT OF WAY WILL FOLLOW MODOT OR M.U.T.C.D. STANDARDS WHICHEVER IS MORE STRINGENT.
- ALL FREE STANDING SIGNS SHALL BE LOCATED A MINIMUM OF TEN (10) FEET AWAY FROM ANY RIGHT OF WAY LINE AND/OR PROPERTY LINE AND A MINIMUM OF THREE (3) FEET FROM THE BACK OF CURBING OR SIDEWALK. ALL SIGNS SHALL ABIDE BY THE REGULATIONS FOR VISIBILITY AT CORNERS, INCLUDING CORNERS FROM DRIVEWAYS AND THE STREET IT INTERSECTS PER SECTION 400.260 OF THE O'FALLON ZONING CODE.
- MATERIALS SUCH AS TREES, ORGANIC DEBRIS, RUBBLE, FOUNDATIONS AND OTHER DELETERIOUS MATERIAL THAT ARE NOT TO BE REUSED, SHALL BE REMOVED FROM THE SITE AND DISPOSED OF IN COMPLIANCE WITH ALL APPLICABLE LAWS AND REGULATIONS. IF THE MATERIAL LISTED PREVIOUSLY ARE REUSED, A LETTER FROM A SOIL ENGINEER MUST CLARIFY AMOUNT, LOCATION, DEPTH, ECT. AND MUST BE APPROVED WITH THE CONSTRUCTION PLANS. LANDFILL TICKETS FOR SUCH DISPOSAL SHALL BE MAINTAINED ON FILE BY THE DEVELOPER. BURNING ON SITE SHALL BE ALLOWED ONLY BY PERMIT FROM THE LOCAL FIRE DISTRICT. IF A BURN PIT IS PROPOSED, THE LOCATION AND MITIGATION SHALL BE SHOWN ON THE GRADING PLAN AND DOCUMENTED BY THE SOILS ENGINEER.
- TWENTY-FOUR (24) HOURS PRIOR TO STARTING ANY OF THE WORK COVERED BY THE ABOVE PLANS AND AFTER APPROVAL THEREOF, THE DEVELOPER SHALL MAKE ARRANGEMENTS WITH THE CONSTRUCTION INSPECTION OFFICE TO PROVIDE FOR INSPECTION OF THE WORK, SUFFICIENT IN THE OPINION OF THE CITY ENGINEER, TO ASSURE COMPLIANCE WITH THE PLANS AND SPECIFICATIONS AS APPROVED.
- THE CITY ENGINEER OR THEIR DULY AUTHORIZED REPRESENTATIVE SHALL MAKE ALL NECESSARY INSPECTIONS OF CITY INFRASTRUCTURE, ESCROW ITEMS OR INFRASTRUCTURE LOCATED ON THE APPROVED PLANS.
- CITY APPROVAL OF ANY CONSTRUCTION SITE PLAN DOES NOT MEAN THAT ANY BUILDING CAN BE CONSTRUCTED ON THE LOTS WITHOUT MEETING THE BUILDING SETBACKS AS REQUIRED BY THE ZONING CODES.
- ALL INSTALLATIONS AND CONSTRUCTION SHALL CONFORM TO THE APPROVED ENGINEERING DRAWINGS. HOWEVER, IF THE DEVELOPER CHOOSES TO MAKE MINOR MODIFICATIONS IN DESIGN AND/OR SPECIFICATIONS DURING CONSTRUCTION, THEY SHALL MAKE SUCH CHANGES AT THEIR OWN RISK, WITHOUT ANY ASSURANCE THAT THE CITY ENGINEER WILL APPROVE THE COMPLETED INSTALLATION OR CONSTRUCTION. IT SHALL BE THE RESPONSIBILITY OF THE DEVELOPER TO NOTIFY THE CITY ENGINEER OF ANY CHANGES FROM THE APPROVED DRAWINGS. THE DEVELOPER MAY BE REQUIRED TO CORRECT THE INSTALLED IMPROVEMENTS SO AS TO CONFORM TO THE APPROVED ENGINEERING DRAWINGS. THE DEVELOPER MAY REQUEST A LETTER FROM THE CONSTRUCTION INSPECTION DIVISION REGARDING ANY FIELD CHANGES APPROVED BY THE CITY INSPECTOR.

EROSION CONTROL NOTES:

- THE PERMITTEE SHALL ASSUME COMPLETE RESPONSIBILITY FOR CONTROLLING ALL SILTATION AND EROSION OF THE PROJECT AREA. THE PERMITTEE SHALL USE WHATEVER MEANS NECESSARY TO CONTROL EROSION AND SILTATION INCLUDING, BUT NOT LIMITED TO, STAKED STRAW BALES AND/OR SILTATION FABRIC FENCES (POSSIBLE METHODS OF CONTROL ARE DETAILED IN THE PLAN). CONTROL SHALL COMMENCE WITH THE CLEARING OPERATIONS AND BE MAINTAINED THROUGHOUT THE PROJECT UNTIL ACCEPTANCE OF THE WORK BY CITY OF O'FALLON AND AS NEEDED BY MODOT. THE PERMITTEE'S RESPONSIBILITIES INCLUDE ALL DESIGN AND IMPLEMENTATION AS REQUIRED TO PREVENT EROSION AND THE DEPOSITING OF SILT. THE CITY OF O'FALLON AND AS REQUIRED BY MODOT MAY AT THEIR OPTION DIRECT THE PERMITTEE IN HIS METHODS AS DEEMED FIT TO PROTECT PROPERTY AND IMPROVEMENTS. ANY DEPOSITING OF SILT OR MUD ON NEW OR EXISTING PAVEMENT SHALL BE REMOVED IMMEDIATELY. ANY DEPOSITING OF SILTS OR MUD IN NEW OR EXISTING STORM SEWERS AND/OR SWALES SHALL BE REMOVED AFTER EACH RAIN AND AFFECTED AREAS CLEANED TO THE SATISFACTION OF THE CITY OF O'FALLON AND AS REQUIRED BY MODOT.
- ALL EROSION CONTROL SYSTEMS ARE TO BE INSPECTED AND CORRECTED WEEKLY, ESPECIALLY WITHIN 48 HOURS OF ANY RAIN STORM RESULTING IN ONE-HALF INCH OF RAIN OR MORE. ANY SILT OR DEBRIS LEAVING THE SITE AND AFFECTING PUBLIC RIGHT OF WAY OR STORM WATER DRAINAGE FACILITIES SHALL BE CLEANED UP WITHIN 24 HOURS AFTER THE END OF THE STORM.
- EROSION CONTROL DEVICES (SILT FENCE, SEDIMENT BASIN, ETC.) SHALL BE IN ACCORDANCE WITH ST. CHARLES COUNTY SOIL AND WATER CONSERVATION DISTRICT EROSION AND SEDIMENT CONTROL GUIDELINES.
- THIS DEVELOPMENT IS REQUIRED TO PROVIDE LONG TERM POST CONSTRUCTION BMP'S SUCH AS; LOW IMPACT DESIGN, SOURCE CONTROL AND TREATMENT CONTROLS THAT PROTECTS WATER QUALITY AND CONTROLS RUN OFF TO THE MAXIMUM EXTENT PRACTICAL IN COMPLIANCE WITH PHASE II ILLICIT STORM WATER DISCHARGE GUIDELINES. (ORD. 5082, SECTION 405.0245)
- GRADED AREAS SHALL BE SEEDED AND MULCHED (STRAWED) WITHIN 14 DAYS OF STOPPING LAND DISTURBANCE ACTIVITIES. UNLESS IT CAN BE SHOWN TO THE CITY ENGINEER THAT WEATHER CONDITIONS ARE NOT FAVORABLE, VEGETATIVE GROWTH IS TO BE ESTABLISHED WITHIN 6 WEEKS OF STOPPING GRADING WORK ON THE PROJECT. THE VEGETATIVE GROWTH ESTABLISHED SHALL BE SUFFICIENT TO PREVENT EROSION AND THE STANDARD SHALL BE AS REQUIRED BY EPA AND DNR. (70% COVERAGE PER SQUARE FOOT) ORD. 5242, SECTION 405.070

GRADING NOTES:

- DEVELOPER MUST SUPPLY CITY CONSTRUCTION INSPECTORS WITH AN ENGINEER'S SOILS REPORT PRIOR TO AND DURING SITE GRADING. THE SOILS REPORT WILL BE REQUIRED TO CONTAIN THE FOLLOWING INFORMATION ON SOIL TEST CURVES (PROCTOR REPORTS) FOR PROJECTS WITHIN THE CITY.
 - MAXIMUM DRY DENSITY.
 - OPTIMUM MOISTURE CONTENT.
 - MAXIMUM AND MINIMUM ALLOWABLE MOISTURE CONTENT.
 - CURVE MUST BE PLOTTED TO SHOW DENSITY FROM A MINIMUM OF 90% COMPACTION AND ABOVE AS DETERMINED BY THE "MODIFIED AASHTO T-180 COMPACTION TEST" (A.S.T.M.-D-157) OR FROM A MINIMUM OF 95% COMPACTION AND ABOVE AS DETERMINED BY THE "STANDARD PROCTOR TEST AASHTO T-99, METHOD C" (A.S.T.M.-D-998). PROCTOR TYPE MUST BE DESIGNATED ON DOCUMENT.
 - CURVE MUST HAVE AT LEAST 5 DENSITY POINTS WITH MOISTURE CONTENT AND SAMPLE LOCATIONS LISTED ON DOCUMENT.
 - SPECIFIC GRAVITY.
 - NATURAL MOISTURE CONTENT.
 - LIQUID LIMIT.
 - PLASTIC LIMIT.

BE ADVISED THAT IF THIS INFORMATION IS NOT PROVIDED TO THE CITY'S CONSTRUCTION INSPECTOR, THE CITY WILL NOT ALLOW GRADING OR CONSTRUCTION ACTIVITIES TO PROCEED ON ANY PROJECT SITE.
- ALL FILL PLACED SHALL BE COMPACTED FROM THE BOTTOM OF THE FILL UP IN 8" LIFTS AND COMPACTED TO 90% MAXIMUM DENSITY AS DETERMINED BY MODIFIED AASHTO T-180 COMPACTION TEST OR 95% OF MAXIMUM DENSITY AS DETERMINED BY THE STANDARD PROCTOR TEST AASHTO T-99. ENSURE THE MOISTURE CONTENT OF THE SOIL IN FILL AREAS CORRESPONDS TO THE COMPACTIVE EFFORT AS DEFINED BY THE STANDARD OR MODIFIED PROCTOR TEST. OPTIMUM MOISTURE CONTENT SHALL BE DETERMINED USING THE SAME TEST THAT WAS USED FOR COMPACTION. SOIL COMPACTION CURVES SHALL BE SUBMITTED TO THE CITY OF O'FALLON PRIOR TO THE PLACEMENT OF FILL. PROOF ROLLING MAY BE REQUIRED TO VERIFY SOIL STABILITY AT THE DISCRETION OF THE CITY OF O'FALLON.
- THE SURFACE OF THE FILL SHALL BE FINISHED SO IT WILL NOT IMPOUND WATER. IF AT THE END OF A DAYS WORK IT WOULD APPEAR THAT THERE MAY BE RAIN PRIOR TO THE NEXT WORKING DAY, THE SURFACE SHALL BE FINISHED SMOOTH. IF THE SURFACE HAS BEEN FINISHED SMOOTH FOR ANY REASON, IT SHALL BE SCARIFIED BEFORE PROCEEDING WITH THE PLACEMENT OF SUCCEEDING LIFTS. FILL SHALL NOT BE PLACED ON FROZEN GROUND, NOR SHALL FILLING OPERATIONS CONTINUE WHEN THE TEMPERATURE IS SUCH AS TO PERMIT THE LAYER UNDER PLACEMENT TO FREEZE.
- ALL SEDIMENT AND DETENTION BASINS ARE TO BE CONSTRUCTED DURING THE INITIAL PHASE OF THE GRADING OPERATION OR IN ACCORDANCE WITH THE APPROVED SWPPP.
- WHEN GRADING OPERATIONS ARE COMPLETE OR SUSPENDED FOR MORE THAN 14 DAYS, PERMANENT GRASS MUST BE ESTABLISHED AT SUFFICIENT DENSITY TO PROVIDE EROSION CONTROL ON SITE. BETWEEN PERMANENT GRASS SEEDING PERIODS, TEMPORARY COVER SHALL BE PROVIDED ACCORDING TO ST. CHARLES SOIL AND WATER CONSERVATION DISTRICT - MODEL SEDIMENT AND EROSION CONTROL REGULATIONS. ALL FINISHED GRADES (AREAS NOT TO BE DISTURBED BY IMPROVEMENTS) IN EXCESS OF 20% SLOPES (5:1) SHALL BE MULCHED AND TACKED AT A RATE OF 100 POUNDS PER 1000 SQUARE FEET WHEN SEEDED.
- NO SLOPES SHALL EXCEED 3 (HORIZONTAL): 1 (VERTICAL) UNLESS OTHERWISE APPROVED BY THE SOILS REPORT AND SPECIFICALLY LOCATED ON THE PLANS AND APPROVED BY THE CITY ENGINEER.
- ALL LOW PLACES WHETHER ON SITE OR OFF SHALL BE GRADED TO PROVIDE DRAINAGE WITH TEMPORARY DITCHES.
- ANY EXISTING WELLS AND/OR SPRINGS WHICH MAY EXIST ON THE PROPERTY MUST BE SEALED IN A MANNER ACCEPTABLE TO THE CITY OF O'FALLON CONSTRUCTION INSPECTION DEPARTMENT AND FOLLOWING MISSOURI DEPARTMENT OF NATURAL RESOURCES STANDARDS AND SPECIFICATIONS. THERE ARE NO WELLS OR SPRINGS KNOWN TO EXIST ON THIS PROPERTY AT THIS TIME.
- SITE GRADING OUTSIDE OF CITY RIGHT-OF-WAY. MATERIAL IS TO BE PLACED IN EIGHT (8) INCH TO TWELVE (12) INCH LOOSE LIFTS AND COMPACTED PER THE APPROVED COMPACTION REQUIREMENTS. ONE (1) COMPACTION TEST WILL BE PERFORMED AT TWO (2) FOOT VERTICAL INTERVALS AND APPROXIMATELY EVERY ONE THOUSAND (1,000) CUBIC YARDS.

STORM SEWER NOTES:

- ALL STORM SEWER INSTALLATION IS TO BE IN ACCORDANCE WITH M.S.D. 2007 STANDARDS AND SPECIFICATIONS EXCEPT AS MODIFIED BY THE CITY OF O'FALLON ORDINANCES.
- BRICK SHALL NOT BE USED IN THE CONSTRUCTION OF STORM SEWER STRUCTURES. PRE CAST CONCRETE STRUCTURES ARE TO BE USED UNLESS OTHERWISE APPROVED BY THE CITY OF O'FALLON.
- ALL CONCRETE PIPES WILL BE INSTALLED WITH O-RING RUBBER TYPE GASKETS.
- CONNECTIONS AT ALL STORM STRUCTURES ARE TO BE MADE WITH A-LOCK JOINT OR EQUAL.
- ALL STORM SEWER SHALL BE REINFORCED CONCRETE PIPE OR H.D.P.E. PIPE. ALL STRUCTURES AND FLARED END SECTIONS MUST BE CONCRETE. MANUFACTURING SPECIFICATIONS MUST BE FOLLOWED AND DETAILS PROVIDED FOR THE INSTALLATION OF H.D.P.E. PIPE. H.D.P.E. PIPE WILL NOT BE ALLOWED FOR DETENTION BASIN OUTFLOWS, FINAL PIPE RUN TO DETENTION BASINS, CREEK DISCHARGE OR OTHER APPROVED MEANS.
- THE DISCHARGE POINT OF ALL FLARED END SECTIONS SHALL BE PROTECTED BY RIP RAP OR OTHER APPROVED MEANS.
- RIP RAP SHOWN AT FLARED END SECTIONS WILL BE EVALUATED IN THE FIELD BY THE ENGINEER, CONTRACTOR, AND CITY INSPECTORS AFTER INSTALLATION FOR EFFECTIVENESS AND FIELD MODIFIED, IF NECESSARY TO REDUCE EROSION ON AND OFF SITE.
- EXISTING INLET STONES THAT ARE CURRENTLY DAMAGED WITHIN THE VICINITY OF THE PROJECT SHALL BE REPLACED AS-NEEDED BY THE CONTRACTOR.

WATER NOTES:

- COORDINATE WITH THE WATER COMPANY ON THE LOCATION OF WATER METERS.
- PROVIDE WATER VALVES TO ISOLATE THE SYSTEM.
- ALL TOPS FOR VALVES, METERS, AND MANHOLES ARE TO BE CONSTRUCTED TO WITHIN 1 INCH (0.08') OF FINISH GRADE. GRADING AROUND STRUCTURE TOPS ON SLOPES NEED TO BE ACCOUNTED FOR.
- DISINFECTING:

DISINFECTING SHALL BE ACCOMPLISHED BY PLACING SUFFICIENT HYPO CHLORITE GRANULE (HTH) IN EACH SECTION OF PIPE TO ACHIEVE A CHLORINE RESIDUAL IN THE PIPELINE. UPON INITIAL FILLING, OF 50 MG/L (PPM) HT TABLETS WILL NOT BE ALLOWED. FOLLOWING COMPLETION OF THE PIPELINE, IT SHALL BE SLOWLY FILLED WITH WATER AND A SAMPLE WILL BE TAKEN IMMEDIATELY AND THE CHLORINE RESIDUAL MUST BE 50 MG/L OR GREATER. THE SOLUTION SHALL BE ALLOWED TO STAND FOR 24 HOURS AND A SAMPLE SHALL THEN BE TAKEN. THE CHLORINE RESIDUAL AFTER 24 HOURS SHALL BE 30 MG/L OR GREATER. IF THE PIPING SHOWS INSUFFICIENT CHLORINE RESIDUALS IN EITHER TEST, THE PIPING SHALL BE RE-CHLORINATED BY THE INJECTION OF HYPO CHLORITE SOLUTION UNTIL SATISFACTORY RESULTS ARE ACHIEVED. ALL DISINFECTING SHALL BE DONE BY THE CONTRACTOR. ONLY THE TESTING TO DETERMINE THE CHLORINE RESIDUAL WILL BE DONE BY THE CITY.
- PRESSURE TESTING:

IMMEDIATELY FOLLOWING DISINFECTING, THE PIPING SHALL BE PUMPED TO A PRESSURE (AT THE LOWEST POINT IN THE PROJECT) OF 150 PSI OR HIGHER WHERE THE WORKING PRESSURE IS HIGHER THAN 150 PSI AS DETERMINED BY THE CITY. IN SUCH CASES, THE PRESSURE SHALL BE AS SPECIFIED BY THE CITY AND TWO PRESSURE TESTS SHALL BE CONDUCTED. THE FIRST TEST SHALL BE WITH THE FIRE HYDRANT AUXILIARY VALVE OPEN AND BE TO 150 PSI. THE SECOND TEST SHALL BE WITH THE FIRE HYDRANT AUXILIARY VALVE CLOSED AND BE TO THE HIGHER PRESSURE AS DIRECTED BY THE CITY. ALL PUMPING EQUIPMENT AND PRESSURE GAUGES SHALL BE PROVIDED BY THE CONTRACTOR. AFTER ACHIEVING THE TEST PRESSURE, THE PIPING SHALL BE LEFT CLOSED FOR A PERIOD OF TWO (2) HOURS. AT THE END OF THIS TIME THE PRESSURE DROP SHALL NOT EXCEED 2 PSI. IN ADDITION, IF THE PRESSURE APPEARS, IN JUDGMENT OF THE CITY'S REPRESENTATIVE, TO BE CONTINUING TO DROP, THE TEST SHALL BE CONTINUED FOR ANOTHER TWO (2) HOURS AND IF ANY FURTHER DROPS OCCUR, THE TEST SHALL BE CONSIDERED A FAILURE. IF THE PRESSURE TEST FAILS, THE CONTRACTOR WILL BE REQUIRED TO FIND AND CORRECT THE SOURCE OF THE LEAKAGE. IF THIS REQUIRES DRAINING OF THE PIPELINE, WHEN THE LEAKAGE IS CORRECTED, THE PIPELINE MUST BE RE-DISINFECTED AND THE PRESSURE TESTED AGAIN UNTIL SATISFACTORY RESULT ARE ACHIEVED. ANY MDNR REQUIRED DECHLORINATION WILL BE PERFORMED BY THE CONTRACTOR.
- BACTERIOLOGICAL TESTING:

AFTER SATISFACTORY DISINFECTING AND PRESSURE TESTING, A SAMPLE SHALL BE TAKEN BY THE CONTRACTOR IN THE PRESENCE OF A CITY REPRESENTATIVE AND SUBMITTED TO A LABORATORY APPROVED BY THE MISSOURI DEPARTMENT OF NATURAL RESOURCES AND THE CITY FOR BACTERIOLOGICAL ANALYSIS. AFTER 24 HOURS, A SECOND SAMPLE SHALL BE TAKEN IN A LIKE MANNER AND SUBMITTED FOR ANALYSIS. THE TWO SAMPLES TAKEN ON CONSECUTIVE DAYS, A MINIMUM OF 24 HOURS APART, MUST BE FOUND TO BE "SAFE" BY THE TESTING LABORATORY, AND COPIES OF THE TEST RESULTS MUST BE SUPPLIED TO THE CITY. IF THE SAMPLES ARE NOT FOUND TO BE "SAFE" FURTHER FLUSHING AND/OR DISINFECTING AS DIRECTED BY THE CITY SHALL BE CONDUCTED BY THE CONTRACTOR UNTIL "SAFE" SAMPLES ON TWO CONSECUTIVE TEST DAYS ARE ACHIEVED. FOLLOWING SUCCESSFUL BACTERIOLOGICAL TESTING AND A DETERMINATION BY THE CITY THAT THE SAMPLES ARE "SAFE", THE MAINS MAY BE PLACED INTO SERVICE.

ROADWAY NOTES:

- ALL PAVING (PUBLIC AND PRIVATE) TO BE IN ACCORDANCE WITH 2006 ST. CHARLES COUNTY STANDARDS AND SPECIFICATIONS EXCEPT AS MODIFIED BY THE CITY OF O'FALLON ORDINANCES.
- TYPE C (BP-1) COMPACTION REQUIREMENTS SHALL BE 98% MINIMUM DENSITY ACCORDING TO ST. CHARLES CO. STANDARD SPECIFICATIONS.
- MATERIAL TESTING AND FREQUENCY. MATERIALS FOR CONSTRUCTION SHALL BE TESTED AND INSPECTED PER THE APPROPRIATE ASTM CODE OR AT THE CITY ENGINEER'S DISCRETION. THE DEVELOPER'S ENGINEER SHALL PERFORM THE FOLLOWING QUALITY CONTROL GUIDELINES:
 - CONCRETE
 - CYLINDERS/COMPRESSIVE STRENGTH. ONE (1) SET OF FOUR (4) CYLINDERS WITHIN THE FIRST FIFTY (50) CUBIC YARDS AND ONE (1) SET PER ONE HUNDRED (100) CUBIC YARDS THEREAFTER. ONE (1) CYLINDER MUST BE TESTED AT SEVEN (7) DAYS, ONE (1) AT FOURTEEN (14) DAYS AND TWO (2) AT TWENTY-EIGHT (28) DAYS. IF THE FIRST (1ST) CYLINDER DOES NOT MEET SPECIFICATIONS AT TWENTY-EIGHT (28) DAYS, THEN THE SECOND (2ND) CYLINDER MUST BE HELD AND TESTED AT DAY FIFTY-SIX (56).
 - PERCENT AIR AND TEMPERATURE. FIRST (1ST) TRUCK BATCH EACH DAY AND TWO (2) THEREAFTER UNTIL A CONSISTENCY IS ENCOUNTERED. ONCE A CONSISTENCY IS ENCOUNTERED, THEN TESTS WILL BE PERFORMED IN CONJUNCTION WITH THE CONCRETE CYLINDERS.
 - SLUMP. FIRST (1ST) TRUCK BATCH EACH DAY AND TWO (2) THEREAFTER UNTIL A CONSISTENCY IS ENCOUNTERED. ONCE A CONSISTENCY IS ENCOUNTERED, THEN TESTS WILL BE PERFORMED IN CONJUNCTION WITH THE CONCRETE CYLINDERS.
 - SUB GRADE AND BASE
 - PROOF ROLL AS DESCRIBED IN SECTION 405.210(B).
 - ONE (1) COMPACTION TEST PER TWO HUNDRED FIFTY (250) FEET OF MAINLINE PAVING.
 - GRADATION TEST FOR SUB BASE MATERIAL.
 - ASPHALT
 - ONE (1) SET OF COMPACTION TESTS PER TWO HUNDRED FIFTY (250) FEET OF MAINLINE.
 - ONE (1) BULK DENSITY TEST PER PAVING OPERATION.
- APPROVAL OF SUB GRADE AND BASE (SUB BASE). THE CITY ENGINEER OR REPRESENTATIVE SHALL APPROVE THE SUB GRADE BEFORE ANY BASE IS PLACED THEREON AND SHALL APPROVE THE BASE BEFORE CONCRETE OR SURFACE COURSE IS PLACED. THE SUB GRADE AND BASE SHALL BE SO CONSTRUCTED THAT IT WILL BE UNIFORM IN DENSITY THROUGHOUT.
- IN ALL FILL AREAS IN THE ROADWAYS, SOIL TESTS SHALL BE SUBMITTED AND APPROVED BY THE CITY ENGINEER FOR EACH FOOT OF FILL AND AT LEAST ONE (1) TEST AND AN AVERAGE OF ONE (1) TEST WITHIN EVERY TWO HUNDRED FIFTY (250) FEET.
- NO TRAFFIC WILL BE ALLOWED ON NEW CONCRETE PAVEMENT UNTIL IT HAS CURED FOR SEVEN (7) DAYS AND IT REACHES THREE THOUSAND FIVE HUNDRED (3,500) PSI WITHIN 28 DAYS. CONCRETE PAVEMENTS SHALL NOT BE APPROVED UNLESS IT REACHES A STRENGTH OF FOUR THOUSAND (4,000) PSI.
- PRIOR TO PLACEMENT OF AGGREGATE BASE MATERIAL ON SUB GRADE AND PRIOR TO PLACEMENT OF PAVEMENT ON BASE MATERIAL, THE SUB GRADE AND BASE MUST BE PROOF-ROLLED WITH A FULLY LOADED (TEN (10) TON LOAD) TANDEM TRUCK OR EQUIVALENT TIRE VEHICLE WITH ONE (1) PASS DOWN EACH DRIVING LANE NO FASTER THAN THREE (3) MILES PER HOUR. IF SOFT SPOTS ARE DETECTED, OR PUMPING, RUTTING OR HEAVING OCCURS GREATER THAN ONE (1) INCH AT THE SUB GRADE, THE ROADBED SHALL BE CONSIDERED UNSATISFACTORY AND THE SOIL IN THESE AREAS SHALL BE REMEDIATED TO THE DEPTH INDICATED BY THE CONTRACTOR'S TESTING FIRM AND APPROVED BY A REPRESENTATIVE OF THE CITY ENGINEER.
- SUB GRADE AND BASE BENEATH PAVEMENTS SHALL BE COMPACTED TO ST. CHARLES COUNTY HIGHWAY DEPARTMENT SPECIFICATIONS. THE MOISTURE RANGE SHALL BE DETERMINED BY THE STANDARD OR MODIFIED PROCTOR DENSITY METHOD AASHTO T-99 AND WITHIN +/-4 PERCENTAGE POINTS OF THE OPTIMUM MOISTURE CONTENT.
- THE ENTIRE WIDTH AND LENGTH WILL CONFORM TO LINE, GRADE AND CROSS SECTION SHOWN ON THE PLANS OR AS ESTABLISHED BY THE ENGINEER. IF ANY SETTLING OR WASHING OCCURS, OR WHERE HAULING RESULTS IN RUTS OR OTHER OBJECTIONABLE IRREGULARITIES, THE CONTRACTOR SHALL IMPROVE THE SUB GRADE OR BASE TO THE SATISFACTION OF THE CITY BEFORE THE PAVEMENT IS PLACED. ADDITIONAL ROLLING OR METHODS TO VERIFY COMPACTION SHALL BE AT THE DISCRETION OF THE CITY ENGINEER. TOLERANCE ALLOWED ON ALL LINES, GRADES AND CROSS SECTIONS SHALL BE PLUS OR MINUS FOUR-HUNDREDTHS (+0.04) FEET.
- UTILITY WORK PRIOR TO BASE CONSTRUCTION. NO BASE COURSE WORK MAY PROCEED ON ANY STREET UNTIL ALL UTILITY EXCAVATIONS (STORM AND SANITARY SEWERS, WATER, GAS, ELECTRIC, ETC.) HAVE BEEN PROPERLY BACK FILLED WITH GRANULAR MATERIAL, CRUSHED STONE OR GRAVEL MECHANICALLY TAMPED IN TEN (10) INCH LIFTS. UTILITIES INSTALLED AFTER SUB GRADE PREPARATION SHALL BE BORED. COMPACTION REQUIREMENTS SHALL FOLLOW ST. CHARLES COUNTY STANDARDS (2006).
- ALL PERMANENT TRAFFIC CONTROL WILL BE PER M.U.T.C.D. OR MODOT STANDARDS.
- ALL SIGN POST, BACKS AND BRACKET ARMS SHALL BE PAINTED BLACK USING CARBOLINE RUST BOND PENETRATING SEALER SG AND CARBOLINE 133 HB PAINT (OR EQUIVALENT AS APPROVED BY CITY OF O'FALLON AND MODOT).

SURVEY NOTES:

- THE CONTRACTOR SHALL BE RESPONSIBLE TO CONTACT THE SURVEY COMPANY WHICH ESTABLISHED THE PROJECT CONTROL (KUHLMANN DESIGN GROUP, INC (314-434-8989)) AND CONFIRM THAT THE CONTROL POINTS DESCRIBED ON THIS DRAWING ARE THE MOST UPDATED AND BEST INFORMATION. (SURVEY COMPANY MAY ESTABLISH IMPROVED PROJECT CONTROL AT A LATER DATE.) CONTRACTOR SHALL USE THE BEST CONTROL BASED ON SURVEYOR'S RECOMMENDATIONS.
- THE CONTRACTOR SHALL ALSO BE RESPONSIBLE TO FIELD VERIFY THE SURVEY CONTROL POINTS AND THE DESIGN COORDINATES SHOWN IN THESE PLANS. FIELD VERIFICATIONS SHALL INCLUDE CONFIRMING THAT THE DESIGN COORDINATES WILL PLACE THE PROPOSED IMPROVEMENTS ACCURATELY TO THE INTENDED PLAN LOCATIONS AND IN RELATION TO THE PROPERTY LINES AND THE BASIS OF BEARING.
- IF ANY ERRORS, DISCREPANCIES, OR OTHERWISE CONCERNS ARISE PERTAINING TO THE ACCURACY OF THE DESIGN COORDINATES OR CONSTRUCTION STAKING/SURVEYS, THE CONTRACTOR SHALL BE RESPONSIBLE TO COORDINATE WITH THE PROJECT SUPERINTENDENT AND THE ENGINEER FOR RESOLUTION PRIOR TO BEGINNING OR CONTINUING CONSTRUCTION.
- ALL CONSTRUCTION STAKING SHALL BE "TO GROUND" AND NOT "TO GRID" FOR REAL DISTANCES. THE CONSTRUCTION STAKING CONTRACTOR SHALL FOLLOW THE RECOMMENDATIONS OF THE KUHLMANN DESIGN GROUP, INC REGARDING TRANSLATIONS BETWEEN GRID AND GROUND. (THIS CONCERN IS MENTIONED SINCE THE HORIZONTAL DATUM FROM KUHLMANN'S DESIGN GROUP, INC REFERENCES STATE PLANE, WHICH IS A GRID SYSTEM.)
- THE CONSTRUCTION STAKING CONTRACTOR SHALL BE RESPONSIBLE FOR ANY REPAIRS, DAMAGES, AND COSTS DUE TO FAULTY CONSTRUCTION STAKING RESULTING FROM INSUFFICIENT FIELD VERIFICATIONS OF THE SURVEY DATUMS, CONTROL, AND DESIGN COORDINATES.

UTILITY CONTACTS

SANITARY SEWERS
CITY OF O'FALLON
100 N. MAIN ST.
O'FALLON, MO. 63366
CONTACT: 636-281-2858

WATER
CITY OF O'FALLON
100 N. MAIN ST.
O'FALLON, MO. 63366
CONTACT: 636-281-2858

STORM SEWER
CITY OF O'FALLON
100 N. MAIN ST.
O'FALLON, MO. 63366
636-281-2858

ELECTRIC
AMEREN UE
200 CALLAHAN ROAD
WENTZVILLE, MO. 63385
636-639-8312

GAS
LACLEDE GAS COMPANY
6400 GRAHAM ROAD
ST. LOUIS, MO. 63134
314-522-2297


TELEPHONE
CENTURY TEL
1151 CENTURY TEL DR.
WENTZVILLE, MO. 63385
636-332-7261

FIRE DISTRICT
O'FALLON FIRE PROTECTION DISTRICT
119 E. ELM ST.
O'FALLON, MO. 63366
636-272-3493

* CITY OF O'FALLON CONSTRUCTION WORK HOURS PER CITY ORDINANCE 3429 AS SHOWN IN SECTION 500.420 OF THE MUNICIPAL CODE OF THE CITY OF O'FALLON ARE AS FOLLOWS:

OCTOBER 1 THROUGH MAY 31
7:00 A.M. TO 7:00 P.M. MONDAY THROUGH SUNDAY
JUNE 1 THROUGH SEPTEMBER 30
6:00 A.M. TO 8:00 P.M. MONDAY THROUGH FRIDAY
7:00 A.M. TO 8:00 P.M. SATURDAY AND SUNDAY

CONSTRUCTION WORK TO BE DONE OUTSIDE OF THESE HOURS REQUIRES PRIOR WRITTEN APPROVAL FROM THE CITY ADMINISTRATOR OR CITY ENGINEER.

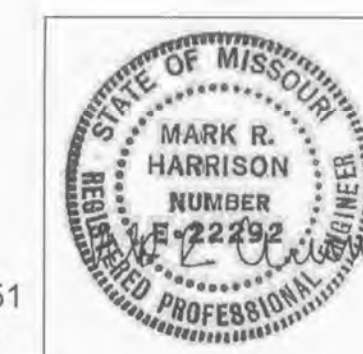

REV	PROJ ID	DATE	DRWN	RVW	APPR



BMCD# 77051
425 S. WOODS AVE. #100
O'FALLON, MO 63366
(314) 682-1000
Date: 06/27/2014
Mark R. Harrison
Professional Engineer
#E-22292

O'FALLON RENEWABLE ENERGY CENTER	REV	0
COMMERCIAL CONSTRUCTION GENERAL NOTES		
Ameren	CP00	