




HOFF ROAD (ROW 60.43' WIDE)

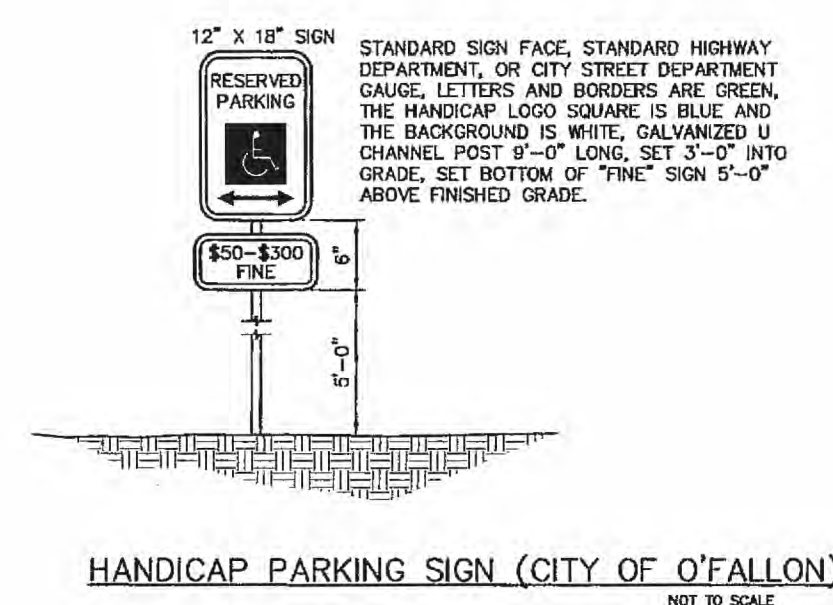


HANDICAP PARKING SIGN (CITY OF O'FALLON)
NOT TO SCALE

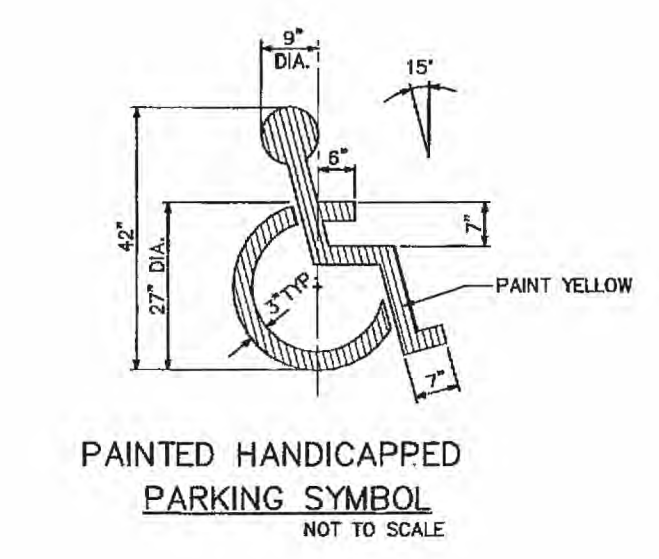


PAINTED HANDICAPPED PARKING SYMBOL
NOT TO SCALE

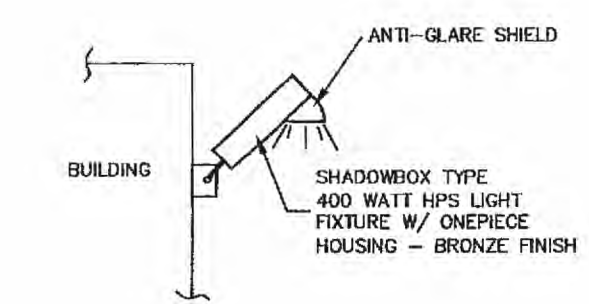


BUILDING MOUNTED LIGHT
NOT TO SCALE

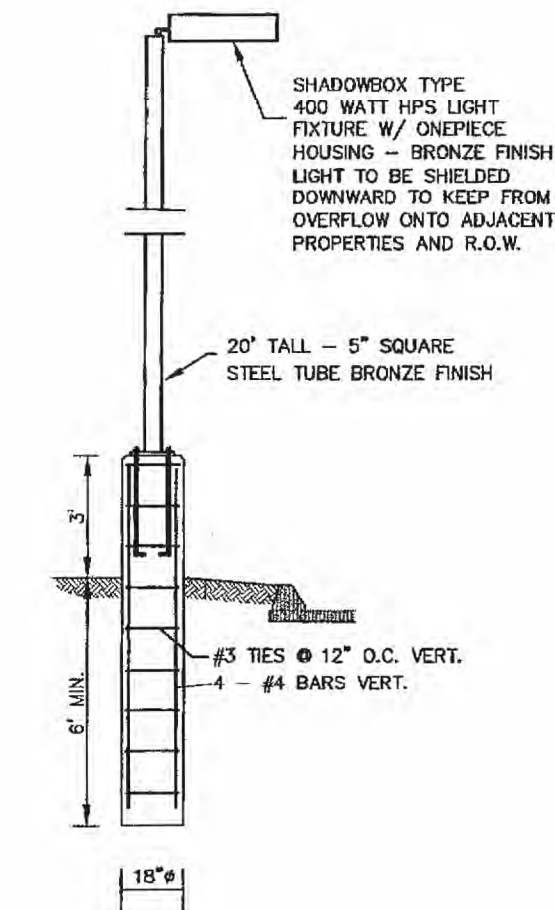


LIGHT POLE & BASE
NOT TO SCALE

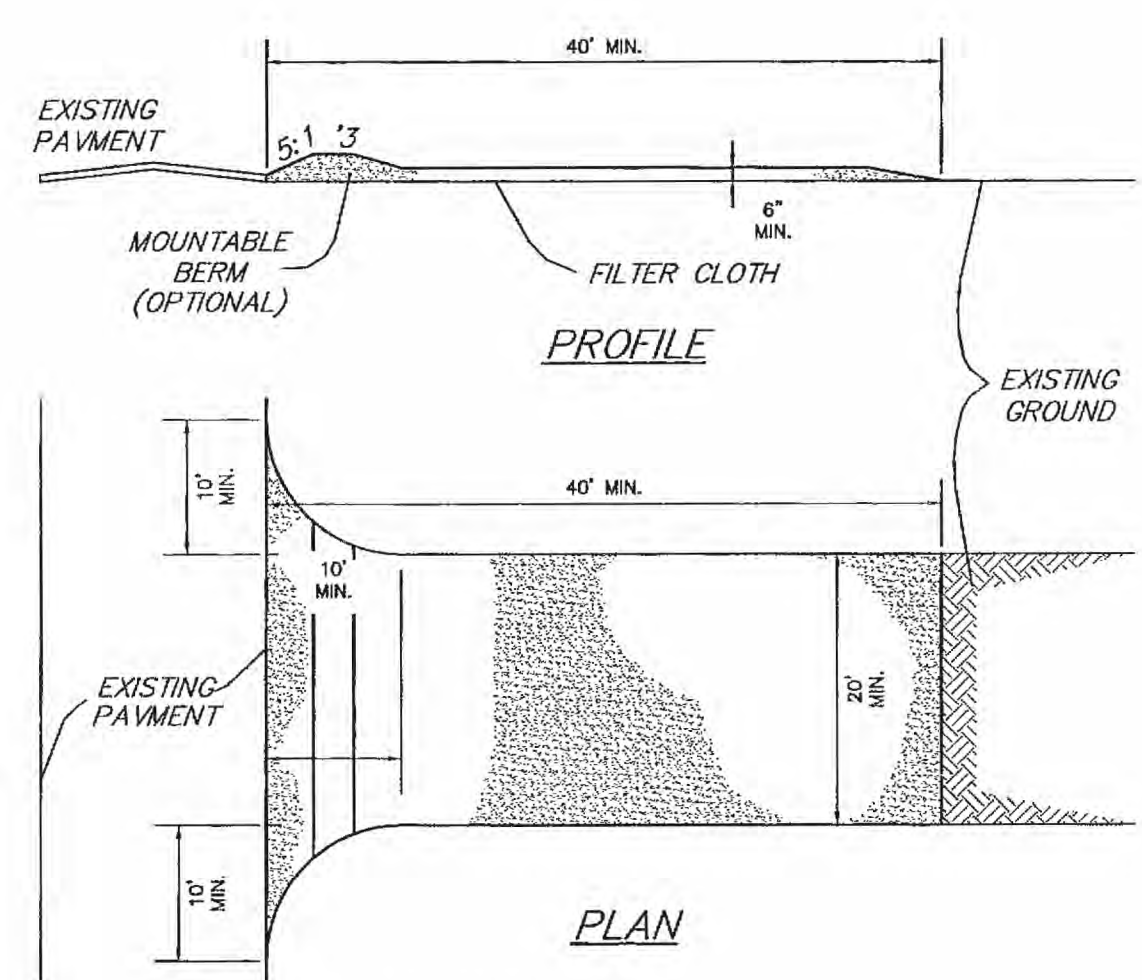


ENTRANCE DETAIL
SCALE 1" = 10'
NOTE: ALL SPOTS ARE TO TOP OF PAVEMENT

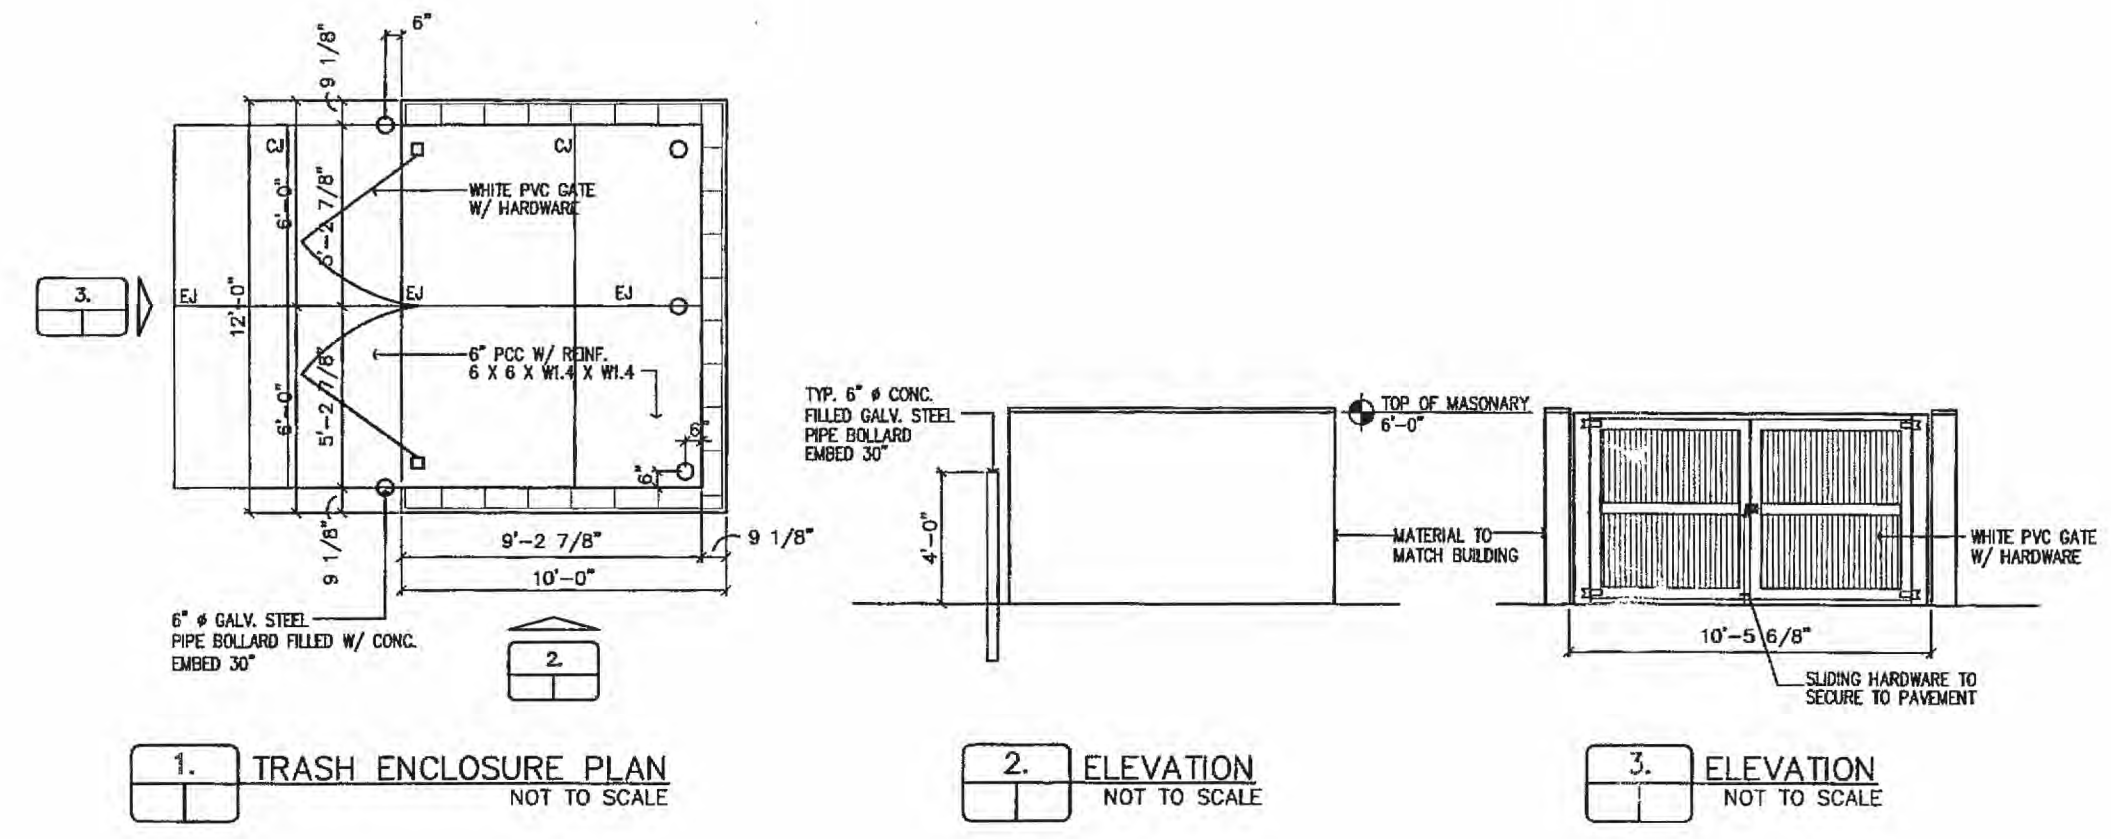

1. TRASH ENCLOSURE PLAN NOT TO SCALE
2. ELEVATION NOT TO SCALE
3. ELEVATION NOT TO SCALE

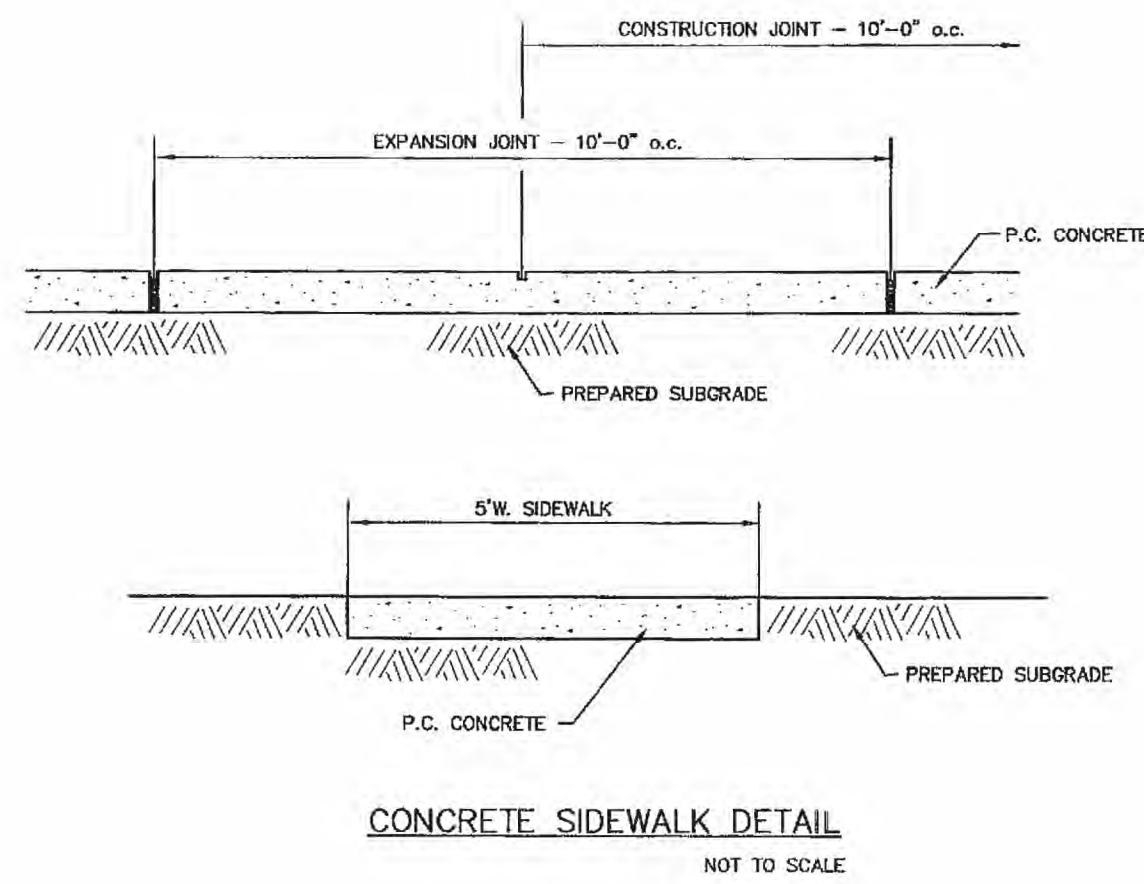


CONCRETE SIDEWALK DETAIL
NOT TO SCALE

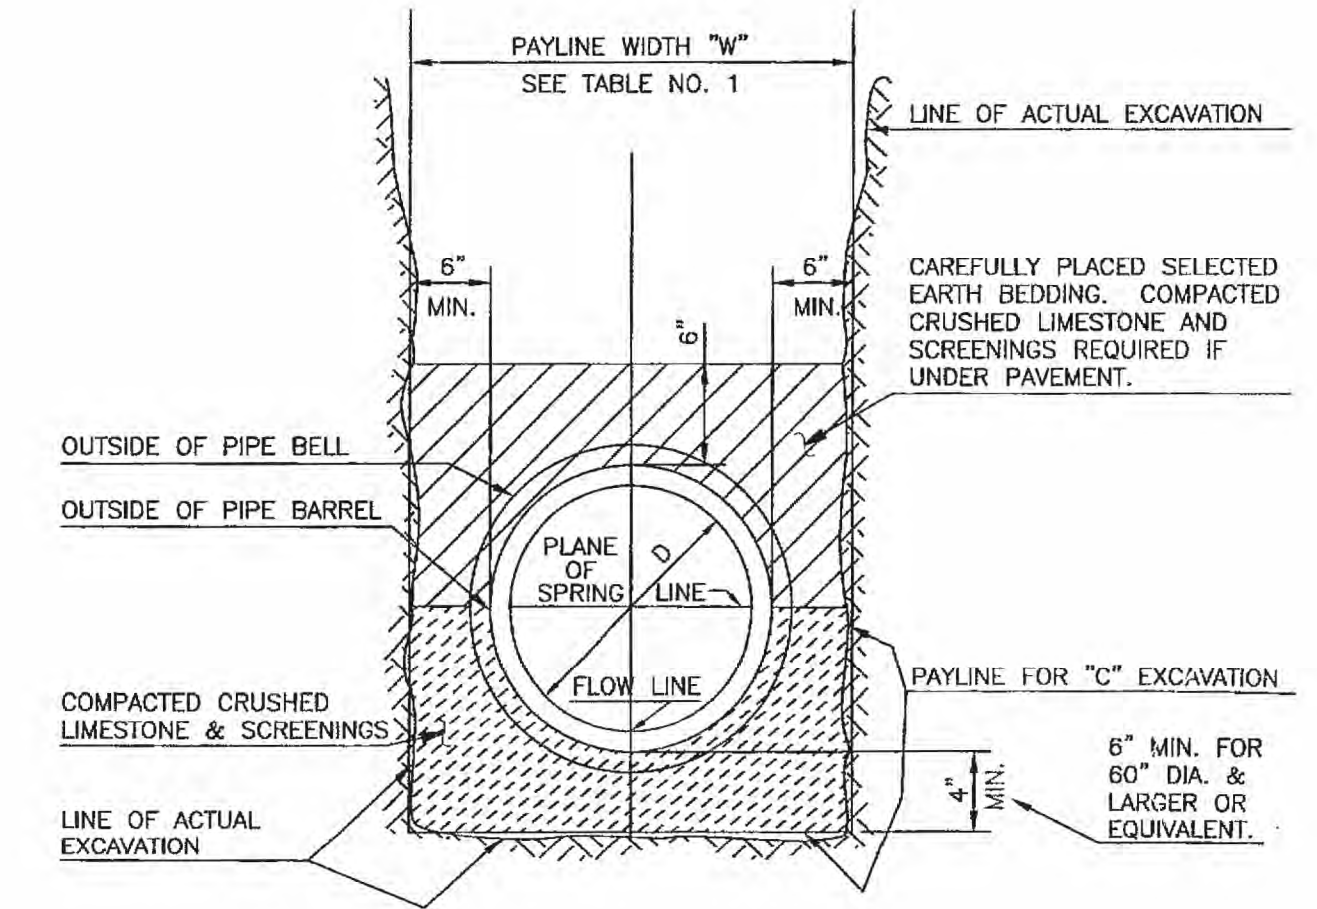

O'FALLON DETAIL
PIPE BEDDING CLASS "C"
(MODIFIED FOR REINFORCED
CONCRETE PIPE)


- CONSTRUCTION SPECIFICATIONS**
- Stone Size - Use 2" stone, or reclaimed or recycled concrete equivalent.
 - Length - As required, but not less than 40 feet (except on a single residence lot where a 30 foot minimum length would apply).
 - Thickness - Not less than six (6) inches.
 - Width - Twenty (20) foot minimum, but not less than the full width at points where ingress or egress occurs.
 - Filter Cloth - Will be placed over the entire area prior to placing of stone. Filter will not be required on a single family residence lot.
 - Surface Water - All surface water flowing or diverted toward construction entrances shall be piped across the entrance. If piping is impractical, a mountable berm with 5:1 slopes will be permitted.
 - Maintenance - The entrance shall be maintained in a condition which will prevent tracking or flowing of sediment onto public rights-of-way. This may require periodic top dressing with additional stone as conditions demand and repair and/or cleanout of any measures used to trap sediment. All sediment spilled, dropped, or tracked onto public rights-of-way must be removed immediately.
 - Washing - Wheels shall be cleaned to remove sediment prior to entrance onto public rights-of-way. When washing is required, it shall be done on an area stabilized with stone and which drains into an approved sediment trapping device.
 - Periodic inspection and needed maintenance shall be provided after each rain.

STABILIZED CONSTRUCTION ENTRANCE/WASHDOWN AREA NOT TO SCALE

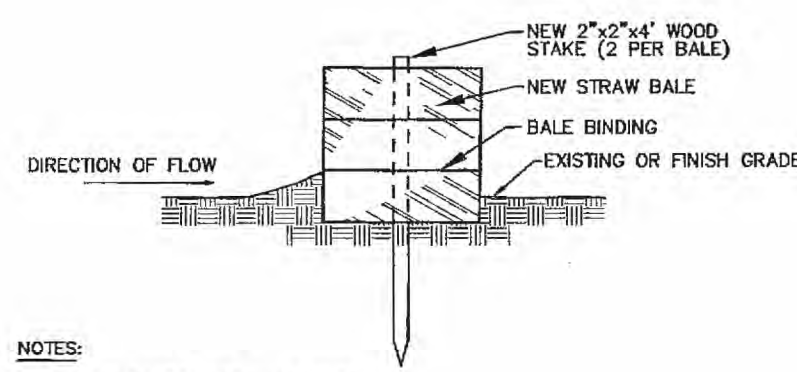


- NOTES:**
- STRAW BALES, NOT HAY BALES SHALL BE USED
 - FRUITY ENDS OF BALES TIGHTLY TOGETHER.
 - INSTALL BALES WITH BINDING AROUND SIDES, NOT TOP AND BOTTOM.
 - FILL ANY GAP BETWEEN BALES BY WEDGING LOOSE STRAW BETWEEN THEM.


SEDIMENT BARRIER
NOT TO SCALE

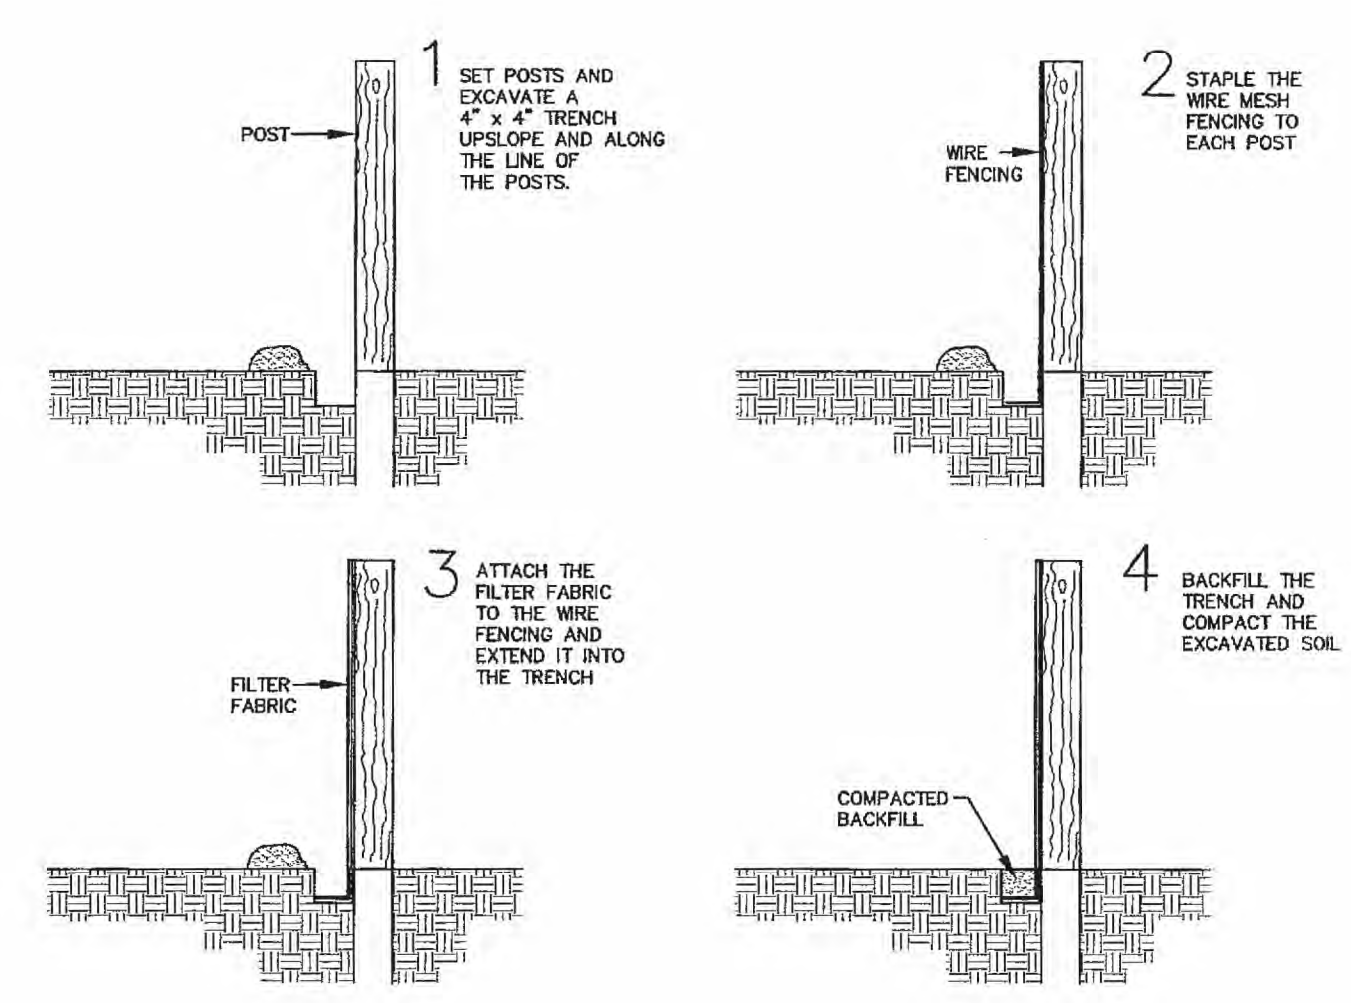

SILTATION FENCE DETAIL

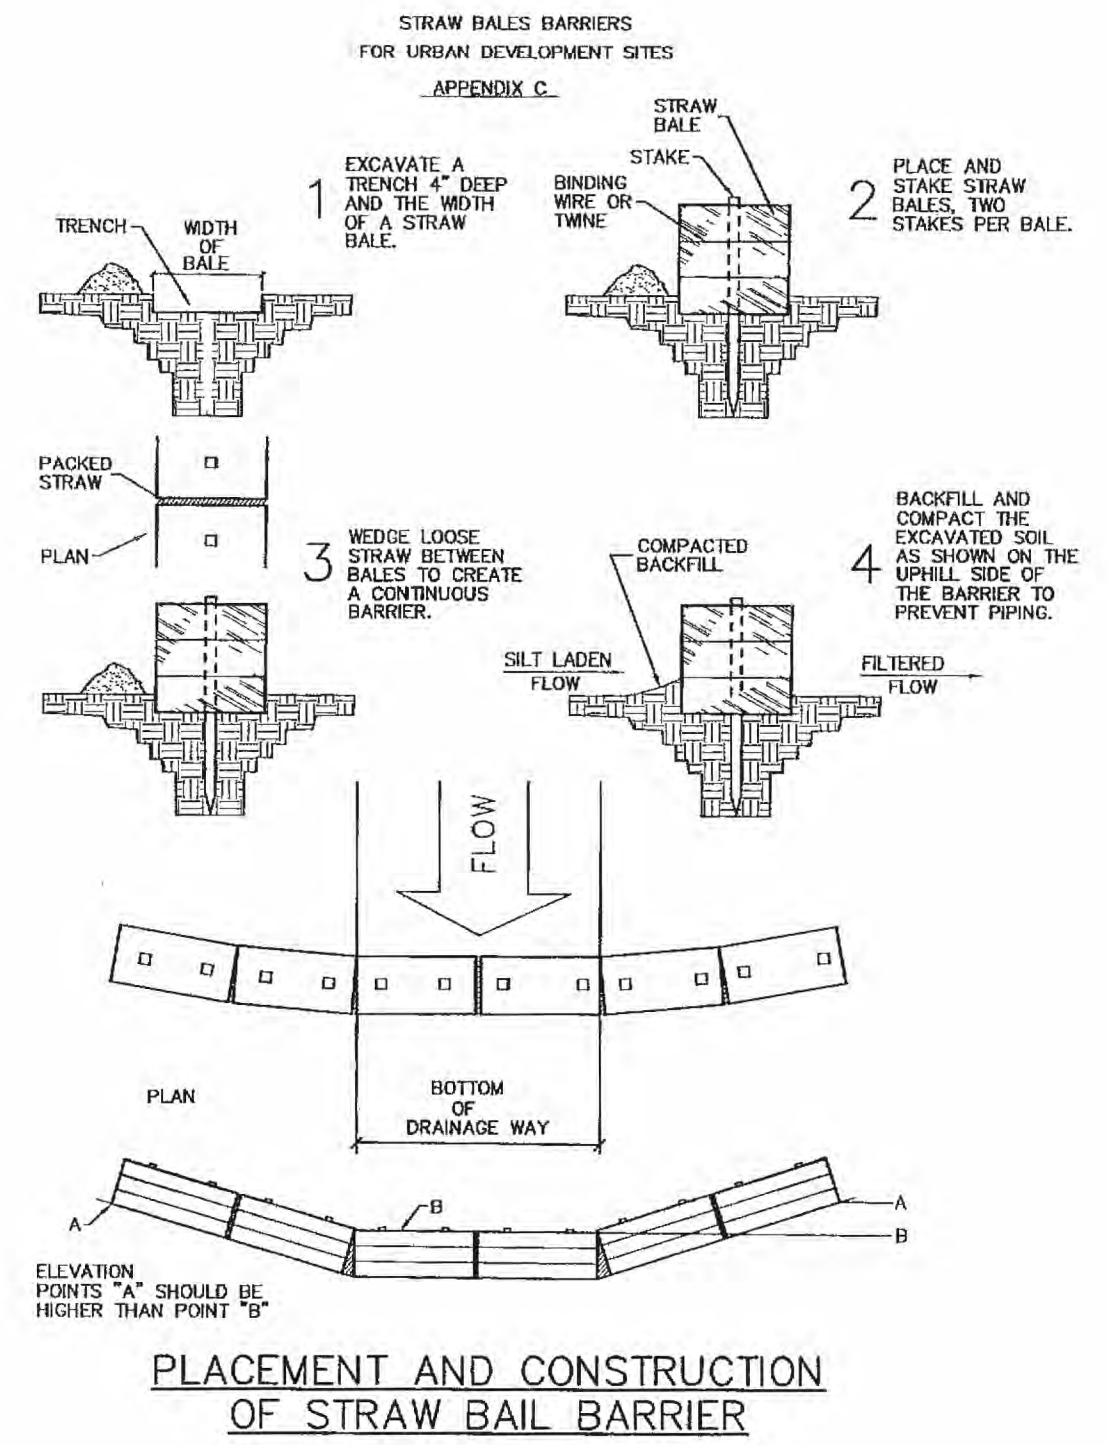

PLACEMENT AND CONSTRUCTION OF STRAW BALE BARRIER

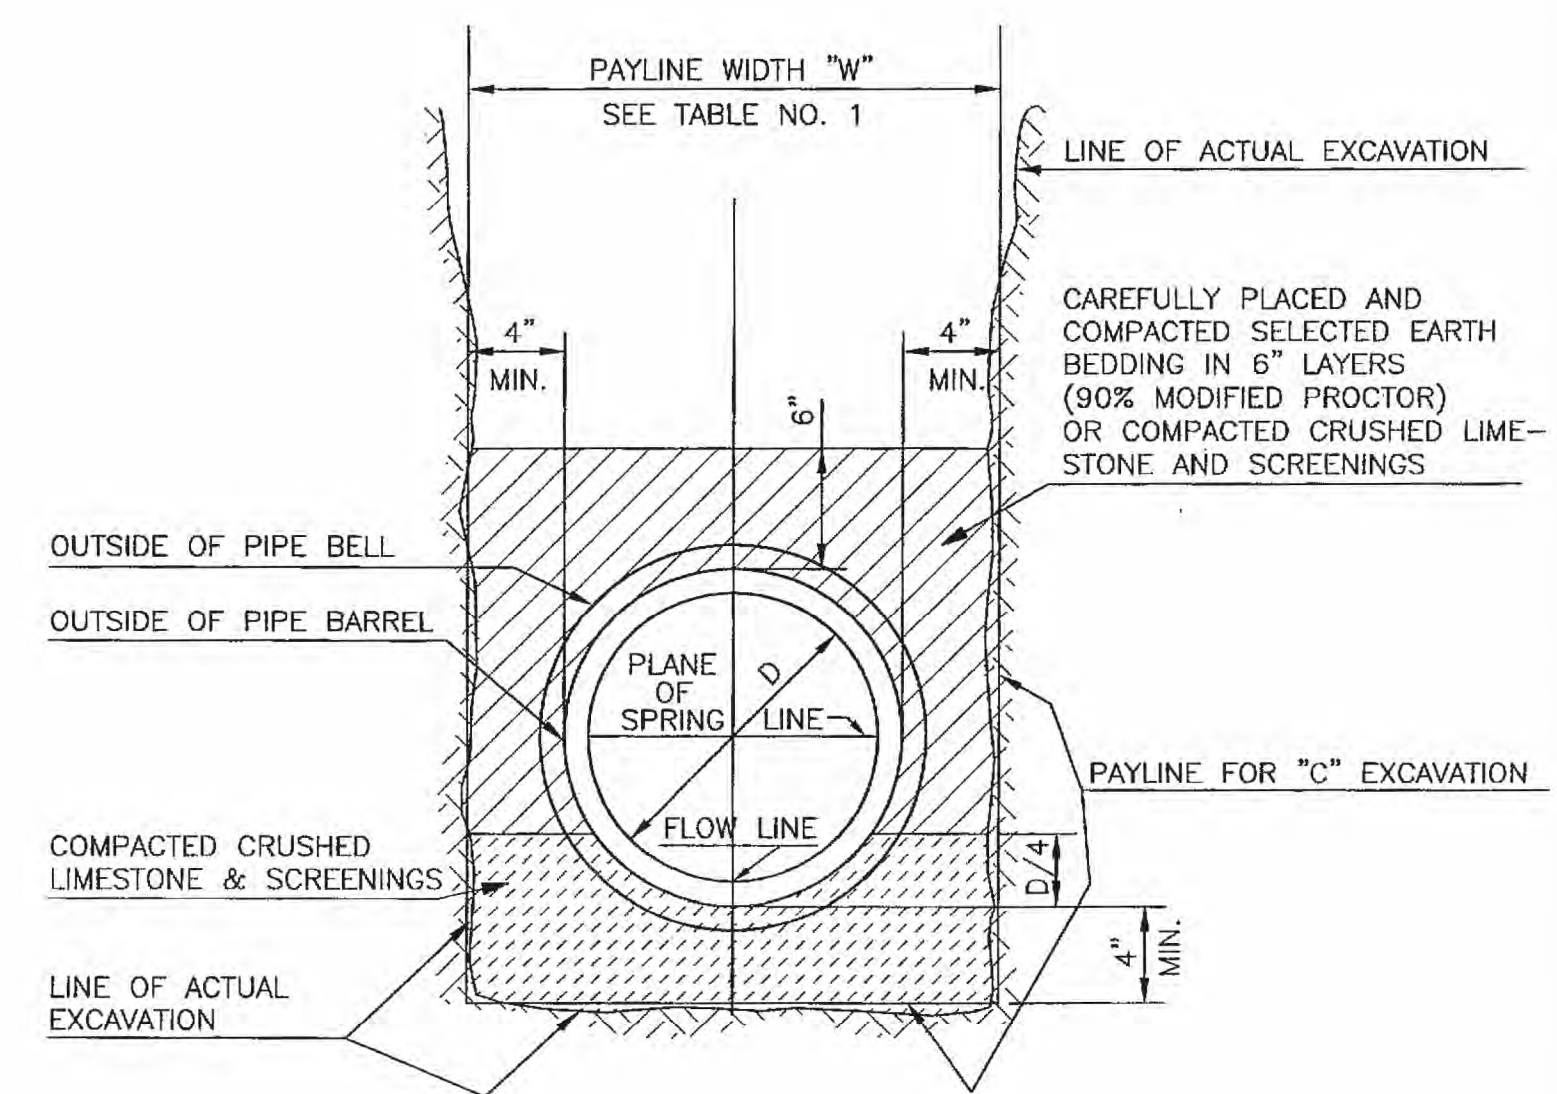

PIPE BEDDING CLASS "C"
(FOR ALL PIPE EXCEPT
REINFORCED CONCRETE PIPE)