







REF. DWG.

BENCH DETAIL

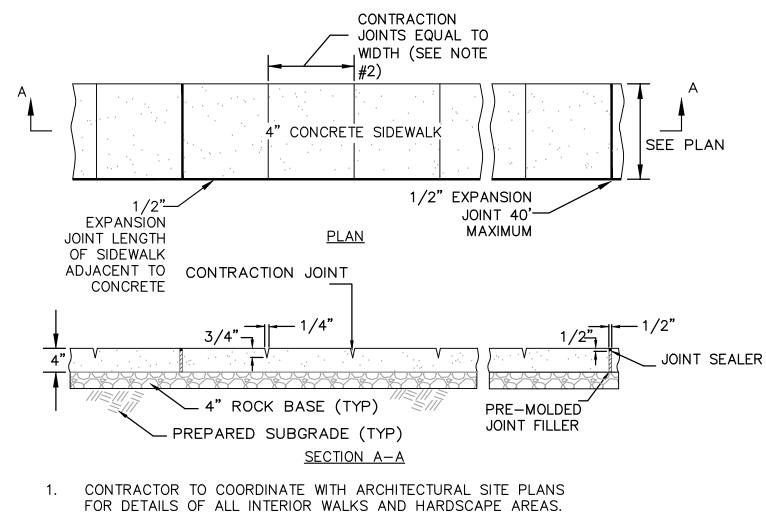


2. DETAIL IS INTENDED FOR SIDEWALK WIDTHS OF 4 TO 6 FEET. CONTRACTOR SHALL COORDINATE WITH ARCHITECT OR ENGINEER FOR ANY SIDEWALK WIDTHS THAT EXCEED 6 FEET.


CONCRETE SIDEWALK DETAIL C4.0

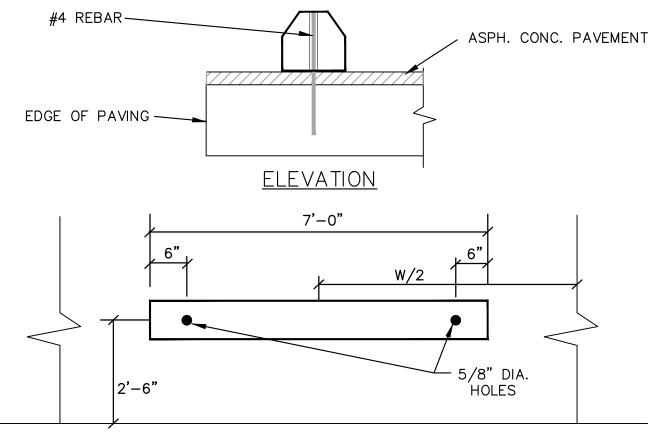


1.) SIMILAR SHAPE MAY BE USED UPON APPROVAL OF ENGINEER.

WHEEL STOP DETAIL REF. DWG. C4.0

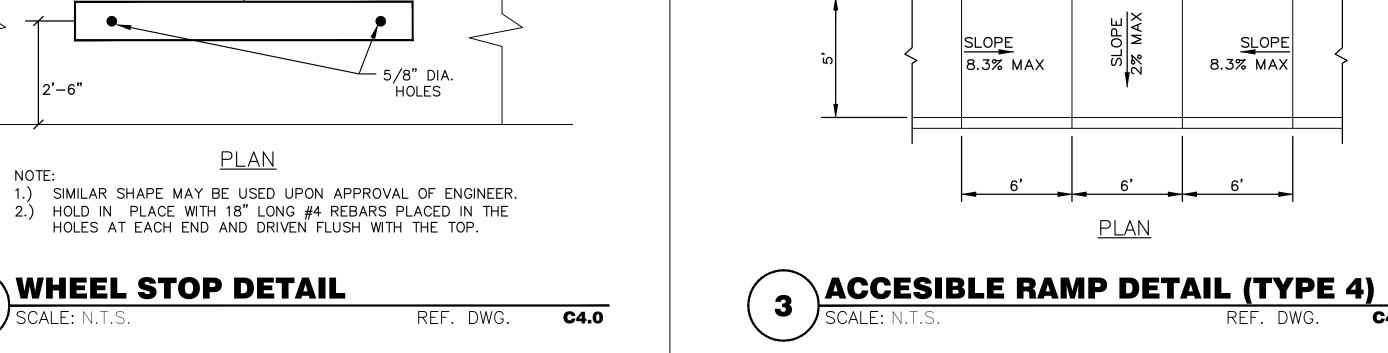

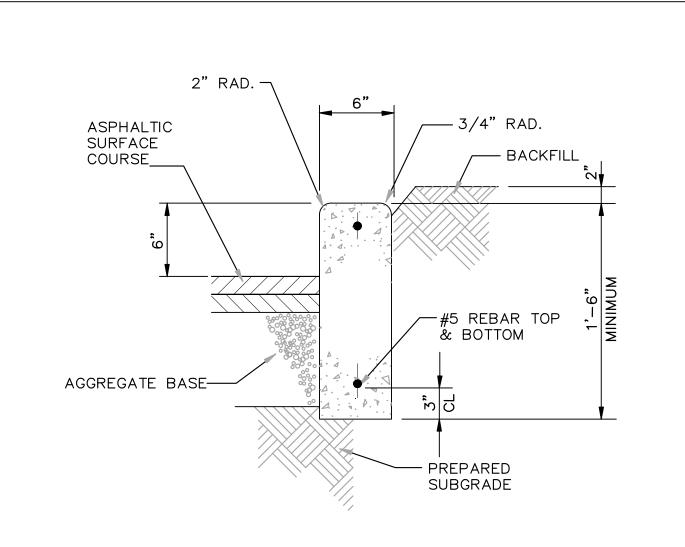

VERTICLE CONCRETE CURB DETAIL

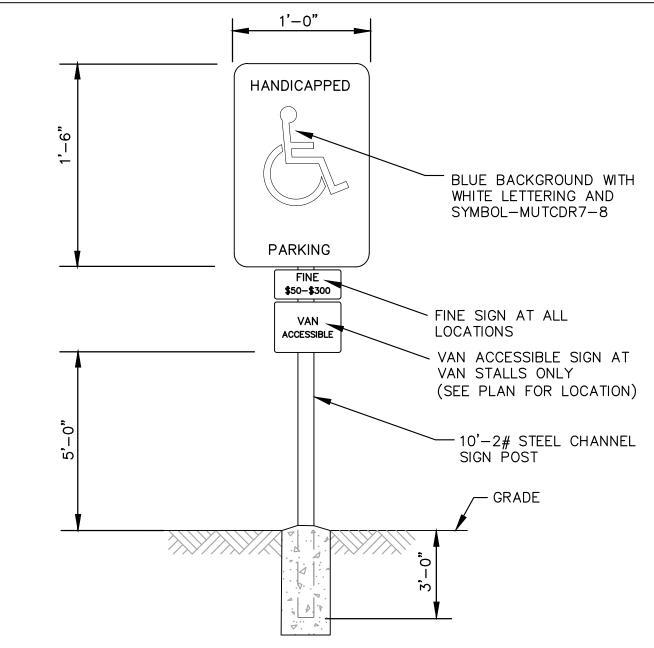

SLOPING

CURB

TOP OF CURB

-GUTTER LINE

SLOPING


CURB

NOTE: MAINTAIN 4" SIDEWALK THICKNESS IN DEPRESSED AREA.

6" CURB-

ELEVATION



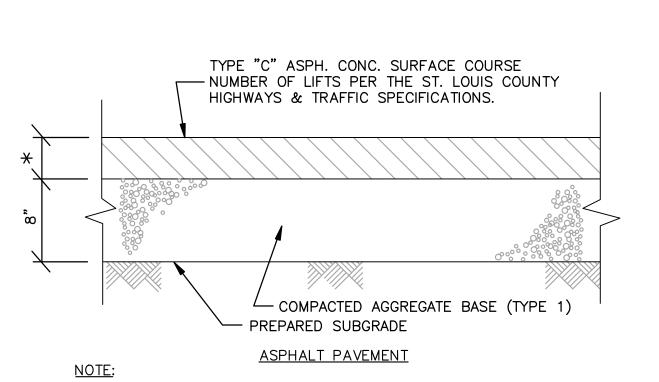


PAVEMENT DETAILS SHOWN FOR REFERENCE ONLY. CONTRACTOR TO VERIFY FINAL PAVEMENT REQUIREMENTS WITH GEOTECH REPORT AND/OR OWNER.

* 3" TYPE C ASPH. CONC. SHALL BE USED FOR PARKING LOT AREAS.


* 4" TYPE C ASPH. CONC. SHALL BE USED FOR DRIVE AISLES.

COMPACT AGGREGATE BASE COURSE TO 95% MODIFIED PROCTOR PER ASTM D-1557.

ASPHALT PAVEMENT DETAIL C4.0

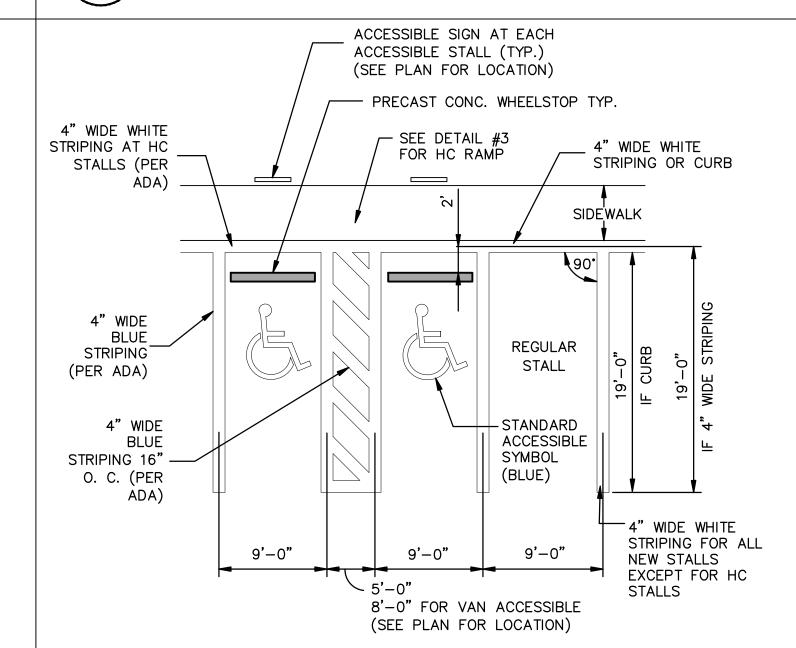

ACCESSIBLE PARKING DETAIL

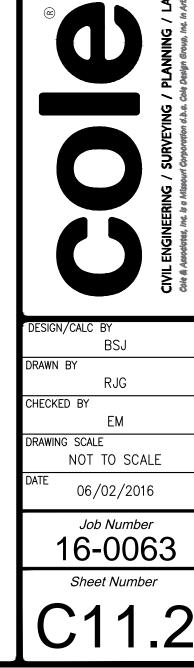

C4.0

SHOPPES AT WING
THE PET DOCTOR/YT
TECHNOLOGY DRIV
O'FALLON, MO 633