


PLAT TWO

PLAT ONE

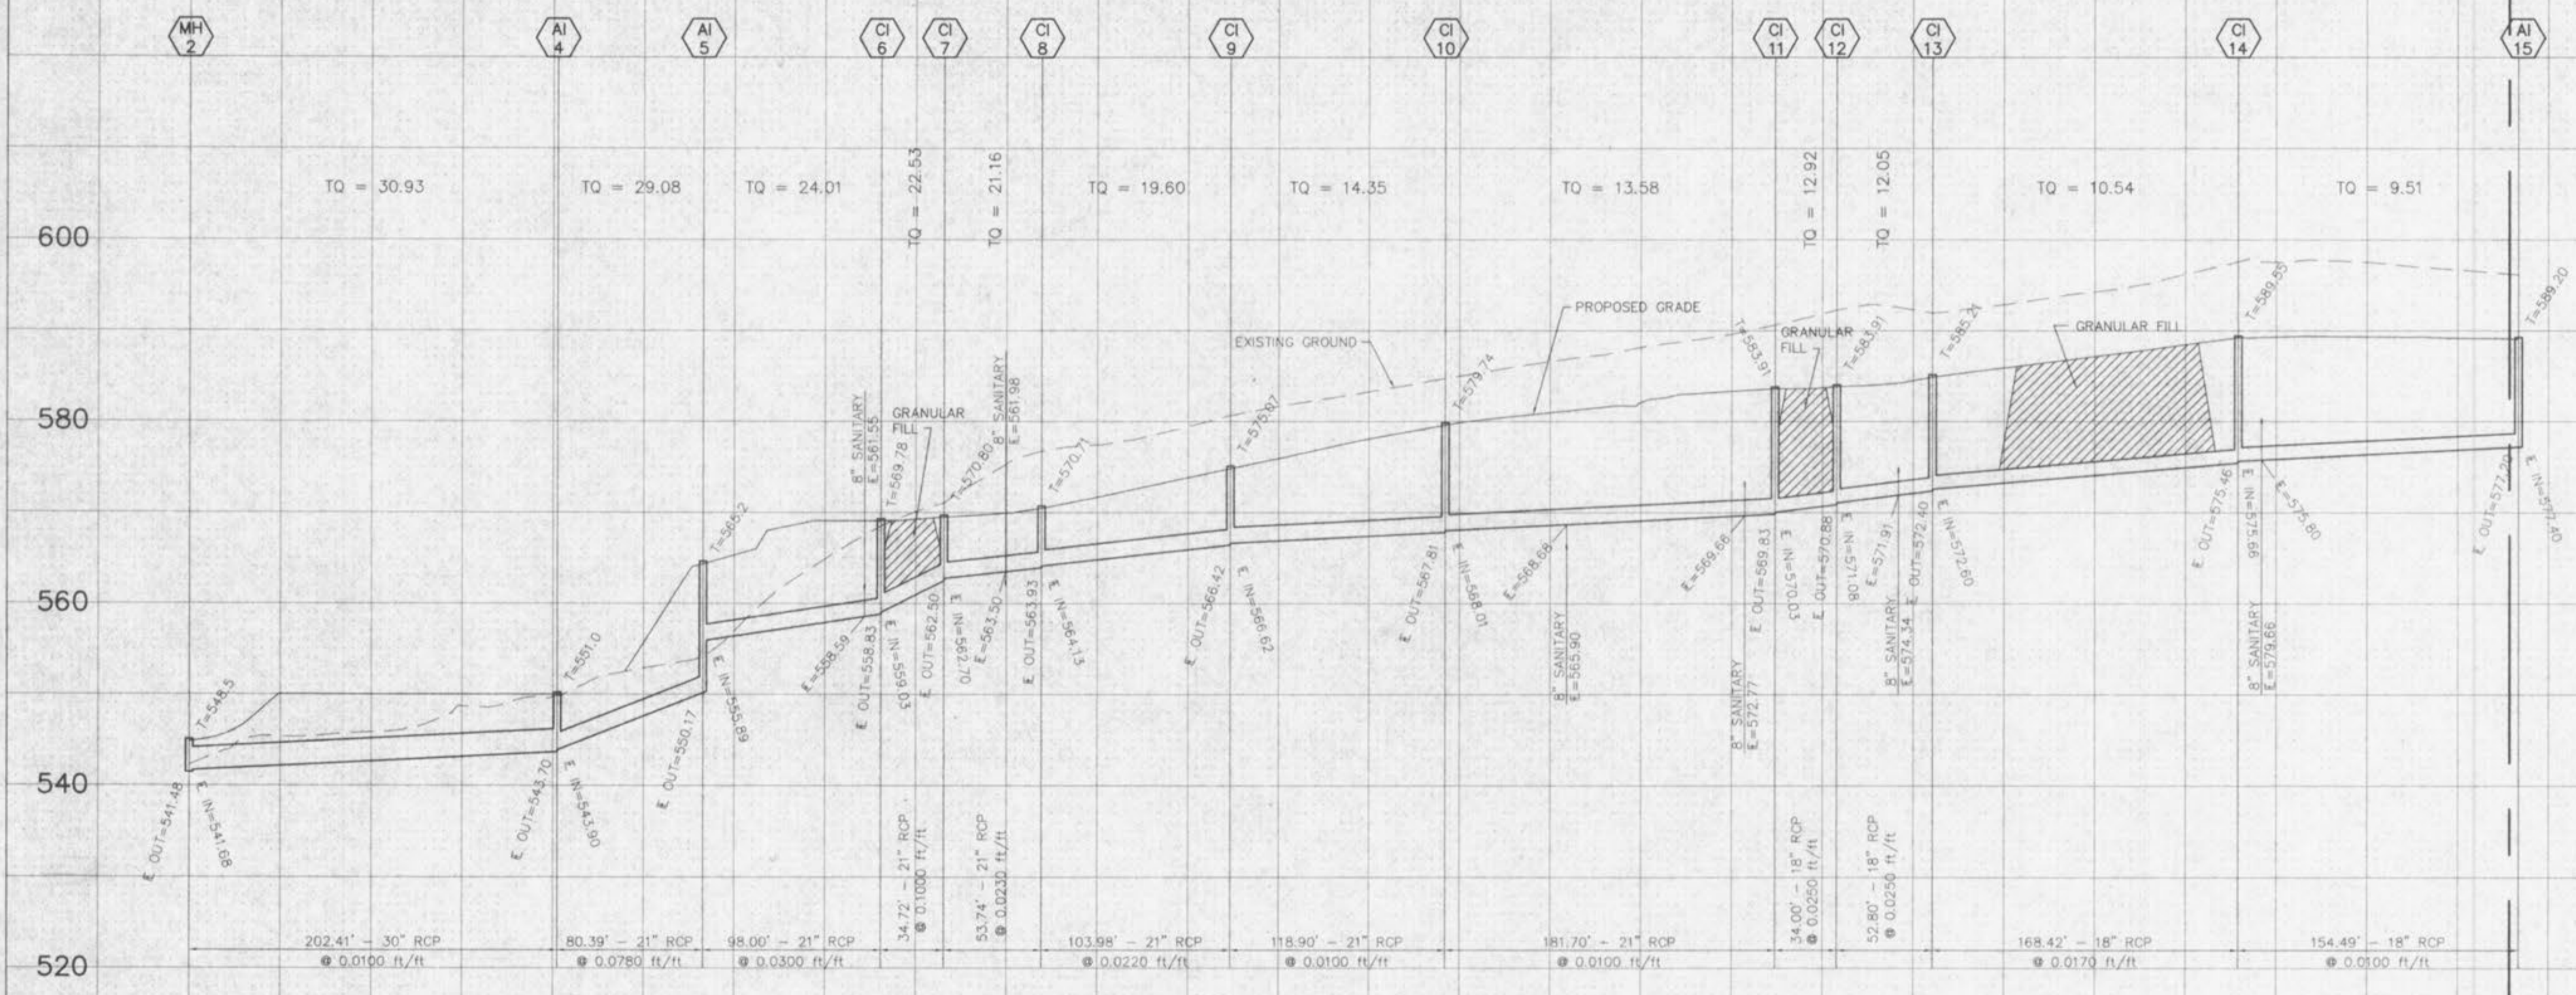


PLAT TWO

PLAT ONE

PLAT TWO

PLAT TWO

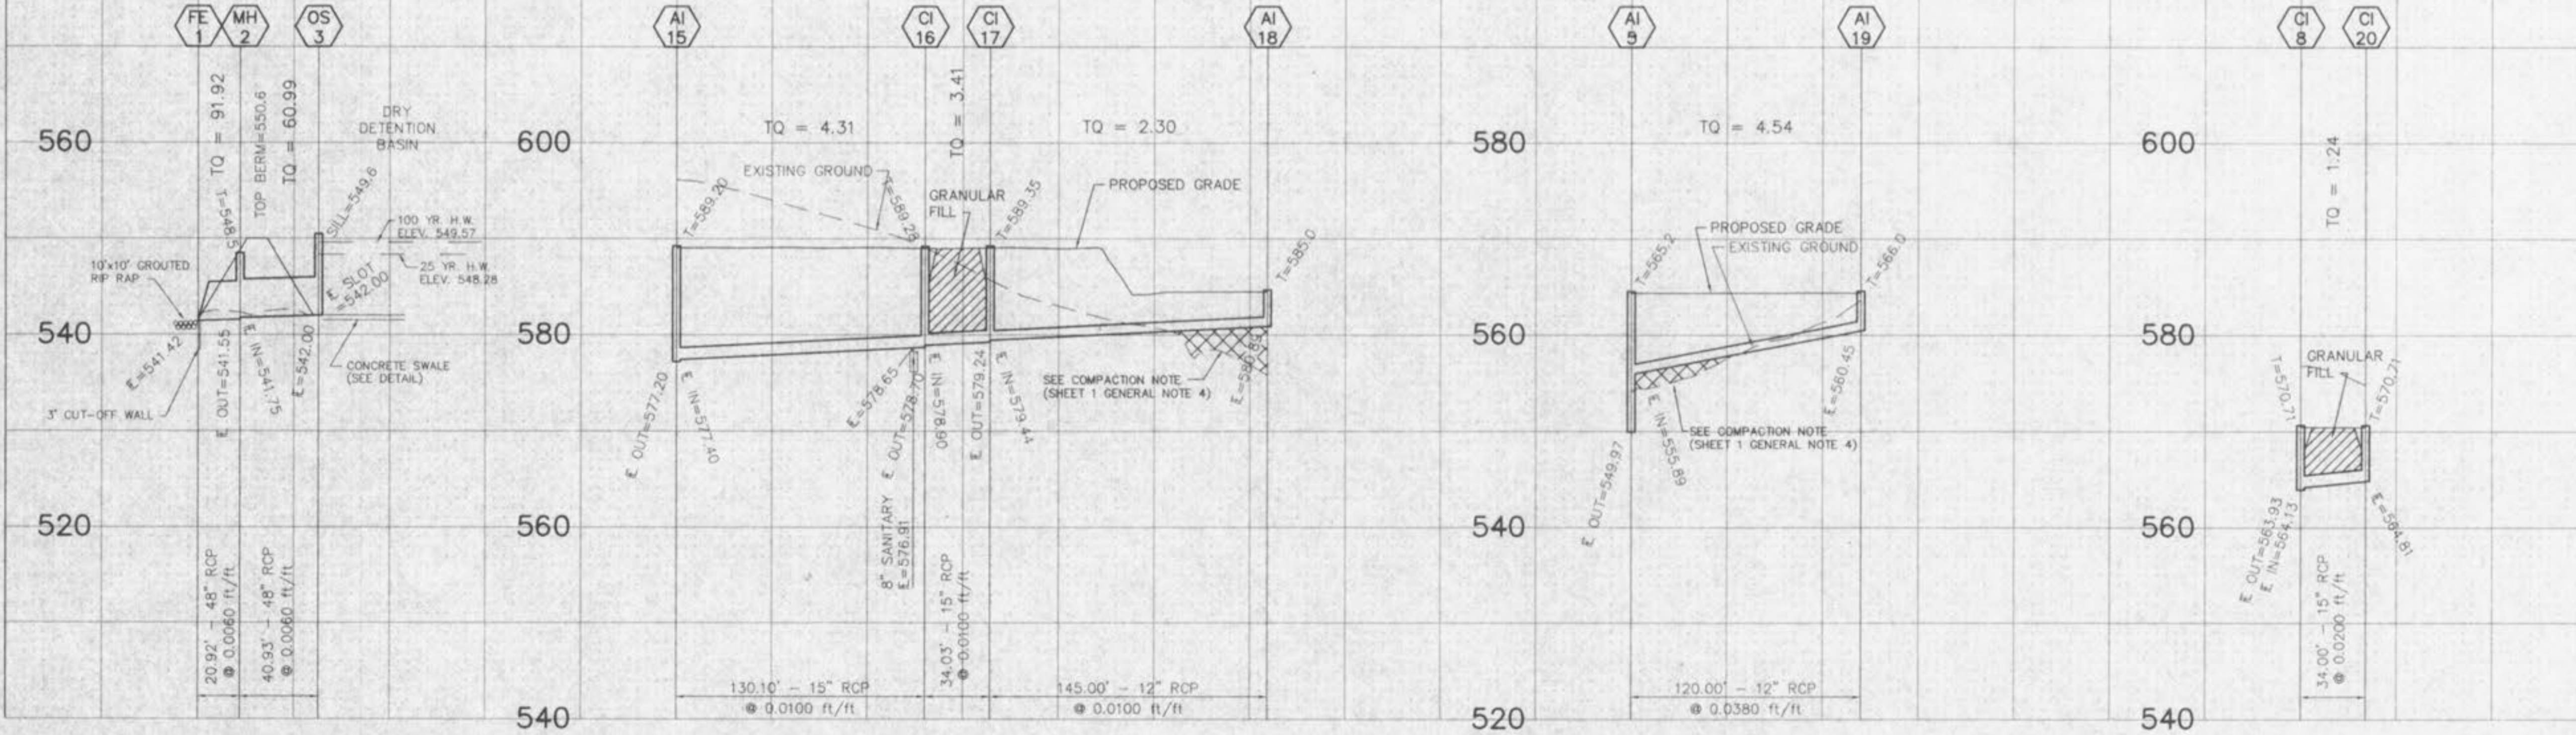

NOTE:

The use of high density polyethylene corrugated pipe will be permitted as an acceptable alternative to reinforced concrete pipe. Pipe shall meet A.S.T.M. O-2321 and AASHTO M-294-921. Concrete flared end sections and inlet structures shall be required. Pipe must have smooth interior wall and is not to be used inside the public right-of-way.

All concrete pipe shall be installed with O-Ring rubber type gaskets per M.S.D. Standard Construction Specifications.

SCALE : 1" = 50' HORIZONTAL
1" = 10' VERTICAL