


REV. 10-22-96
 REV. 11-01-96

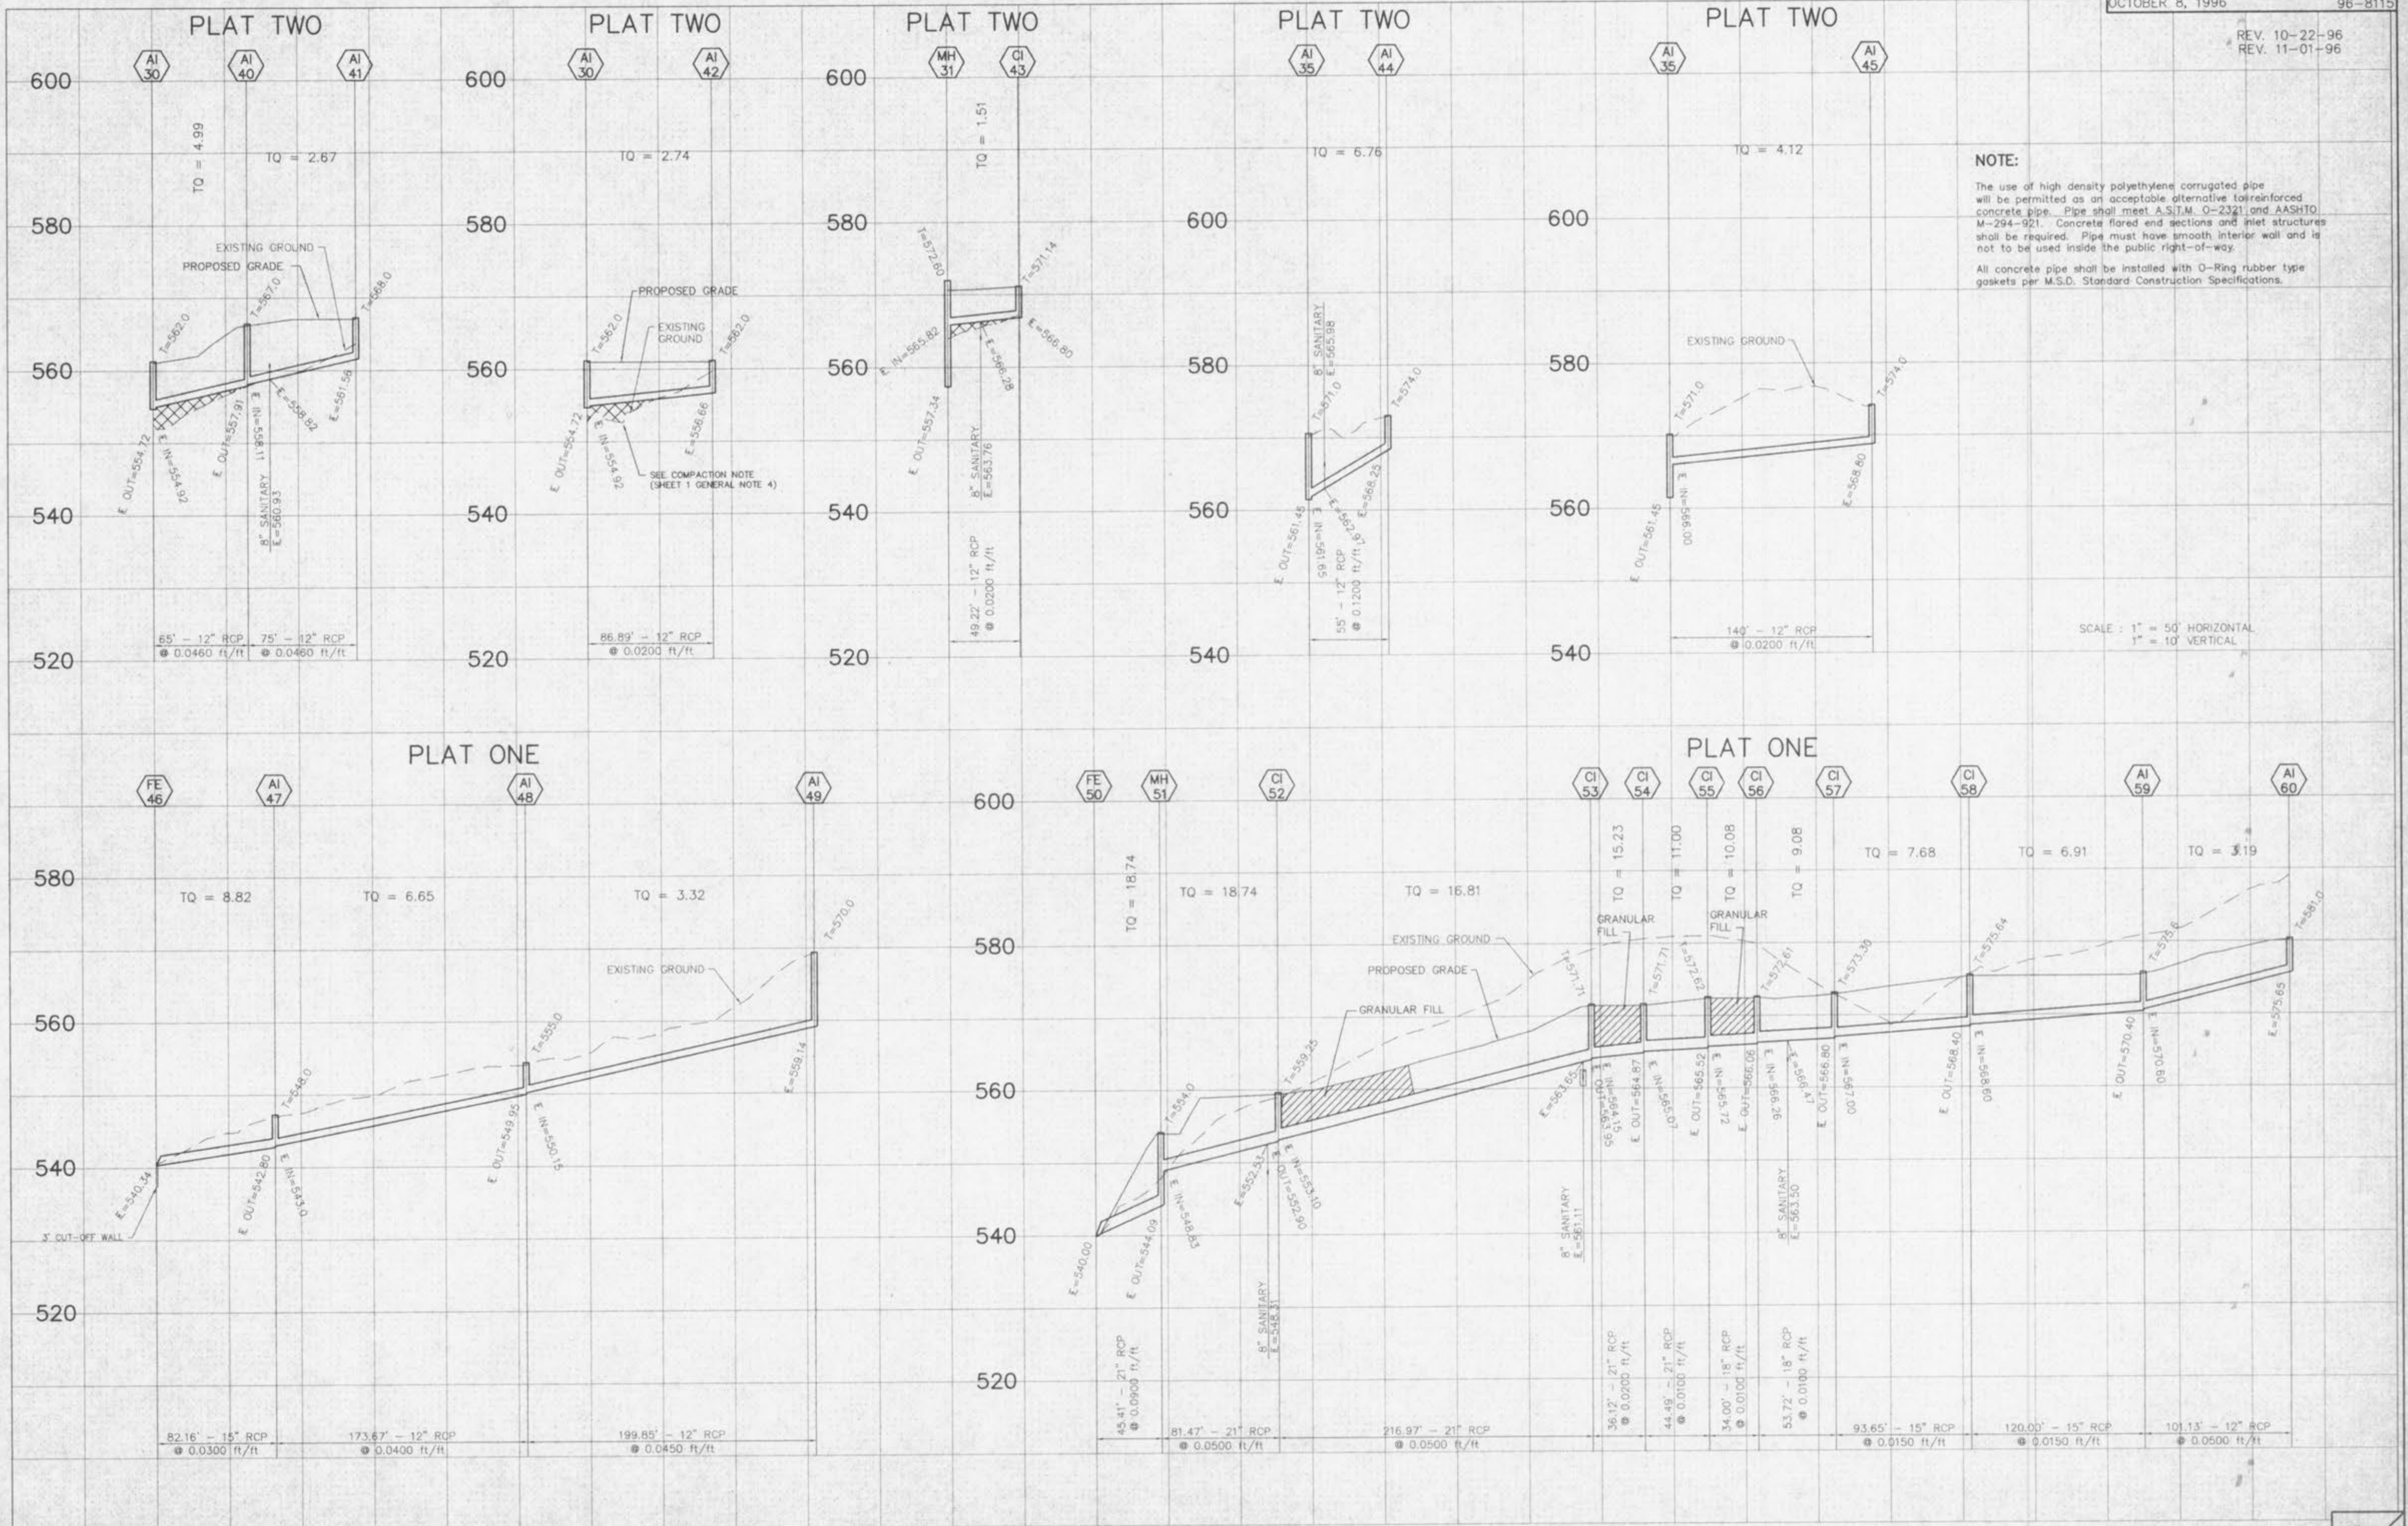

NOTE:
 The use of high density polyethylene corrugated pipe will be permitted as an acceptable alternative to reinforced concrete pipe. Pipe shall meet A.S.T.M. O-2321 and AASHTO M-294-921. Concrete flared end sections and inlet structures shall be required. Pipe must have smooth interior wall and is not to be used inside the public right-of-way.
 All concrete pipe shall be installed with O-Ring rubber type gaskets per M.S.D. Standard Construction Specifications.

SCALE: 1" = 50' HORIZONTAL
 1" = 10' VERTICAL

C:\DWG\8115\96\ 1001.DWG, 4:03:34 PM, 10/08/96, STATION 3