



ROUND PIPE				HORIZONTAL ELLIPTICAL PIPE			
INSIDE DIAMETER OF PIPE (INCHES)	"W" PAYLINE WIDTH OF TRENCH (INCHES)	"W" PAYLINE WIDTH OF TRENCH (FEET)	PIV-VOLUMES CU FT PER FT. OF TRENCH (CONCRETE ENGAGEMENT)	INSIDE DIAMETER OF PIPE (INCHES)	"W" PAYLINE WIDTH OF TRENCH (INCHES)	"W" PAYLINE WIDTH OF TRENCH (FEET)	PIV-VOLUMES CU FT PER FT. OF TRENCH (CONCRETE ENGAGEMENT)
4	30	2.50	3.28				
6	30	2.50	3.59				
8	30	2.50	3.87				
10	30	2.50	4.09				
12	30	2.50	4.25				
15	36	3.00	5.55				
18	36	3.00	5.77	14 x 23	41	3.42	5.94
21	39	3.25	6.61				
24	42	3.50	7.39	19 x 30	49	4.08	7.68
27	45	3.75	8.18	22 x 34	53	4.42	8.61
30	48	4.00	9.30	24 x 38	56	4.83	9.70
33	53	4.42	10.53	27 x 42	62	5.17	10.71
36	56	4.67	11.43	29 x 45	66	5.50	11.72
39		DISCONTINUED		32 x 49	71	5.92	13.14
42	63	5.25	13.36	34 x 53	75	6.25	14.05
48	70	5.83	15.67	38 x 60	83	6.92	16.18
54	77	6.42	18.15	43 x 68	92	7.67	18.81
60	84	7.00	20.73	48 x 76	101	8.42	21.59
66	91	7.58	23.45	53 x 83	109	9.08	24.35
72	98	8.17	26.37	58 x 91	118	9.83	27.45
78	105	8.75	29.39	63 x 98	126	10.50	30.50
84	112	9.33	32.57	68 x 106	135	11.25	33.91
90	119	9.92	35.90	72 x 113	143	11.92	36.99
96	126	10.50	39.37	77 x 121	152	12.67	40.69
102	133	11.08	42.99	82 x 128	160	13.33	44.45
108	140	11.67	46.75	87 x 136	168	14.00	47.79
114	147	12.25	50.66	92 x 143	176	14.67	51.70
120	154	12.83	54.72	97 x 151	185	15.42	56.01
126	161	13.42	58.92				
132	168	14.00	63.27	106 x 166	202	16.83	64.48
144	182	15.17	72.40	116 x 180	218	18.17	73.59


DUCKETT CREEK SANITARY DISTRICT			
PAYLINE WIDTHS OF TRENCH AND PAY-QUANTITIES OF CONCRETE	BSM	KLA	DATE
12-21-99	MOOB	1	12-21-99

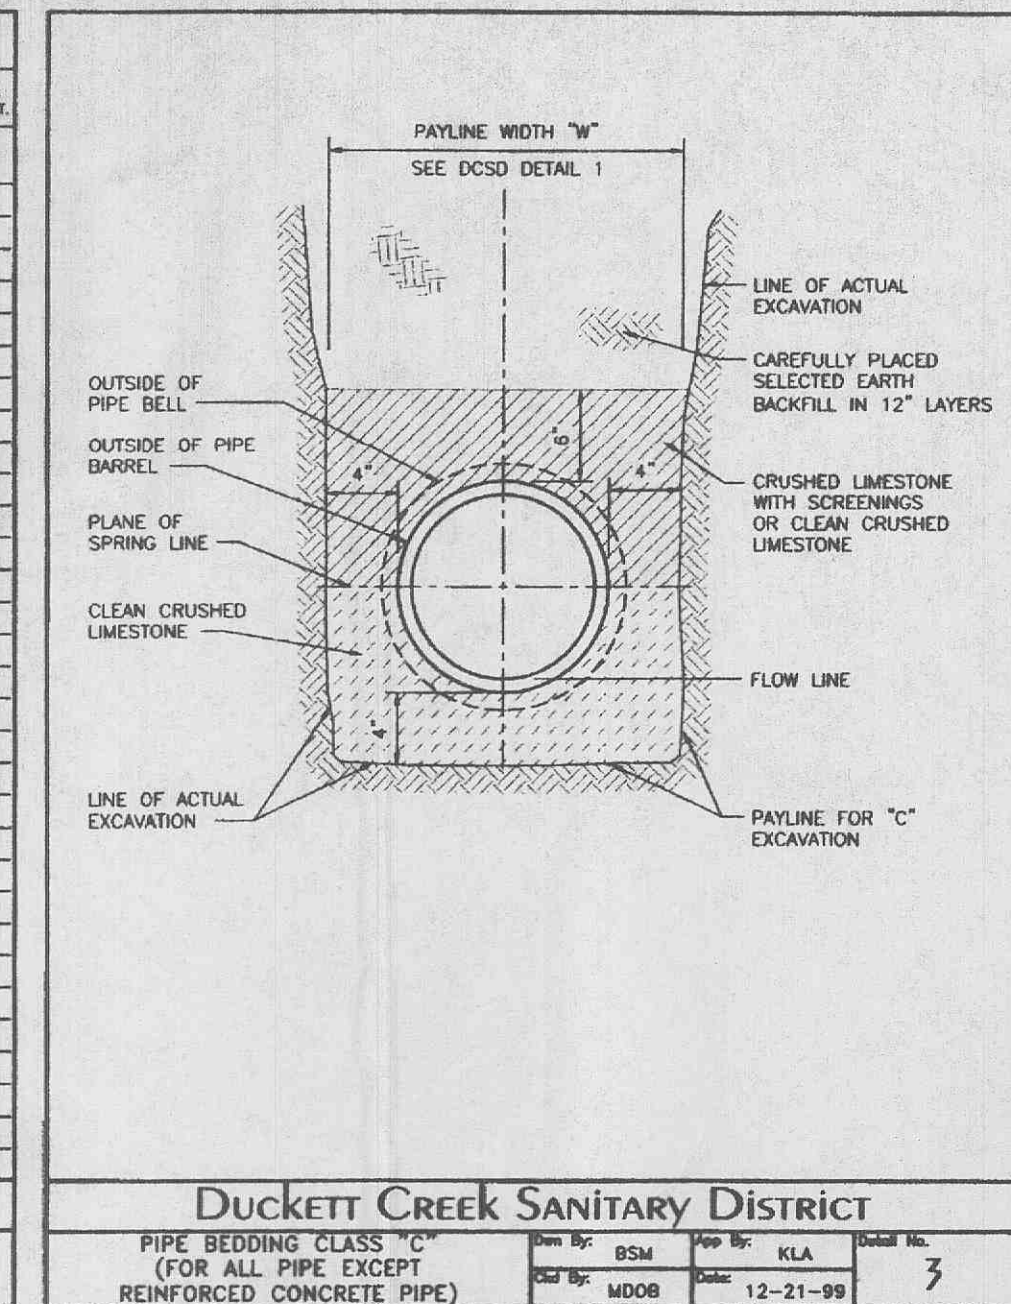


DUCKETT CREEK SANITARY DISTRICT			
PIPE BEDDING CLASS "C" (FOR ALL PIPE EXCEPT REINFORCED CONCRETE PIPE)	BSM	KLA	DATE
12-21-99	MOOB	3	12-21-99

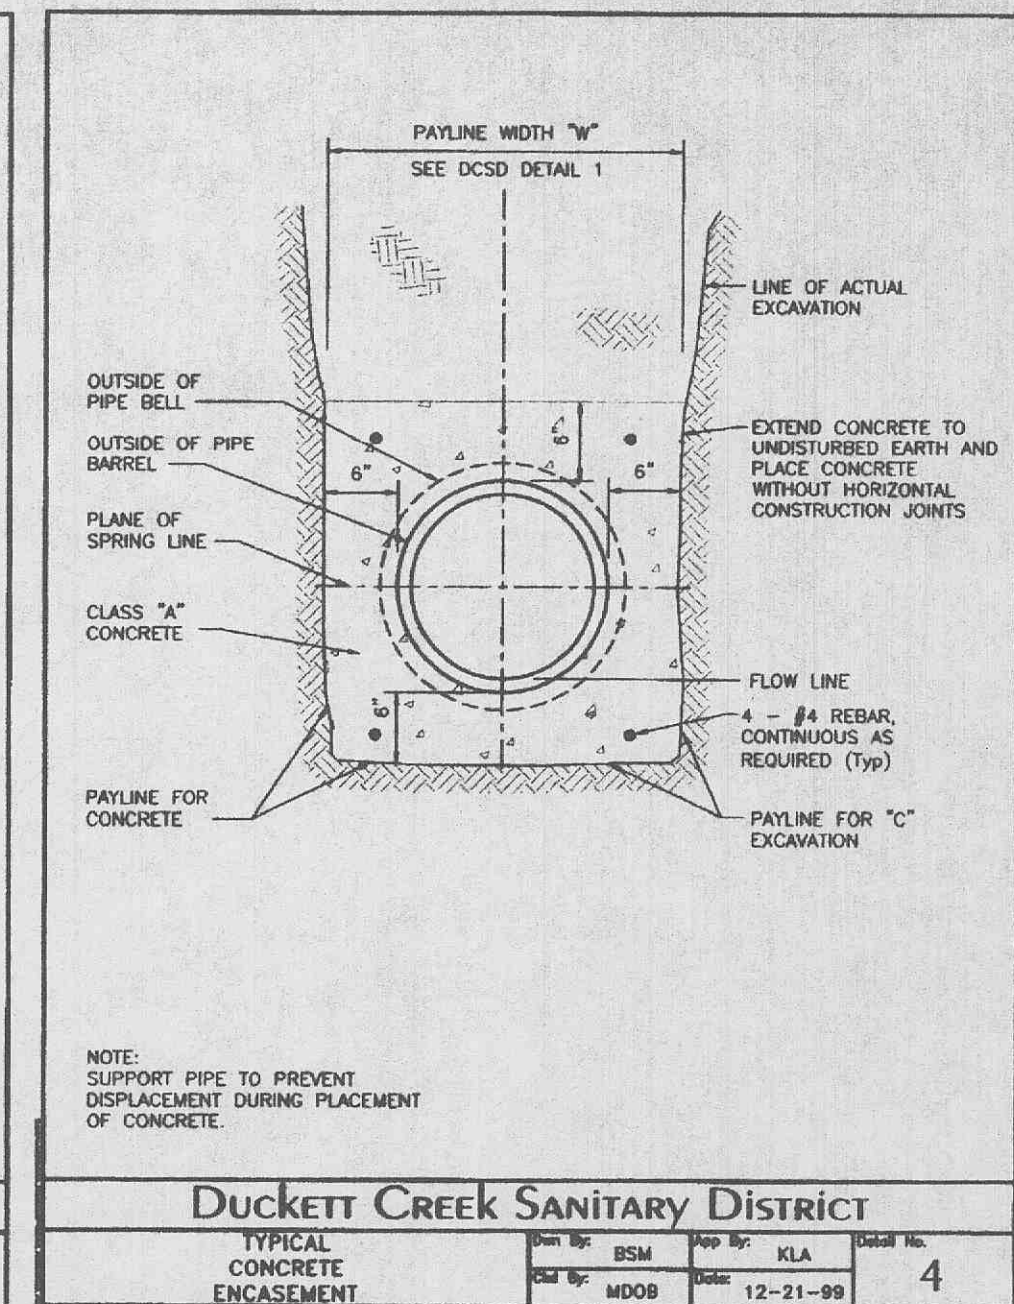









DUCKETT CREEK SANITARY DISTRICT			
TYPICAL CONCRETE ENCASEMENT	BSM	KLA	DATE
12-21-99	MOOB	4	12-21-99

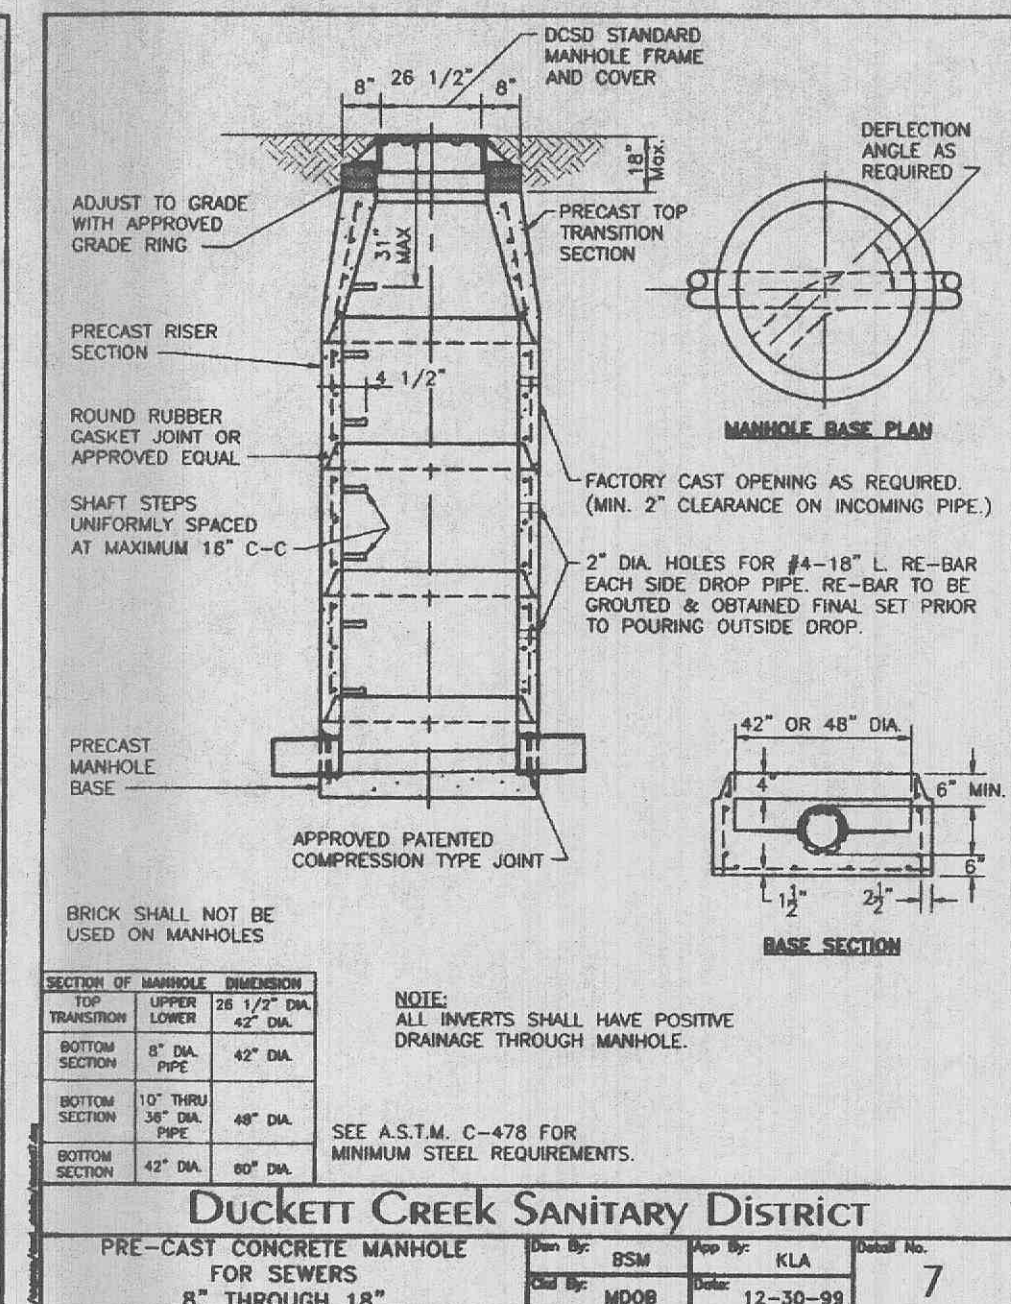

DUCKETT CREEK SANITARY DISTRICT			
PRE-CAST CONCRETE MANHOLE FOR SEWERS 8" THROUGH 18"	BSM	KLA	DATE
12-30-99	MOOB	7	12-30-99

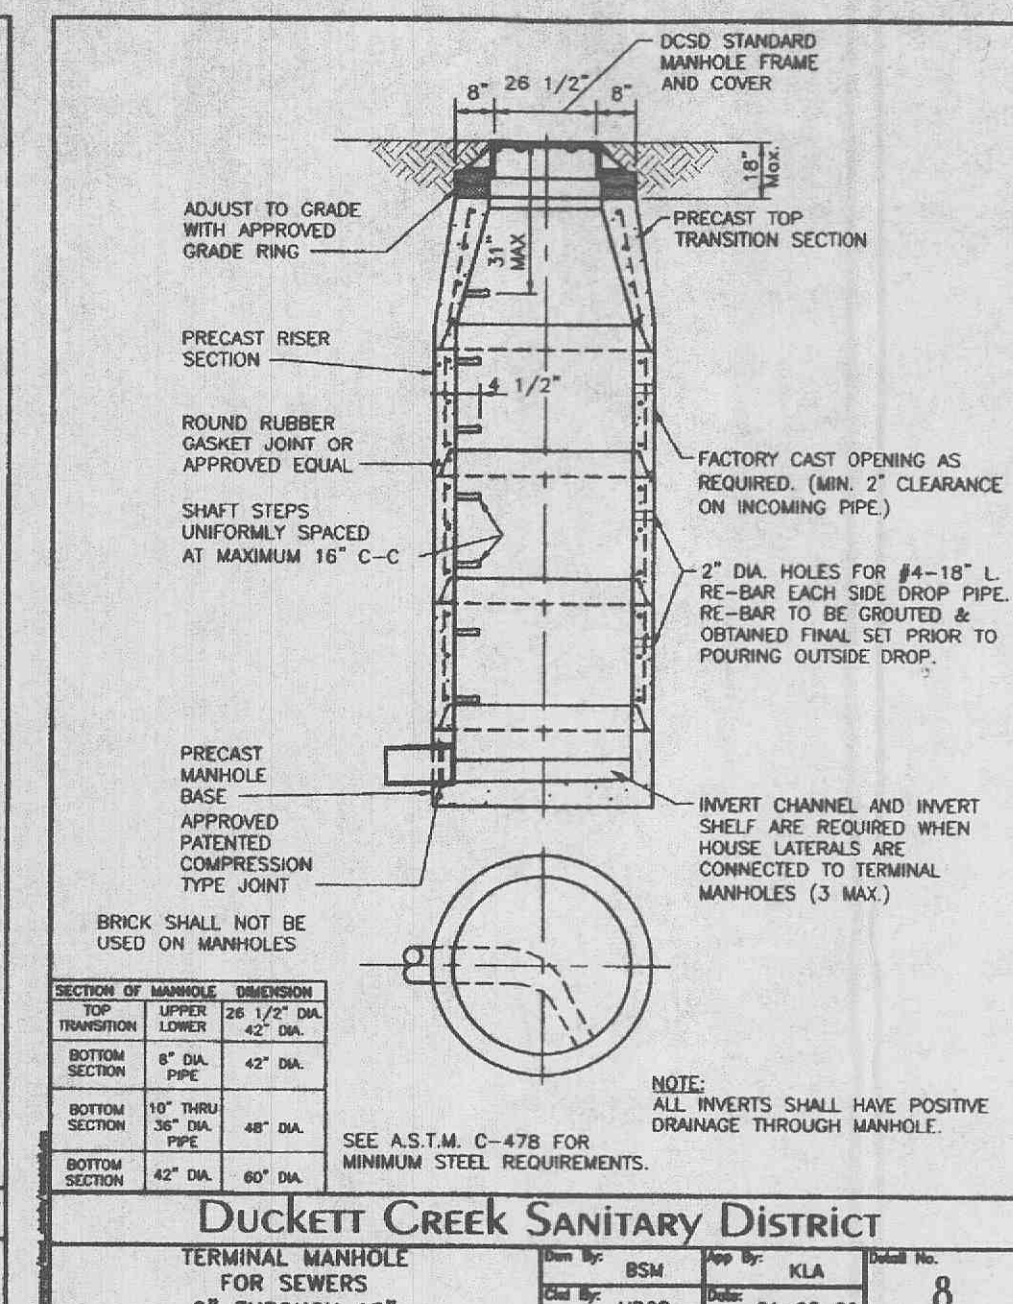

DUCKETT CREEK SANITARY DISTRICT			
TERMINAL MANHOLE FOR SEWERS 8" THROUGH 18"	BSM	KLA	DATE
01-03-00	MOOB	8	01-03-00

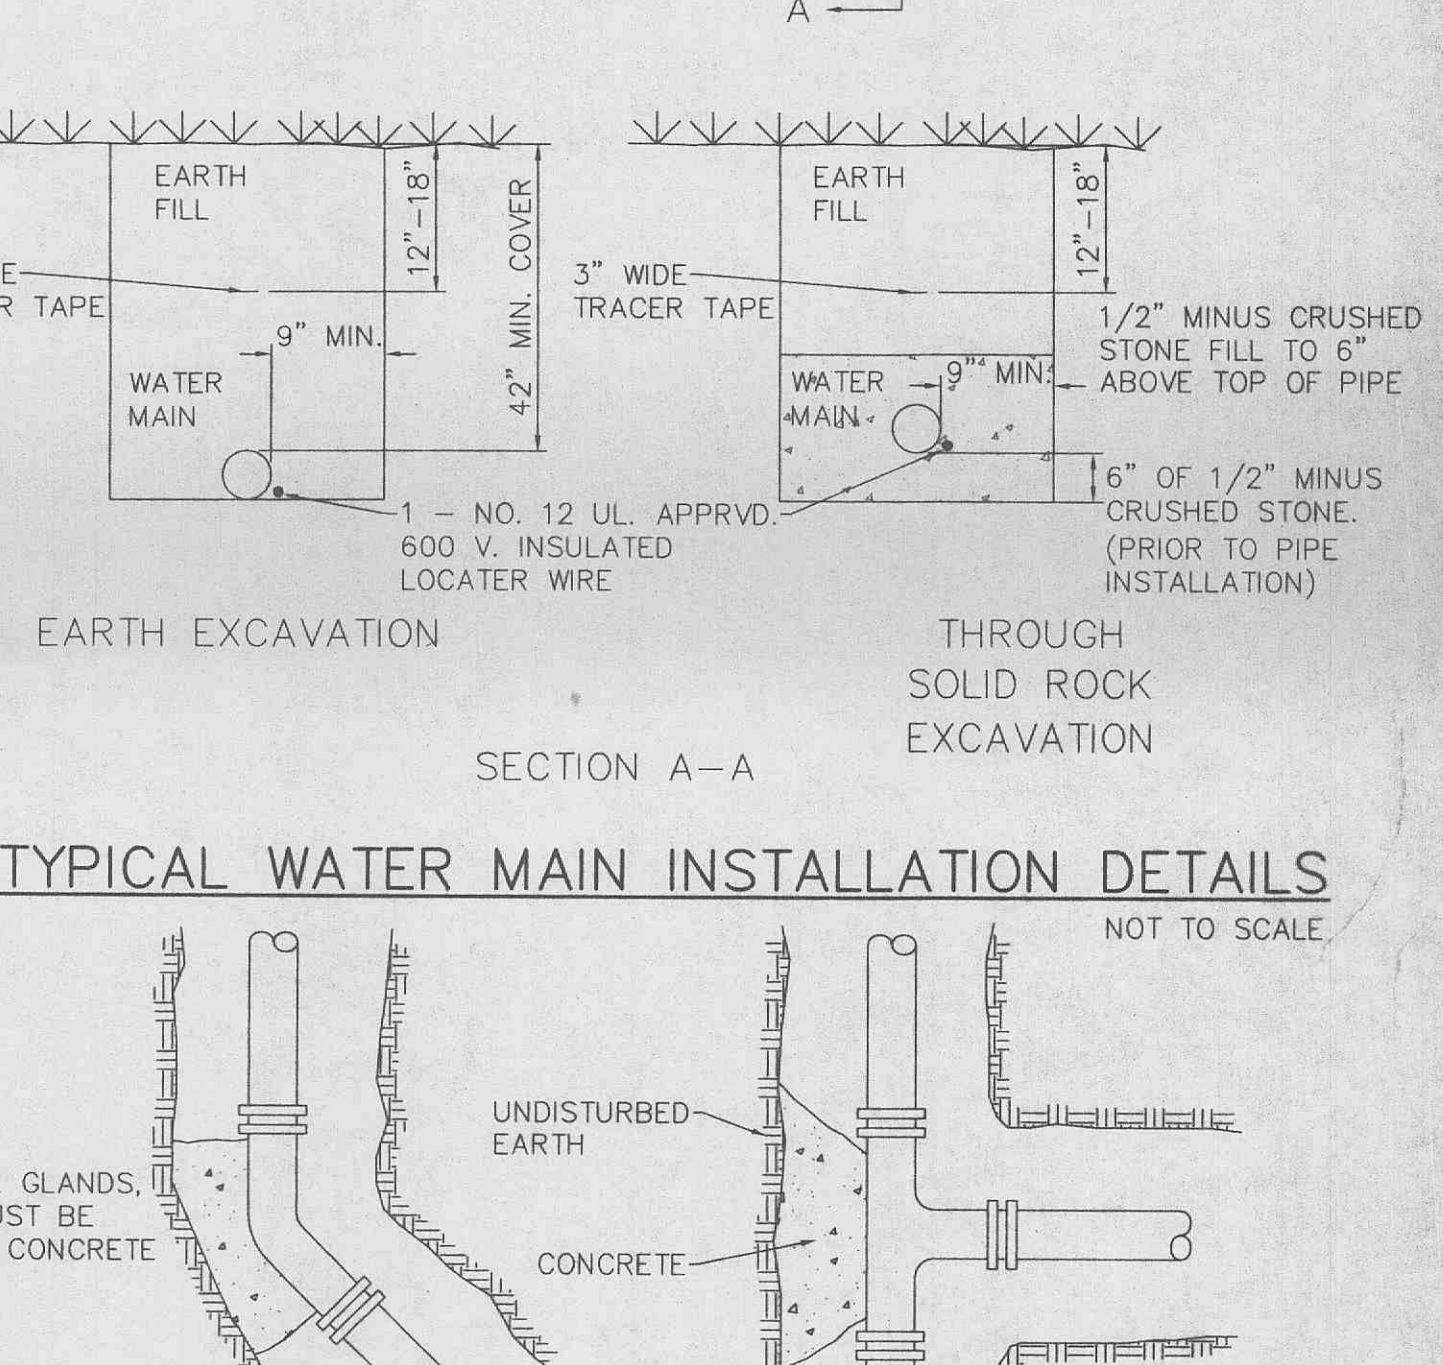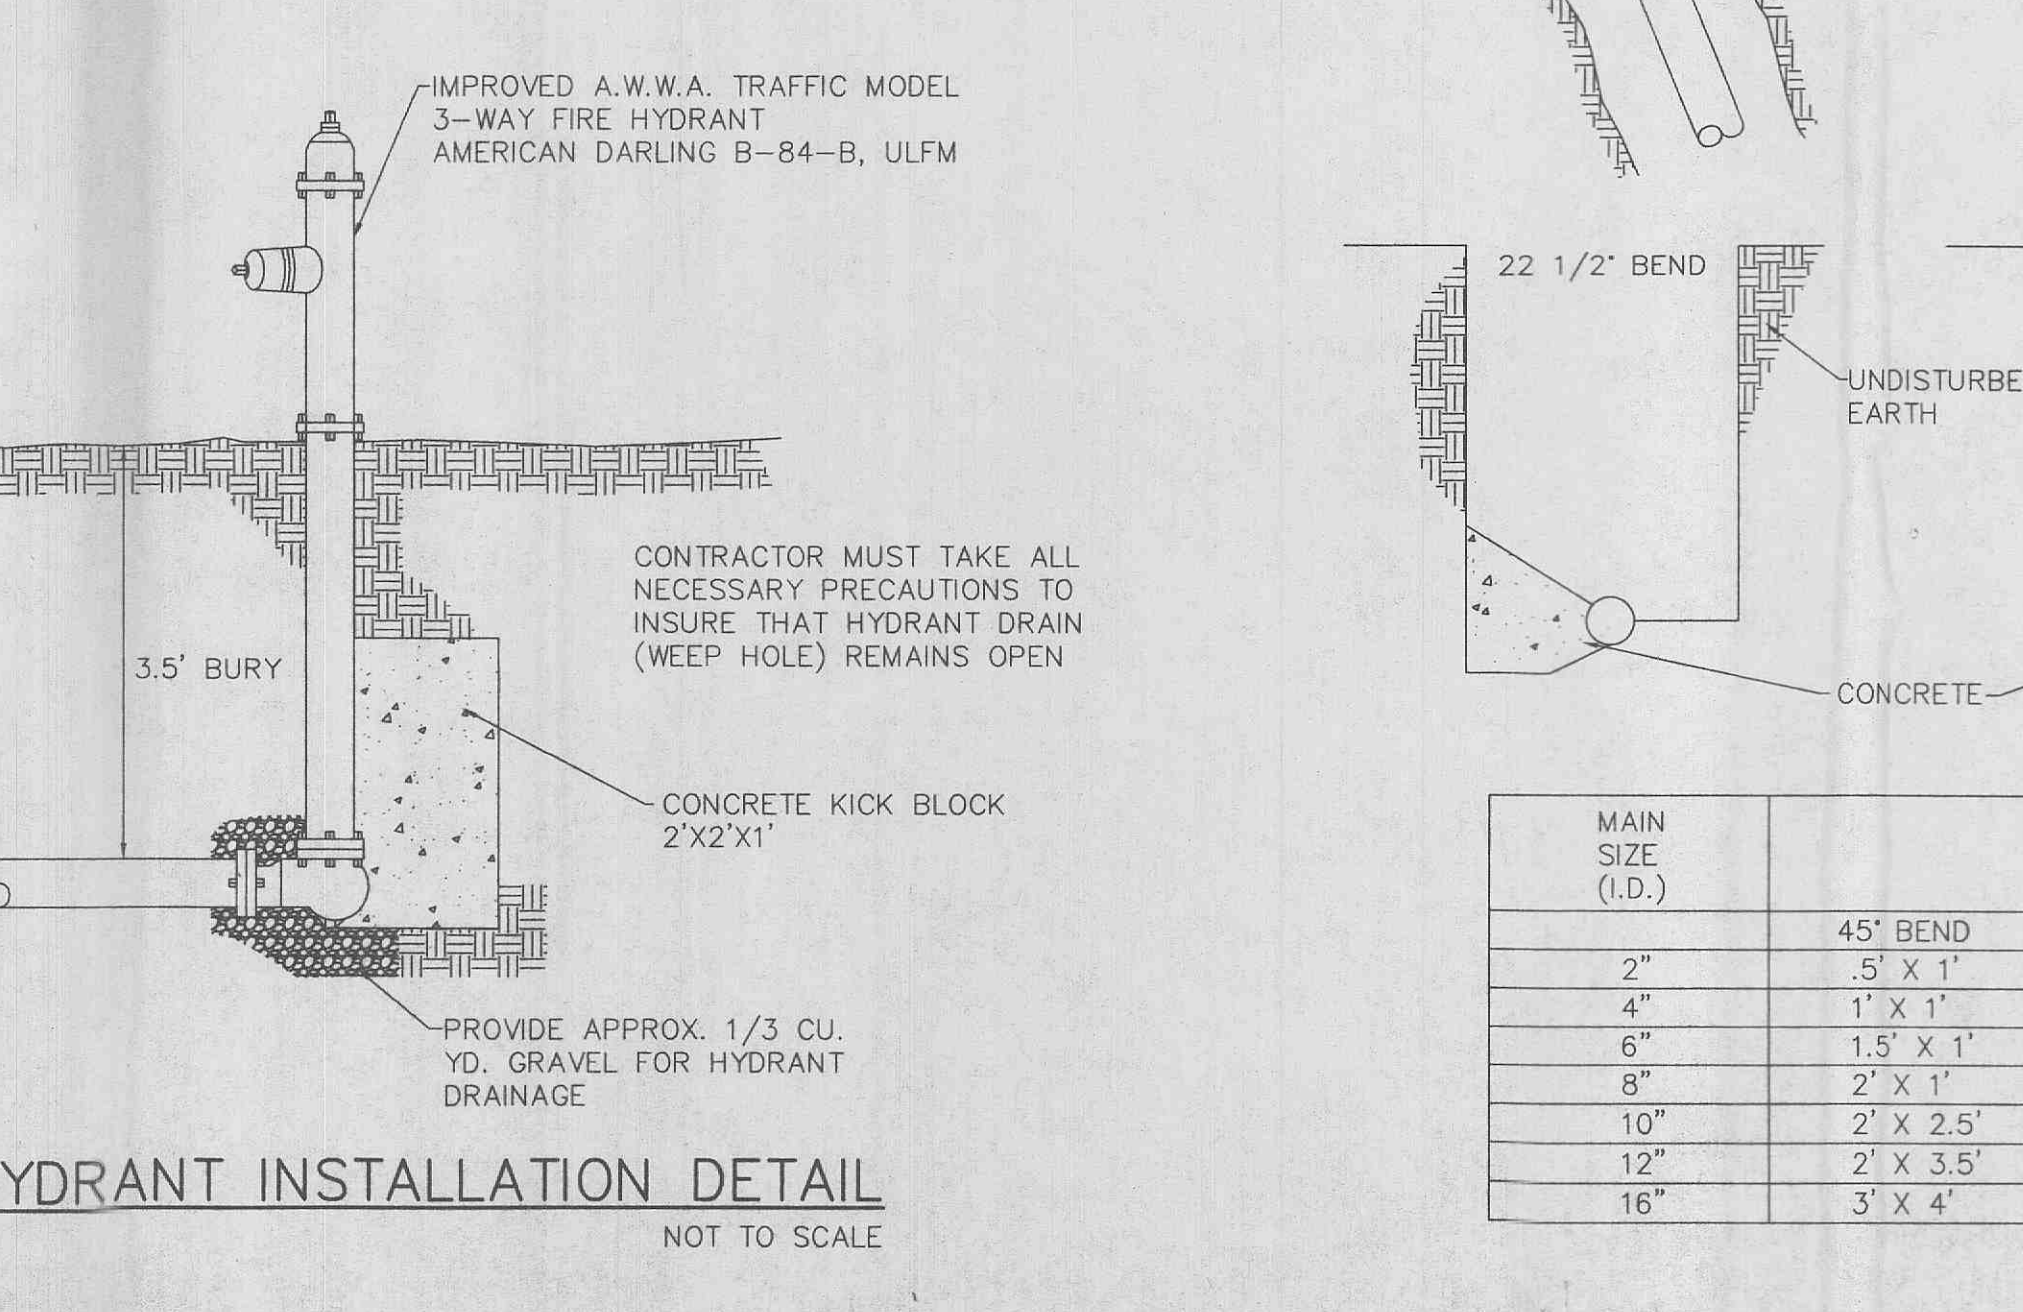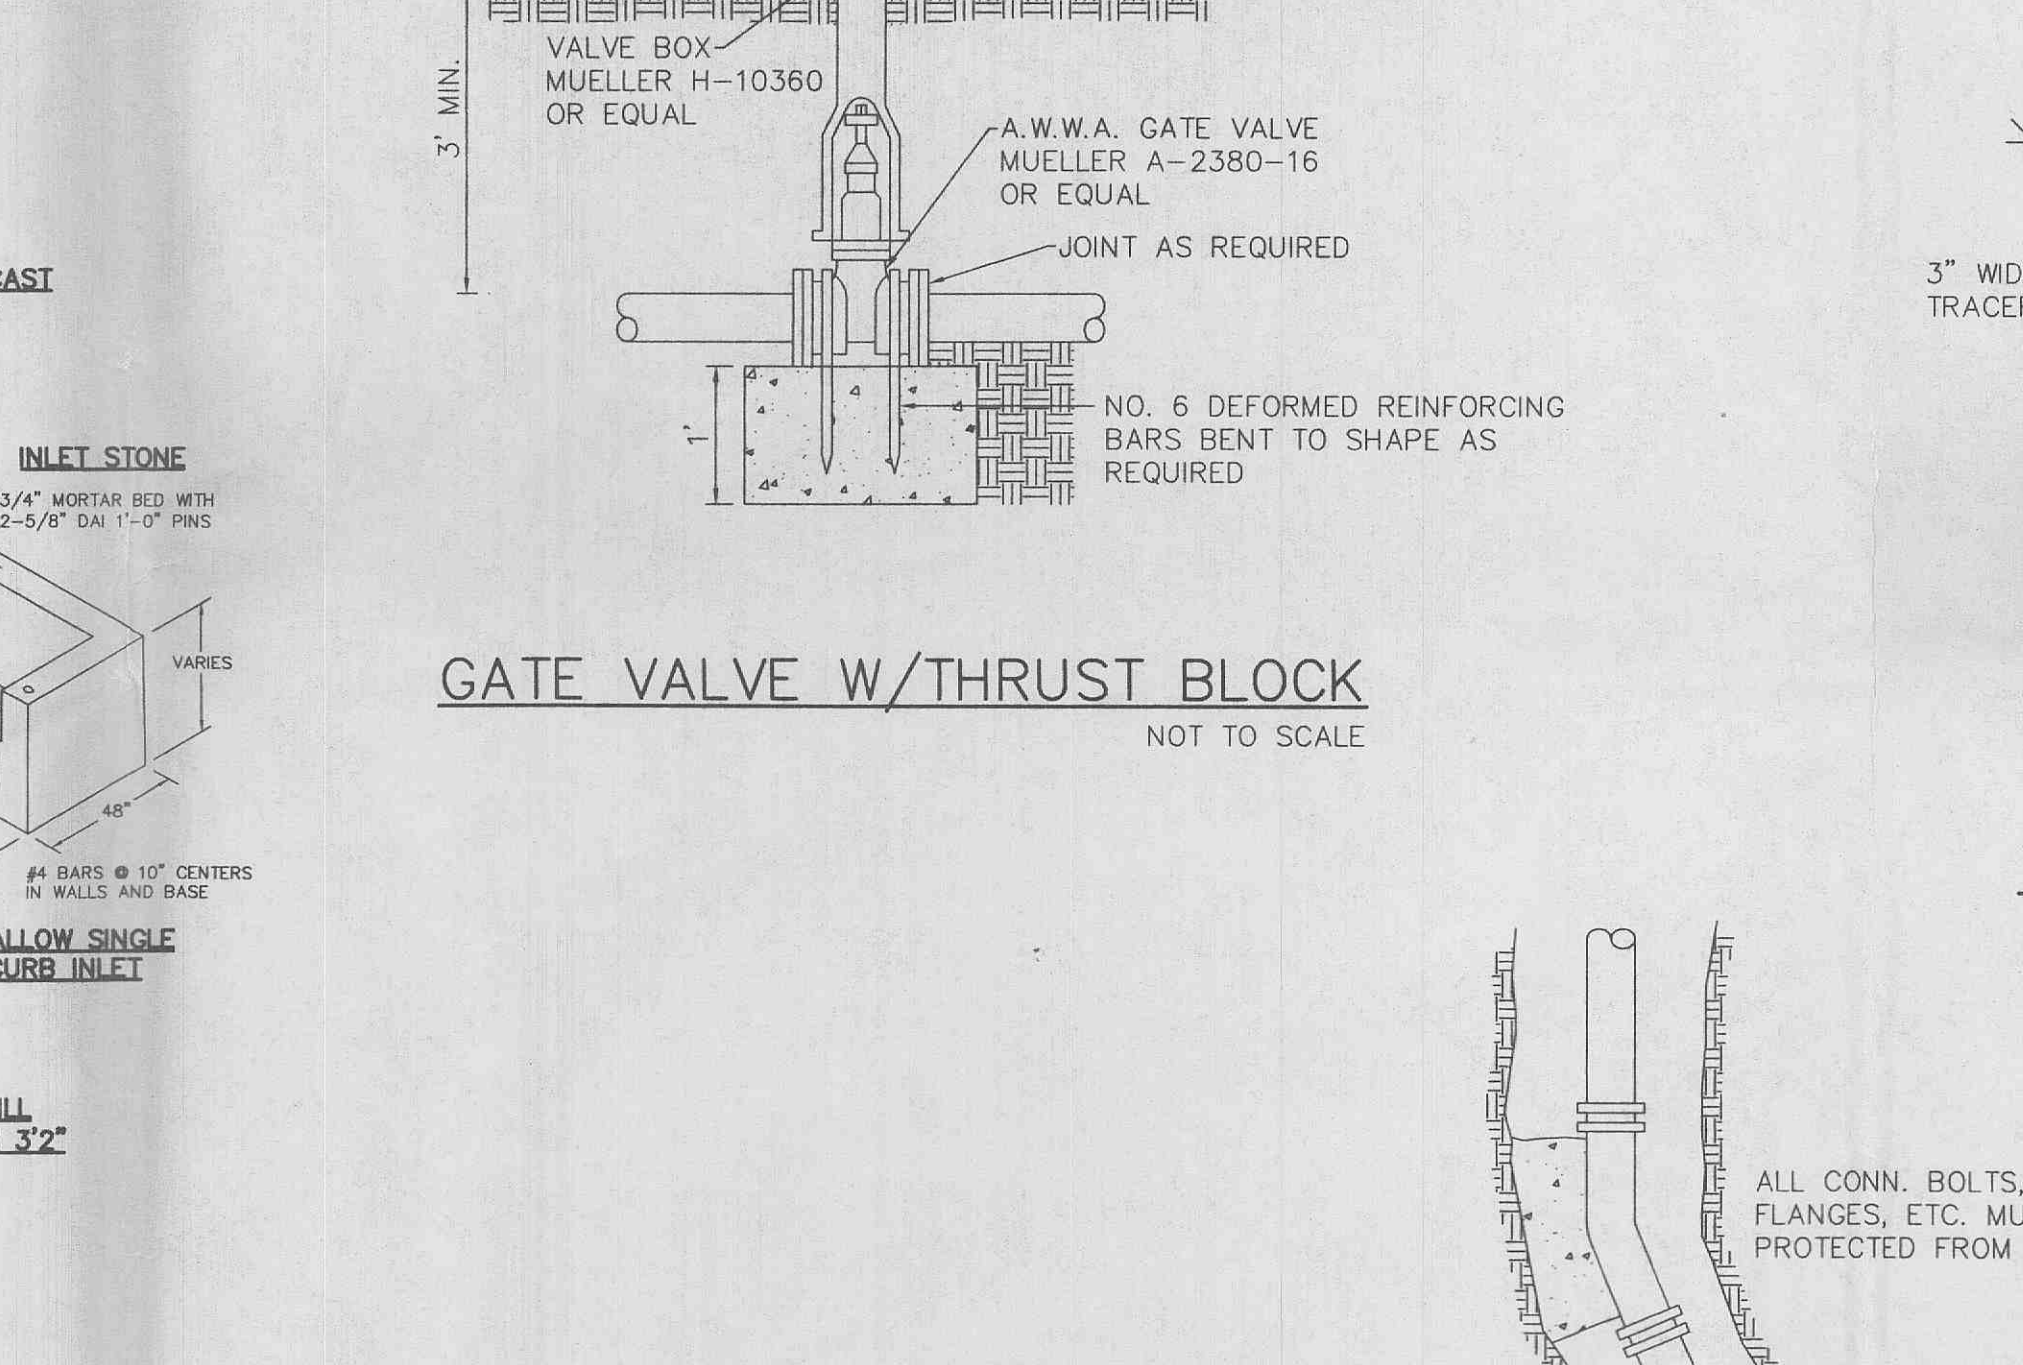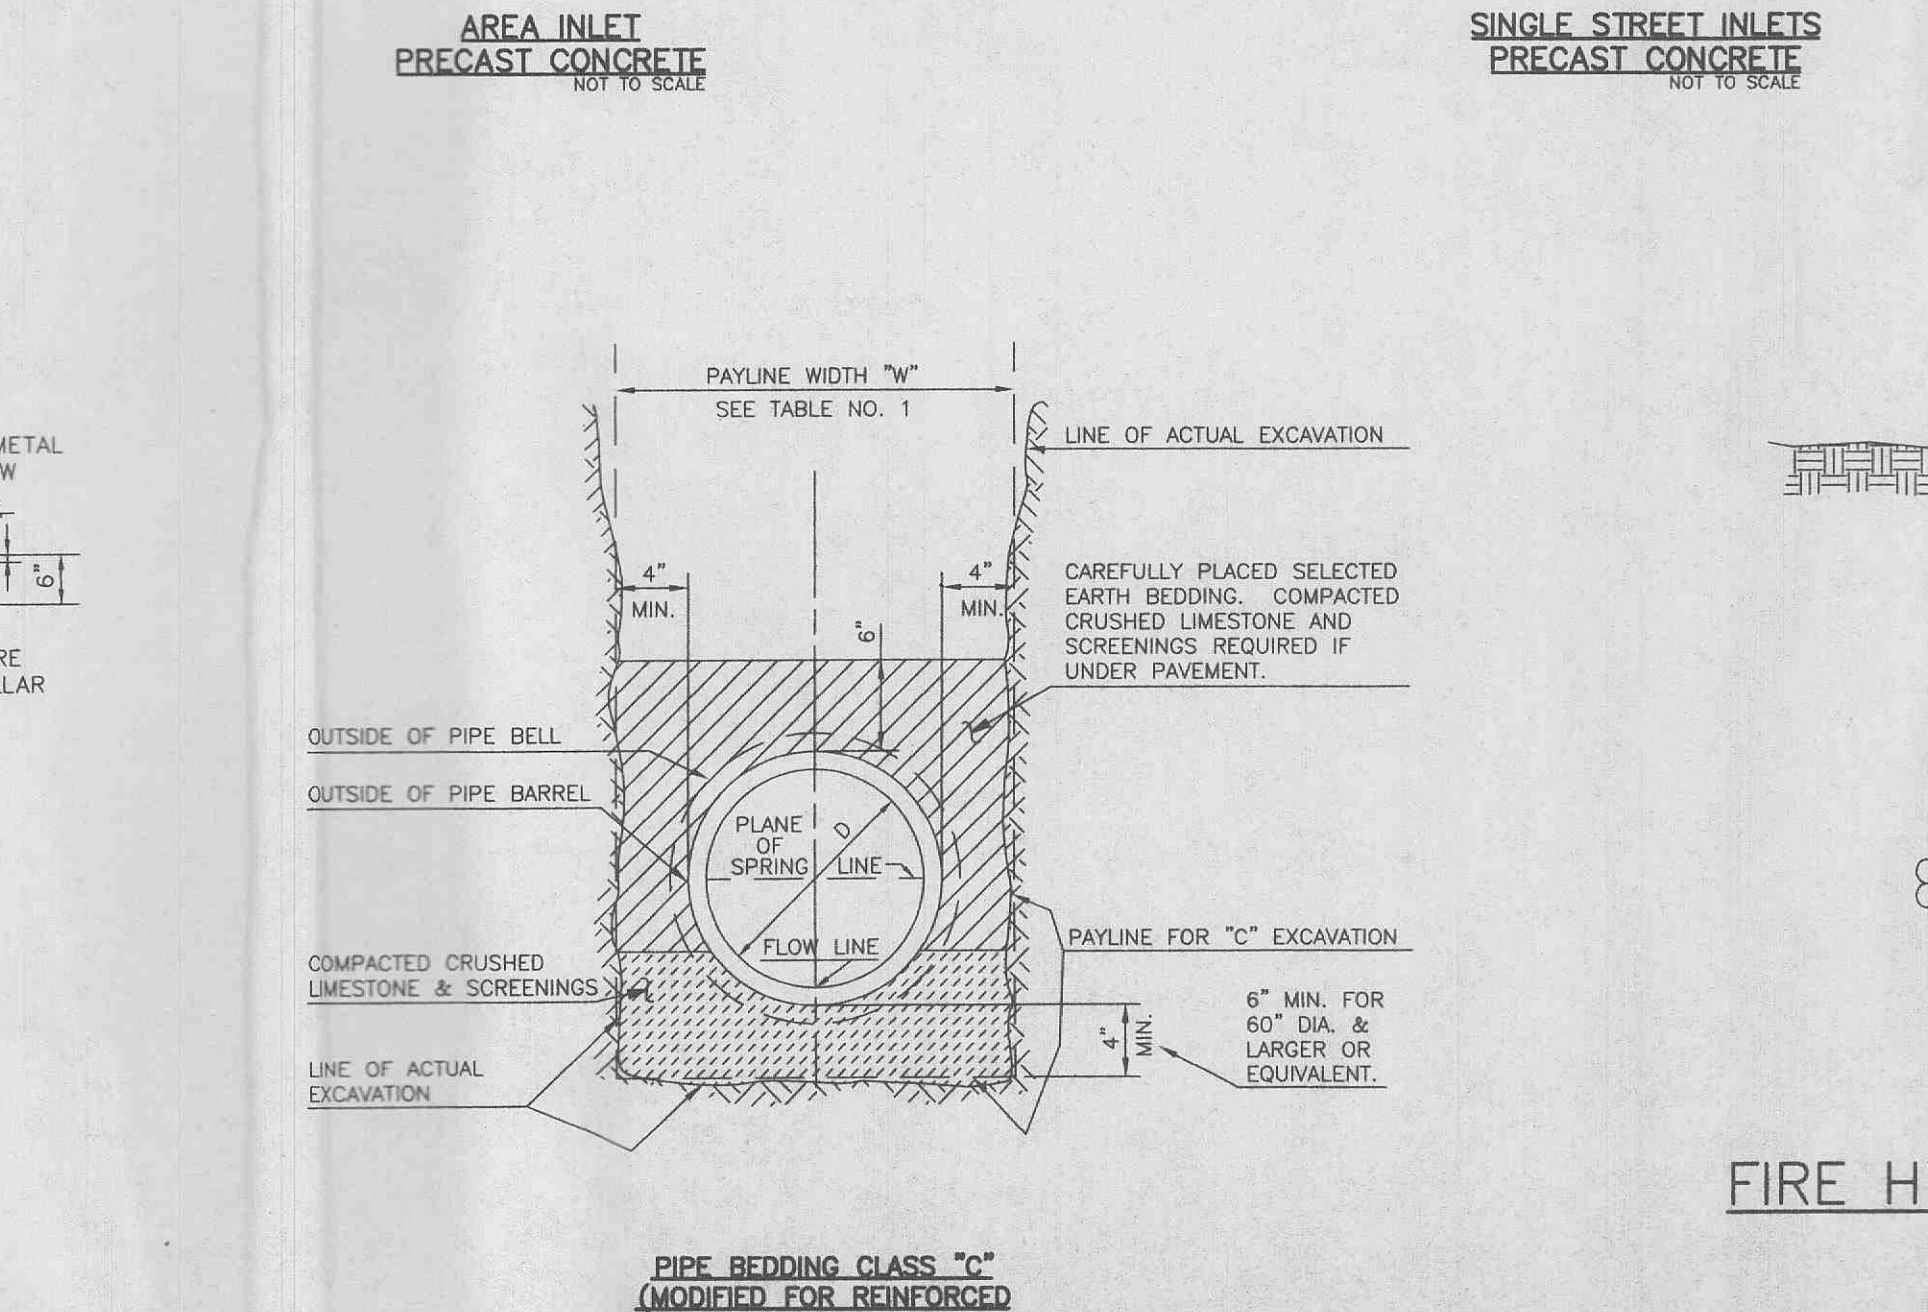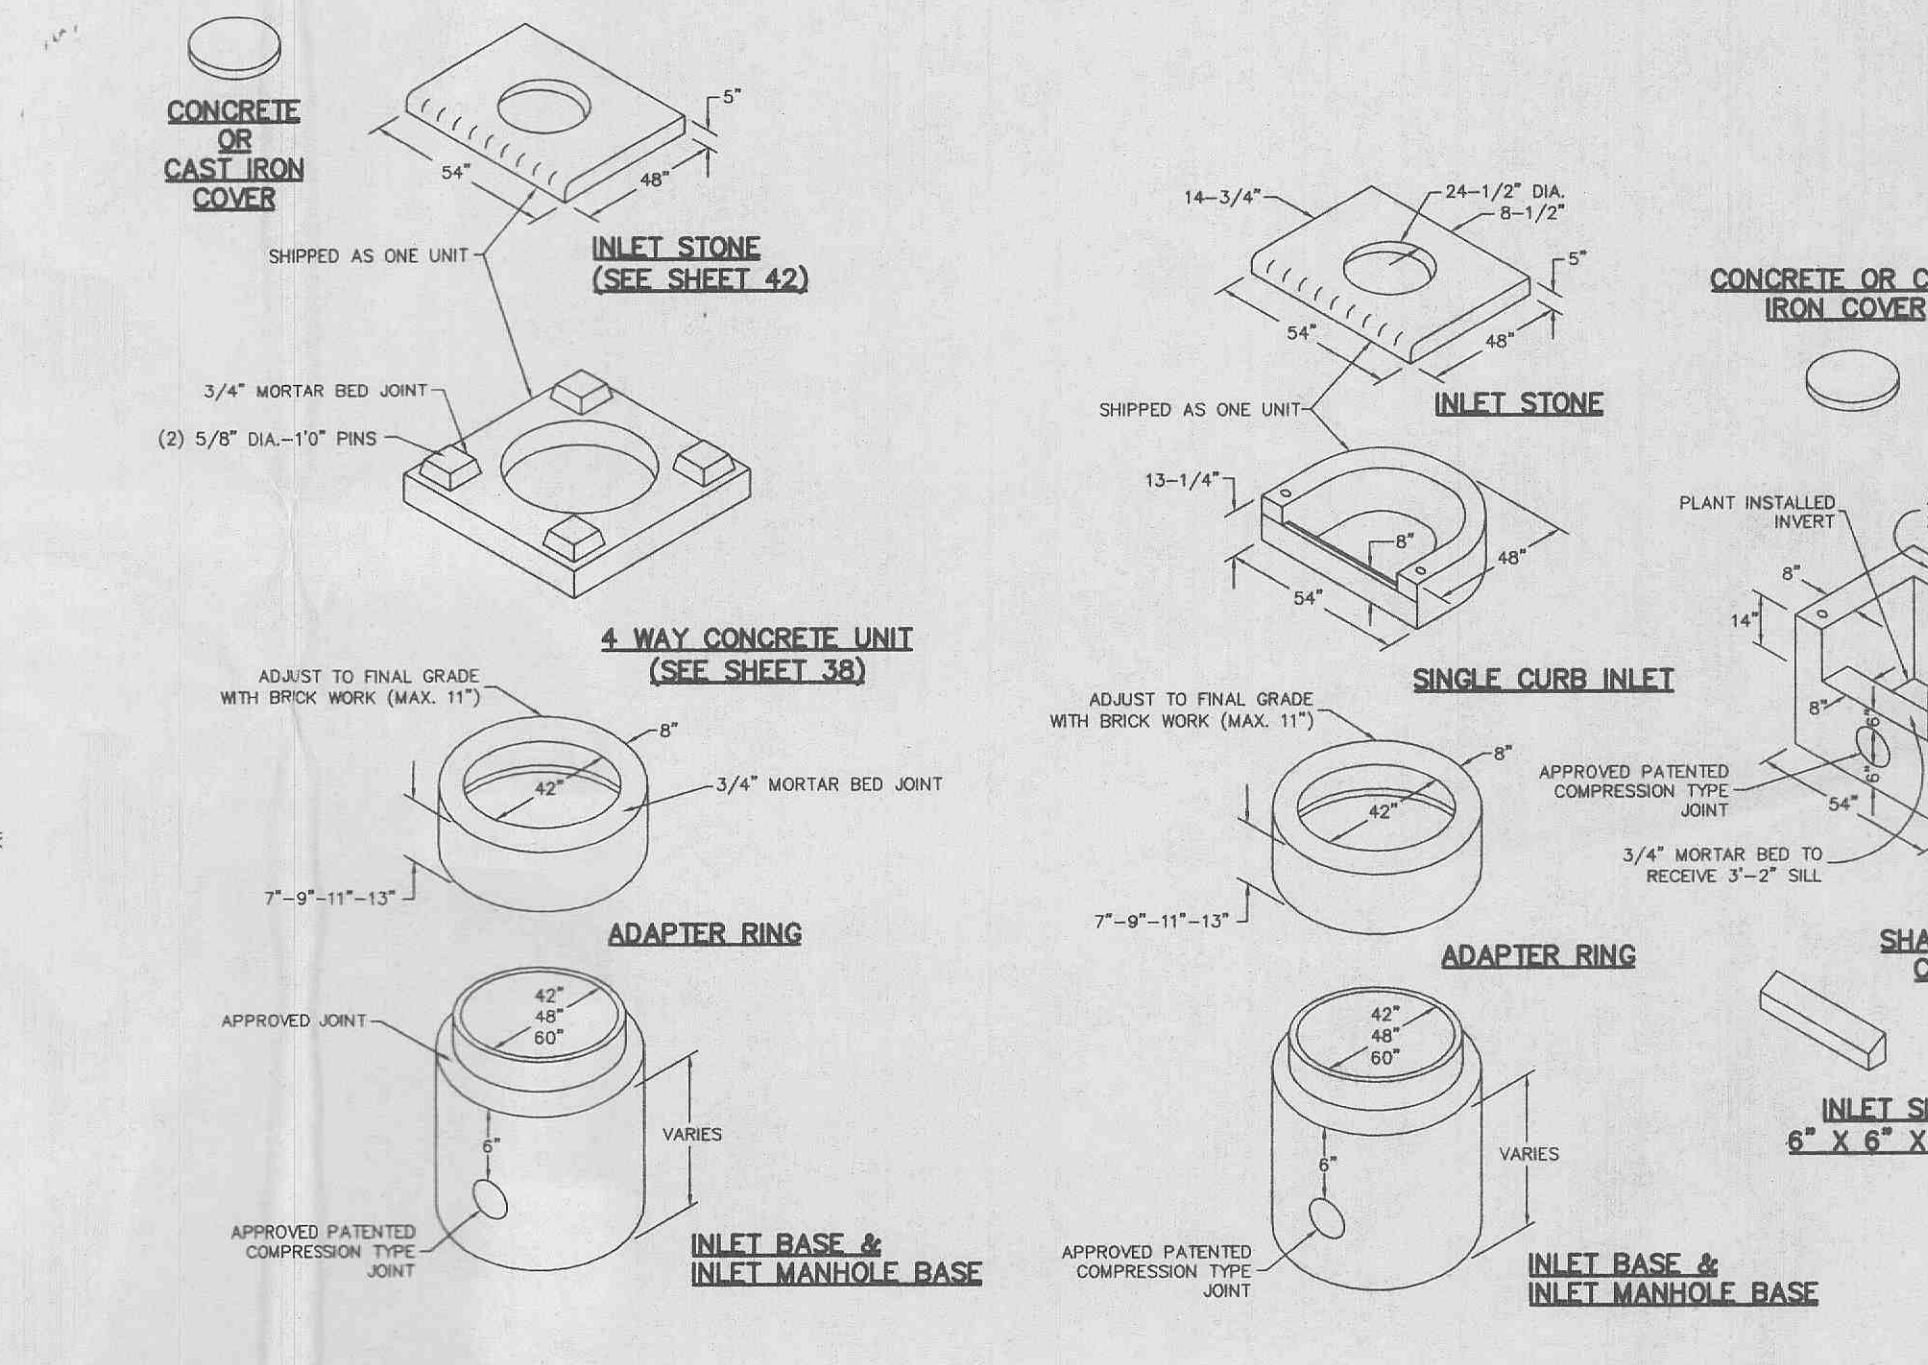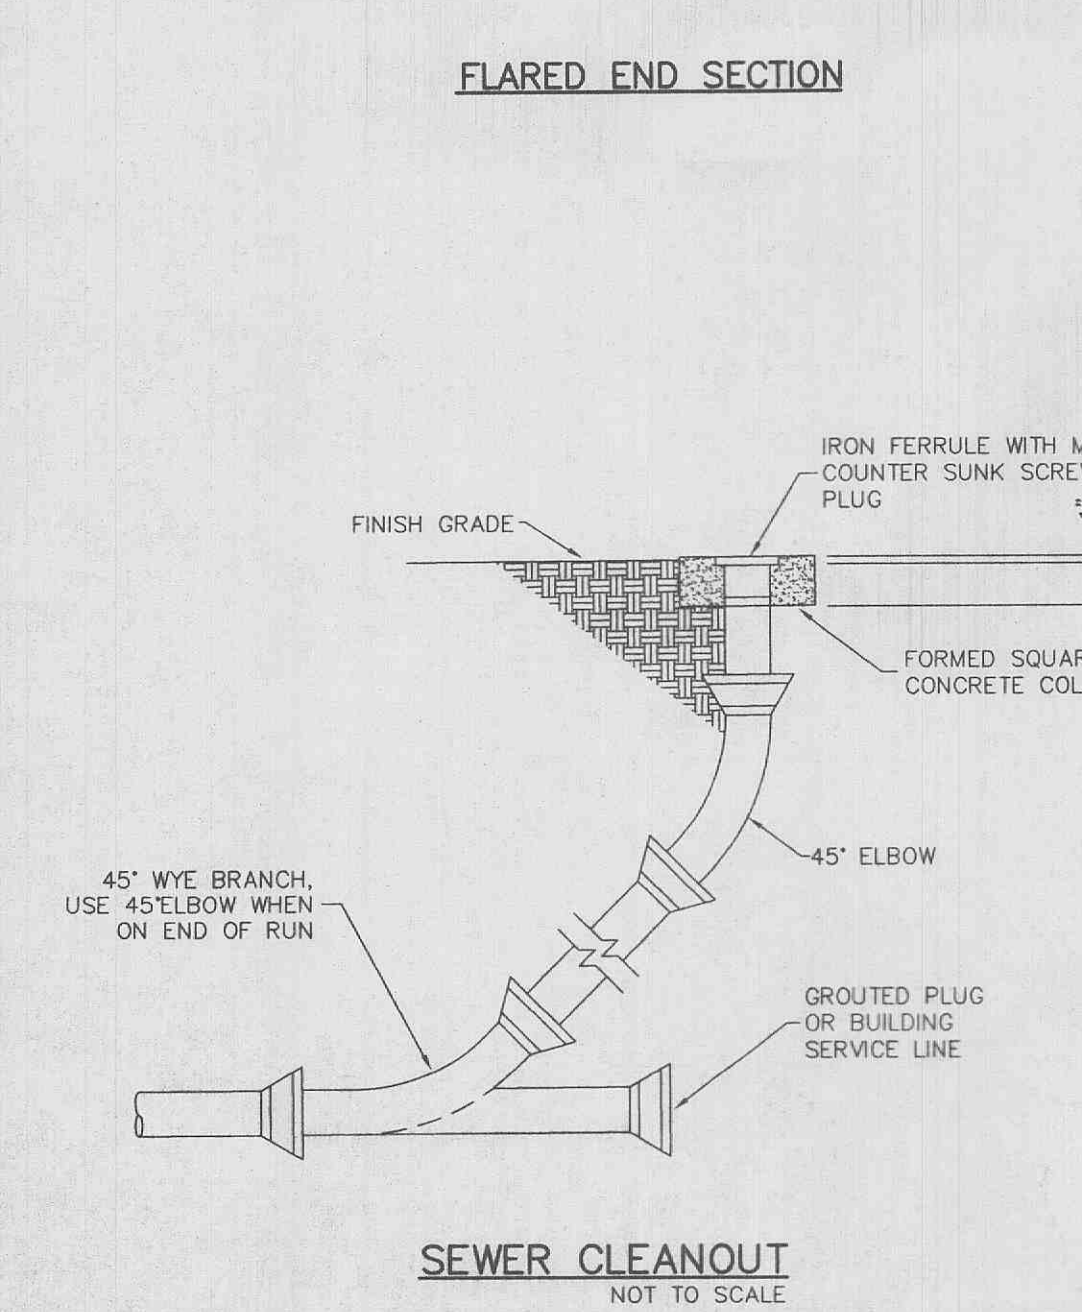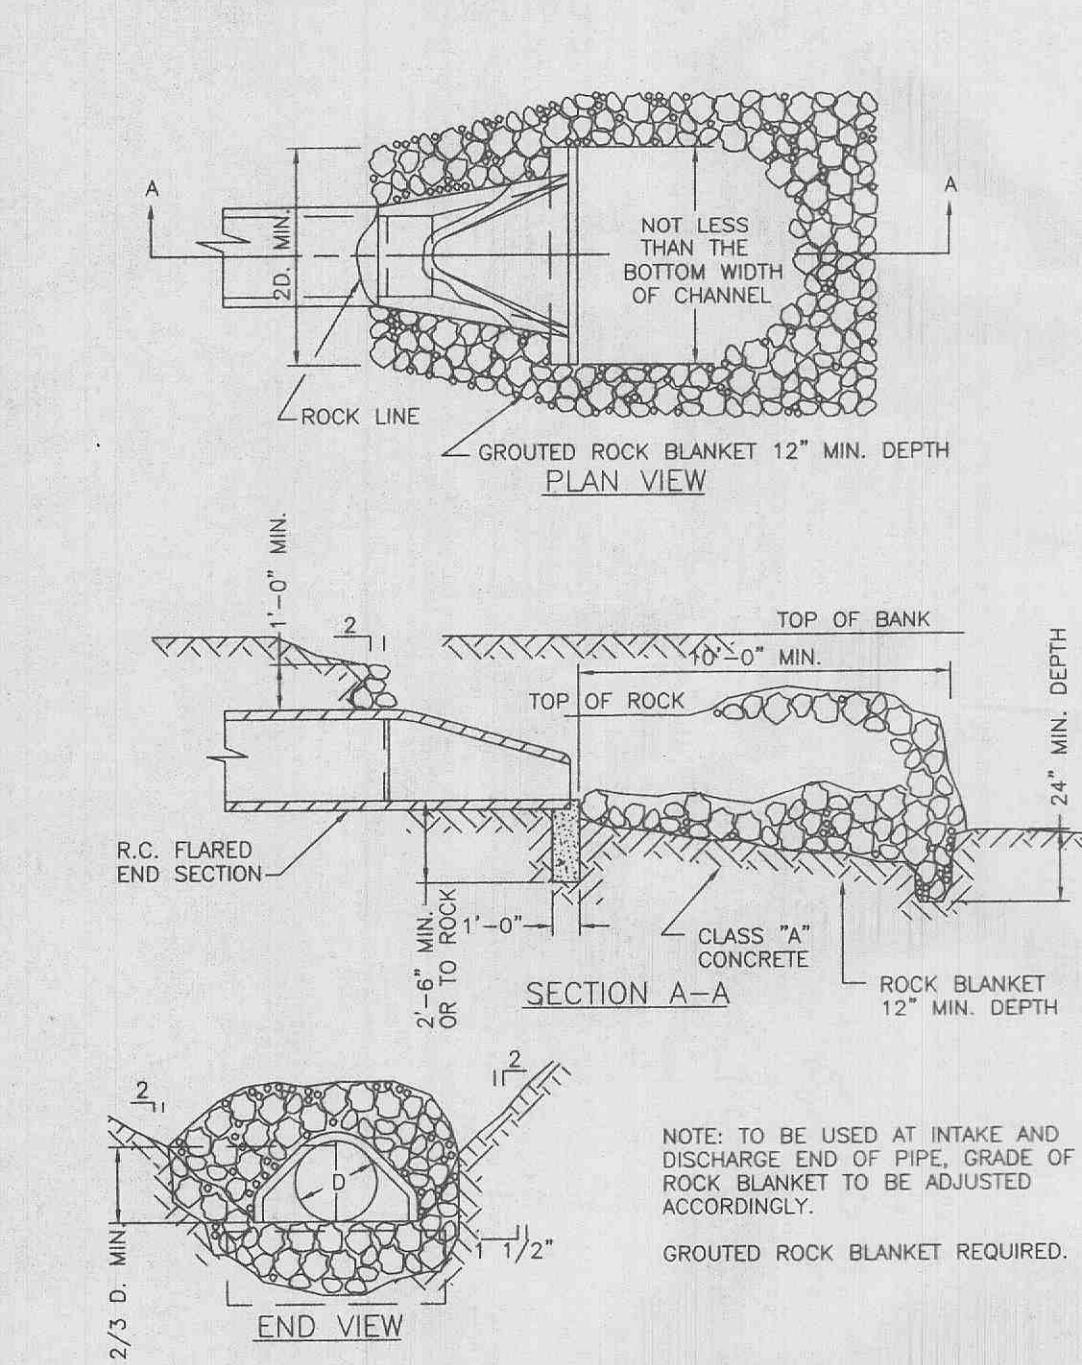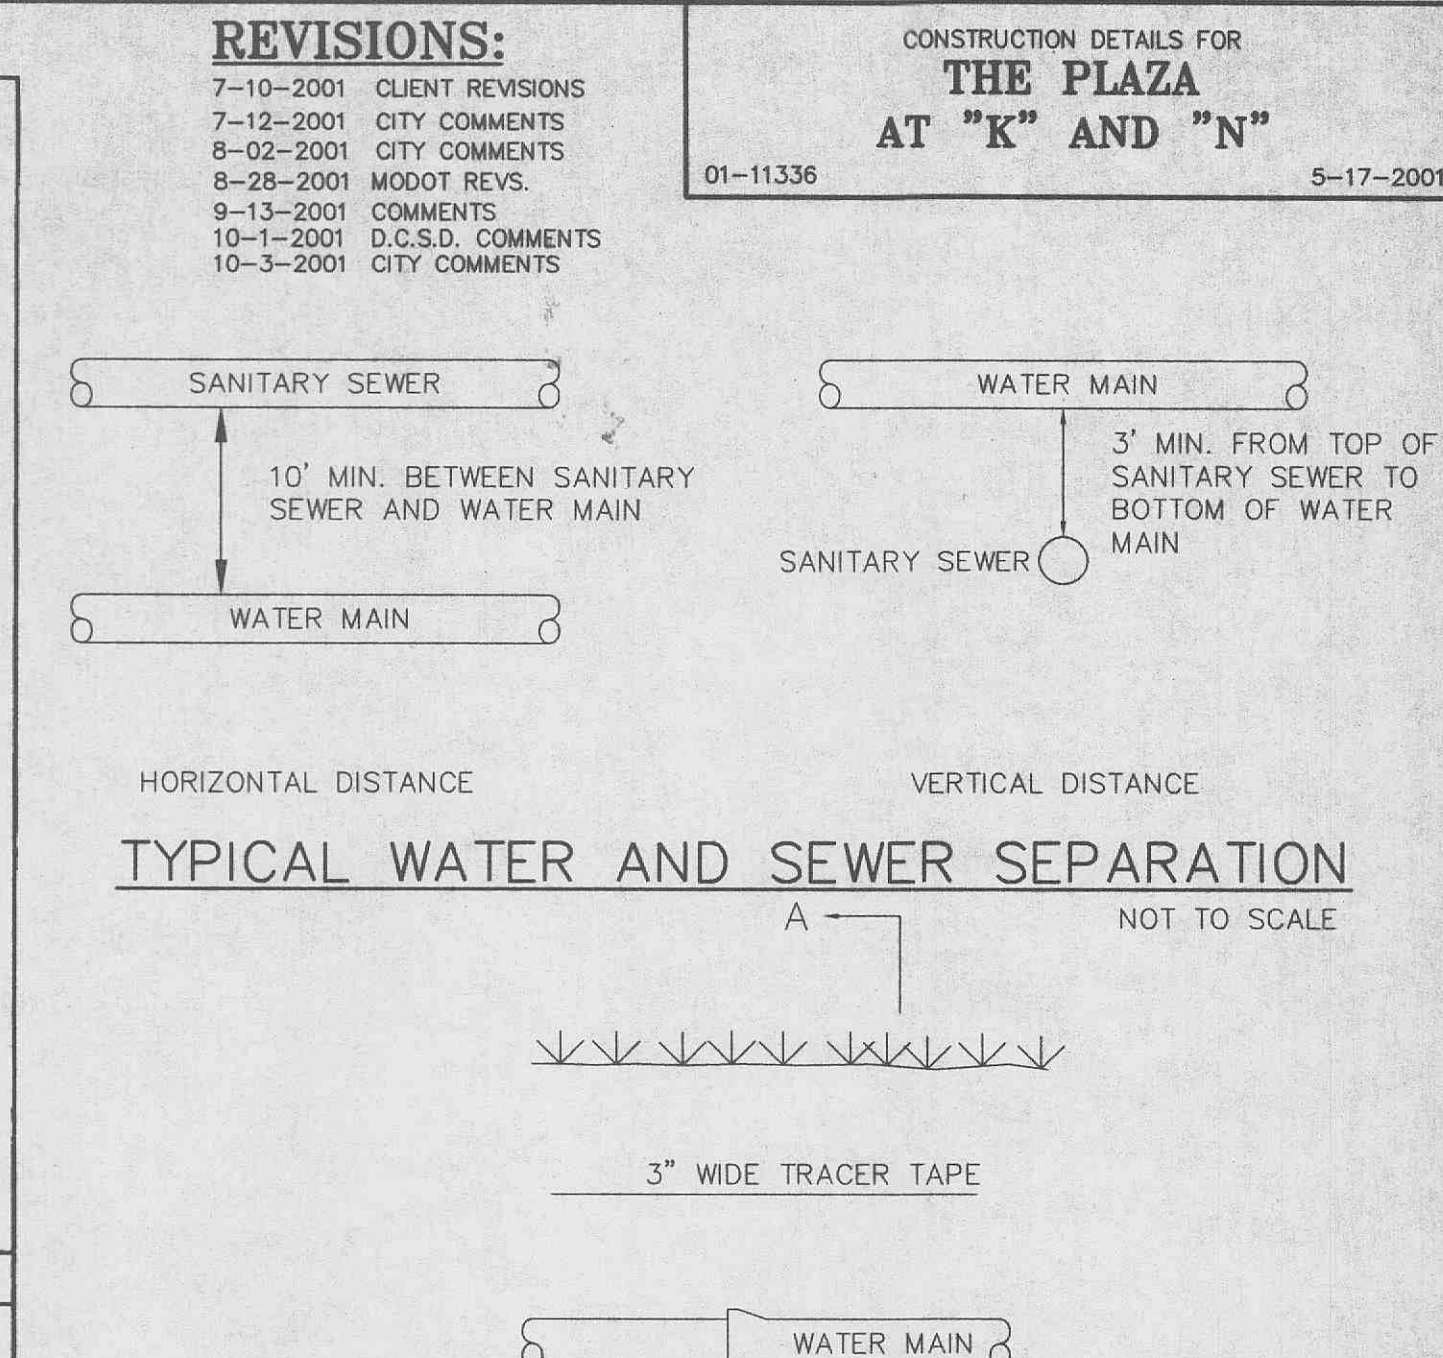

MAIN SIZE (I.D.)	MIN. THRUST BLOCK BEARING DIMENSIONS TO BEAR AGAINST UNDISTURBED EARTH				
	45° BEND	22 1/2° BEND	TEE	VALVE	CROSS
2"	.5' X 1'	.5' X 1'	.5' X 1'	.5' X 1'	.5' X 1'
4"	1' X 1'	1' X 1'	2' X 1'	2' X 1'	1' X 1'
6"	1.5' X 1'	1' X 1'	2' X 1'	2' X 1'	1' X 1'
8"	2' X 1'	1' X 1'	2' X 2.5'	2' X 2'	1' X 1.5'
10"	2' X 2.5'	1.5' X 2'	2' X 3.5'	2' X 3'	2' X 2'
12"	2' X 3.5'	1.5' X 2.5'	3' X 3.5'	3' X 3'	2' X 3'
16"	3' X 4'	2' X 3'	4' X 4.5'	3' X 4.5'	3' X 3.5'

TYPICAL THRUST BLOCK DETAILS NOT TO SCALE

E:\DGA\11000R\US\11336 C:\sese11 Mueller\Rea\11 Center\Construction\11336con.dwg Mod Oct 03 13:55:03 2001 STATION 11 SCOTT L.