
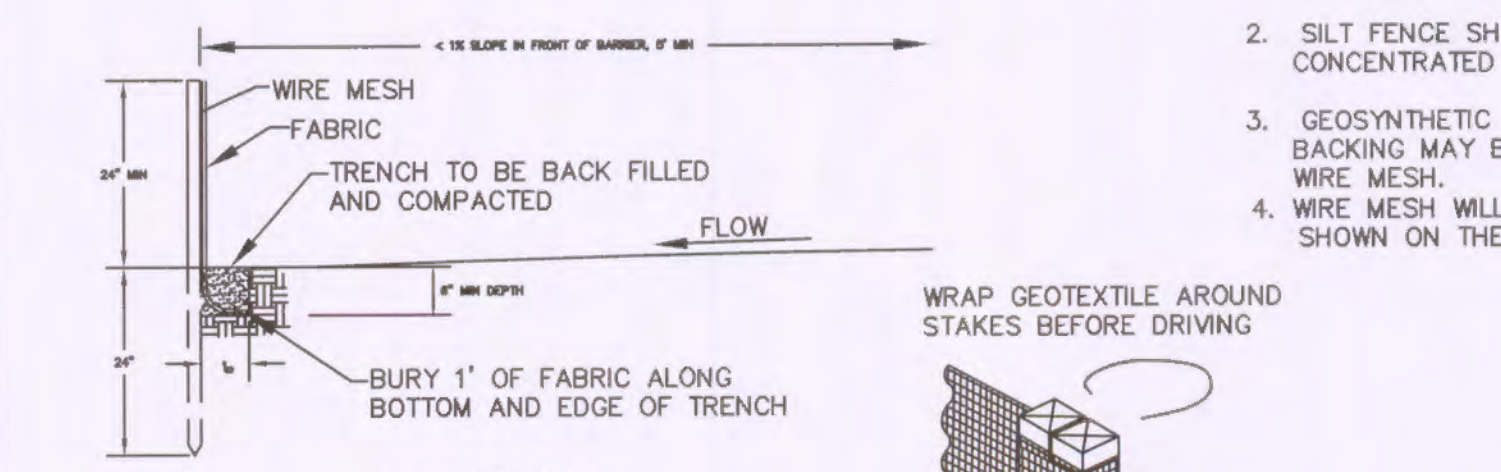


- DESIGN CRITERIA**
- SILT FENCE FOR SHEET FLOW SHALL HAVE A MAXIMUM DRAINAGE AREA OF 1/4 ACRE PER 100 LF.
 - STRAW BALE BARRIERS FOR SHEET FLOW SHALL HAVE A MAXIMUM DRAINAGE AREA OF 1/4 ACRE PER 100 LF.
 - REFER TO INDIVIDUAL ESC FIGURE FOR INSTALLATION.
 - TERRACING INCLUDES LOGS, WATTLES & FILTER SOCKS.

CITY OF O'FALLON
ENGINEERING DEPARTMENT
O'FALLON, MISSOURI



**SPACING CHART
FOR ESC DEVICES**

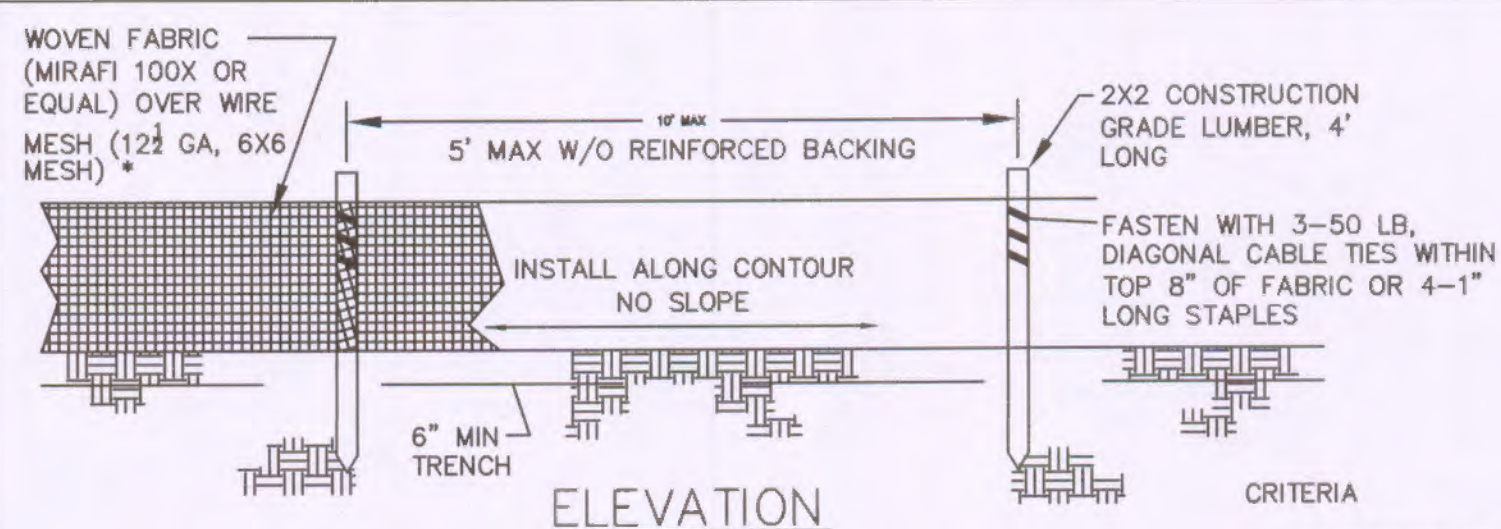

- CRITERIA**
- SILT FENCE SHALL BE 24 INCHES HIGH.
 - SILT FENCE SHALL NOT BE USED FOR CONCENTRATED FLOWS.
 - GEOSYNTHETIC REINFORCED SILT FENCE BACKING MAY BE USED IN LIEU OF WIRE MESH.
 - WIRE MESH WILL BE USED AT LOCATIONS SHOWN ON THE APPROVED SWPPP.

CITY OF O'FALLON
ENGINEERING DEPARTMENT
O'FALLON, MISSOURI

**SILT FENCE INSTALLATION
SHEET FLOW (ONLY)**

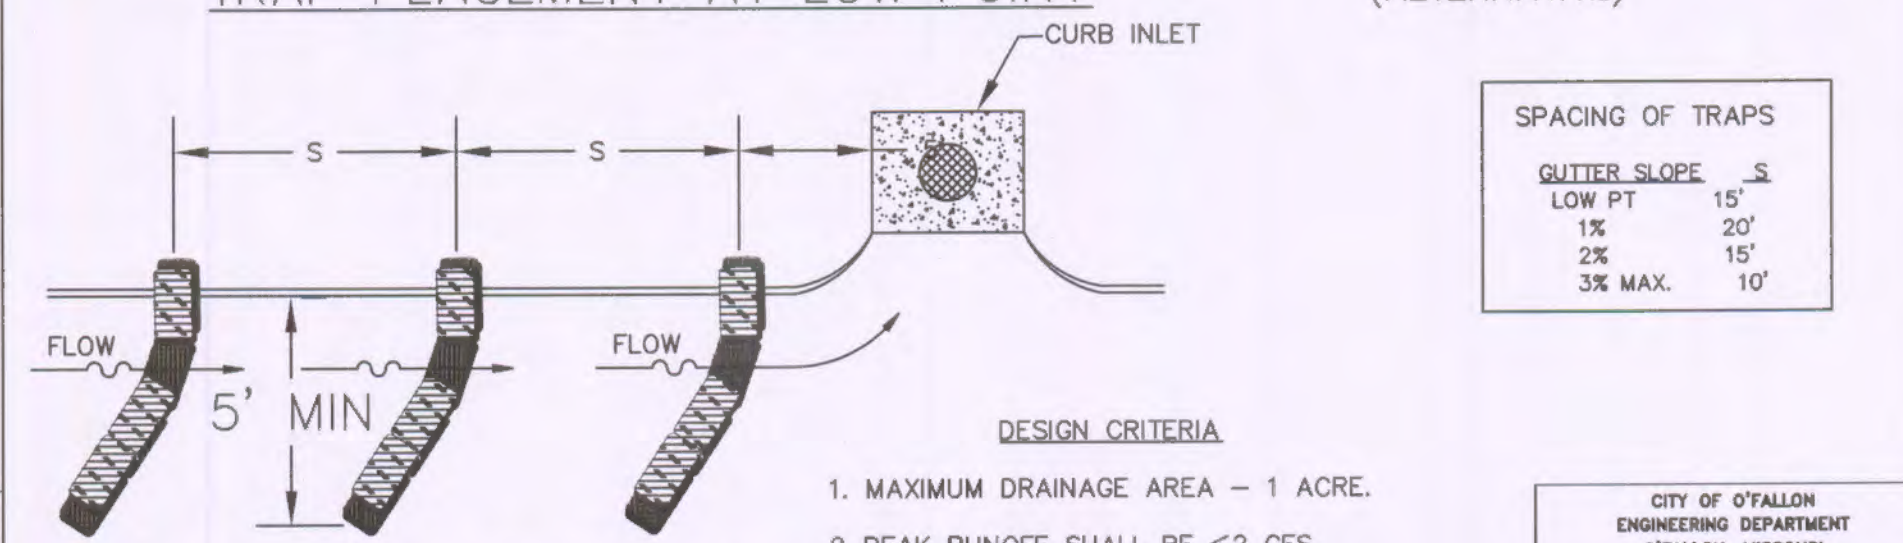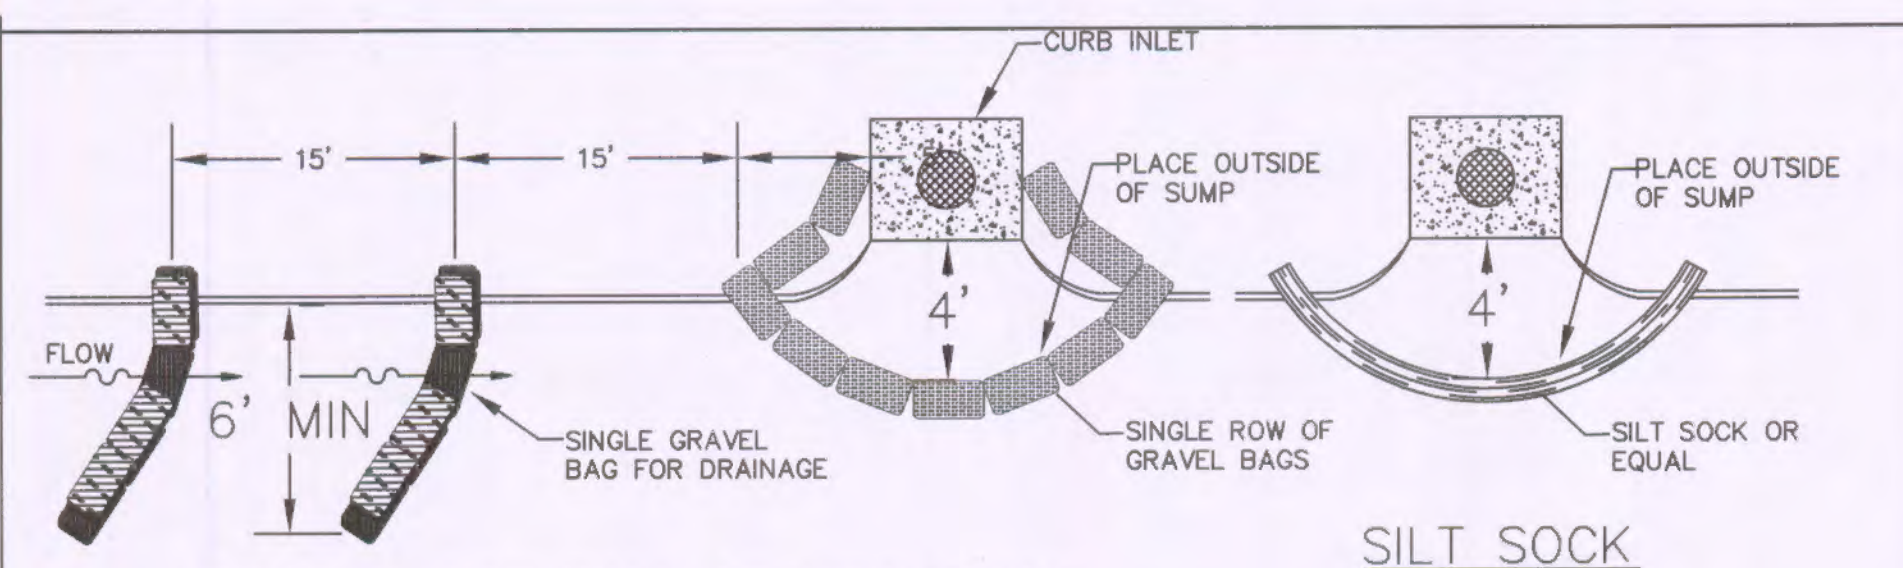



SPACING OF TRAPS

GUTTER SLOPE	S
LOW PT	15'
1%	20'
2%	15'
3% MAX.	10'

- DESIGN CRITERIA**
- MAXIMUM DRAINAGE AREA - 1 ACRE.
 - PEAK RUNOFF SHALL BE ≤ 2 CFS BASED ON THE 6-MONTH STORM.
 - STACK GRAVEL BAGS DOUBLE HIGH. PROVIDE GAP FOR DRAINAGE.

CITY OF O'FALLON
ENGINEERING DEPARTMENT
O'FALLON, MISSOURI






**CURB INLET
PROTECTION**

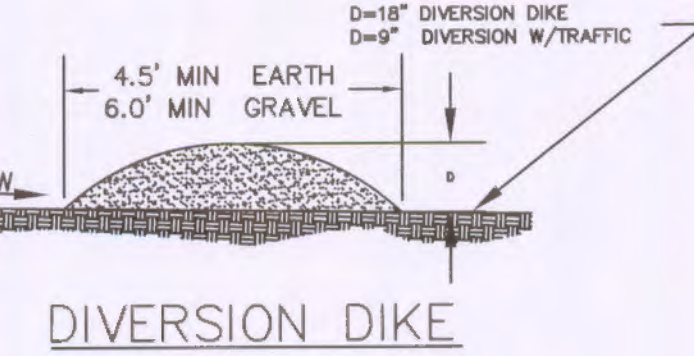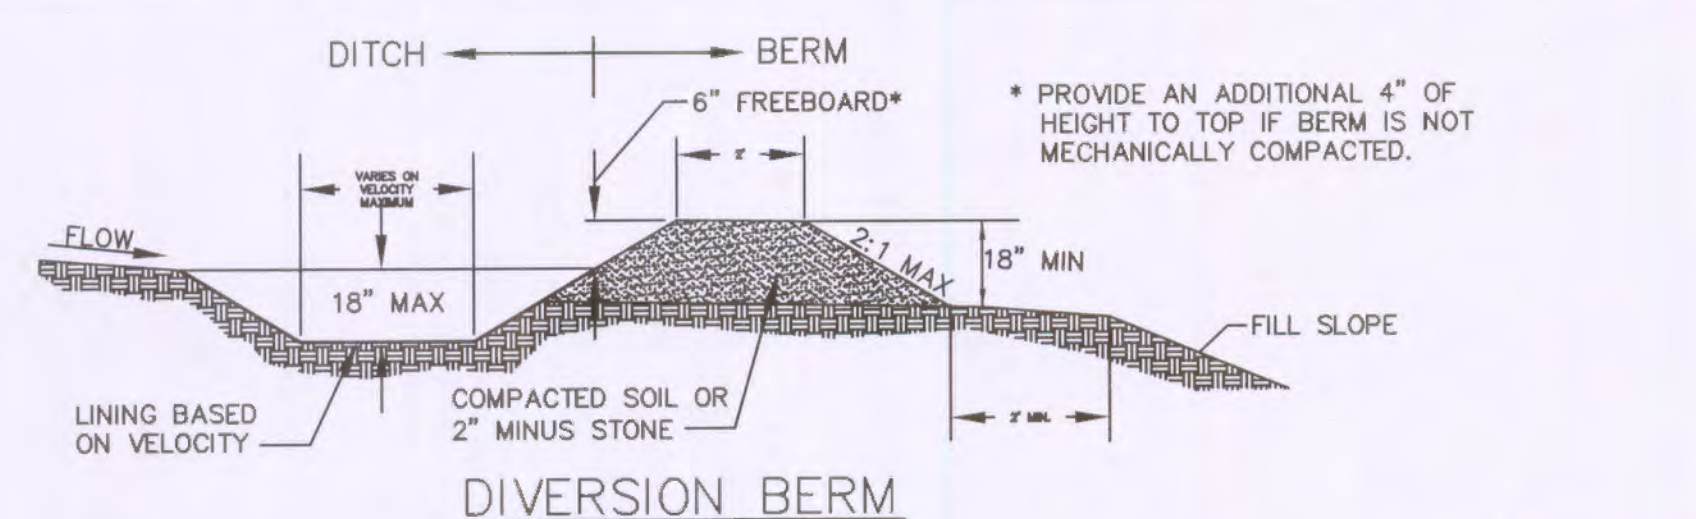

- DESIGN CRITERIA**
- DIVERSIONS SHALL BE USED FOR DRAINAGE AREAS ≤ 3 ACRES.
 - DIVERSION CHANNELS SHALL BE DESIGNED TO CONVEY THE 6-MO STORM AT NON-EROSIVE VELOCITIES.
 - CRITICAL LOCATIONS SHALL BE DESIGNED FOR THE 15YR / 20MIN. STORM.
 - MAXIMUM CHANNEL SLOPE OF 3% WITHOUT CHECK DAMS.
 - SWALE SEDIMENT TRAPS ARE TO BE USED IN HIGHLY EROSION AREAS.
 - CHANNELS SHALL BE PROTECTED USING APPROPRIATE CHANNEL LINERS.
 - CHANNEL OUTLETS MUST BE STABILIZED.
 - STORM SEWERS MAY BE USED IN LIEU OF OPEN CHANNELS.

CITY OF O'FALLON
ENGINEERING DEPARTMENT
O'FALLON, MISSOURI


**DIVERSION BERMS
+ DIKES**

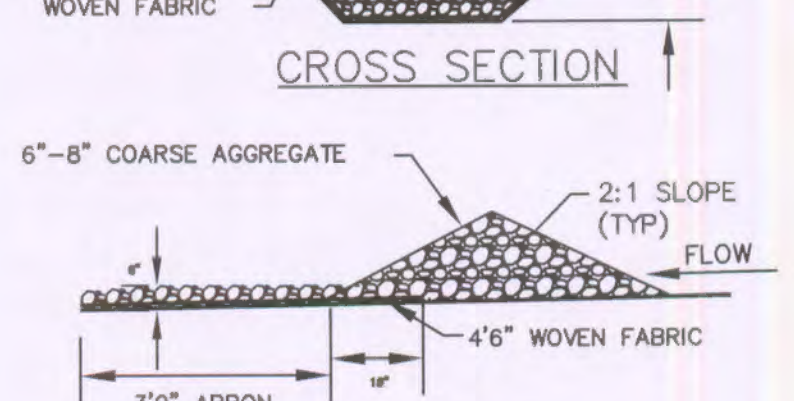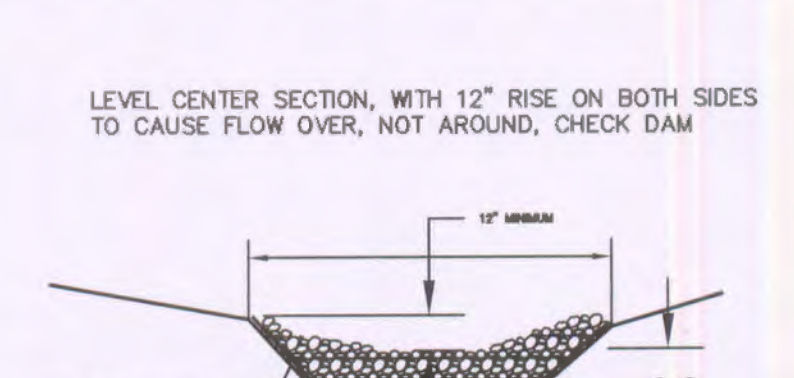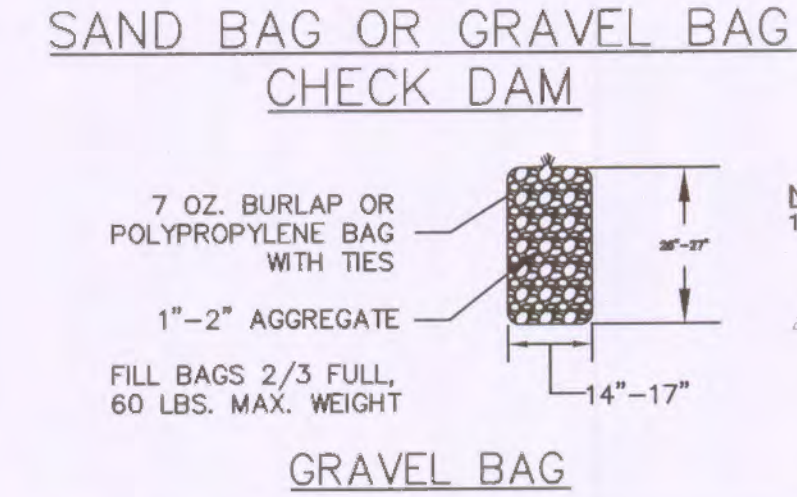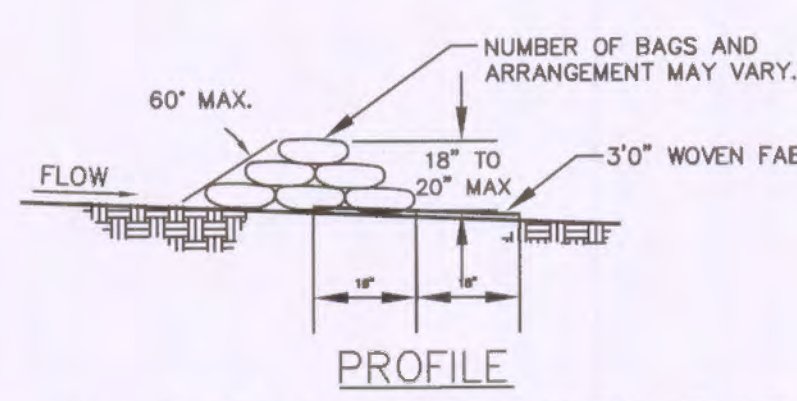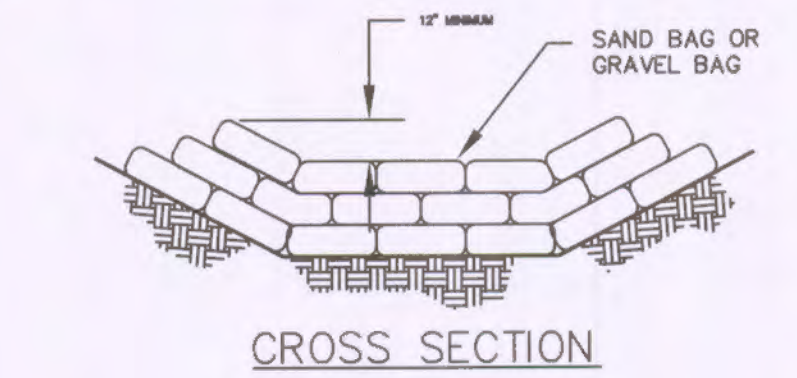

- NOTE:**
- CHECK DAMS MAY BE CONSTRUCTED OF SEVERAL ESC CHECK DAM PRODUCTS.
 - SEE TABLE 60-12 AND ESC 1 FOR CHECK DAM SPACING.

CITY OF O'FALLON
ENGINEERING DEPARTMENT
O'FALLON, MISSOURI


CHECK DAMS

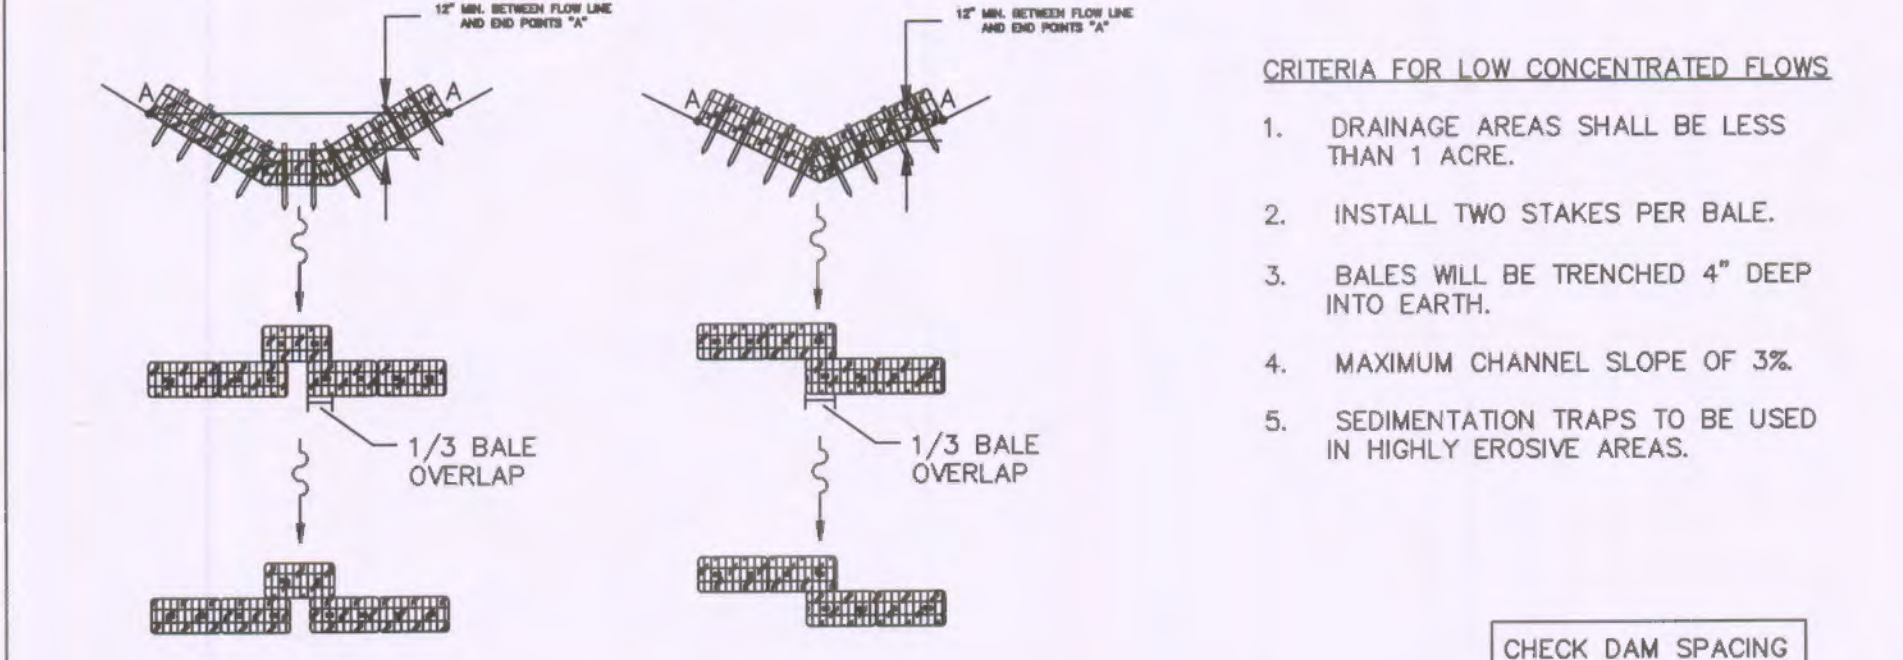

- CRITERIA FOR LOW CONCENTRATED FLOWS**
- DRAINAGE AREAS SHALL BE LESS THAN 1 ACRE.
 - INSTALL TWO STAKES PER BALE.
 - BALES WILL BE TRENCHED 4" DEEP INTO EARTH.
 - MAXIMUM CHANNEL SLOPE OF 3%.
 - SEDIMENTATION TRAPS TO BE USED IN HIGHLY EROSION AREAS.


CHECK DAM SPACING

Ditch Slope	Maximum Spacing
3%	50%
2%	75%

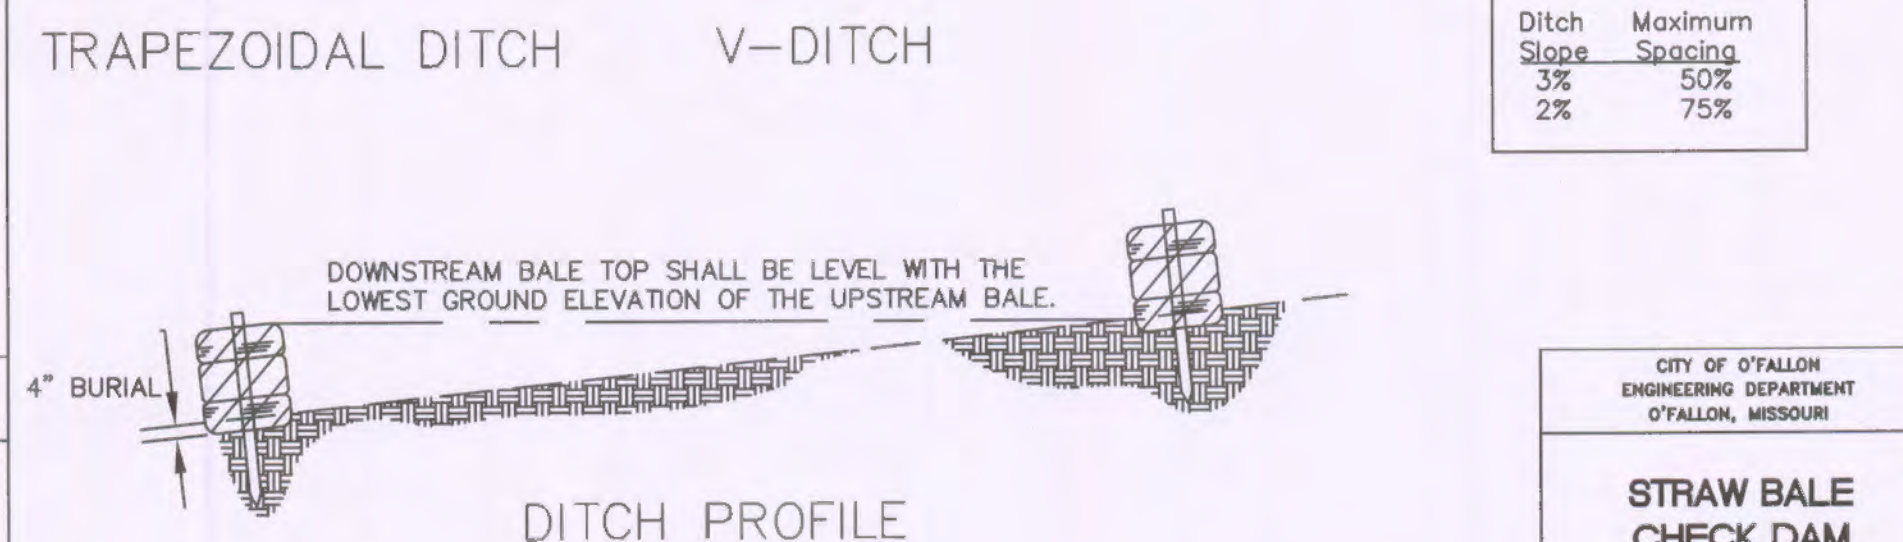


CITY OF O'FALLON
ENGINEERING DEPARTMENT
O'FALLON, MISSOURI

**STRAW BALE
CHECK DAM**

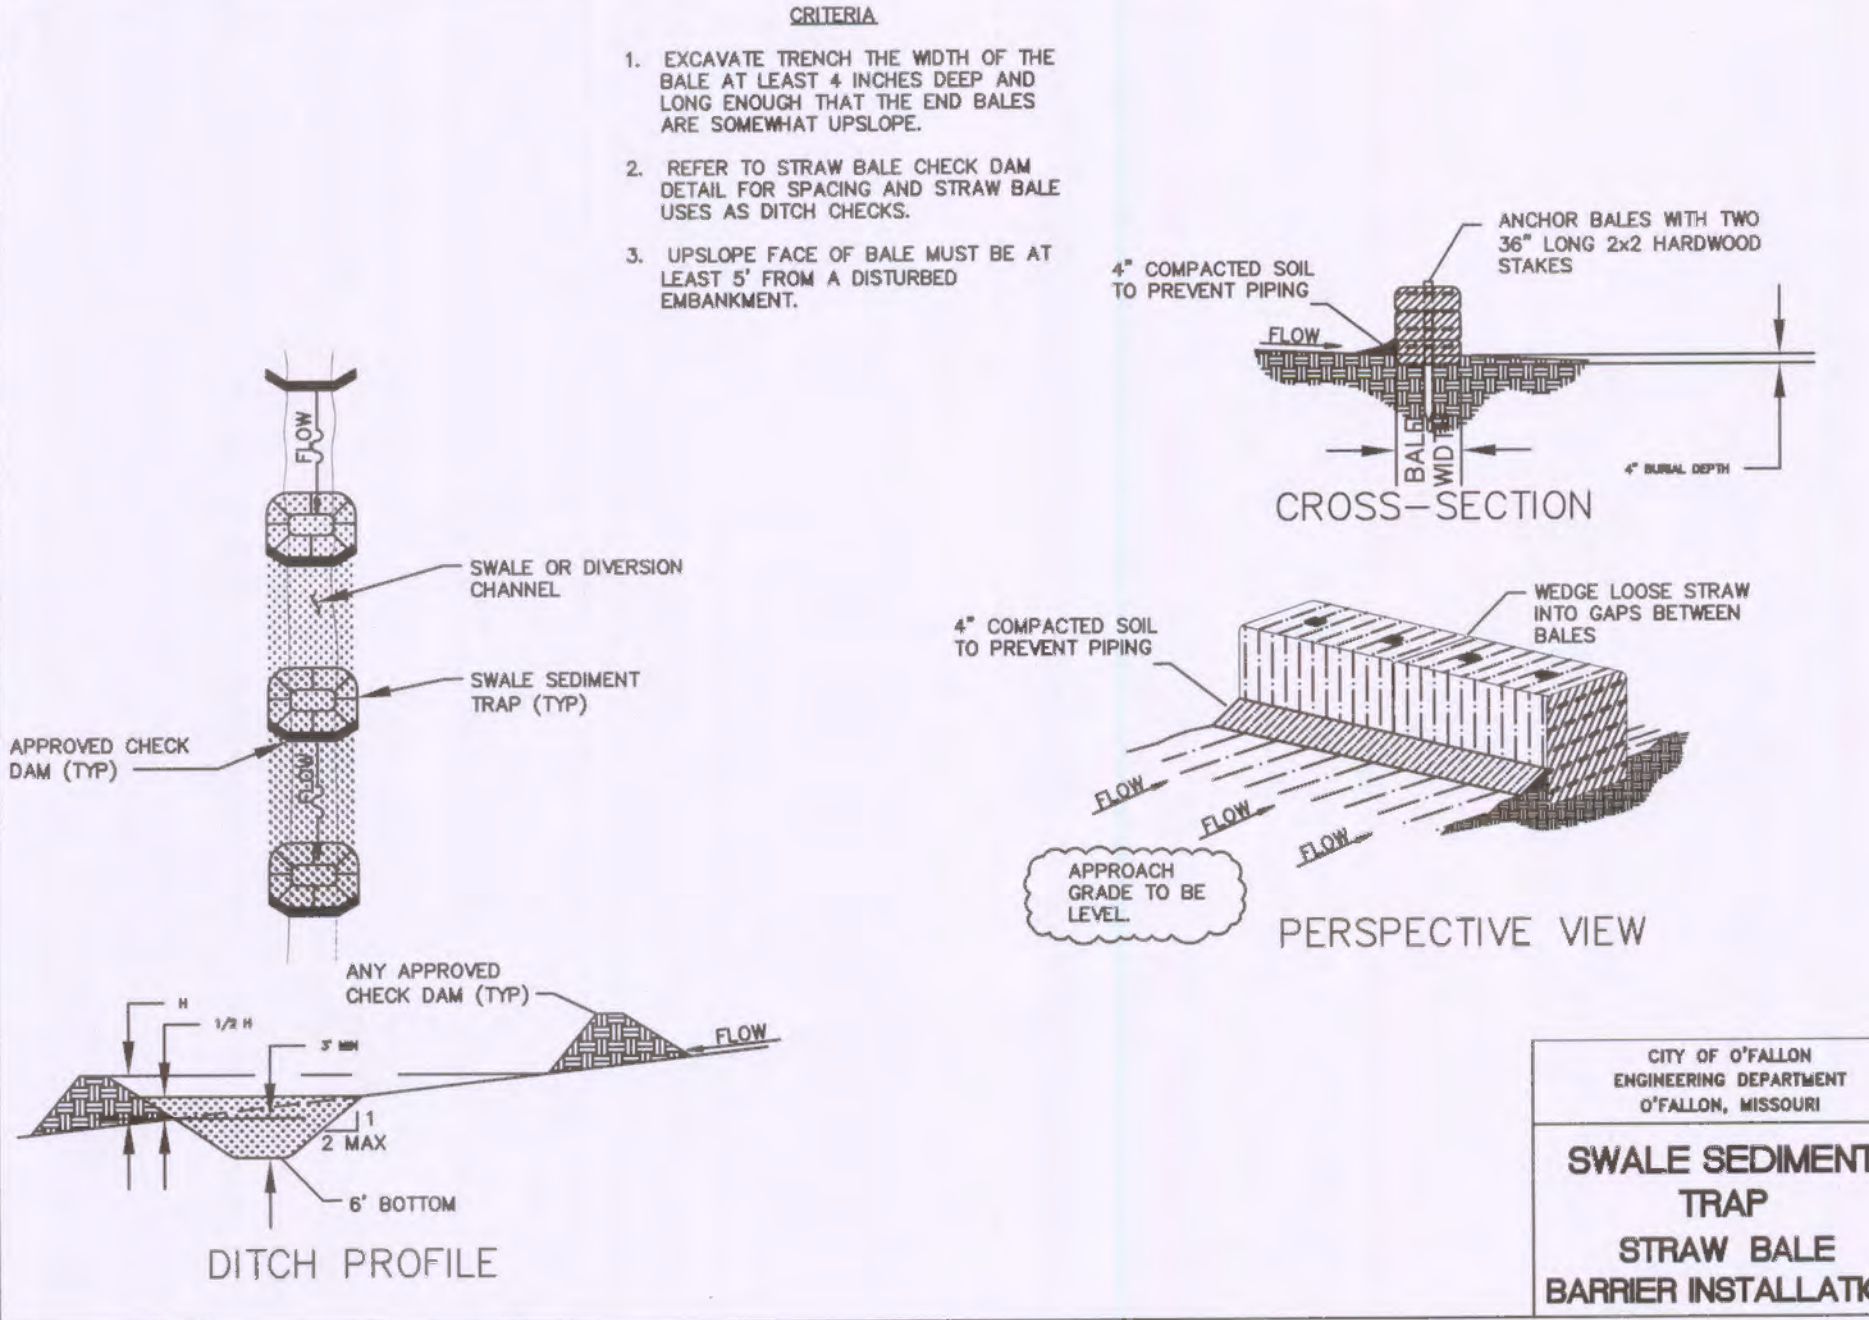

CITY OF O'FALLON
ENGINEERING DEPARTMENT
O'FALLON, MISSOURI

**SWALE SEDIMENT
TRAP
STRAW BALE
BARRIER INSTALLATION**

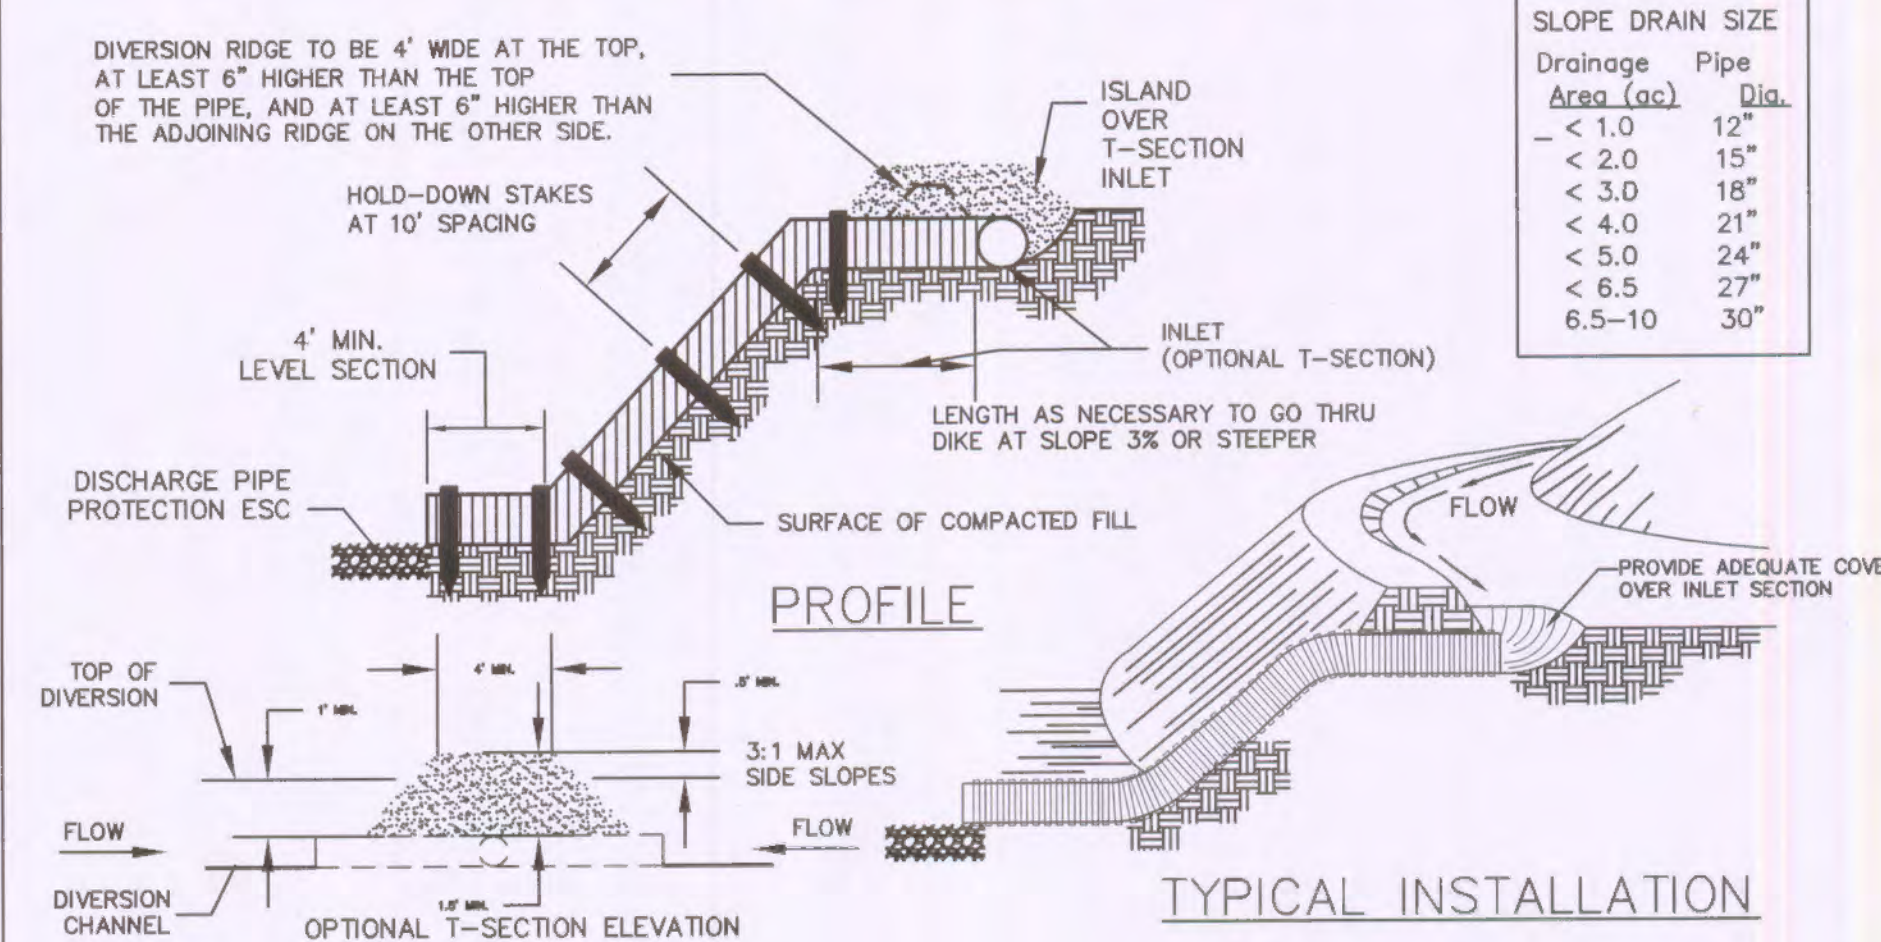


SLOPE DRAIN SIZE

Drainage Pipe Area (sq ft)	Drainage Pipe Dia.
< 1.0	12"
< 2.0	15"
< 3.0	18"
< 4.0	21"
< 5.0	24"
< 6.5	27"
6.5-10	30"

- NOTE:**
- PIPE CAN BE CMP, PVC, FLEXIBLE TUBING, OR SIMILAR.
 - THIS METHOD MUST BE USED IN CONJUNCTION WITH OTHER ESC DEVICES. THIS IS NOT A STAND ALONE CONTROL DEVICE.

CITY OF O'FALLON
ENGINEERING DEPARTMENT
O'FALLON, MISSOURI

**TEMPORARY
SLOPE DRAIN**

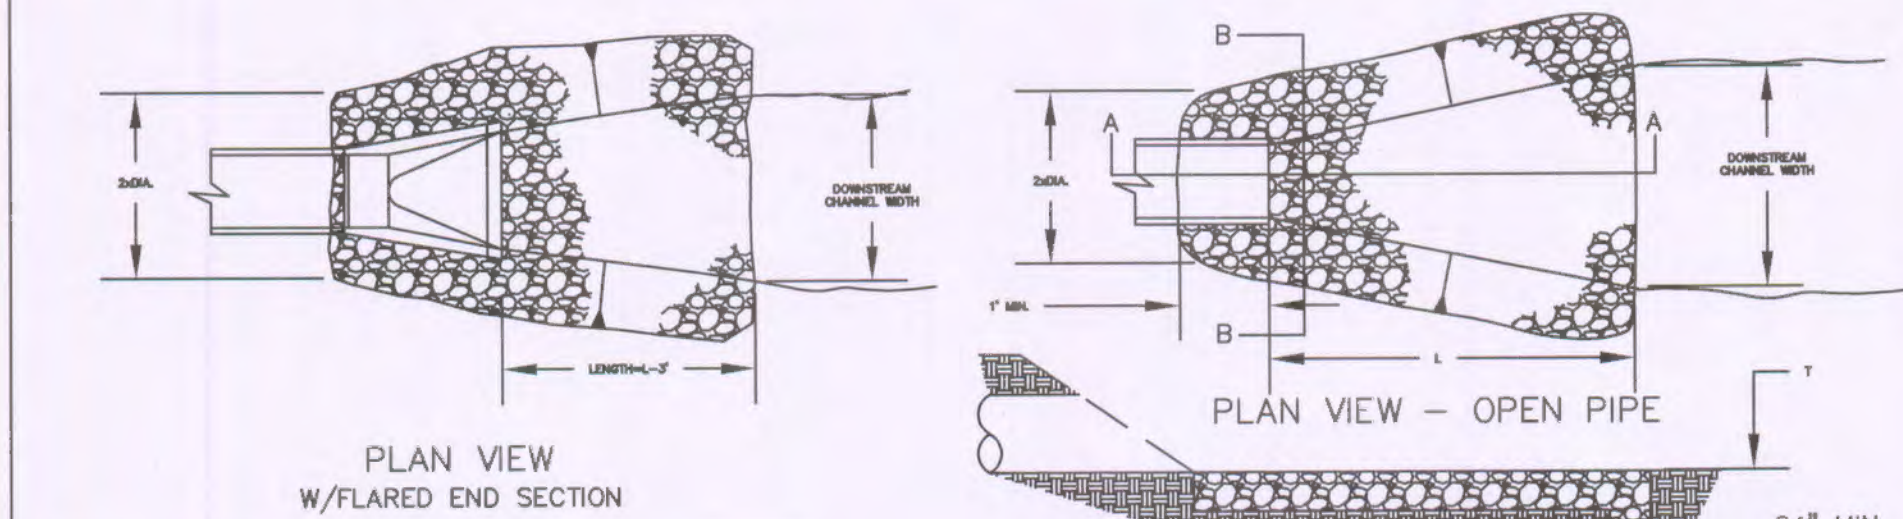

RIPRAP SIZE & APRON DIMENSION

PIPE SIZE (inch)	VELOCITY < 5 FPS				VELOCITY < 10 FPS			
	d ₅₀ (inch)	d _{max} (inch)	T (inch)	L (inch)	d ₅₀ (inch)	d _{max} (inch)	T (inch)	L (inch)
12	5	9	15	12	5	9	15	16
15	5	9	15	14	5	9	15	18
18-24	5	9	15	16	9	14	24	20
27-30	5	9	15	18	9	14	24	22
36-42	14	24	22	12	18	27	26	
48-54	9	14	24	26	12	18	27	30
60-66	12	18	27	34	15	24	30	38
72-84	15	24	30	42	15	24	30	46
96	18	27	30	50	18	27	30	54


- DESIGN CRITERIA**
- FROUDE NUMBER MUST BE ≤ 2.50 .
 - USE 3 TIMES PIPE DIAMETER FOR DOWNSTREAM CHANNEL WIDTH IF THERE IS NO DEFINED CHANNEL.
 - BANK PROTECTION HEIGHT TO BE 2/3 TIMES PIPE DIAMETER.
 - ROCK SLOPES SHALL BE NO STEEPER THAN 3:1.

CITY OF O'FALLON
ENGINEERING DEPARTMENT
O'FALLON, MISSOURI

**TEMPORARY OUTLET
PIPE DISCHARGE
PROTECTION**

PROJECT TITLE
PRIMROSE SCHOOL
OF O'FALLON AT
WINGHAVEN
7778 WINGHAVEN BLVD,
O'FALLON, MISSOURI

GRIMES CONSULTING, INC.
Civil Engineering & Surveying Services
13265 OLD TESSON ROAD
STATE 3020
ST. LOUIS, MO 63128
PHONE: (314) 949-6100
FAX: (314) 949-6100
WWW.GRIMESCONSULTING.COM
CONTACT: LENNY MEERS
EMAIL: lenny@grimesconsulting.com

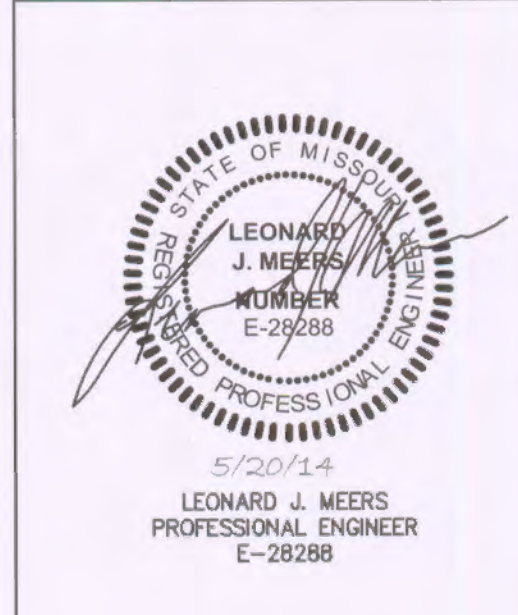

5/20/14
LEONARD J. MEERS
PROFESSIONAL ENGINEER
E-29288

Developer / Owner Information
EVERGREEN
2390 E CAMELBACK RD, PHOENIX, ARIZONA
24 Hr. Emergency Contact: ALEX GONZALEZ
Primary Contact: ALEX GONZALEZ
Phone: (602) 808-8600
Fax: (602) 567-7101
Email: agonzalez@evgr.com

P+Z No.
983154.03
City No.
TBD
Page No.