

SCALES:

1" = 20' HORIZONTAL

1" = 5' VERTICAL

s19759/Sanitary Sewer Profiiles.dwg CTB: Trans-std-AMH.ctb PLOT DATE: 3/27/2019 9:26:58 AM

SPECIAL NOTE TO CONTRACTOR(S):

EXISTING UNDERGROUND AND ABOVE-GRADE FACILITIES, STRUCTURES, AND UTILITIES HAVE BEEN PLOTTED ON THESE CONTRACT DOCUMENTS BASED ON THE INFORMATION AND SURVEYS AVAILABLE AT THE TIME OF DRAWING PREPARATION. THE LOCATIONS OF THESE FEATURES MUST, THEREFORE, BE

CONSIDERED APPROXIMATE, ONLY. IN ADDITION, THERE MAY BE OTHER FACILITIES, STRUCTURES, AND

UTILITIES WHICH DID NOT EXIST (OR THE EXISTENCE OF WHICH WAS NOT KNOWN) AT THE TIME OF DRAWING PREPARATION. IT IS THE SOLE RESPONSIBILITY OF THE CONTRACTOR(S) TO HAVE <u>ALL</u> EXISTING

FACILITIES, STRUCTURES, AND UTILITIES LOCATED IN THE FIELD PRIOR TO ANY EXCAVATION OR 인 행 및 CONSTRUCTION ACTIVITY; <u>AND</u> TO PROTECT ALL SUCH EXISTING FEATURES (EXCEPT THOSE SPECIFICALLY AND FOR REMOVAL OR DEMOLITION) DURING CONSTRUCTION.

				535
			LATERAL CONNECTION	
				530
	MANHOLE			
	(103)		EX. MANHOLE	525
	$ \gamma $		(105)	
	517.98			
			2119 I	520
	-+-///			E1E
				515
				510
				505
				500
		EX. 104' ~ 8" PVC		
	FL OUT = 499.80 (SE) FL IN = 499.80 (NW) FL IN = 504.79 (NE)	@ 2.00% (PUBLIC)	FL OUT = 501. <u>99 (SE)</u> FL IN = 501. <u>99 (NW)</u>	495
	= 499 99.80 04.75		1.09	
	NUT = N = 4 = N = 5		= 20 = 20	
			D Z L L	490
				105
+				485
+00 E		3+00		<u>480</u> 4+00 4-

GENERAL NOTES:

35 PVC.

1. T = TOP OF MANHOLE CASTING OR INLET STONE.

2. ALL SANITARY SEWER PIPE TO BE SDR 35 PVC OR APPROVED EQUAL.

3. ALL SANITARY SEWER THAT IS 6" IS TO BE SCHEDULE 40 PVC PIPE. SEWERS THAT ARE 8" OR LARGER MAY BE SCHEDULE

4. CONTRACTOR TO PROVIDE COMPACTED GRANULAR BACKFILL TO THE SUBGRADE OF THE PAVEMENT FOR ALL TRENCHES UNDER PAVEMENT.

5. PIPE CENTERLINE APPLIES TO CENTERLINE OF STRUCTURE.

6. LOCATION OF UTILITIES ON PIPE PROFILES ARE APPROXIMATE.

7. DISTANCES BETWEEN STRUCTURES ARE MEASURED TO THE CENTER OF THE STRUCTURES.

DENSITY AS DETERMINED BY ASTM D-15571-180 AASHTO MODIFIED COMPACTION TEST AND BE VERIFIED BY THE ENGINEER.

9. CONTRACTOR SHALL EXPOSE ALL WATER AND GAS MAINS PRIOR TO SANITARY SEWER PIPE INSTALLATION AND VERIFY TOP OF ELEVATIONS OF UTILITIES.

10. ALL SEWER CONSTRUCTION AND MATERIALS TO BE IN ACCORDANCE WITH THE METROPOLITAN ST. LOUIS SEWER DISTRICT STANDARD CONSTRUCTION SPECIFICATIONS FOR DRAINAGE FACILITIES, 2009.


11. WHEN THE WATER LINES CROSS THE SANITARY SEWER, A MINIMUM SEPARATION OF 18" SHALL BE MAINTAINED BETWEEN WATER LINE AND SANITARY SEWER.

PRINTS ISSUED

05/11/18 - Permit Set

REVISIONS:

3 12/7/2018 Addendum #3 **5** 03/26/2019 Addendum #5 (Civil Issue)

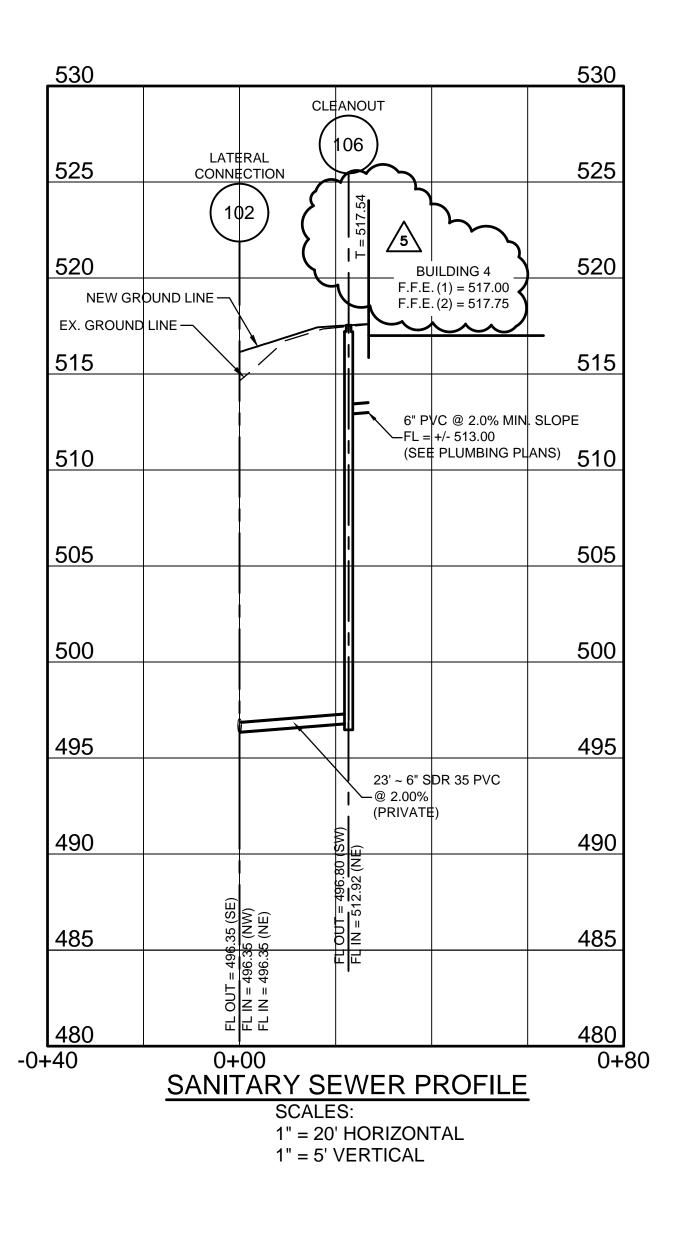

THE PROFESSIONALS WHOSE SIGNATURES AND SEALS APPEAR HERE, ASSUME RESPONSIBILITY FOR WHAT APPEARS ON THIS SHEET ONLY. ALL OTHER PLANS, SPECIFICATIONS, REPORTS, AND OTHER DOCUMENTS, DESIGN OR REVISIONS BY CONTRACTORS, OWNER OR OTHERS ARE NOT PART OF THE PROJECT FOR WHICH THIS SEAL INDICATES RESPONSIBILITY. COF MI APRILM. GIESMANN NUMBER E-2001004592 . _____ 'S/ONAL" 01/03/2019 April Geismann Name: . Civil Engineer Discipline: License No. Expiration Date: 12/31/2019 NO BLVD 63366 ALL HES I, MO Ч, О

Ū Z

ĭ O ⊂

- Ц О

С

RENEW

8. FILL MATERIAL UPON WHICH THE PROPOSED SEWERS ARE TO BE LAID SHALL BE COMPACTED TO 90% OF MAXIMUM



SHEET TITLE SANITARY SEWER PROFILES PROJECT NUMBER: 17050 SHEET NUMBER: C8.¹