

1" = 5' VERTICAL

CONNECTION 142 530 530 CLEANOUT **BUILDING 10** F.F.E. (1) = 516.85 F.F.E. (2) = 517.60 NEW GROUND LINE — EX. GROUND LINE — 6" PVC @ 2.0% MN. SLOPE -FL = +/- 512.89 (SEE PLUMBING PLANS) 510 3' ~ 6" SDR 35 PVC @ 2.00%— (PRIVATE) 505 505 500 500 T = 512.74 (W) : 512.74 (N) : 512.74 (E) 495 495 ŏ|≅≅ 교교교 490 0+00 0+60 -0+40 SANITARY SEWER PROFILE

SCALES:

1" = 20' HORIZONTAL


1" = 5' VERTICAL

CLEANOUT 530 530 146 525 525 CONNECTION 132 LATERAL CONNECTION 520 520 NEW GROUND LINE — 510 EX. GROUND LINE 510 50' ~ 6" SDR 35 PVC 2' ~ 6" SDR 35 PVC **2.00%** └─@|2.00% (PRIVATE) (PRIVATE) 505 505 500 500 T = 510.13 (S 510.13 (N) 510.13 (E) 495 21<u>2</u> <u>z</u> 교교교 490 0+00 -0+40 1+00 SANITARY SEWER PROFILE

SCALES:

1" = 20' HORIZONTAL

1" = 5' VERTICAL

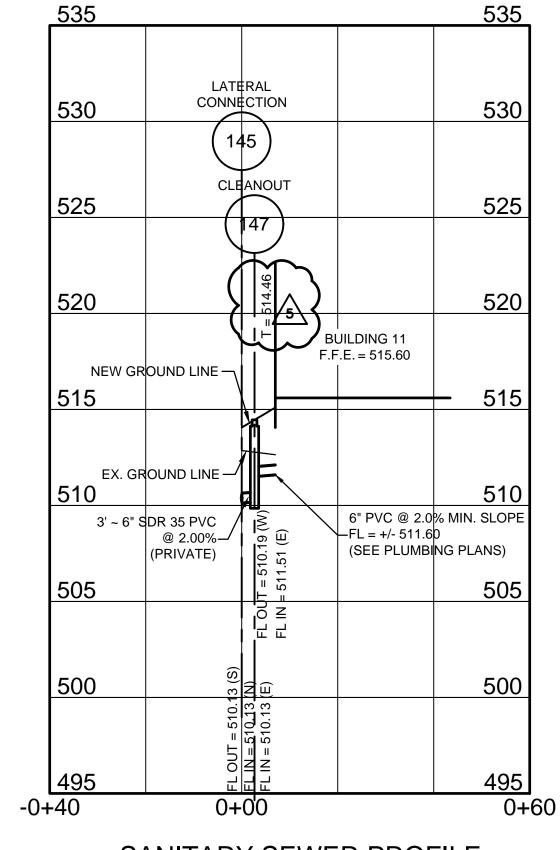

SANITARY SEWER PROFILE

SCALES: 1" = 20' HORIZONTAL 1" = 5' VERTICAL

PRINTS ISSUED 05/11/18 - Permit Set

REVISIONS:

03/26/2019 Addendum #5 (Civil Issue)





GENERAL NOTES:

1. T = TOP OF MANHOLE CASTING OR INLET STONE.

Call Before you DIG

1-800-344-7483

MISSOURI ONE-CALL SYSTEM INC.

MODOT (314) 340-4100

TOLL FREE

- 2. ALL SANITARY SEWER PIPE TO BE SDR 35 PVC OR APPROVED EQUAL.
- 3. ALL SANITARY SEWER LATERALS SHALL BE A MINIMUM OF 6" SCHEDULE 40 PVC PIPE.

4. CONTRACTOR TO PROVIDE COMPACTED GRANULAR BACKFILL TO THE SUBGRADE OF THE PAVEMENT FOR ALL TRENCHES UNDER PAVEMENT.

- 5. PIPE CENTERLINE APPLIES TO CENTERLINE OF STRUCTURE.
- 6. LOCATION OF UTILITIES ON PIPE PROFILES ARE APPROXIMATE.
- 7. DISTANCES BETWEEN STRUCTURES ARE MEASURED TO THE CENTER OF THE STRUCTURES.

8. FILL MATERIAL UPON WHICH THE PROPOSED SEWERS ARE TO BE LAID SHALL BE COMPACTED TO 90% OF MAXIMUM DENSITY AS DETERMINED BY ASTM D-15571-180 AASHTO MODIFIED COMPACTION TEST AND BE VERIFIED BY THE ENGINEER.

9. CONTRACTOR SHALL EXPOSE ALL WATER AND GAS MAINS PRIOR TO SANITARY SEWER PIPE INSTALLATION AND VERIFY TOP OF ELEVATIONS OF UTILITIES.

10. ALL SEWER CONSTRUCTION AND MATERIALS TO BE IN ACCORDANCE WITH THE METROPOLITAN ST. LOUIS SEWER DISTRICT STANDARD CONSTRUCTION SPECIFICATIONS FOR DRAINAGE FACILITIES, 2009.

11. WHEN THE WATER LINES CROSS THE SANITARY SEWER, A MINIMUM SEPARATION OF 18" SHALL BE MAINTAINED BETWEEN WATER LINE AND SANITARY SEWER.

SPECIAL NOTE TO CONTRACTOR(S):

EXISTING UNDERGROUND AND ABOVE-GRADE FACILITIES, STRUCTURES, AND UTILITIES HAVE BEEN PLOTTED ON THESE CONTRACT DOCUMENTS BASED ON THE INFORMATION AND SURVEYS AVAILABLE AT THE TIME OF DRAWING PREPARATION. THE LOCATIONS OF THESE FEATURES MUST, THEREFORE, BE CONSIDERED APPROXIMATE, ONLY. IN ADDITION, THERE MAY BE OTHER FACILITIES, STRUCTURES, AND UTILITIES WHICH DID NOT EXIST (OR THE EXISTENCE OF WHICH WAS NOT KNOWN) AT THE TIME OF DRAWING PREPARATION. IT IS THE SOLE RESPONSIBILITY OF THE CONTRACTOR(S) TO HAVE ALL EXISTING FACILITIES, STRUCTURES, AND UTILITIES LOCATED IN THE FIELD PRIOR TO ANY EXCAVATION OR CONSTRUCTION ACTIVITY; AND TO PROTECT ALL SUCH EXISTING FEATURES (EXCEPT THOSE SPECIFICALLY DRAWN BY: AMH NOTED FOR REMOVAL OR DEMOLITION) DURING CONSTRUCTION.

SHEET TITLE SANITARY SEWER **PROFILES**

PROJECT NUMBER: 17050

SHEET NUMBER: