




Note: Other connections such as anchor coupling are allowable with additional details and approval.

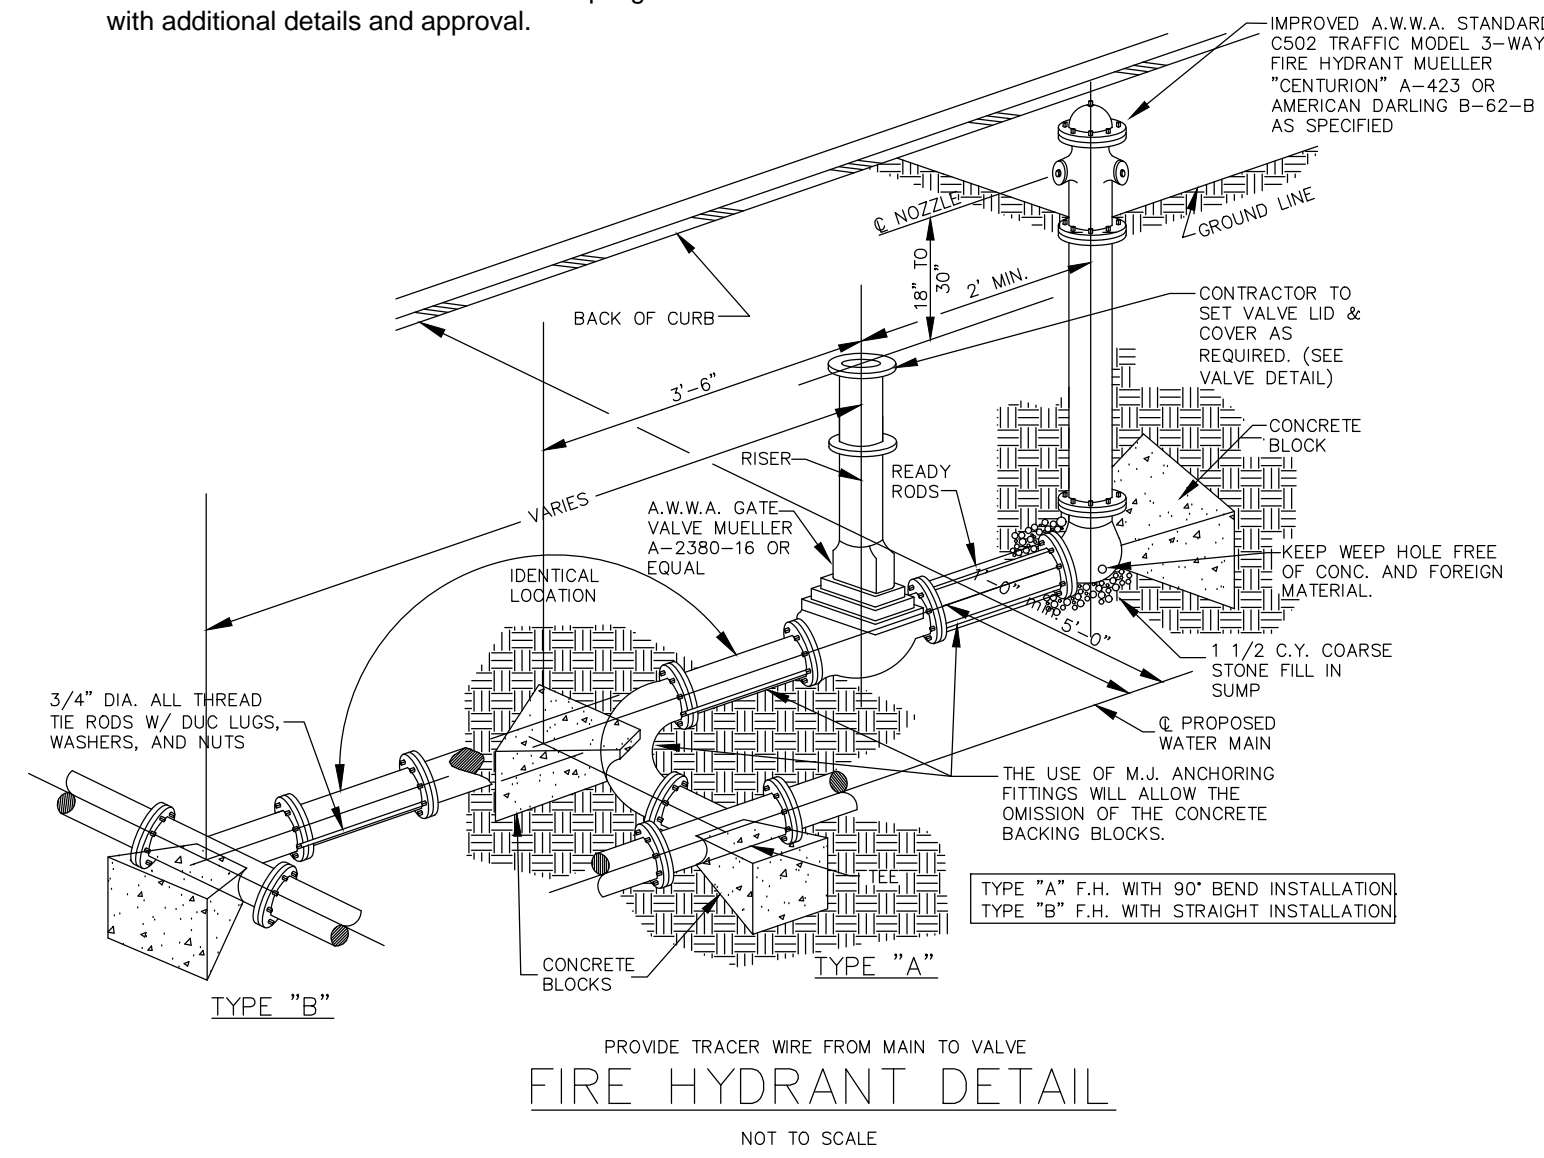

CITY OF FALLON
ENGINEERING DEPARTMENT
FALLON, MISSOURI

FIRE HYDRANT DETAILS

Ductile Iron Pipe installation shall follow the Ductile Iron Research Association (DIPRA) guide line.
The Installation of PVC Pipe shall follow the Uni-Bell PVC Pipe Association Handbook of PVC Design and Construction.

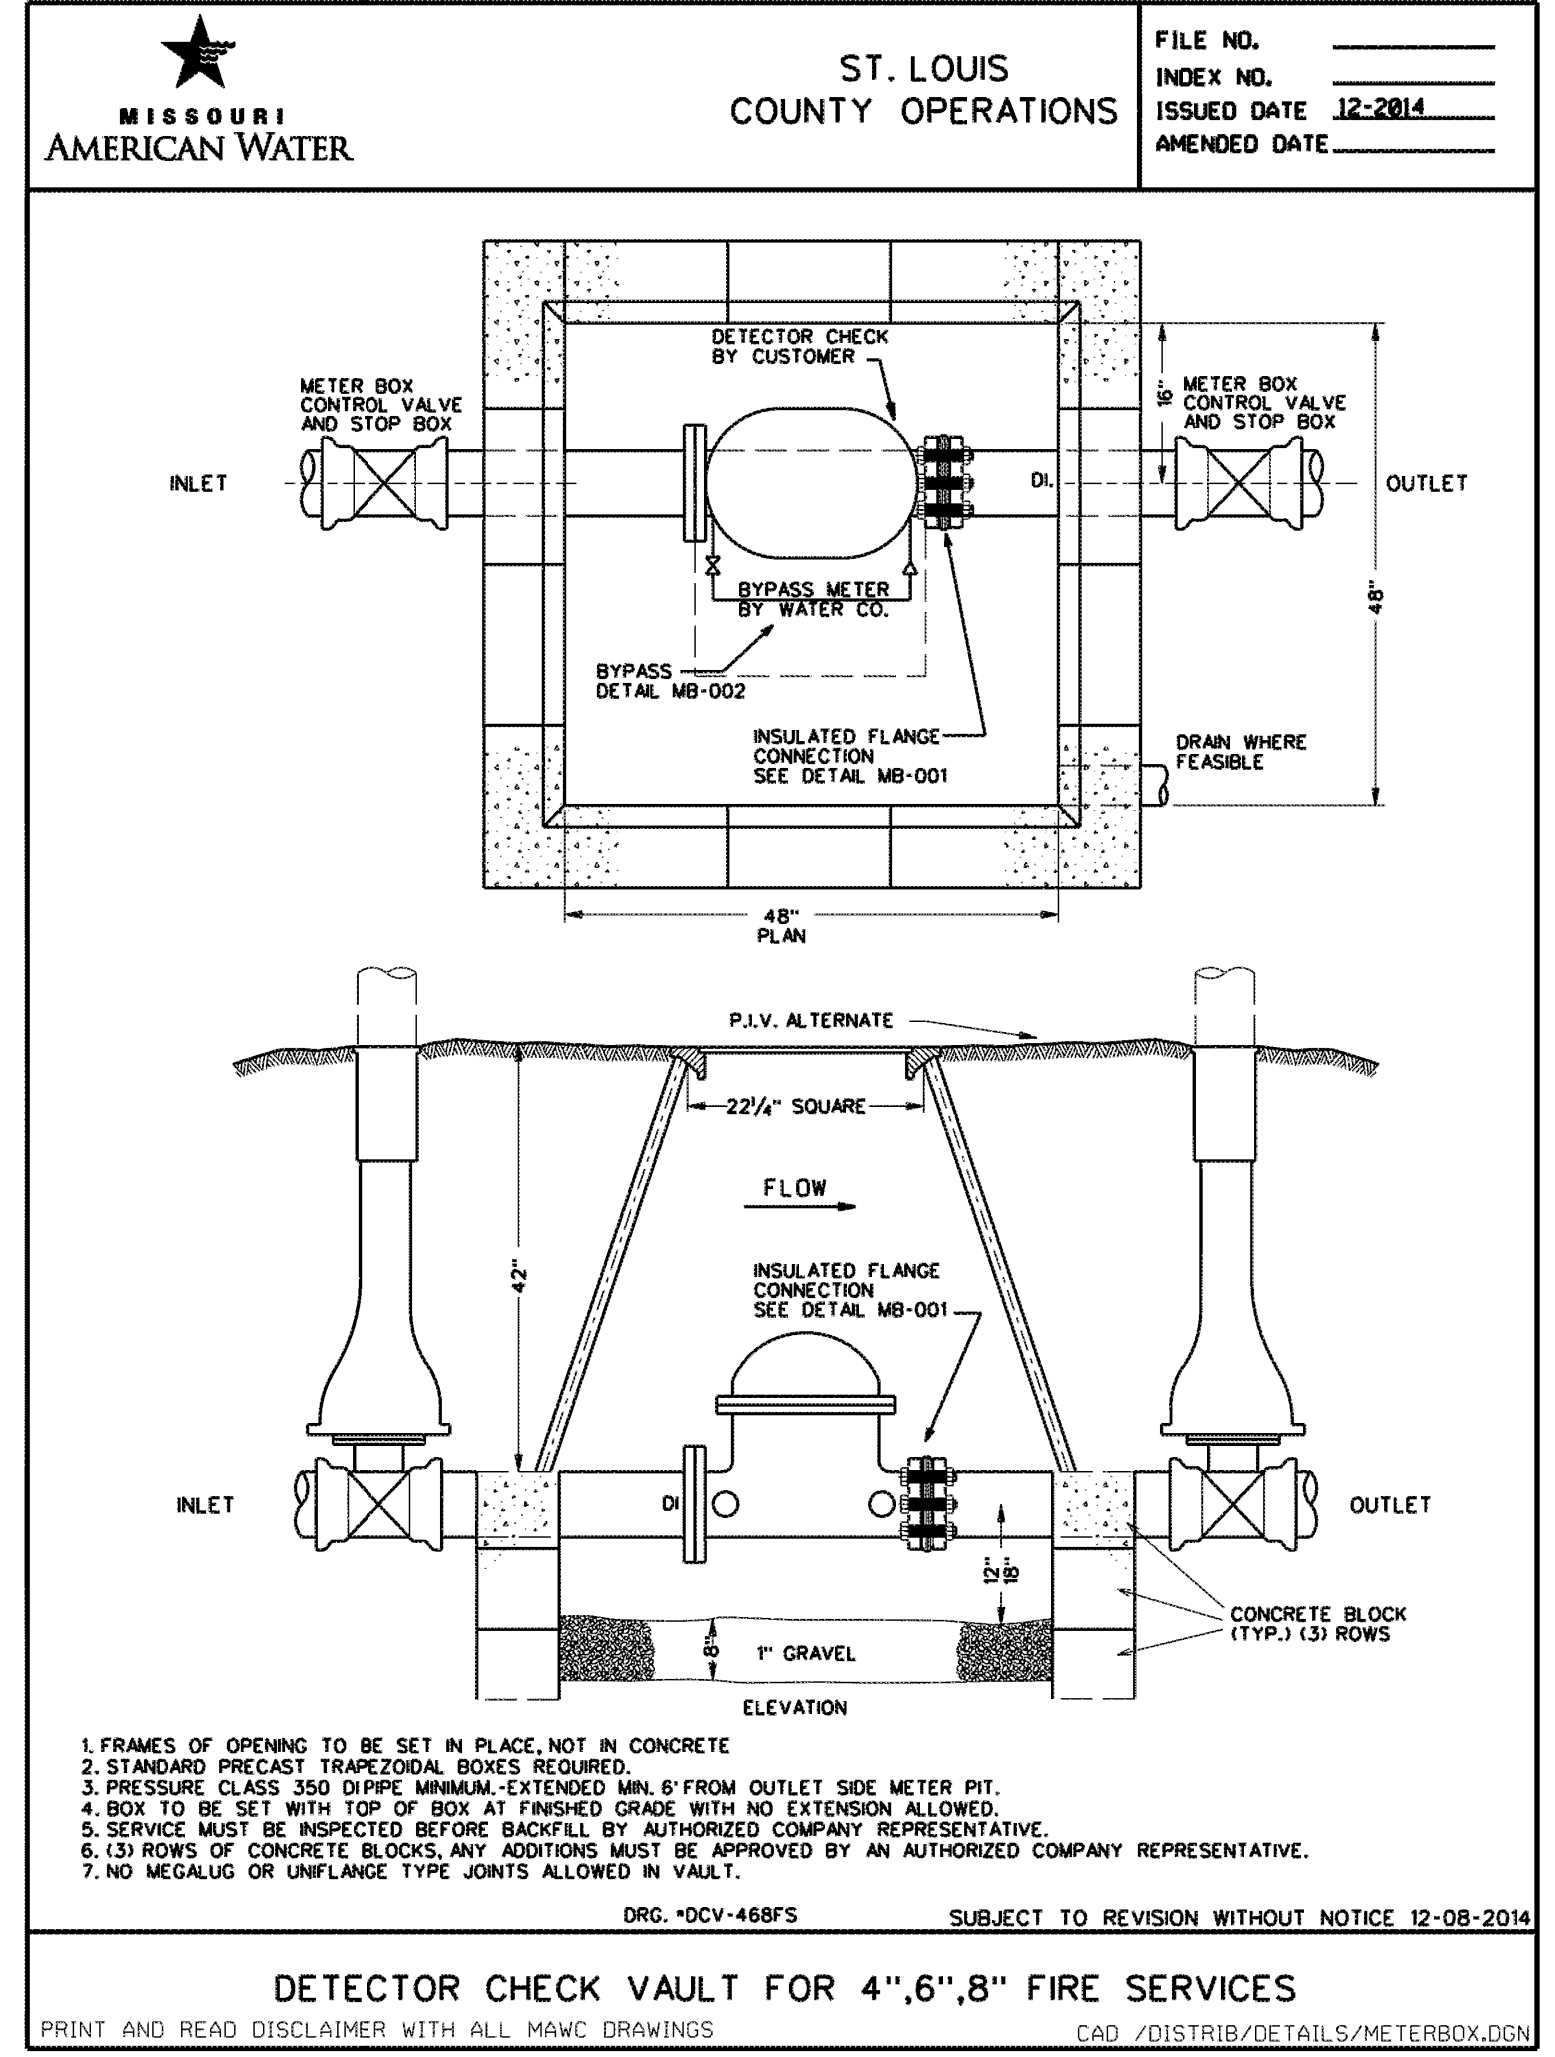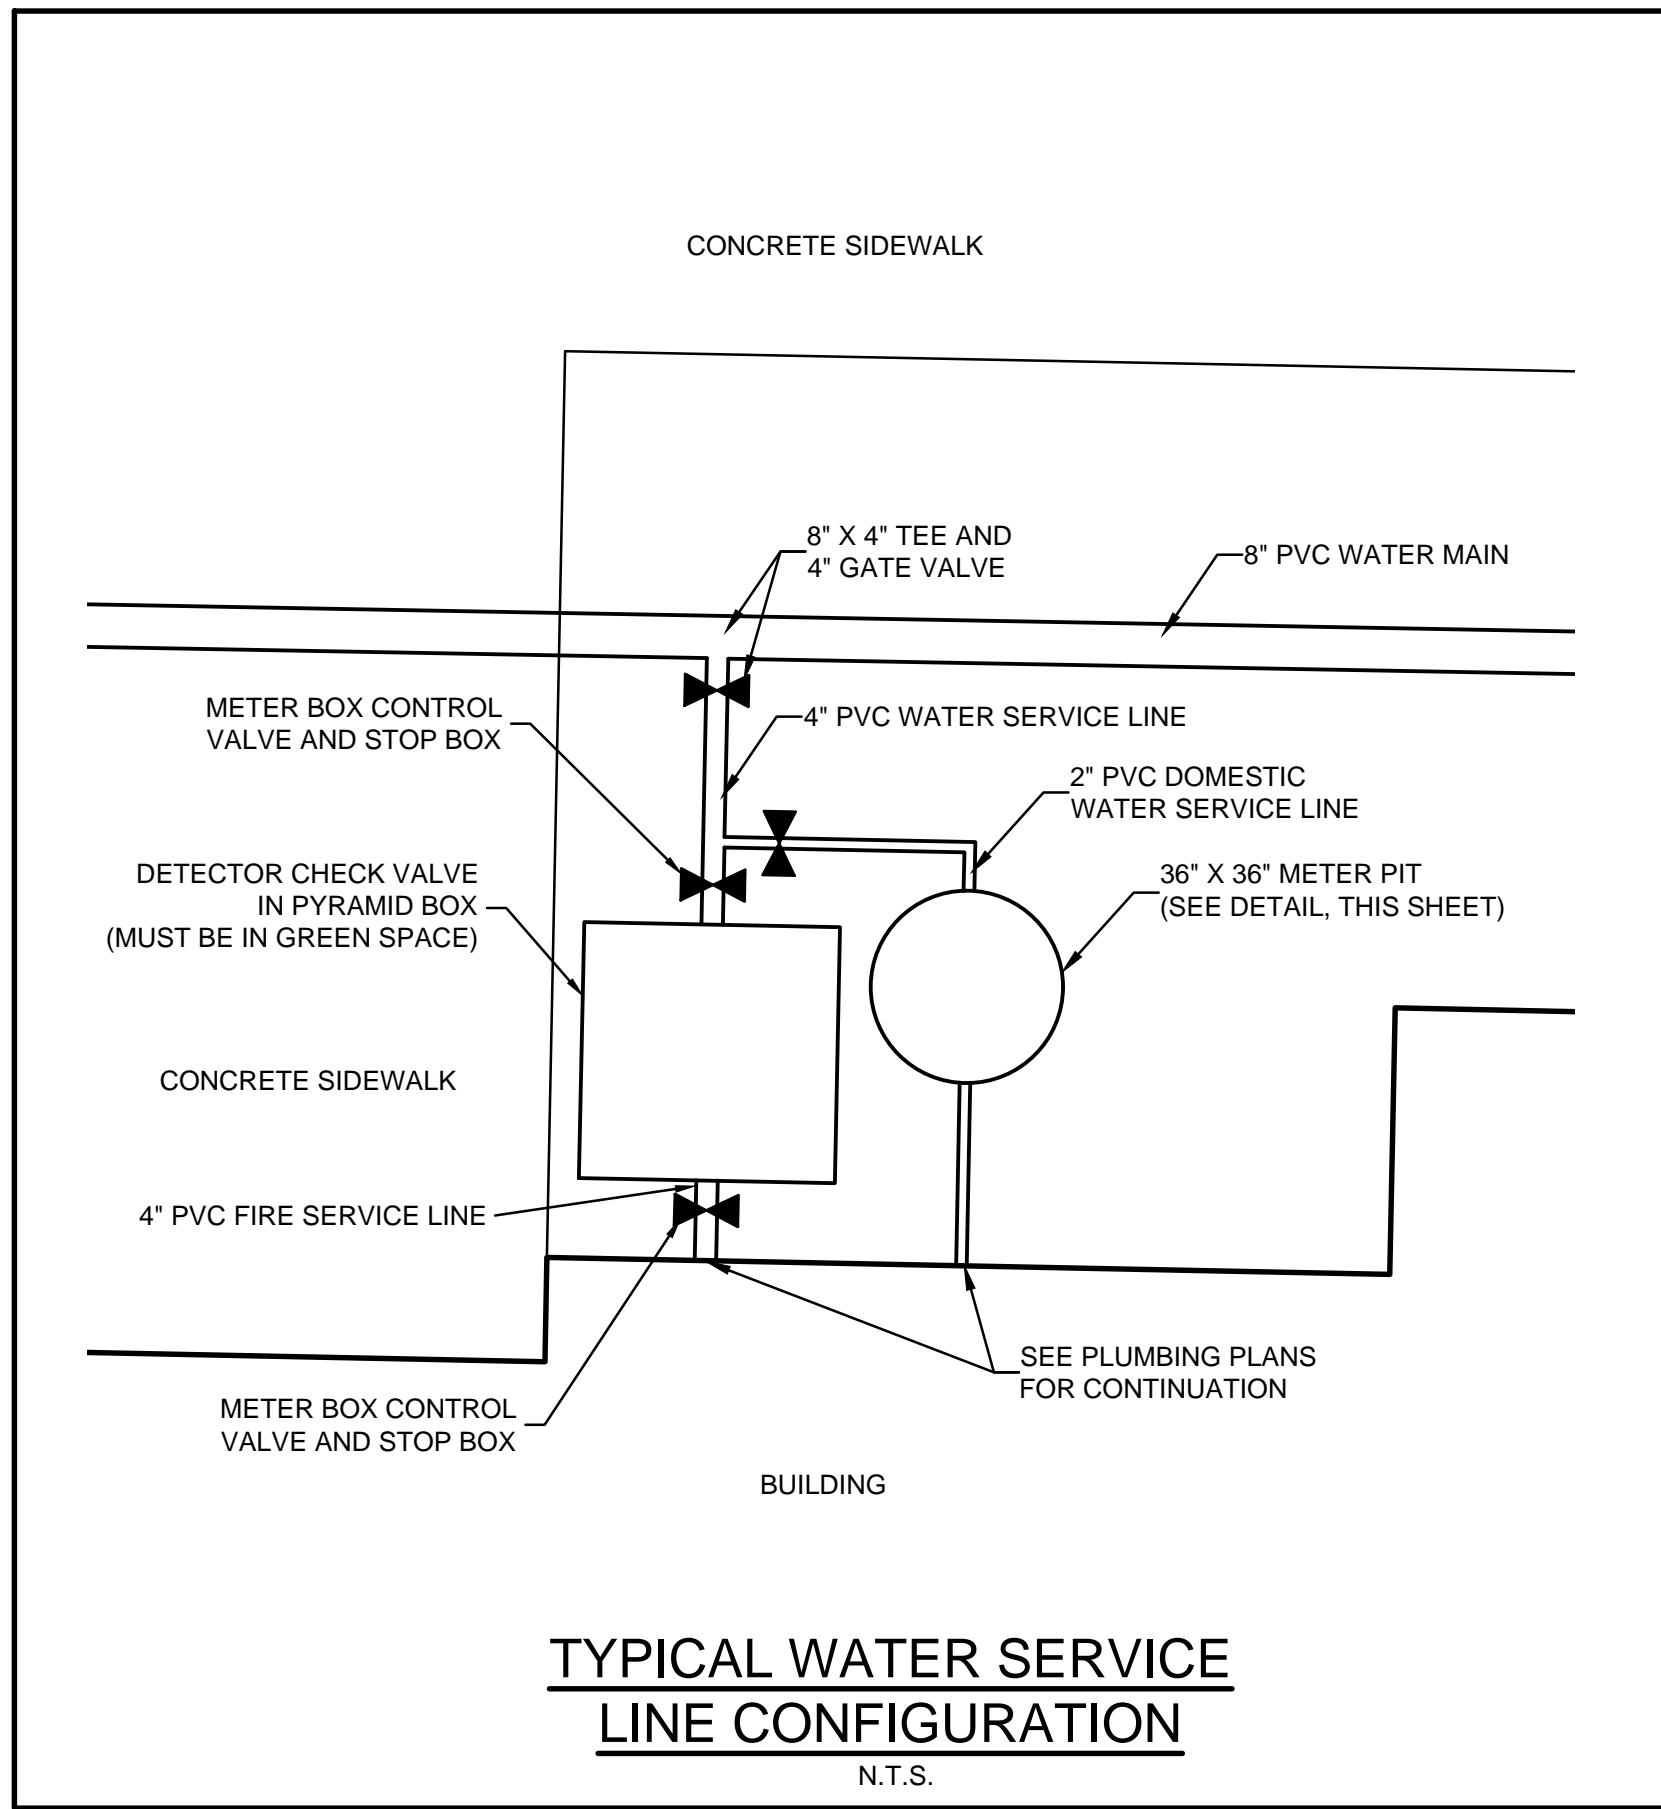

PRINTS ISSUED
05/11/18 - Permit Set

REVISIONS:





HORNER SHIFRIN

101 LAURA K DR. STE. 101 OFALLON, MO 63366-2091
636-329-8296 • FAX 636-335-2010 • WWW.HORNERSHIFRIN.COM
DISCIPLINE: PROFESSIONAL ENGINEERING
CERTIFICATE OF AUTHORITY: 000169
EXPIRATION DATE: DECEMBER 31, 2018

STATE OF MISSOURI
APRIL 17 2018
APRIL GEISMANN
E-2001004592
PROFESSIONAL ENGINEER

7/18/18

Name: April Geismann
Discipline: Civil Engineer
License No. E2001004592
Expiration Date: 12/31/2019

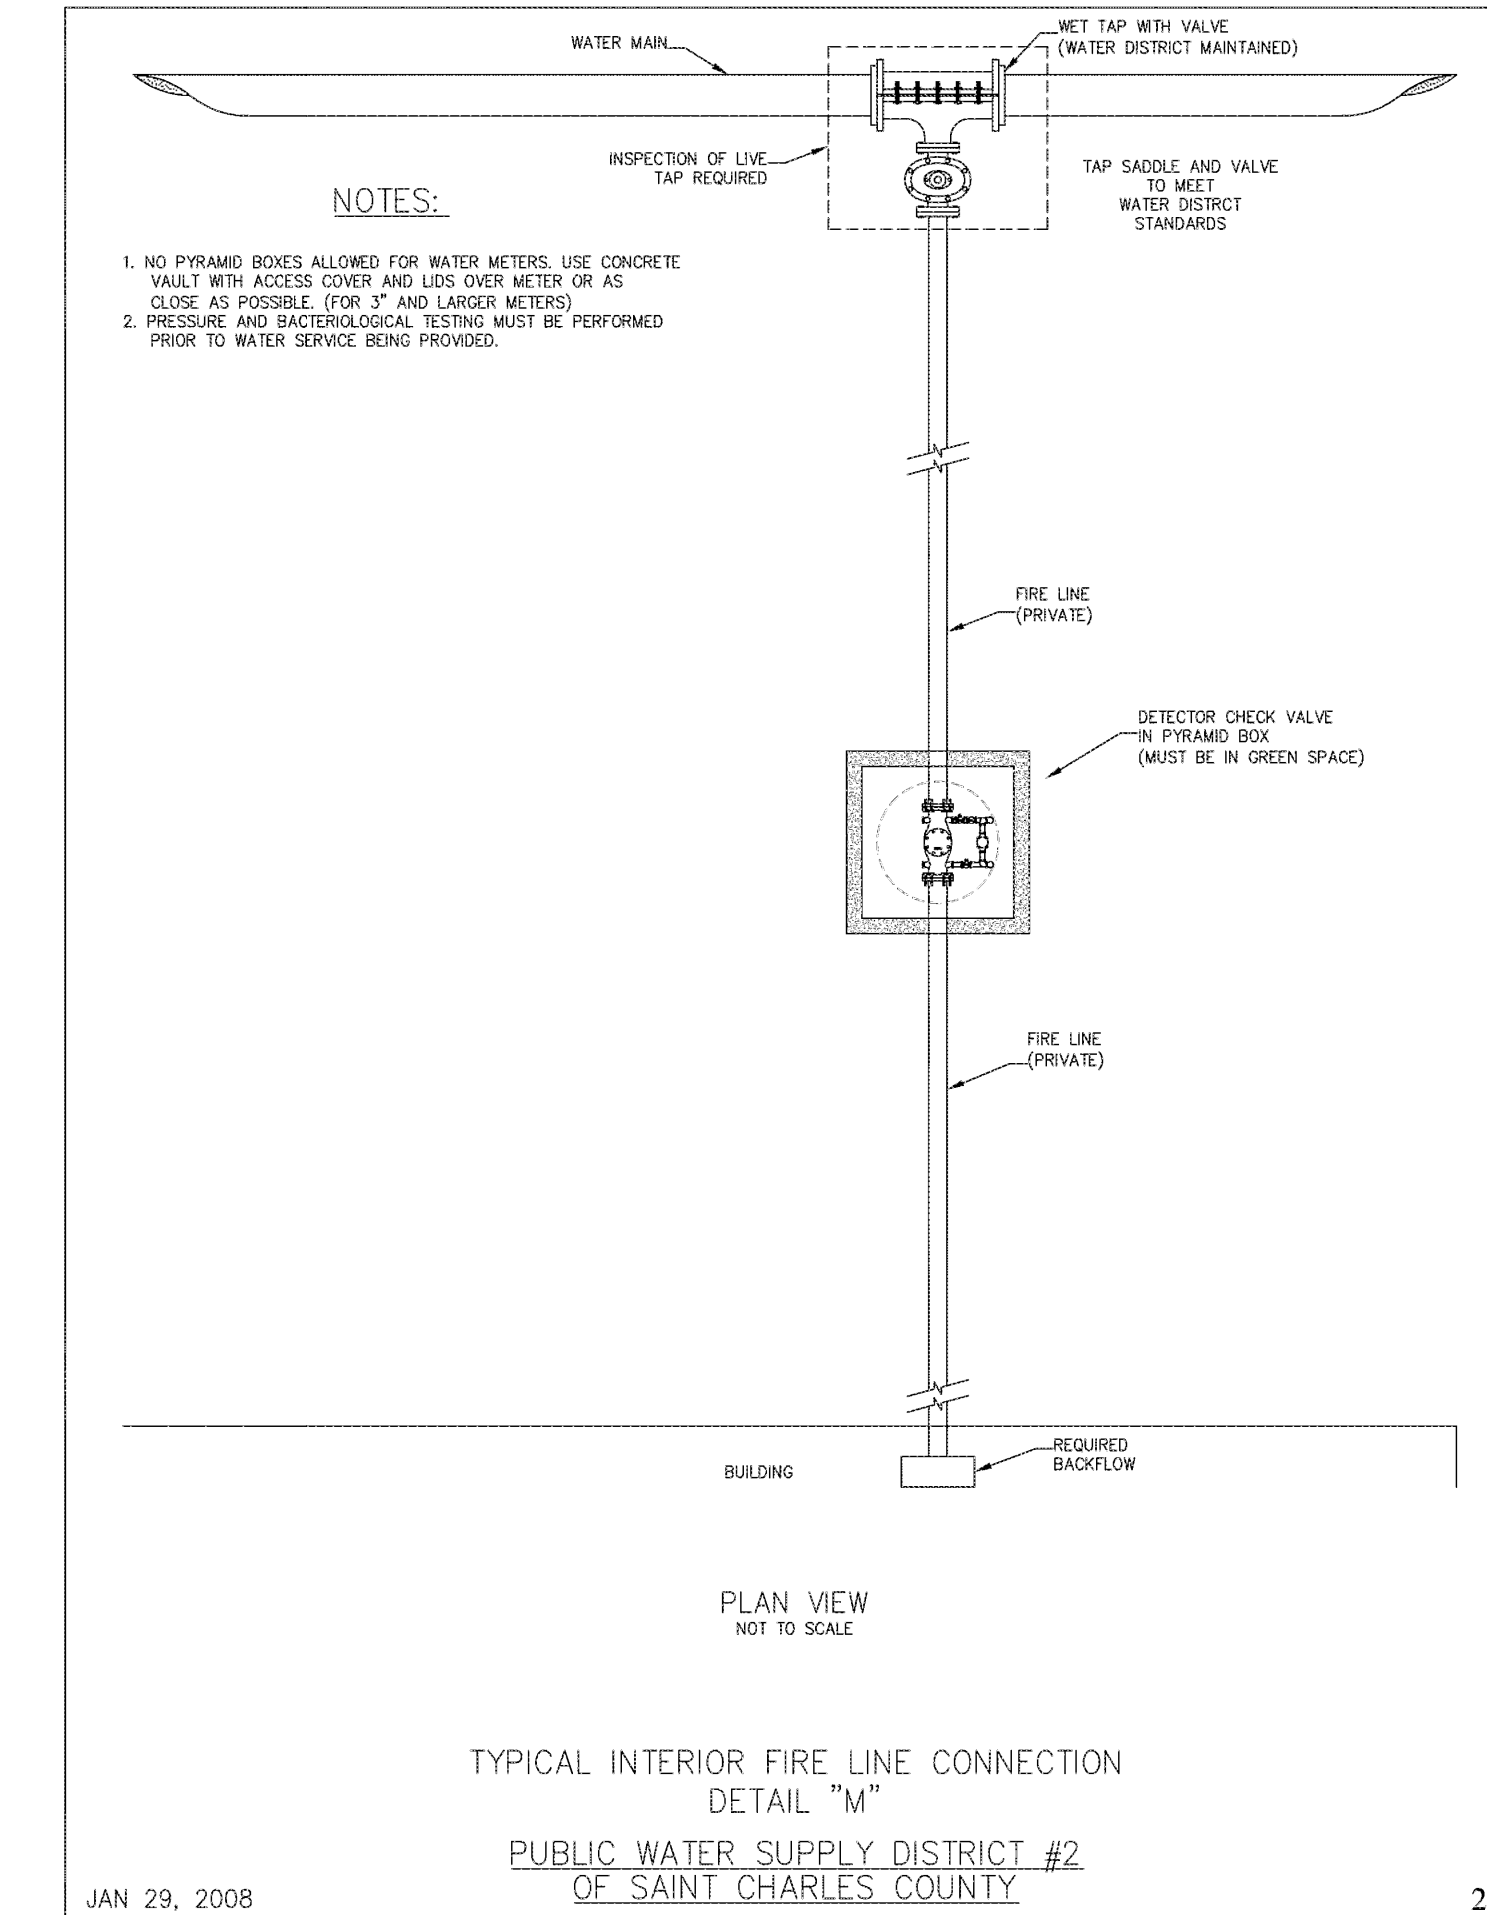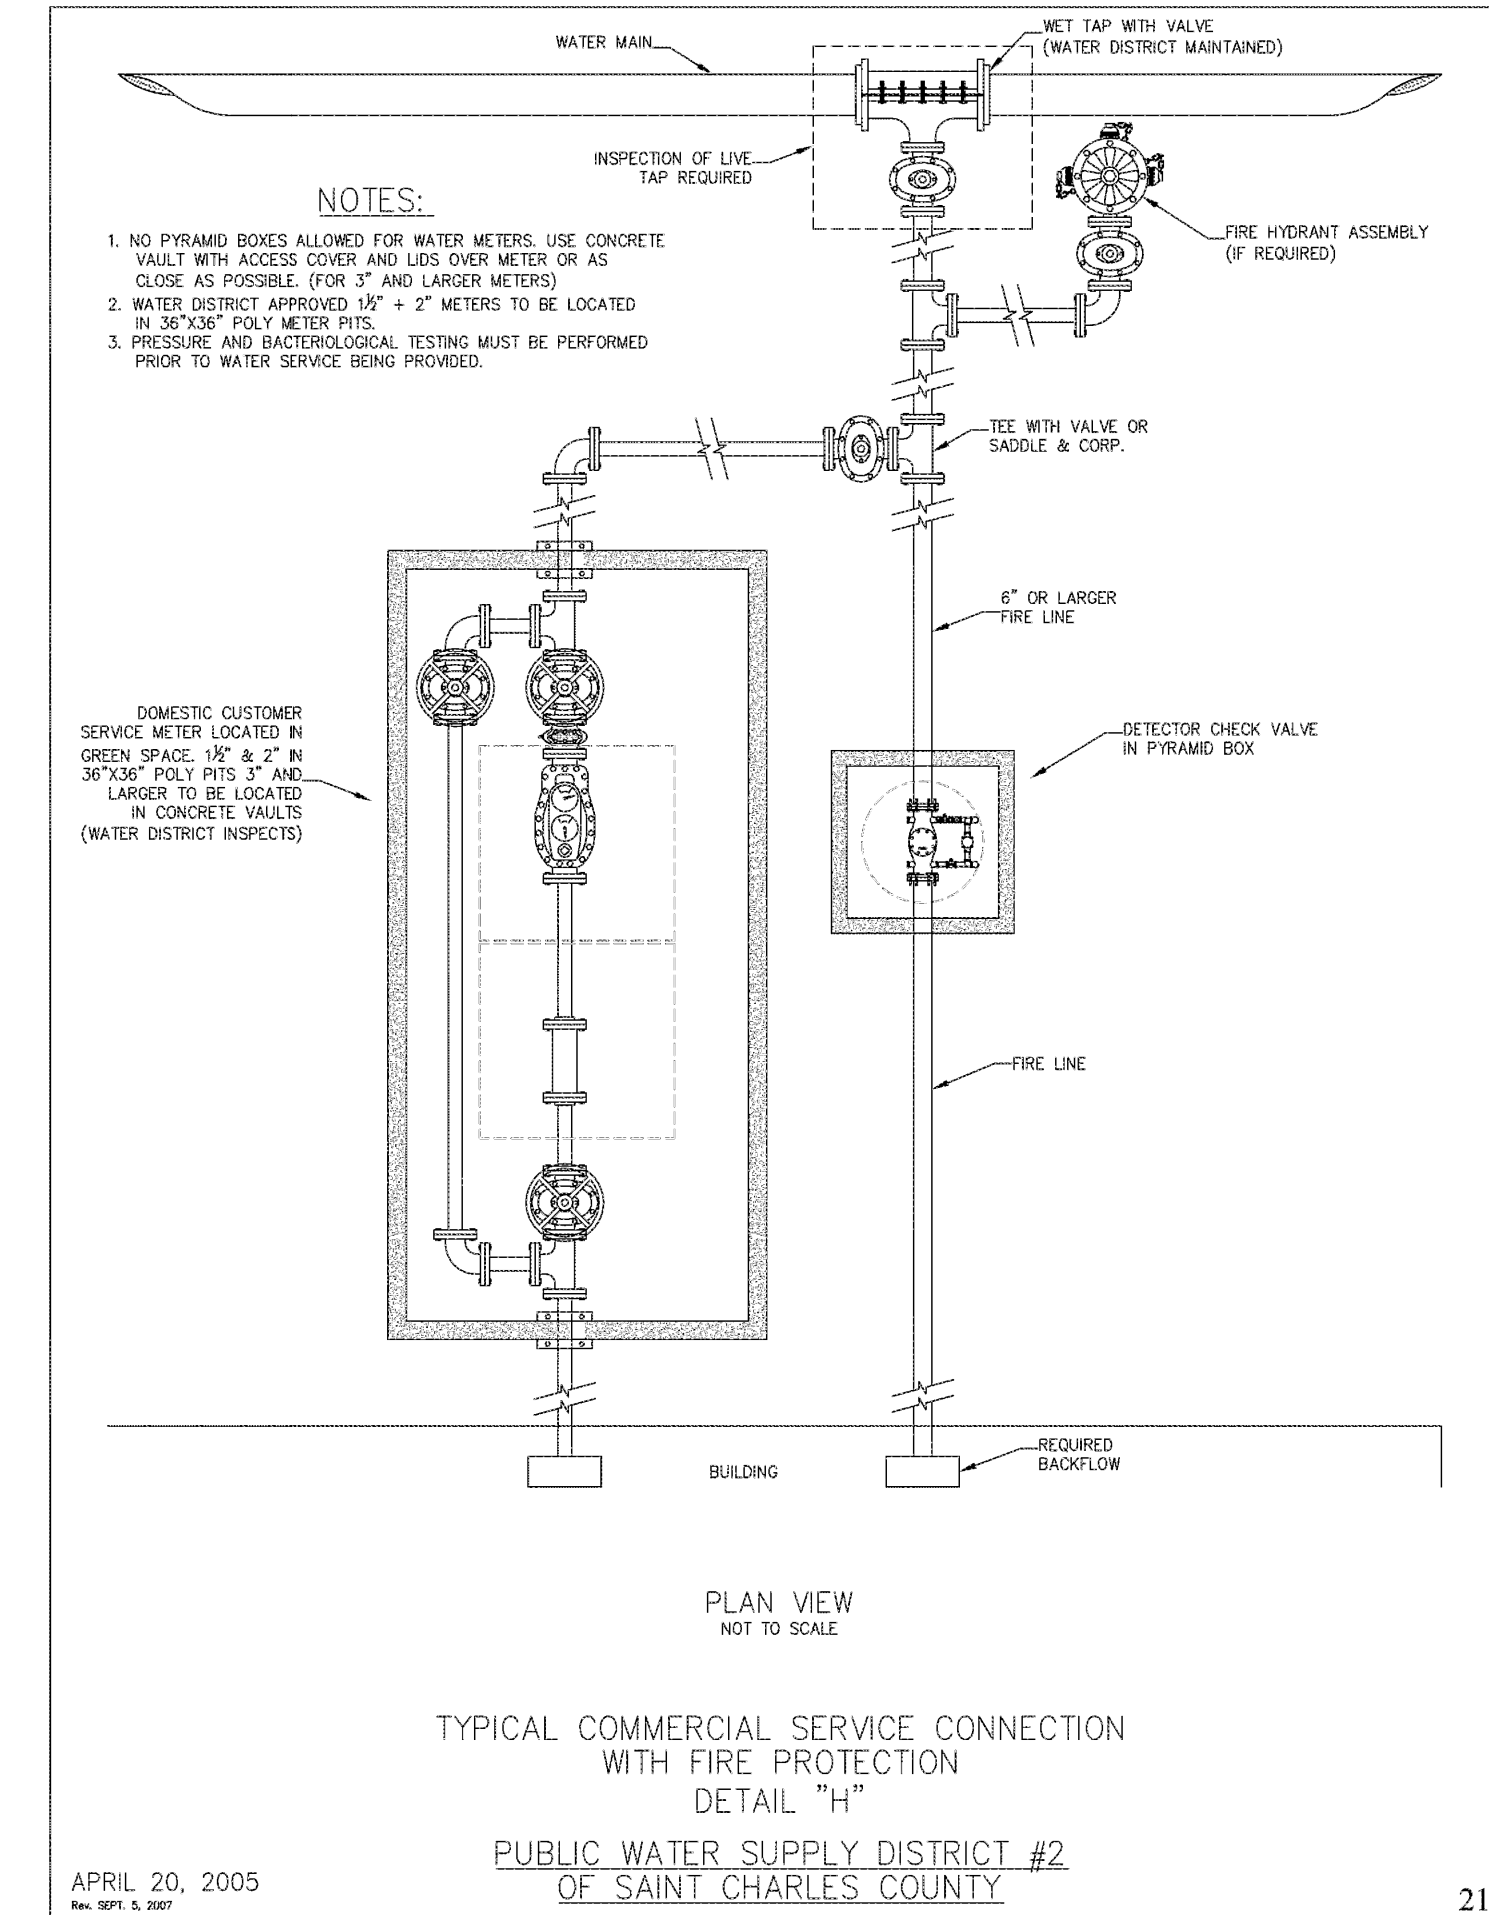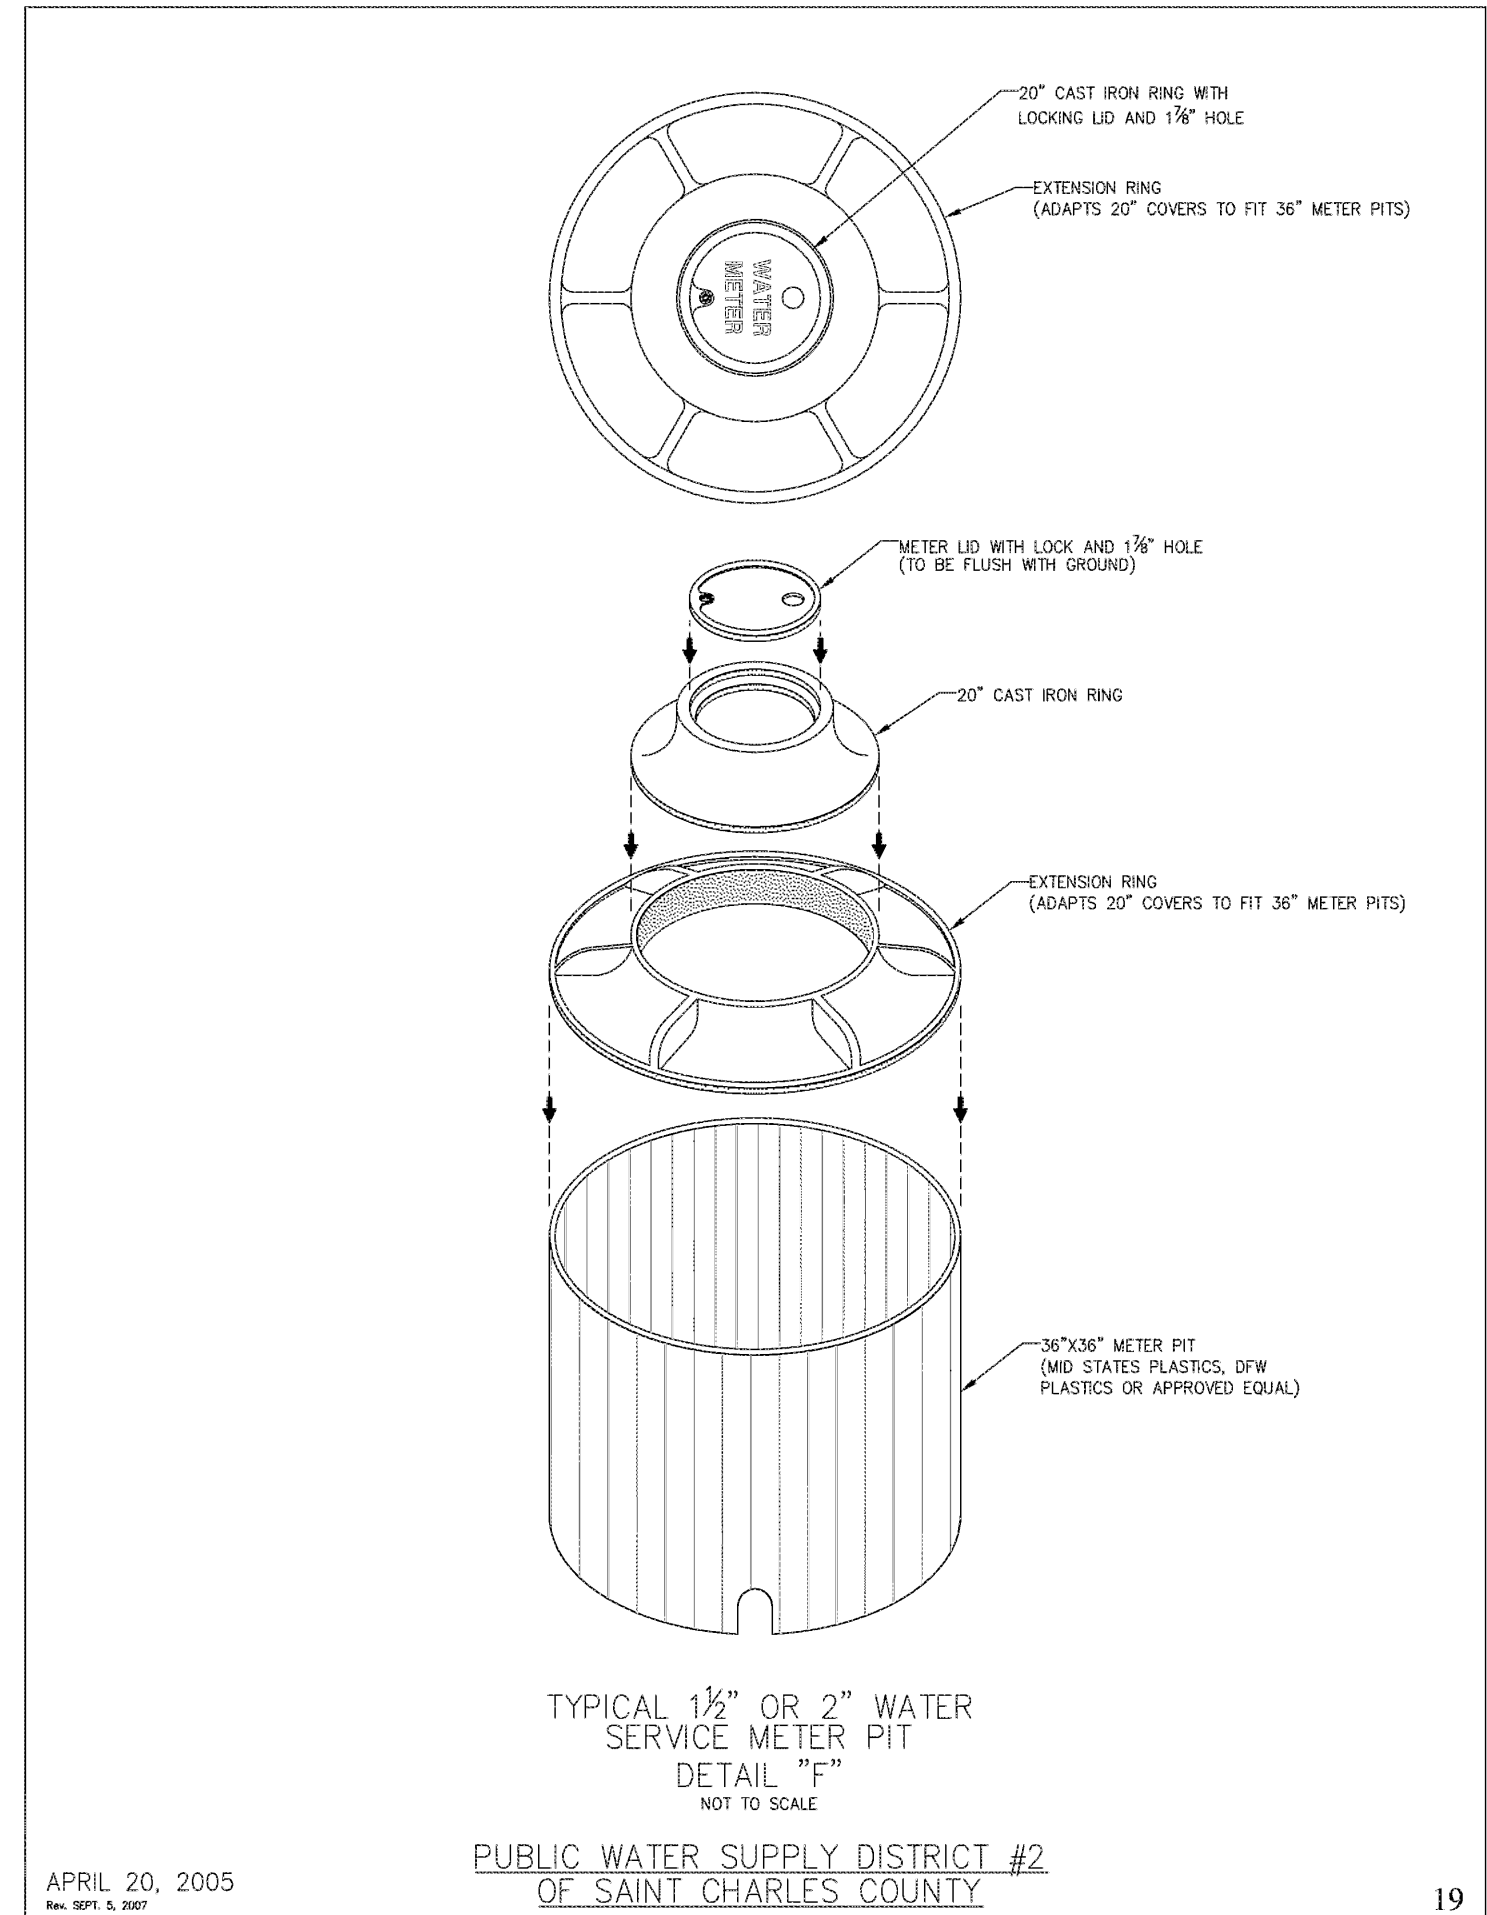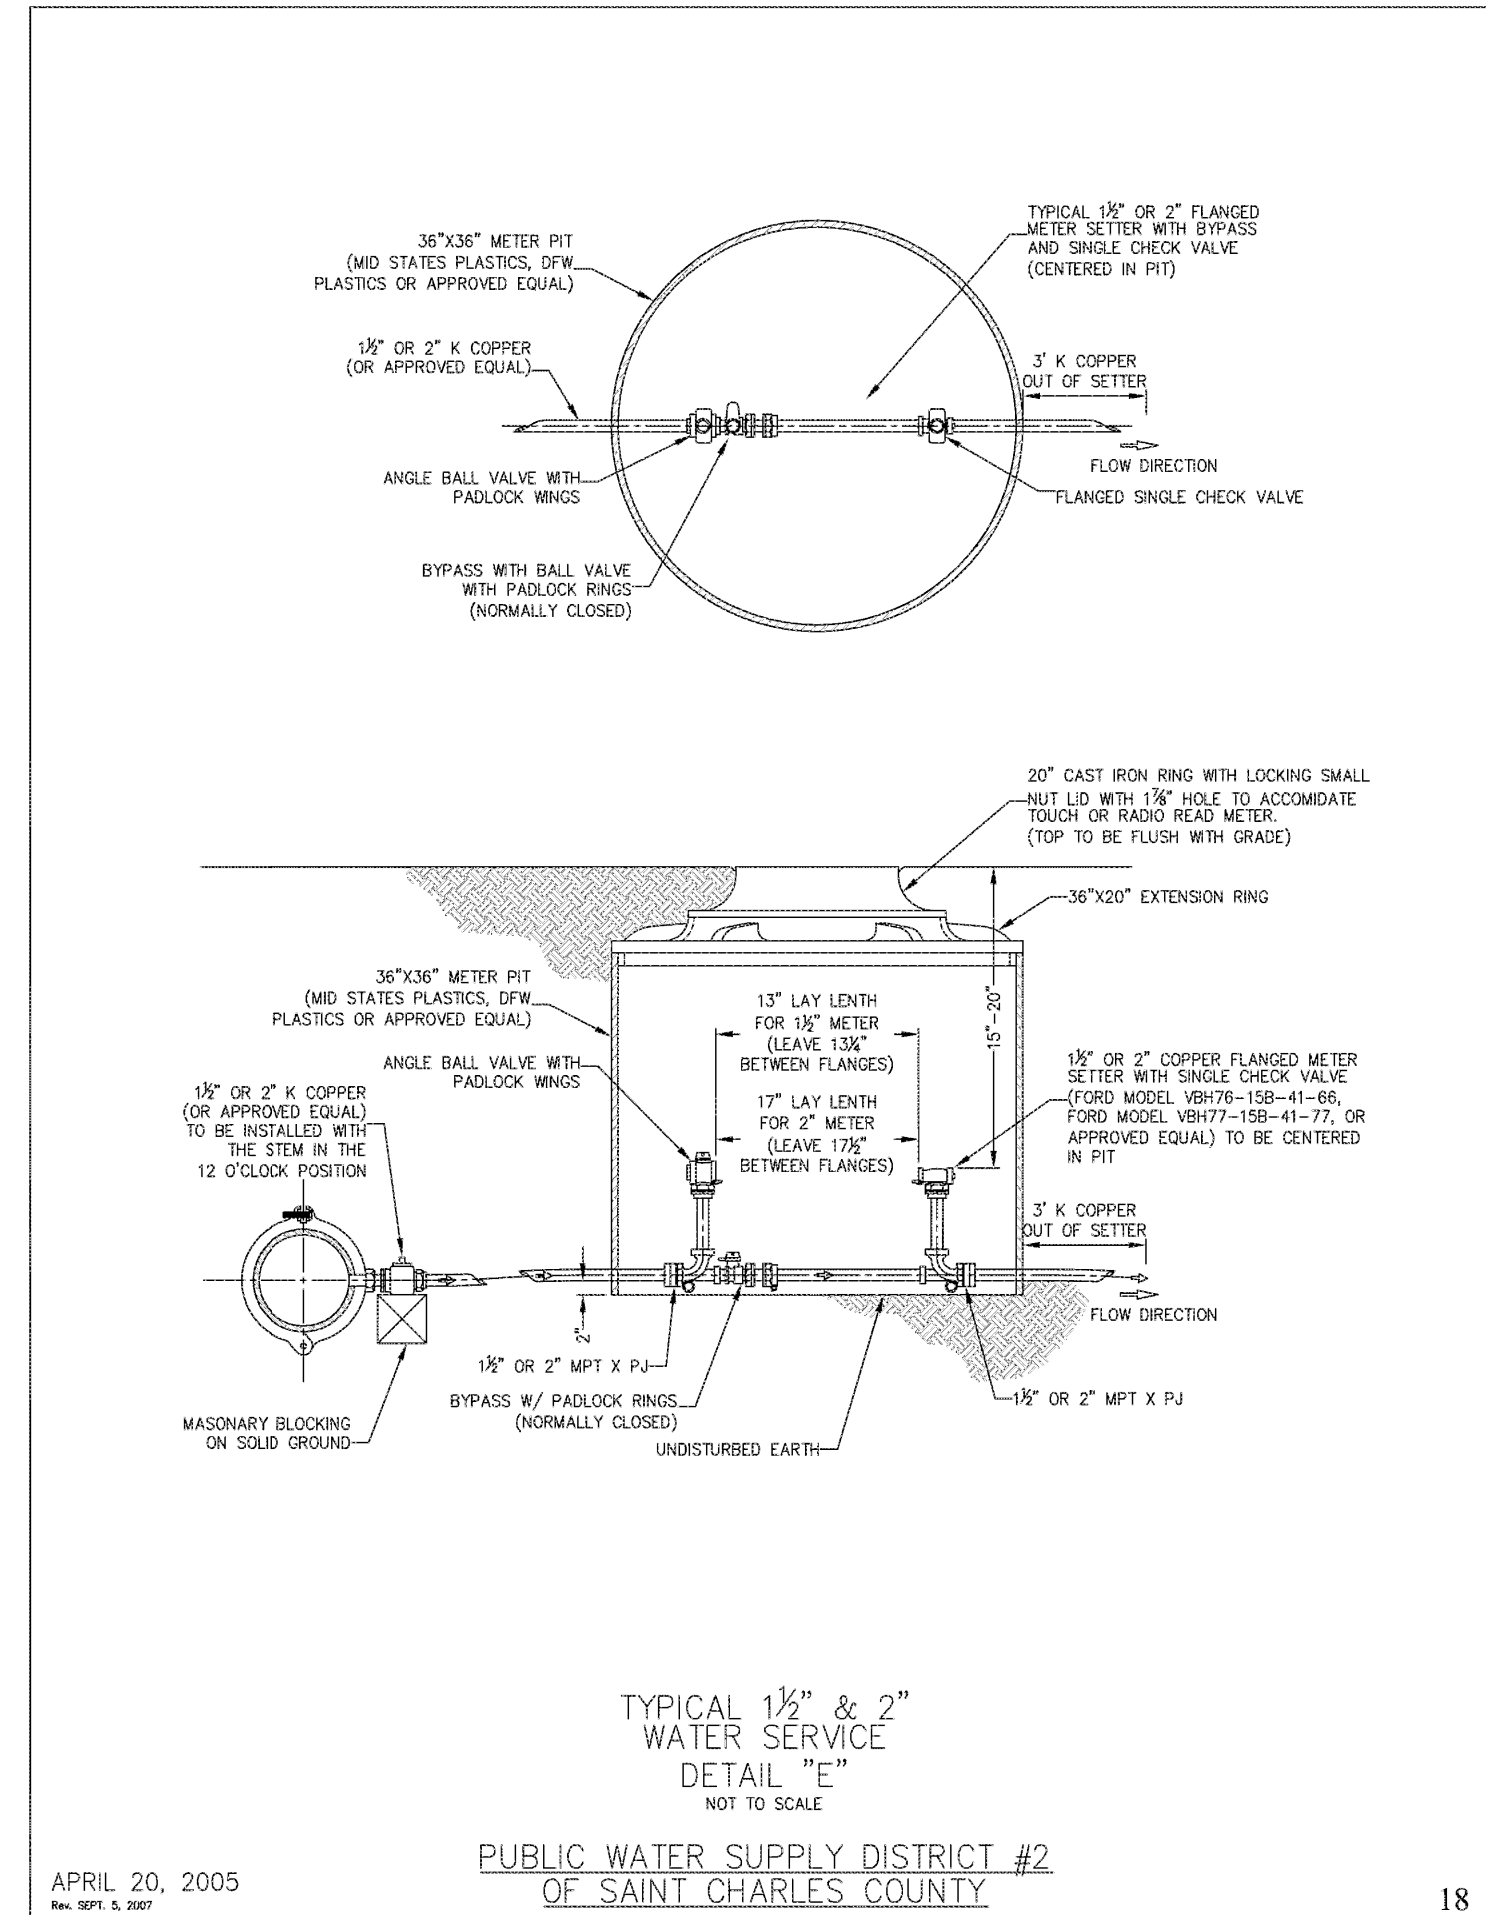

RENEW O'FALLON

**T.R. HUGHES BLVD
O'FALLON, MO 63366**

SHEET TITLE: WATER DETAILS

PROJECT NUMBER: 17050

SHEET NUMBER:

C10.10

DRAWN BY: AMH CHECKED BY: AMG

OPERATOR: AMHARRISON
 CTR: Trans-stu.cdw
 PLOT DATE: 6/22/2018 1:44:38 PM
 DWG: C:\pwworkspace\aharrison\dwg\17050\Details.dwg
 PAGE SETUP NAME: ...
 SAVE DATE: 7/19/2018 2:12:13 PM