


THERE SHALL BE NO OBSTRUCTIONS, I.E. PLANTINGS, BUSHES, TREES, SIGNS, LIGHT STANDARDS, ETC. WITHIN SIX (6) FEET OF ANY FIRE DEPARTMENT CONNECTION TO AN AUTOMATIC FIRE SUPPRESSION SYSTEM.

THE MINIMUM FIRE FLOW FROM A SINGLE FIRE HYDRANT SHALL BE 1500 GALLONS PER MINUTE AT TWENTY (20) PSI RESIDUAL PRESSURE.

MATCH LINE "B", SEE SHEET C38

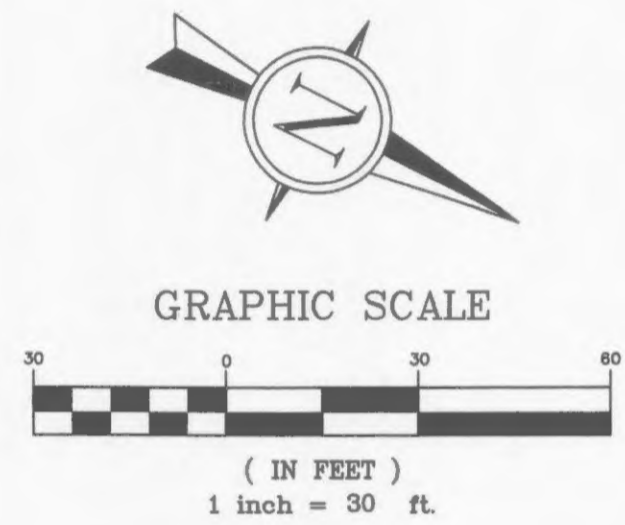

N/F
DB 997, PG. 1532
ZONED R5
MM MANAGEMENT CORP.
MOBILE HOME PARK

LOT 49

LOT 50

LOT 51

LOT 52

LOT 53

LOT 54

BROOKHAVEN
PLAT BOOK 35, PAGE 159
ZONED R4
SINGLE FAMILY HOMES



9/28/04 CITY OF O'FALLON CMNTS
8/12/02 CITY OF O'FALLON CMNTS

SOUTHERNSIDE APARTMENTS
WATER & ELECTRIC LINE PLAN
JAMES ENGINEERING & SURVEYING CO., INC.
ENGINEERS PLANNERS SURVEYORS
10811 BIG BEND BLVD. KIRKWOOD, MO 63122
PHONE: (314) 822-1006 FAX: (314) 822-0006

PROJECT # 184025
H:\Engineering\Projects\184025\dwg\C36-38-WATER.dwg 10/4/2005 4:39:16 PM CDT

C37

PREPARED FOR:
HENNESSEY DEVELOPMENT
9904 CLAYTON RD.
SUITE 122
ST. LOUIS, MO. 63124
PH. (314) 991-1248
FAX (314) 991-0964

CITY OF O'FALLON FILE NO. 3101.01

MATCH LINE "A", SEE SHEET C36

