


GRAPHIC SCALE

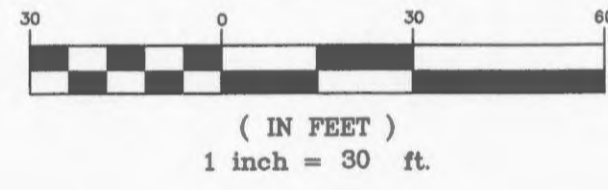


THERE SHALL BE NO OBSTRUCTIONS, I.E. PLANTINGS, BUSHES, TREES, SIGNS, LIGHT STANDARDS, ETC. WITHIN SIX (6) FEET OF ANY FIRE DEPARTMENT CONNECTION TO AN AUTOMATIC FIRE SUPPRESSION SYSTEM.

THE MINIMUM FIRE FLOW FROM A SINGLE FIRE HYDRANT SHALL BE 1500 GALLONS PER MINUTE AT TWENTY (20) PSI RESIDUAL PRESSURE.

MATCH LINE "B", SEE SHEET C37

PREPARED FOR:  
HENNESSEY DEVELOPMENT  
9904 CLAYTON RD.  
SUITE 122  
ST. LOUIS, MO. 63124  
PH. (314) 991-1248  
FAX (314) 991-0964

CITY OF O'FALLON FILE NO. 3101.01

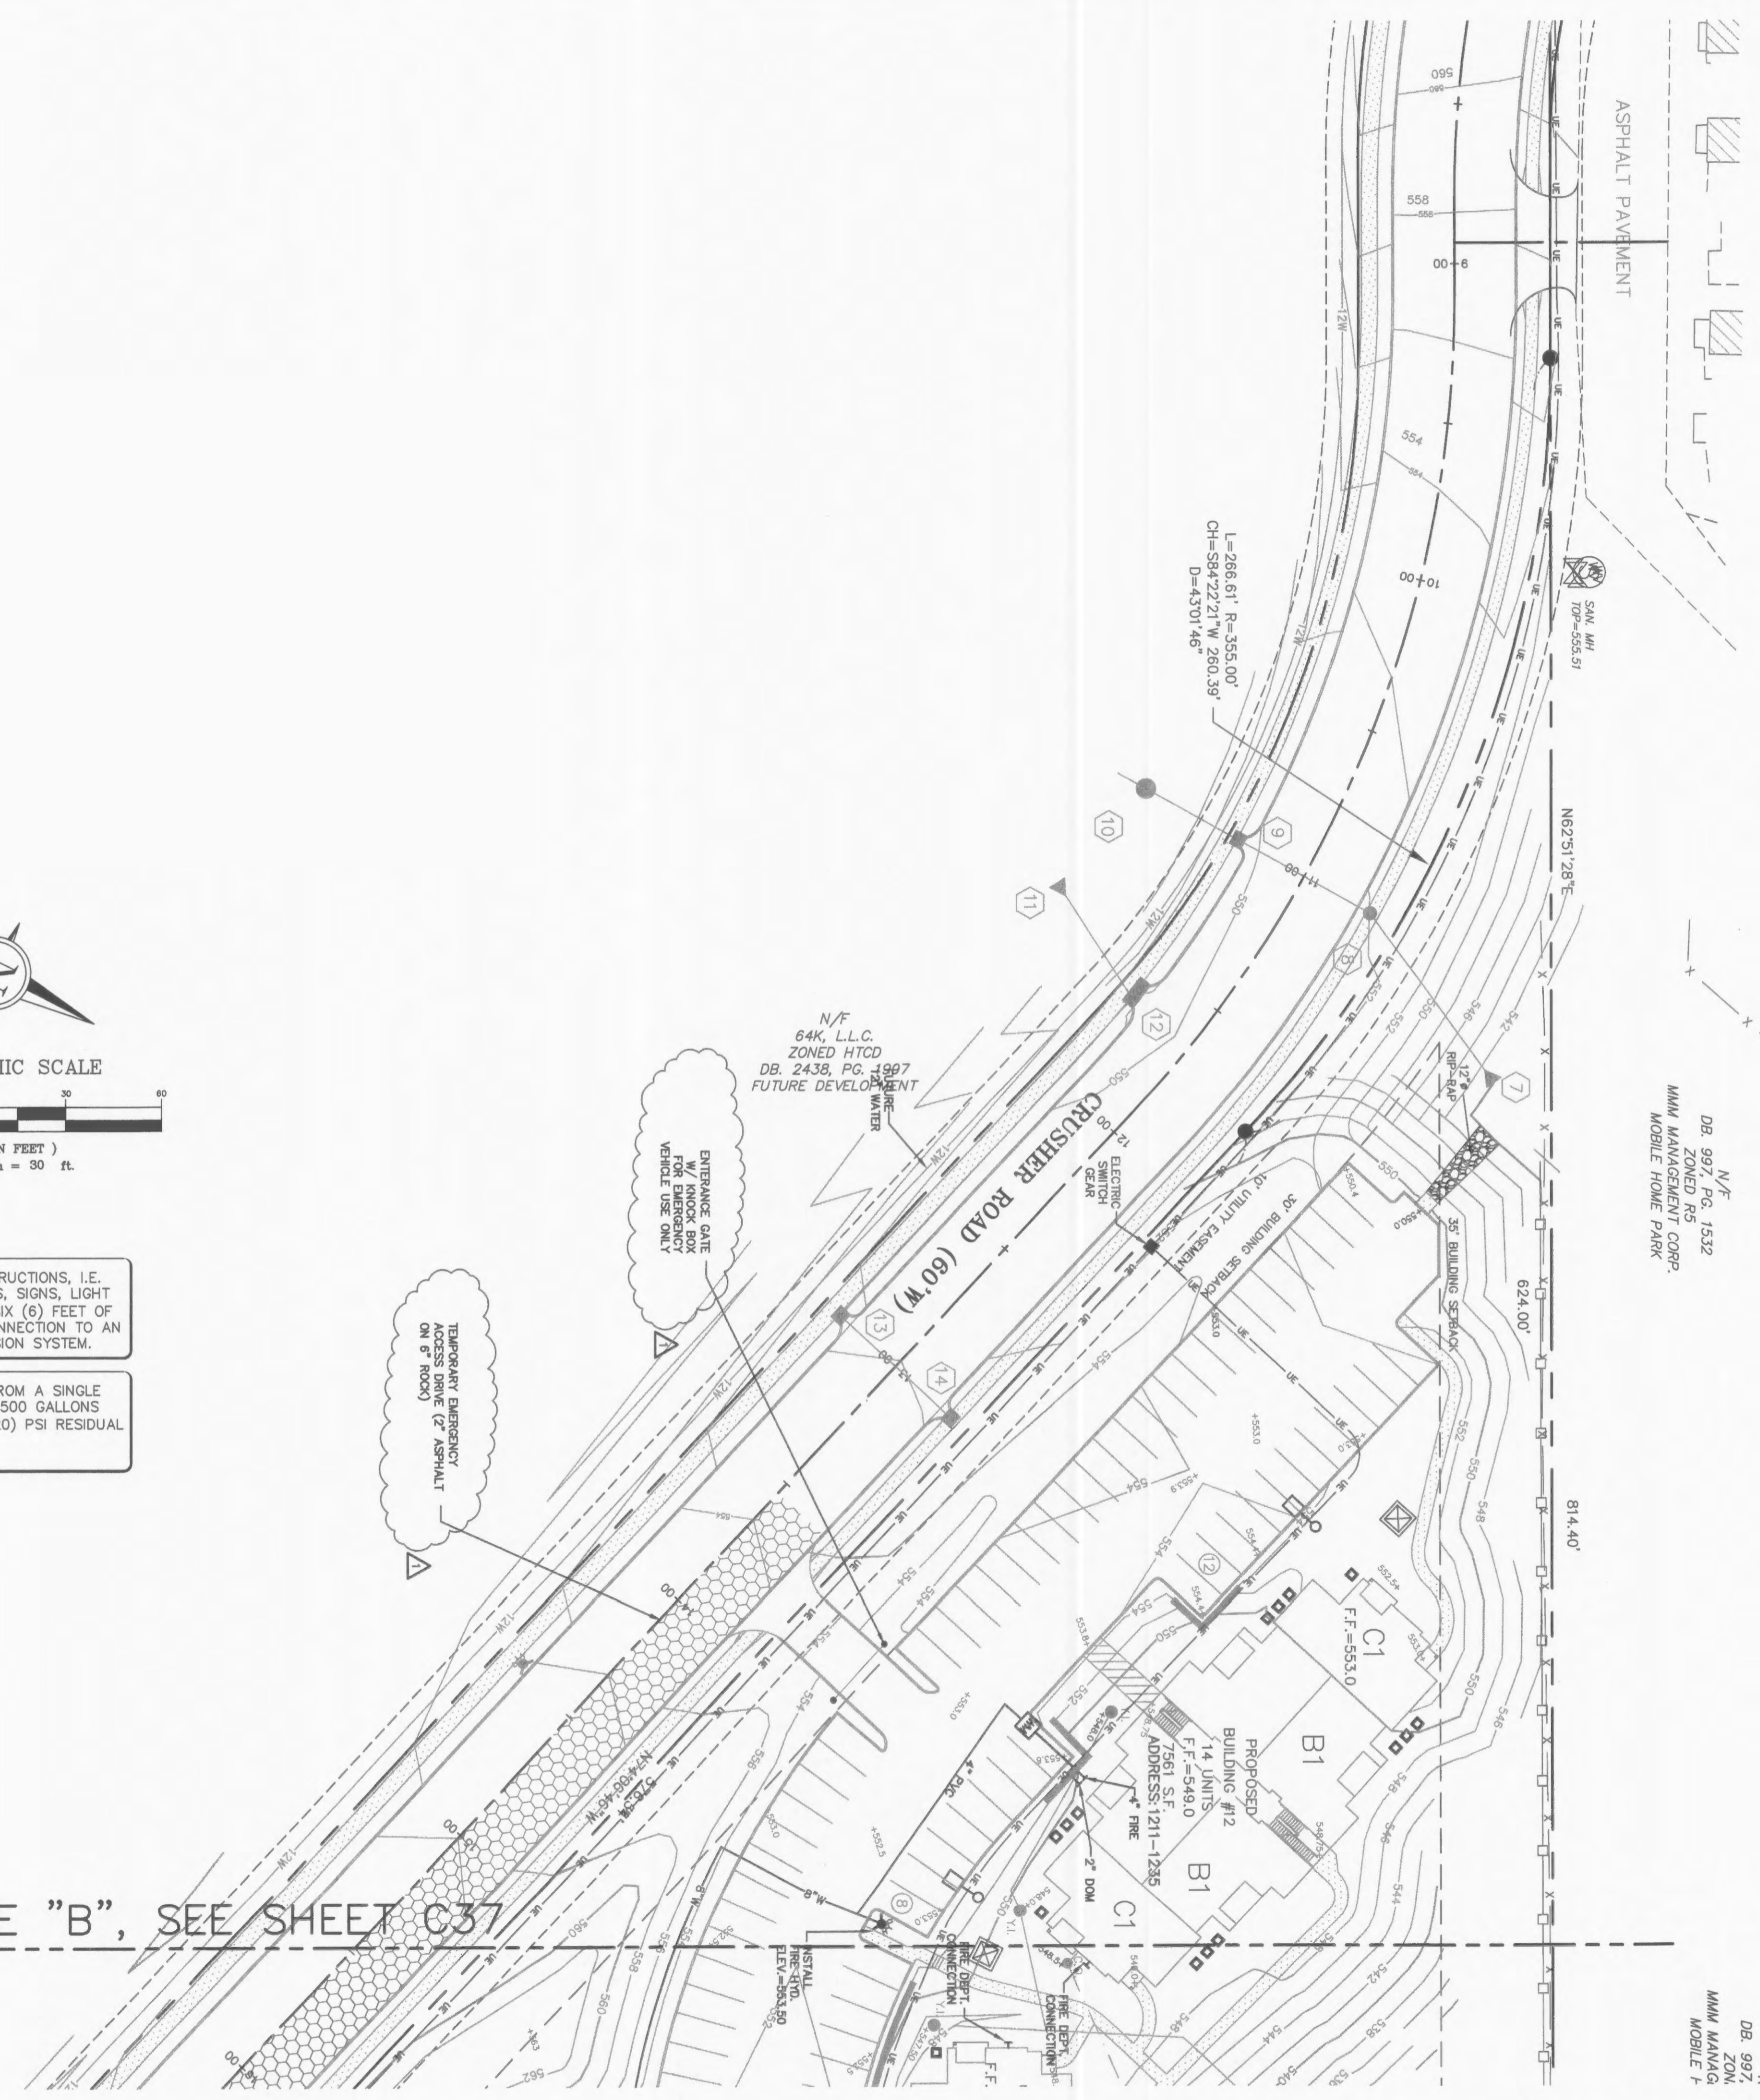

SOUTHERNSIDE APARTMENTS	
WATER & ELECTRIC LINE PLAN	
<b>JAMES ENGINEERING &amp; SURVEYING CO., INC.</b> ENGINEERS PLANNERS SURVEYORS 10811 BIG BEND BLVD. KIRKWOOD, MO. 63122 PHONE: (314) 822-1006 FAX: (314) 822-0006	
PROJECT # 184025	C38
<small>N:\Engineering Projects\184025\dwg\C38-WATER.dwg 10/4/2005 4:39:16 PM CDT</small>	

- △ 9/26/04 CITY OF O'FALLON CMNTS
- △ 8/12/02 CITY OF O'FALLON CMNTS