


ASPHALT PAVEMENT

- NOTES:
1. PAVEMENT DETAILS SHOWN FOR REFERENCE ONLY. CONTRACTOR TO VERIFY FINAL PAVEMENT REQUIREMENTS WITH GEOTECH REPORT AND/OR OWNER.
 2. ASPHALT SURFACE SHALL BE COMPACTED TO 98% MAXIMUM DENSITY.


1 LIGHT DUTY ASPHALT (PARKING AREAS)
SCALE: N.T.S. REF. DWG. C4.1

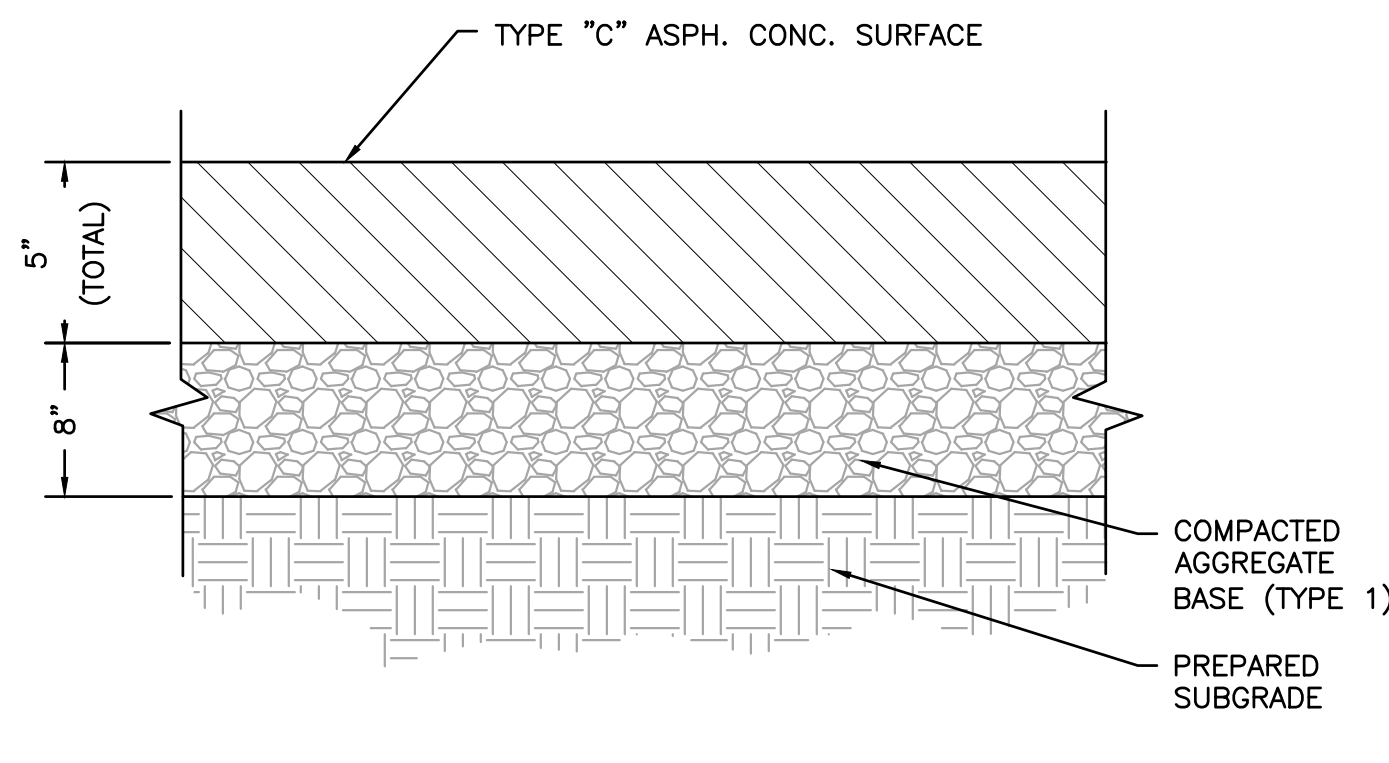

ASPHALT PAVEMENT

- NOTES:
1. PAVEMENT DETAILS SHOWN FOR REFERENCE ONLY. CONTRACTOR TO VERIFY FINAL PAVEMENT REQUIREMENTS WITH GEOTECH REPORT AND/OR OWNER.
 2. ASPHALT SURFACE SHALL BE COMPACTED TO 98% MAXIMUM DENSITY.


2 HEAVY DUTY ASPHALT (DRIVE AISLES)
SCALE: N.T.S. REF. DWG. C4.1

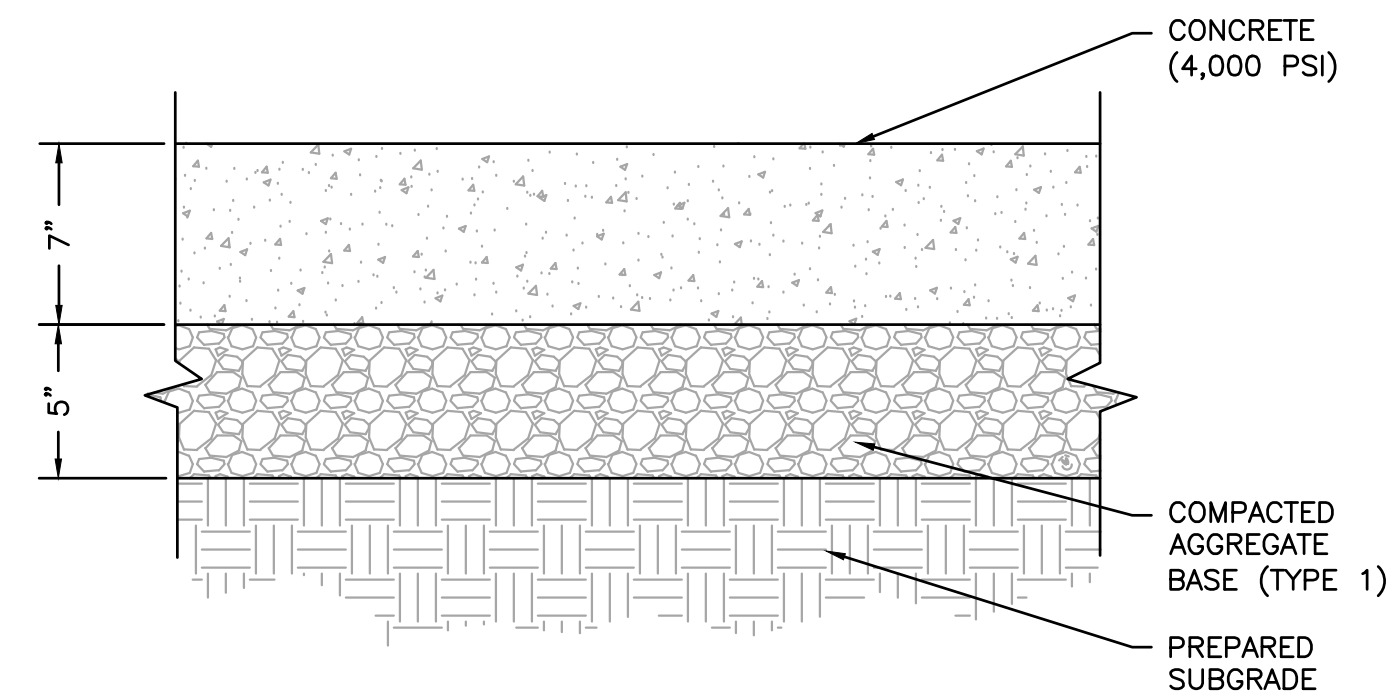

CONCRETE PAVEMENT DETAIL

- NOTES:
1. PAVEMENT DETAILS SHOWN FOR REFERENCE ONLY. CONTRACTOR TO VERIFY FINAL PAVEMENT REQUIREMENTS WITH GEOTECH REPORT AND/OR OWNER.
 2. CONTRACTOR TO INSTALL CONCRETE PAVEMENT JOINTS PER THE AMERICAN CONCRETE INSTITUTES "GUIDE FOR DESIGN AND CONSTRUCTION OF CONCRETE PARKING LOTS"
 3. ALL CONCRETE SHALL BE MINIMUM 4000 PSI AT 28 DAYS.


3 CONCRETE PAVEMENT DETAIL
SCALE: N.T.S. REF. DWG. C4.1

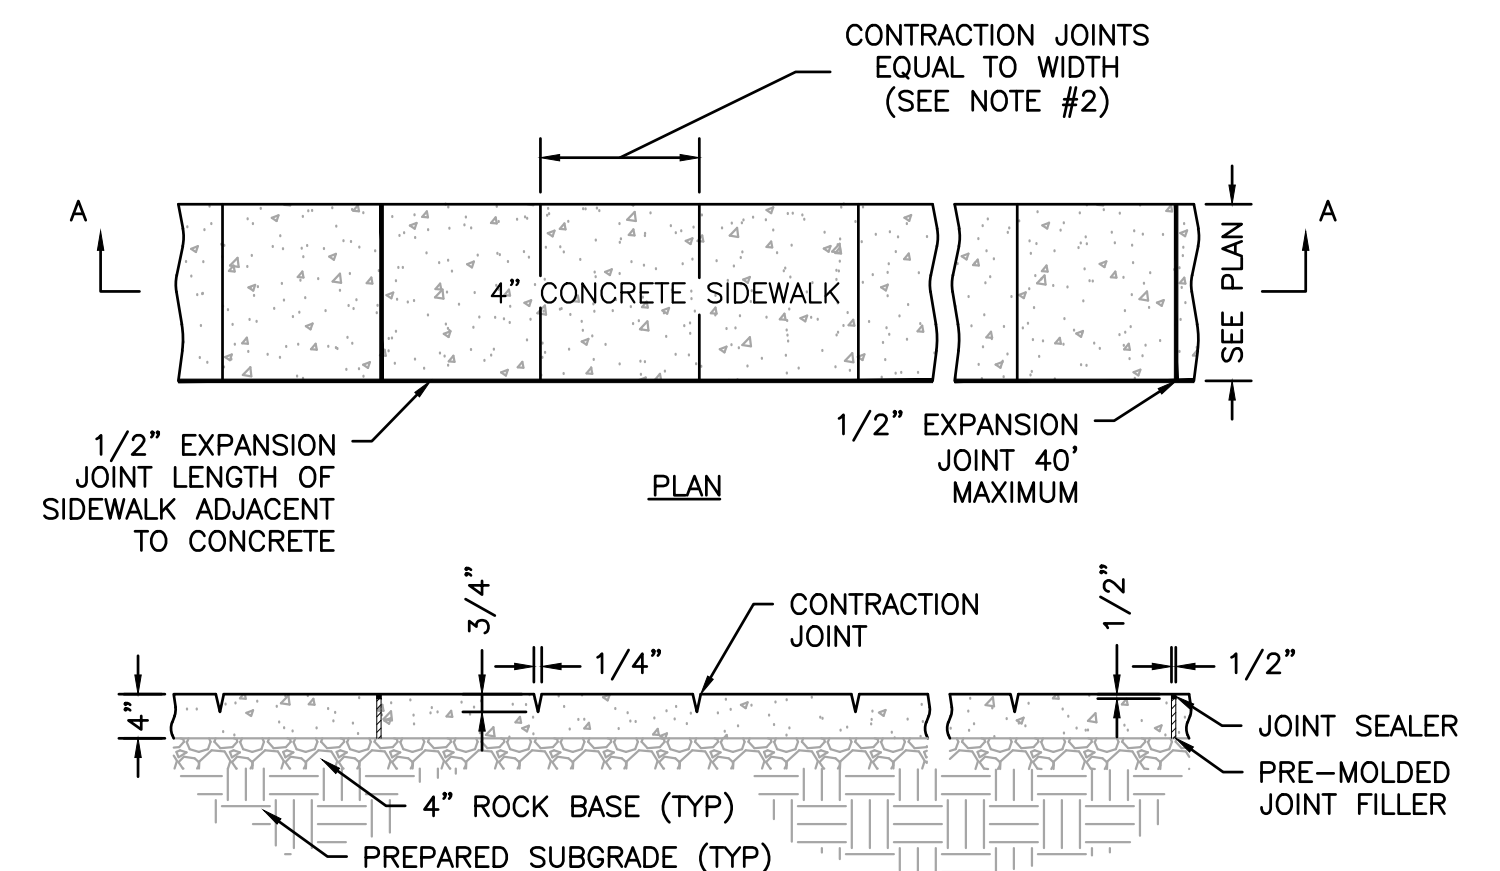

SECTION A-A

- NOTES:
1. CONTRACTOR TO COORDINATE WITH ARCHITECTURAL SITE PLANS FOR DETAILS OF ALL INTERIOR WALKS AND HARDSCAPE AREAS.
 2. DETAIL IS INTENDED FOR SIDEWALK WIDTHS OF 4 TO 6 FEET. CONTRACTOR SHALL COORDINATE WITH ARCHITECT OR ENGINEER FOR ANY SIDEWALK WIDTHS THAT EXCEED 6 FEET.
 3. ALL NON-REINFORCED CONCRETE SHALL BE 4000 PSI AT 28 DAYS


4 CONCRETE SIDEWALK DETAIL
SCALE: N.T.S. REF. DWG. C4.1

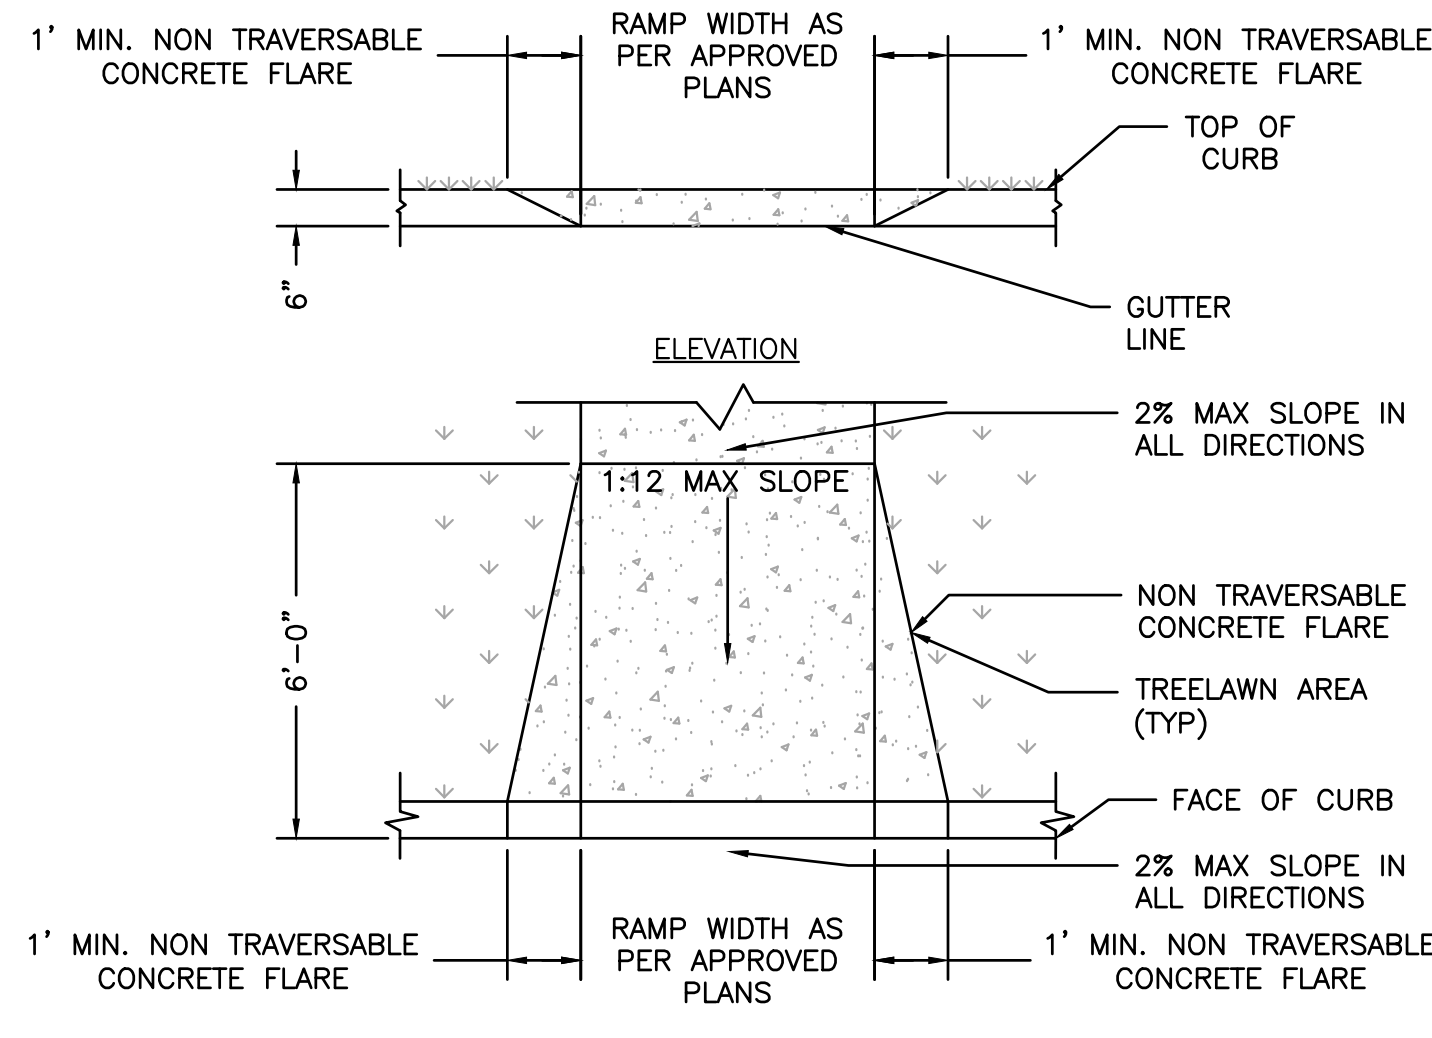

PLAN

- NOTE:
1. MAINTAIN 4" SIDEWALK THICKNESS IN DEPRESSED AREA.
 2. ALL NON-REINFORCED CONCRETE SHALL BE 4000 PSI AT 28 DAYS.


5 FLARED ACCESSIBLE RAMP DETAIL (IN GRASS)
SCALE: N.T.S. REF. DWG. C4.1

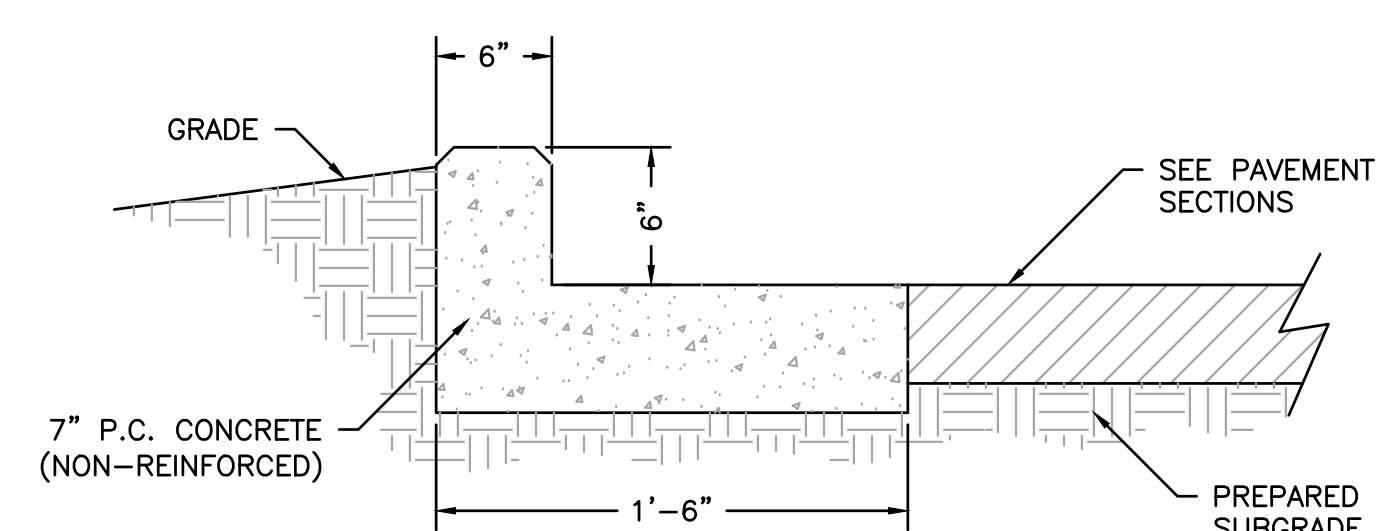

PREPARED SUBGRADE


- NOTES:
1. ALL CONCRETE SHALL BE MIN. FC=4,000 P.S.I. AT 28 DAYS.
 2. ANY UNSUITABLE SOIL (AS DETERMINED BY SOILS ENGINEER) BELOW STRUCTURE SHALL BE REMOVED AND REPLACED WITH SELECT EARTHEN MATERIAL COMPACTED IN PLACE WITH VIBRATORY TAMPER.
 3. ALL EXPOSED CONCRETE EDGES TO HAVE 3/4" CHAMFER.
 4. DIMENSIONS SHOWN ARE TO FACE OF CURB.

6 CONCRETE CURB AND GUTTER DETAIL
SCALE: N.T.S. REF. DWG. C4.1

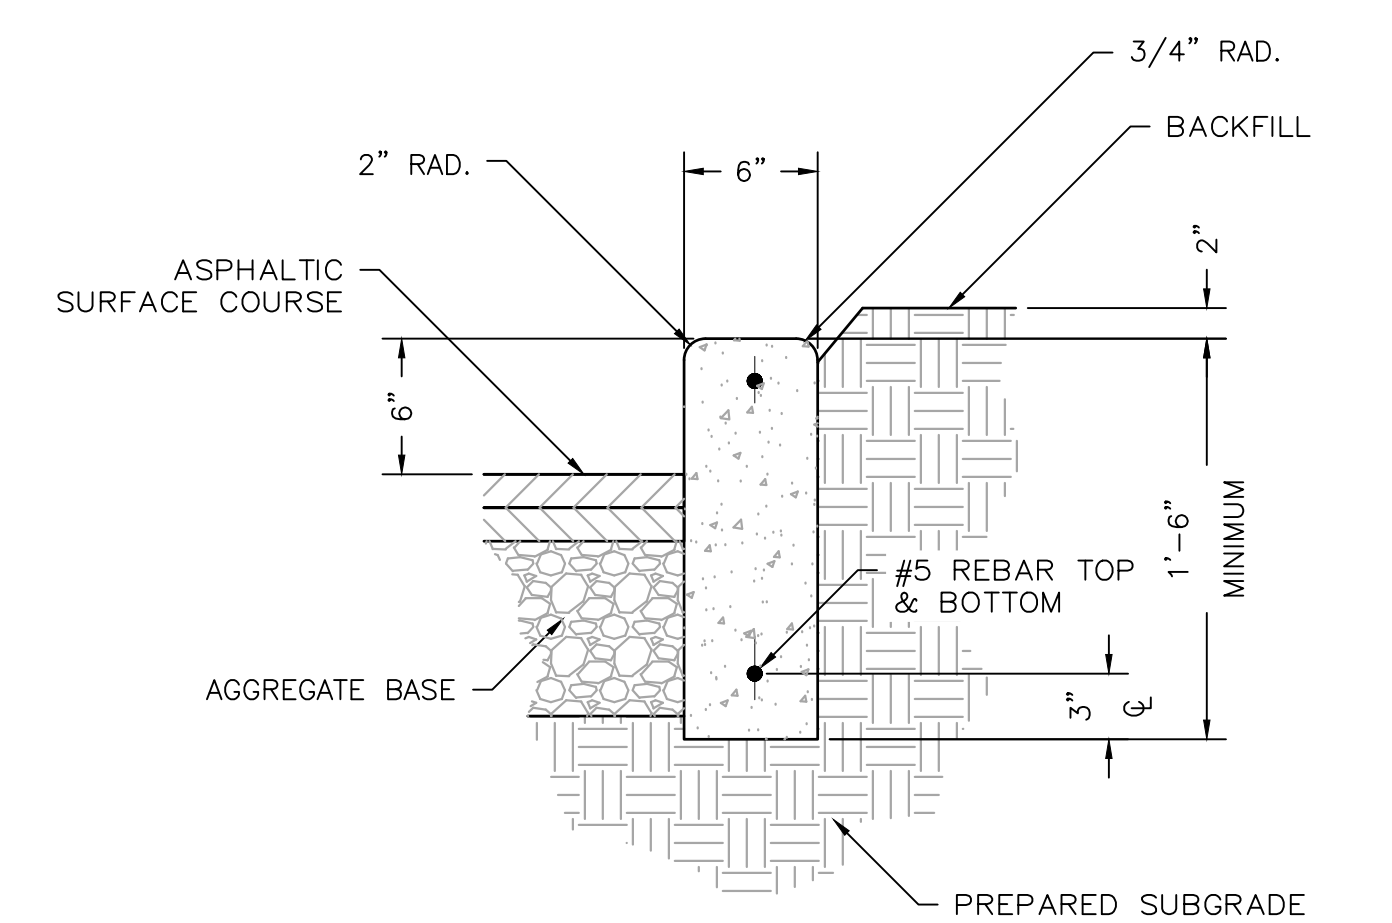


PREPARED SUBGRADE

7 VERTICAL CONCRETE CURB DETAIL
SCALE: N.T.S. REF. DWG. C4.1

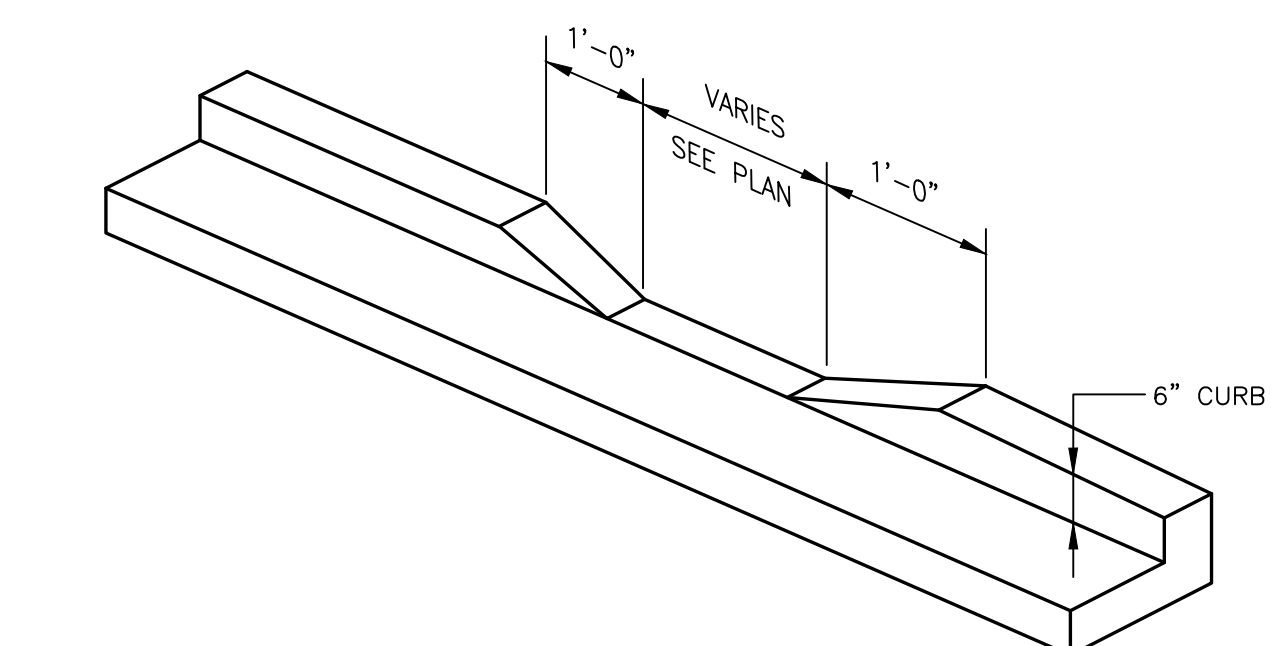


8 DEPRESSED CURB DETAIL
SCALE: N.T.S. REF. DWG. C4.1

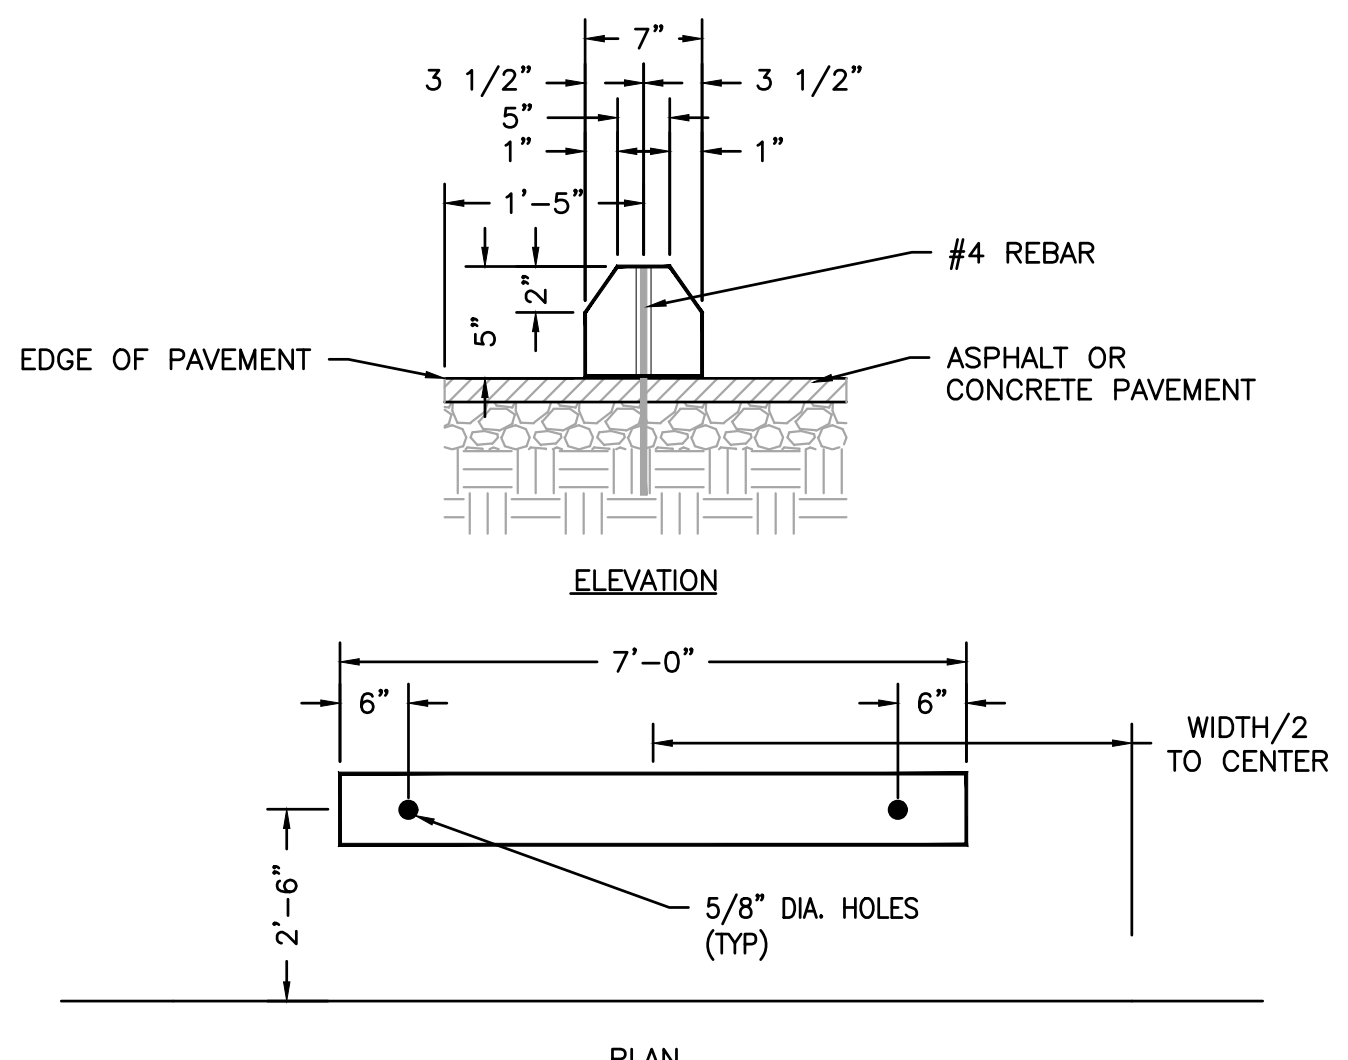

PLAN

- NOTES:
1. SIMILAR SHAPE MAY BE USED UPON APPROVAL OF ENGINEER.
 2. HOLD IN PLACE WITH 18" LONG #4 REBAR'S PLACED IN THE HOLES AT EACH END AND DRIVEN FLUSH WITH THE TOP.

9 WHEEL STOP DETAIL
SCALE: N.T.S. REF. DWG. C4.1

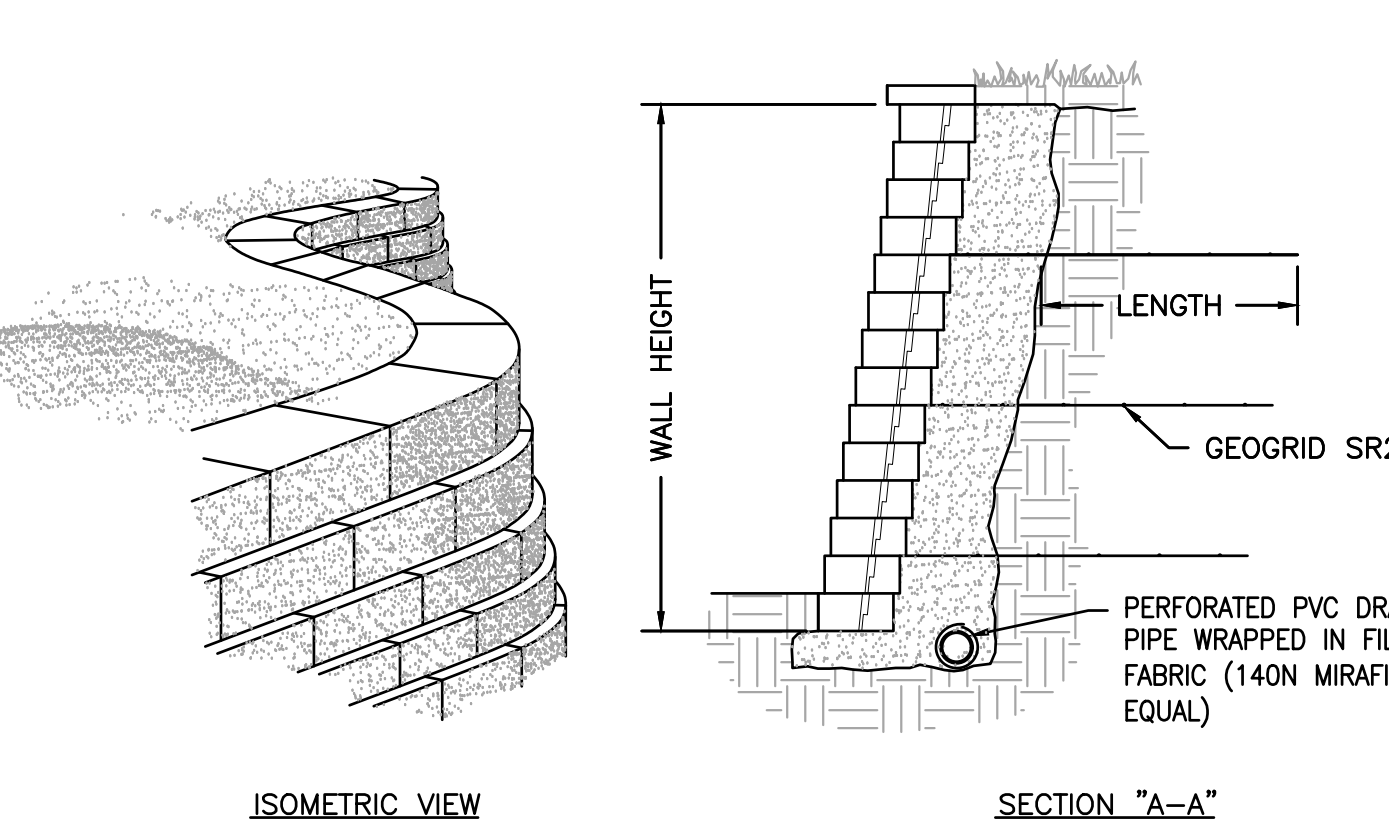


ISOMETRIC VIEW


SECTION "A-A"

- NOTES:
1. ALL CONSTRUCTION SHALL BE PER THE MANUFACTURERS RECOMMENDATION.
 2. SHOP DRAWINGS BEARING THE SEAL OF A REGISTERED ENGINEER TO BE SUPPLIED TO THIS ENGINEER FOR APPROVAL.
 3. ACCEPTED ALTERNATE WALL SYSTEM: KEYSTONE OR HERCULES
 4. TW= TOP OF RETAINING WALL, BW= GRADE AT BASE OF WALL.
 5. FENCING SHALL BE PROVIDED ON ALL RETAINING WALLS TALLER THAN 4 FEET.

10 RETAINING WALL DETAIL
SCALE: N.T.S. REF. DWG. C4.1

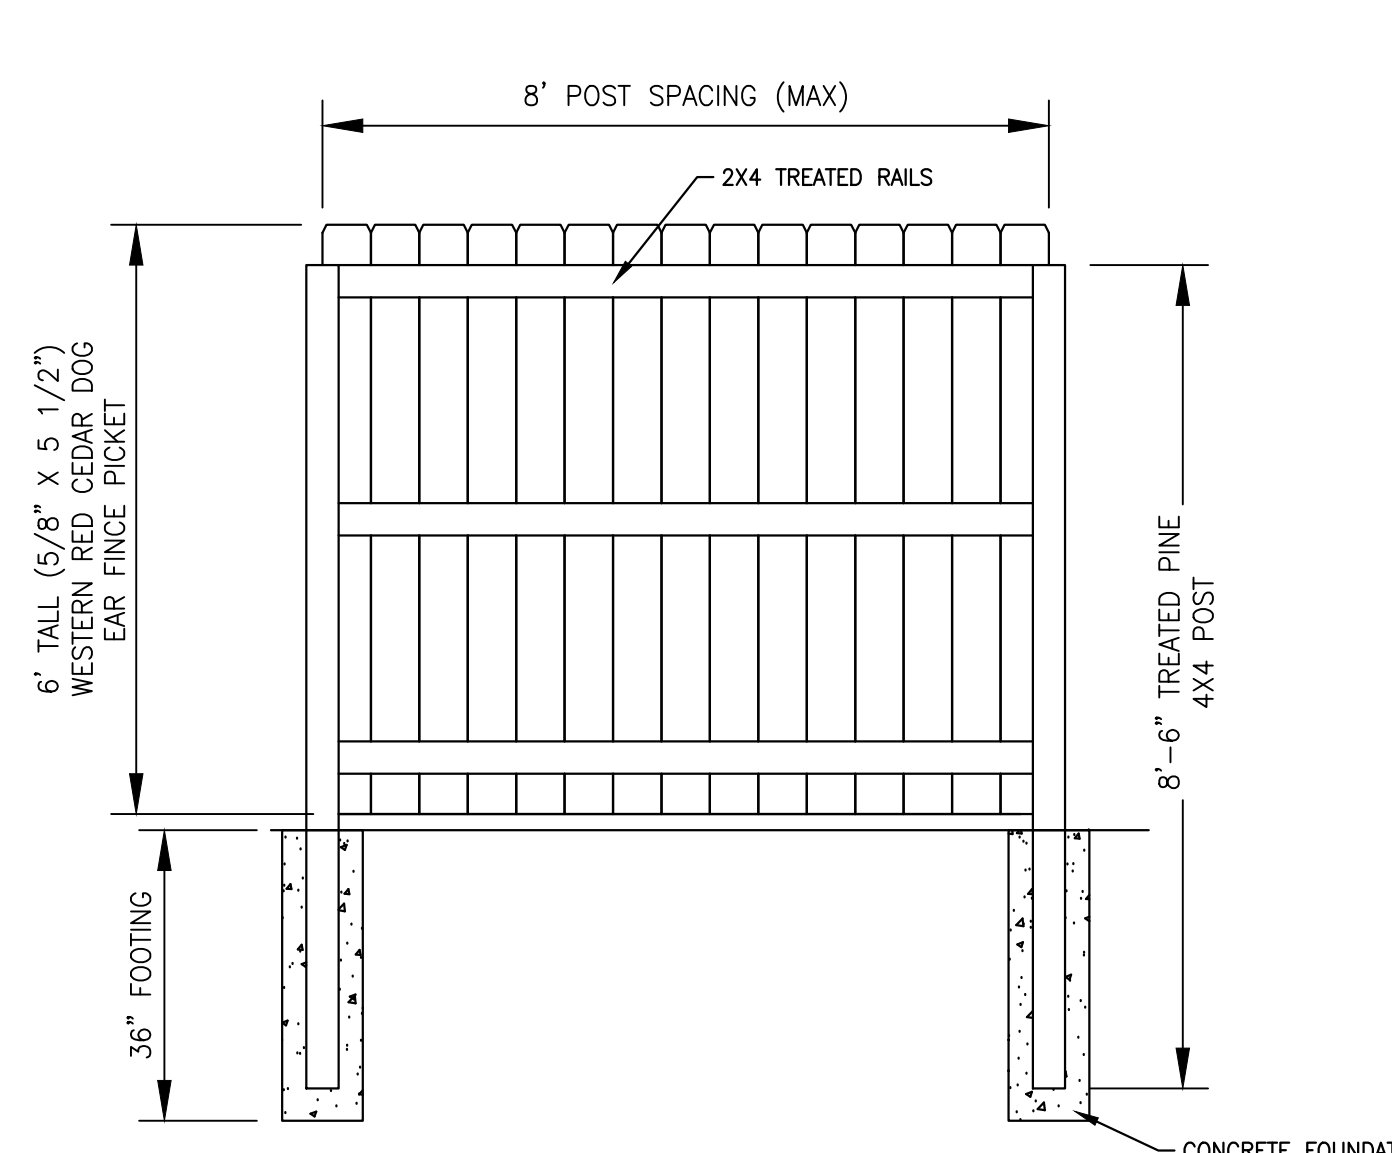

11 6' PRIVACY FENCE
SCALE: N.T.S. REF. DWG. C4.1

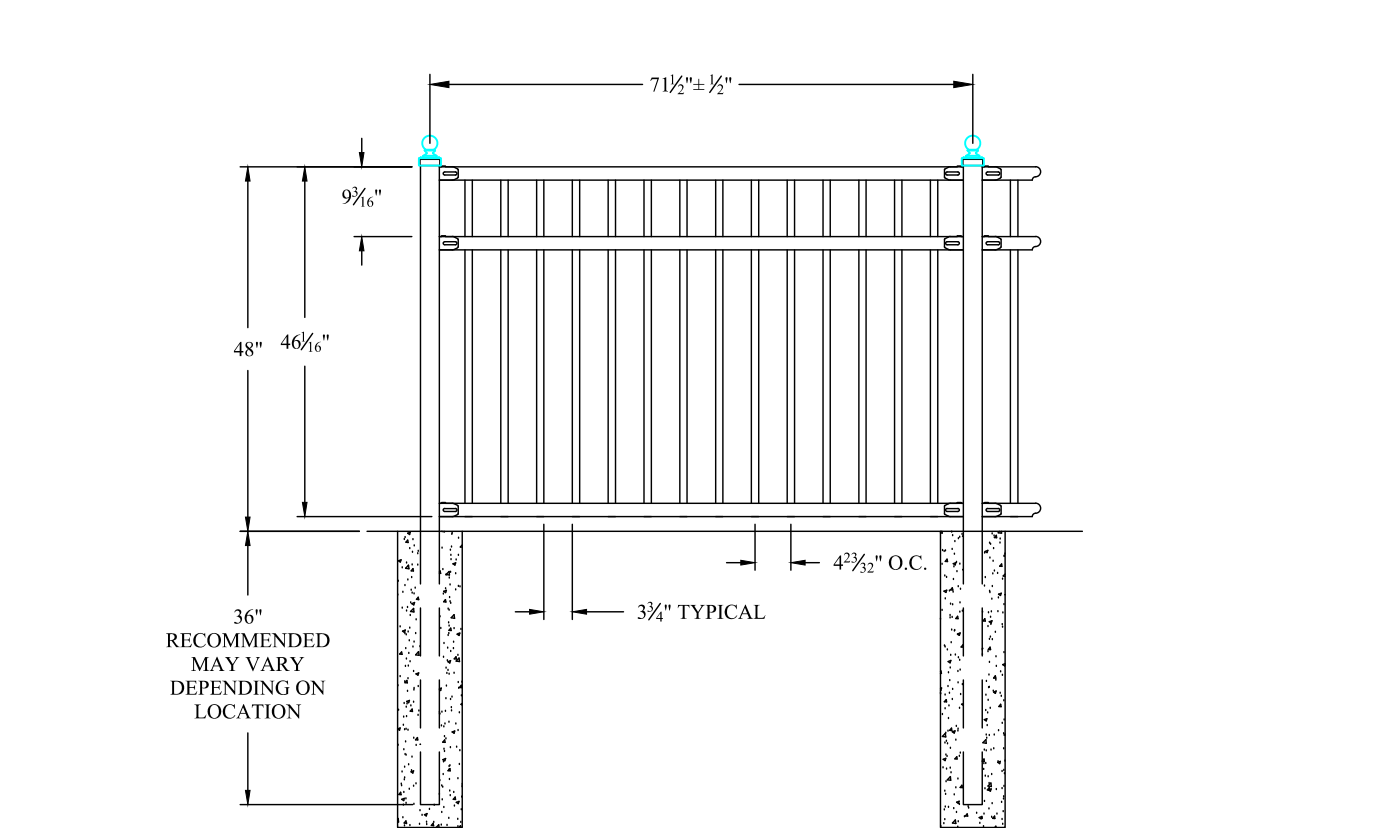


4' HT. AMERISTAR ECHELON-II ALUMINUM FENCE
NOT TO SCALE

12 PEDESTRIAN RATED FENCE
SCALE: N.T.S. REF. DWG. C4.1

USER: Matt Stueber TAB: C9.0 DETAILS
DATE: June 17, 2022 7:20:05 AM
DRAWING: S:\085\0852021\21-0154\CADD\C-Plan\PoolSheet\0-IPAL DETAIL 21-0154.dwg

DEVELOPER/OWNER:
MOHR CAPITAL LLC
14643 DALLAS PARKWAY SUITE 1000
DALLAS, TX 75254
(214) 801-9860

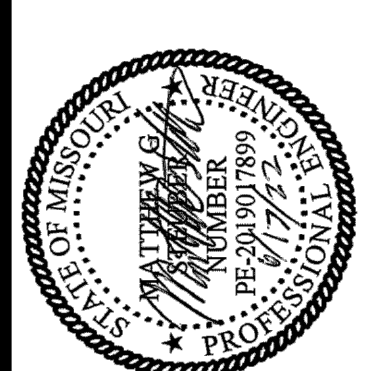

TEXAS ROADHOUSE IMPROVEMENT PLANS
MEXICO ROAD
O'FALLON, MO 63368
DETAILS

+ ST. CHARLES
3205 57th Street
St. Charles, MO 63303
636.978.7508 tel
www.colerpl.com

COLE
CIVIL ENGINEERING / SURVEYING / PLANNING / LANDSCAPE ARCHITECTURE
Civil & Architectural, Inc. is a Missouri Government Sub. Code Design Group. See its Address & Trust Agreement approved by the State.

DESIGN/CALC BY: MGS
DRAWN BY: MGS
CHECKED BY: MGS
DRAWING SCALE: AS SHOWN
DATE: 06/17/2022
Job Number: 21-0154
Sheet Number: C9.0