


**TWIN CHIMNEYS  
Water Plans**

August 22, 1988 86-164H

REV. 07-14-88 KAN 3 Way F.H.  
REV. 10-28-88 JT  
REV. 11-14-88 PLS UIC CAPABILITY - WATER  
REV. 11-28-88 PLS (ADD NEW WATER DETAILS PER PLAN)  
REV. 5-18-89 PER CLIENT  
REV. 7-30-90 PER CLIENT

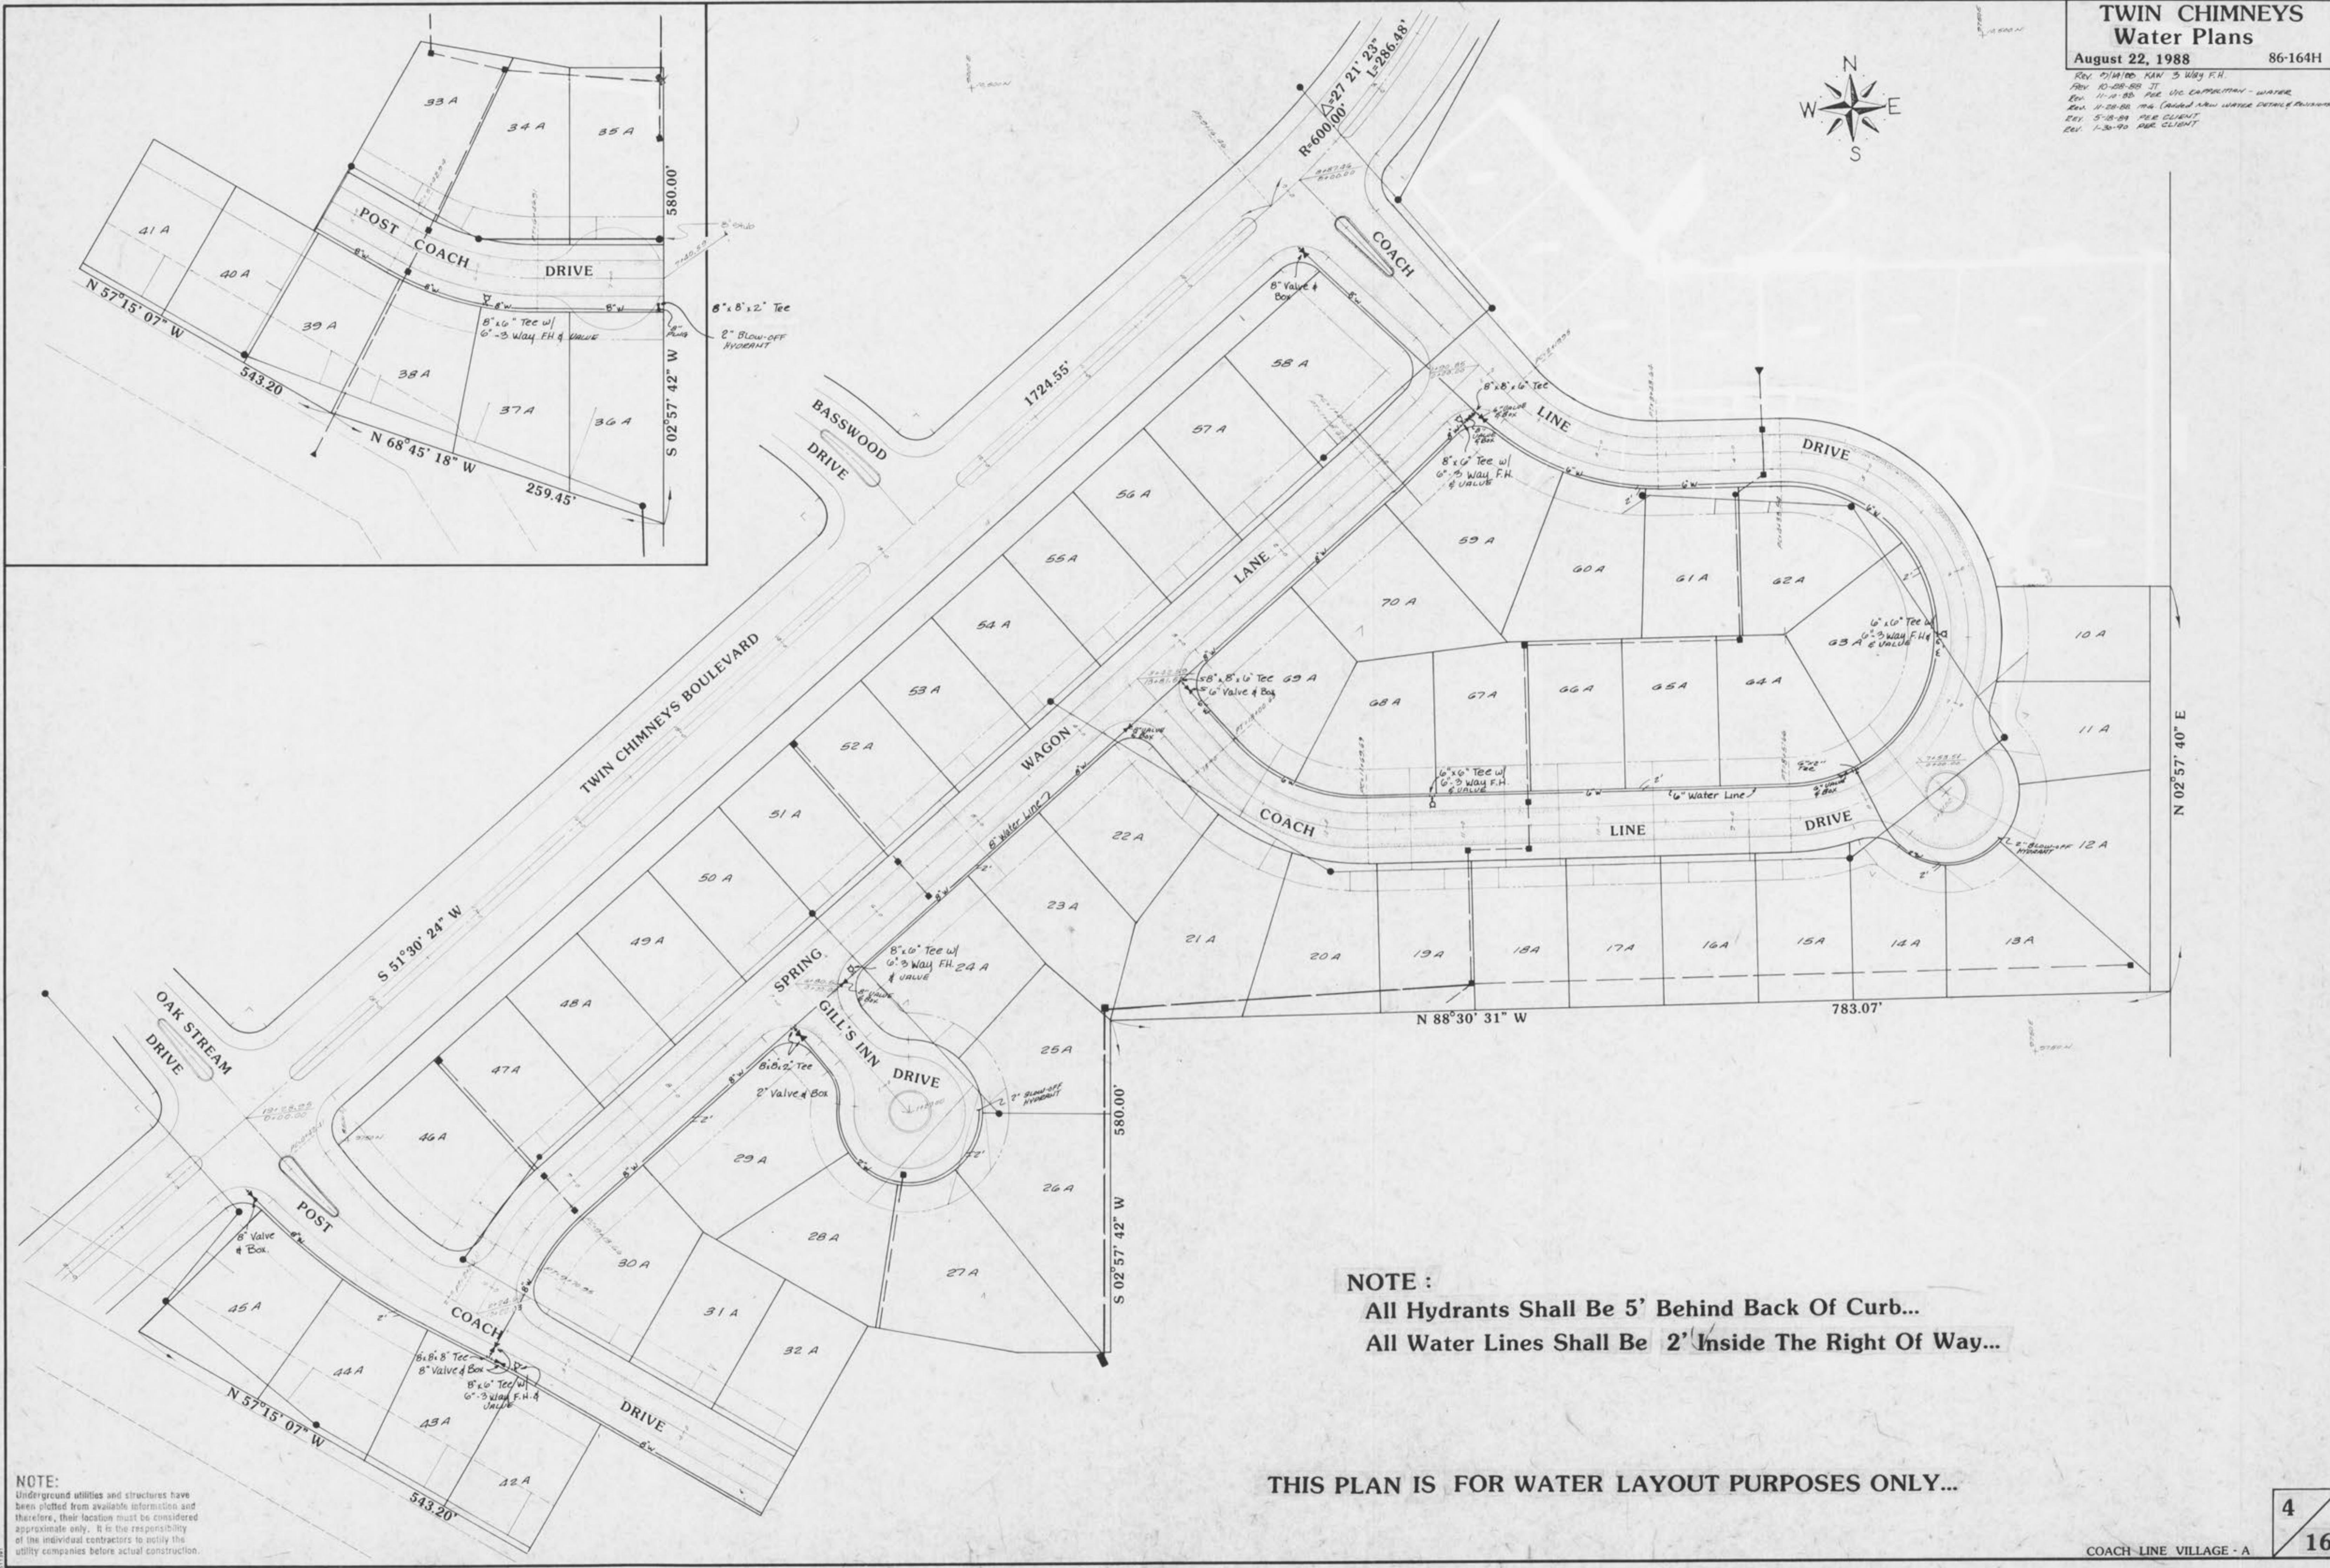

**NOTE :**  
All Hydrants Shall Be 5' Behind Back Of Curb...  
All Water Lines Shall Be 2' Inside The Right Of Way...

**THIS PLAN IS FOR WATER LAYOUT PURPOSES ONLY...**

**NOTE:**  
Underground utilities and structures have been plotted from available information and therefore, their location must be considered approximate only. It is the responsibility of the individual contractors to notify the utility companies before actual construction.