


NOTES:

1. ALL HARDWARE 8-88 STAINLESS STEEL INCLUDING BELLVILLES COAT ALL SURFACE WITH KOPR-SHIELD BEFORE MATING.
2. FOR GROUND BOND TO STEEL ONLY: INSERT A TOOTH WASHER BETWEEN LUG AND STEEL, COAT ALL SURFACES WITH KOPR-SHIELD.
3. ALL HOLES ARE COUNTERSUNK 1/16".


TYPICAL GROUND BAR

5

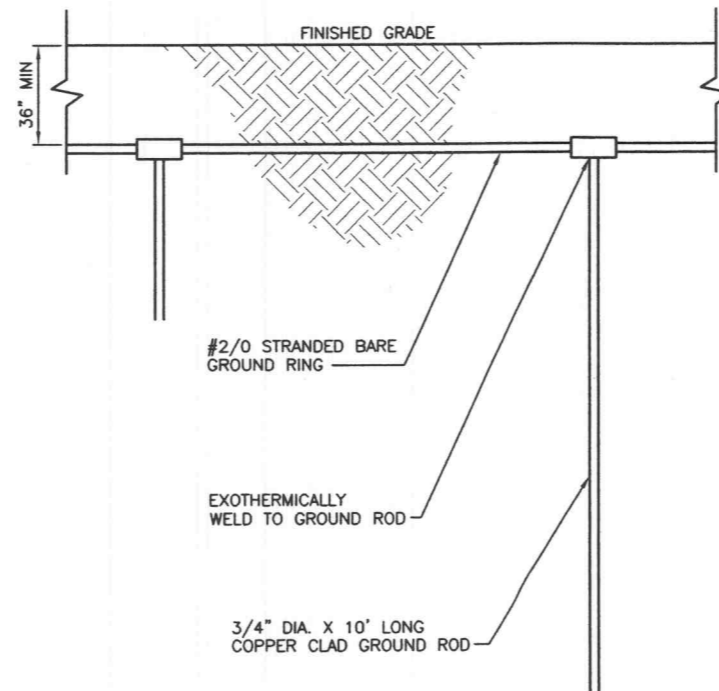

EXTERNAL GROUND RING DETAIL

6


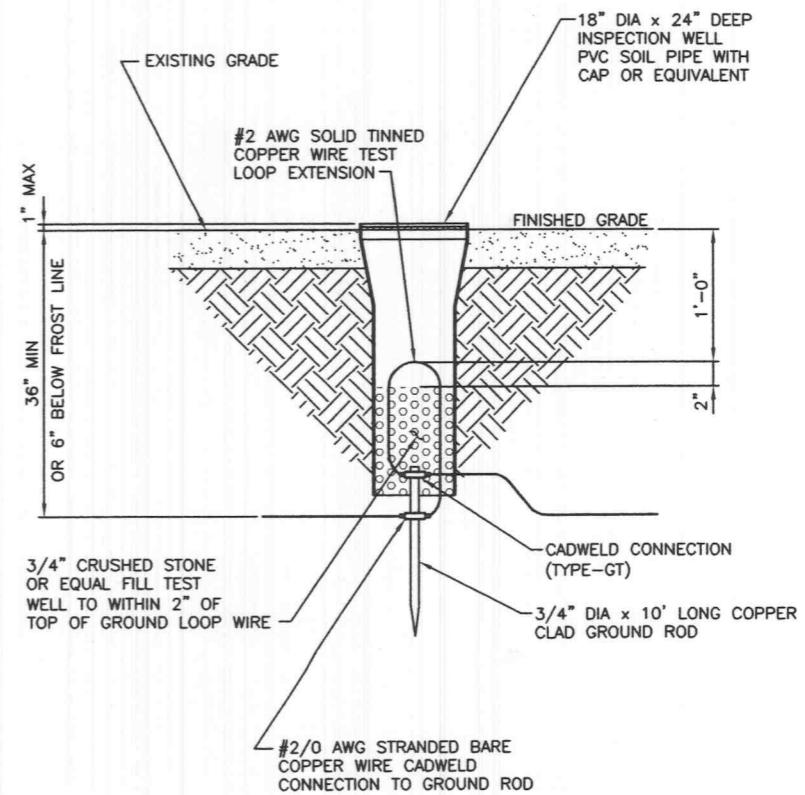


INSPECTION WELL

2



CIS COMMUNICATIONS,  
165 N MERAMEC AVE, ST  
CLAYTON, MO 63105  
OFFICE: 314-721-5000  
FAX: 314-727-6500  
TOLL FREE: 877-472-0000

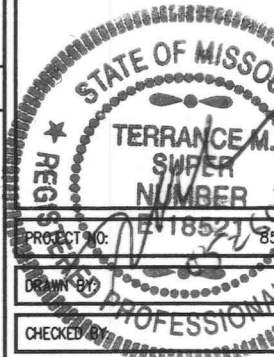

SUBMITTALS		
A	05/23/06	ISSUED FOR REVIEW
D	05/25/06	ISSUED FOR CONSTRUCTION

THE INFORMATION CONTAINED IN THIS SET OF DOCUMENTS IS PROPRIETARY BY NATURE. ANY USE OR DISCLOSURE OTHER THAN THAT WHICH RELATES TO US CELLULAR COMMUNICATIONS INC. IS STRICTLY PROHIBITED.

SITE NAME  
MEXICO AND HIGHWAY

8621-8635 MEXICO ROAD  
O'FALLON, MISSOURI 63301

SHEET TITLE  
GROUNDING DETAILS (2)

SHEET NUMBER  
G-3