



THE UNDERGROUND UTILITIES SHOWN HEREON WERE PLOTTED FROM AVAILABLE INFORMATION AND DO NOT NECESSARILY REFLECT THE ACTUAL EXISTENCE, NONEXISTENCE, SIZE, TYPE, NUMBER OR LOCATION OF THESE OR OTHER UTILITIES. THE GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THE ACTUAL LOCATION OF ALL UNDERGROUND UTILITIES, SHOWN OR NOT SHOWN, AND SAID UTILITIES SHALL BE LOCATED IN THE FIELD PRIOR TO ANY GRADING, EXCAVATION OR CONSTRUCTION OF IMPROVEMENTS. THESE PROVISIONS SHALL IN NO WAY ABSOLVE ANY PARTY FROM COMPLYING WITH THE UNDERGROUND FACILITY SAFETY AND DAMAGE PREVENTION ACT, CHAPTER 319, RSMo

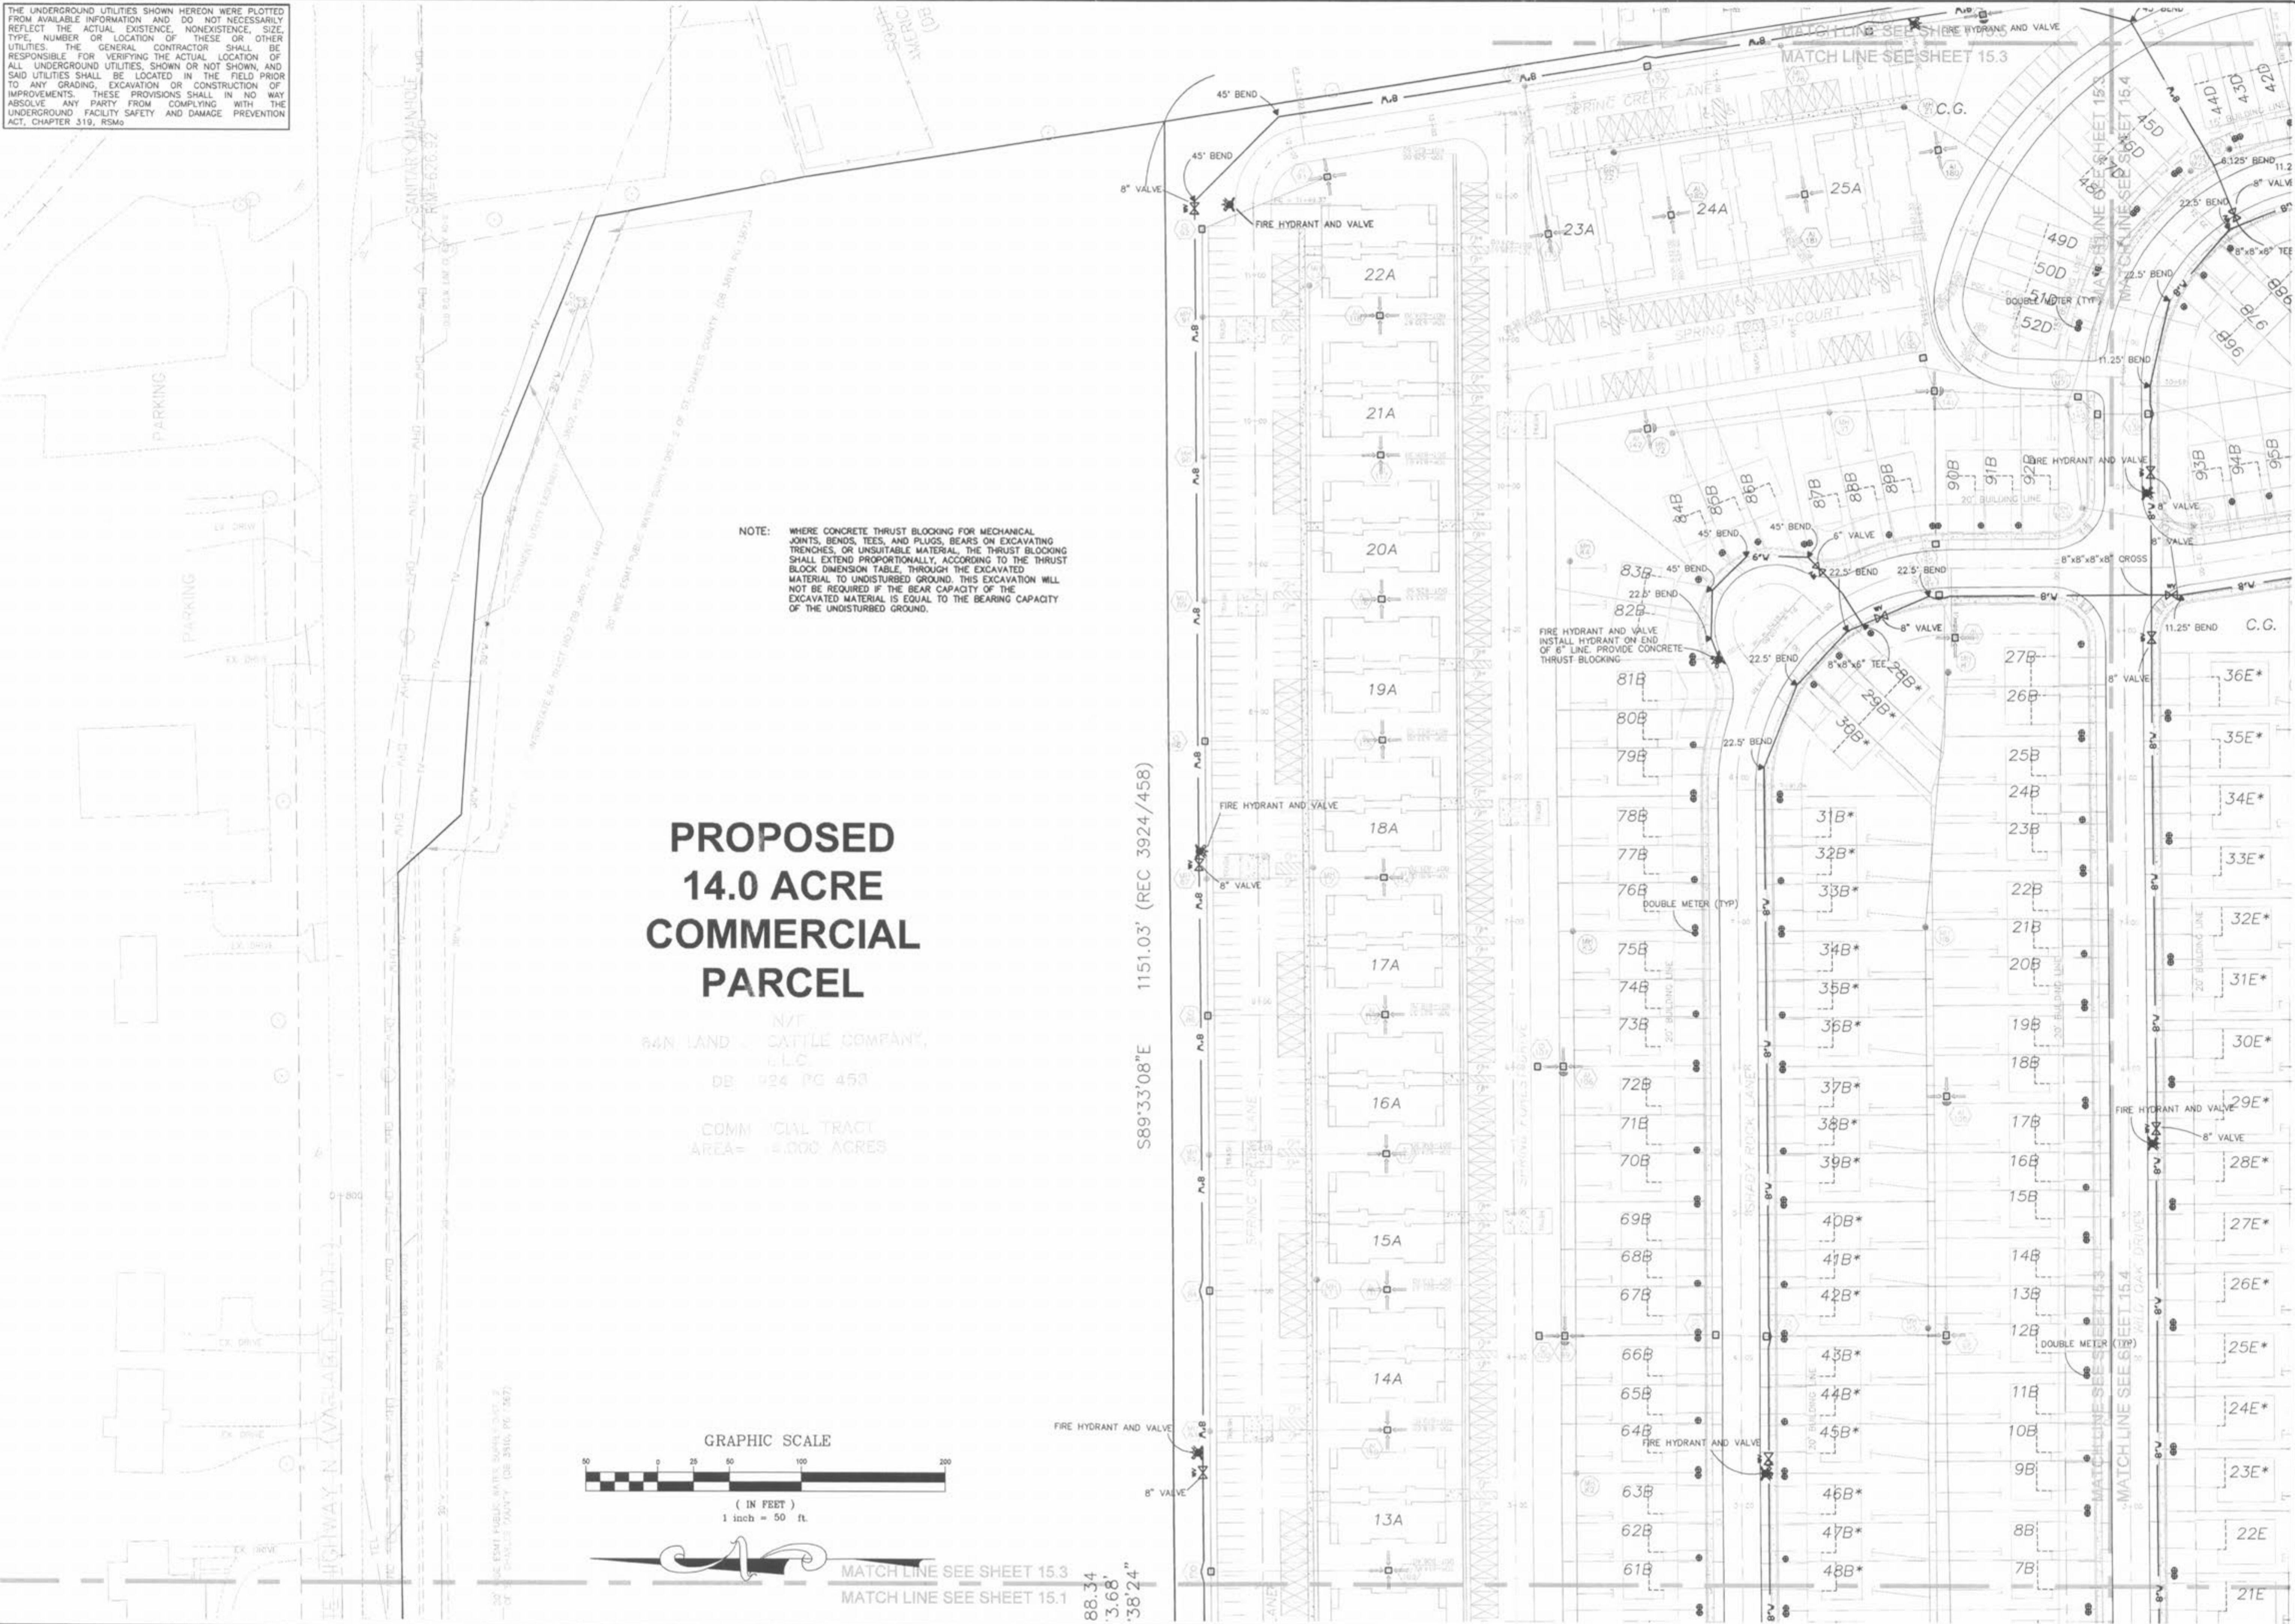

NOTE: WHERE CONCRETE THRUST BLOCKING FOR MECHANICAL JOINTS, BENDS, TEES, AND PLUGS, BEARS ON EXCAVATING TRENCHES, OR UNSUITABLE MATERIAL, THE THRUST BLOCKING SHALL EXTEND PROPORTIONALLY, ACCORDING TO THE THRUST BLOCK DIMENSION TABLE, THROUGH THE EXCAVATED MATERIAL TO UNDISTURBED GROUND. THIS EXCAVATION WILL NOT BE REQUIRED IF THE BEAR CAPACITY OF THE EXCAVATED MATERIAL IS EQUAL TO THE BEARING CAPACITY OF THE UNDISTURBED GROUND.

PROPOSED 14.0 ACRE COMMERCIAL PARCEL

N/T
64N LAND & CATTLE COMPANY,
L.L.C.
DB: 924 PG 453
COMMERCIAL TRACT
AREA = 14.000 ACRES

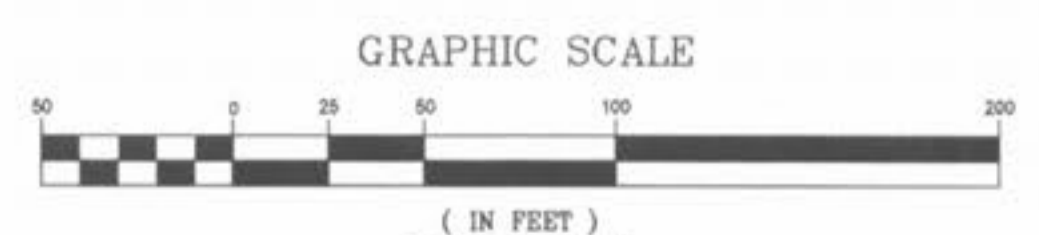

S89°33'08"E 1151.03' (REC 3924/458)

ISSUE	REMARKS/DATE
1	03-02-05 FIRST SUBMITTAL
2	04-04-05 REVISED PER DCSO COMMENTS
3	05-23-05 REVISED PER CITY OF FALLON COMMENTS
4	05-27-05 REVISED PER DCSO COMMENTS
5	06-09-05 REVISED PER PASO #2 COMMENTS
6	06-22-05 REVISED PER CITY OF FALLON COMMENTS
7	07-14-05 REVISED PER PASO #2 COMMENTS
8	08-08-05 REVISED PER CITY OF FALLON COMMENTS

PREPARED FOR:
SPRINGHURST, L.L.C.
5081 NEW BAUMGARTNER ROAD
ST. LOUIS, MISSOURI 63129
(314) 487-6717



THE **STERLING** CO.
ENGINEERS & SURVEYORS
5055 NEW BAUMGARTNER ROAD
ST. LOUIS, MISSOURI 63129
(314) 487-6717 FAX 487-8844
E-Mail: Sterling@sterling-eng-srv.com

PROJECT:	THE VILLAGES AT SPRINGHURST		
DRAWN:	DESIGNED:	CHECKED:	WATER DISTRIBUTION PLAN

NO	03	12	269
M.S.D.	SHEET		
P#	15.3		
DIGITAL FILE LOCATION	SERVER=STERLING-2		
DATE	12/28/05		
OF	-		

BASE MAP

PC#2804