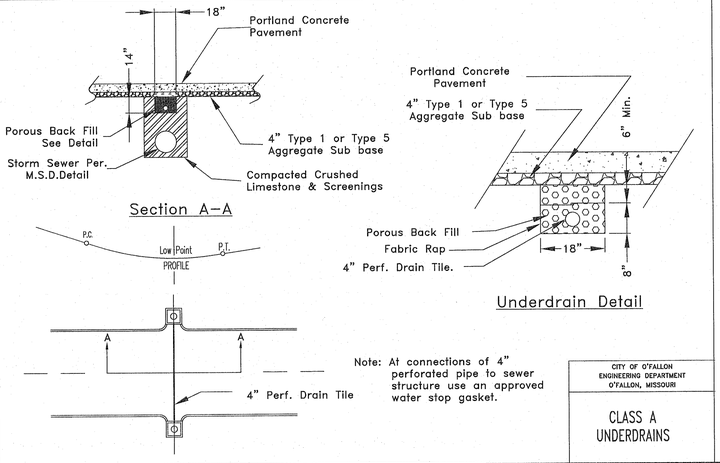

Note: At connections of 4" perforated pipe to sewer structure use an approved water stop gasket.

CITY OF O'FALLON
ENGINEERING DEPARTMENT
O'FALLON, MISSOURI

CLASS A
UNDERDRAINS



NOTE:
1. To be used at intake and discharge end of pipe. Grade of Rock Blanket to be adjusted accordingly.
2. Woven Geotextile Fabric required under Rock Blanket.

* The discharge point of all flared end sections hall be protected by rip rap or other approved means.

** Rip rap shown at flared end sections will be evaluated in the field by the Engineer, Contractor, and City Inspectors after installation for effectiveness and field modified, if necessary to reduce erosion on and off site.

MSD Type 5 Rock Blanket (% By Weight Passing)

Sieve	Maximum	Minimum	
12 inch	90	70	
6 inch	30	10	
1/2 inch	5	0	

CITY OF O'FALLON
ENGINEERING DEPARTMENT
O'FALLON, MISSOURI

SEWER CONSTRUCTION DETAILS
FLARED END SECTION
(INLET/OUTLET PROTECTION)

* The City of O'Fallon must be provided with a symbol/medallion for review and approval prior to installation. Contact the City if any information is needed.

Size	Style	Adhesive	Message (Part #)
3 7/8" TO 4"	Crystal Cap or Standard Style	Epoxy	No Dumping Drains to Waterway





CITY OF O'FALLON
ENGINEERING DEPARTMENT
O'FALLON, MISSOURI

STORM DRAIN
MARKER LOCATION

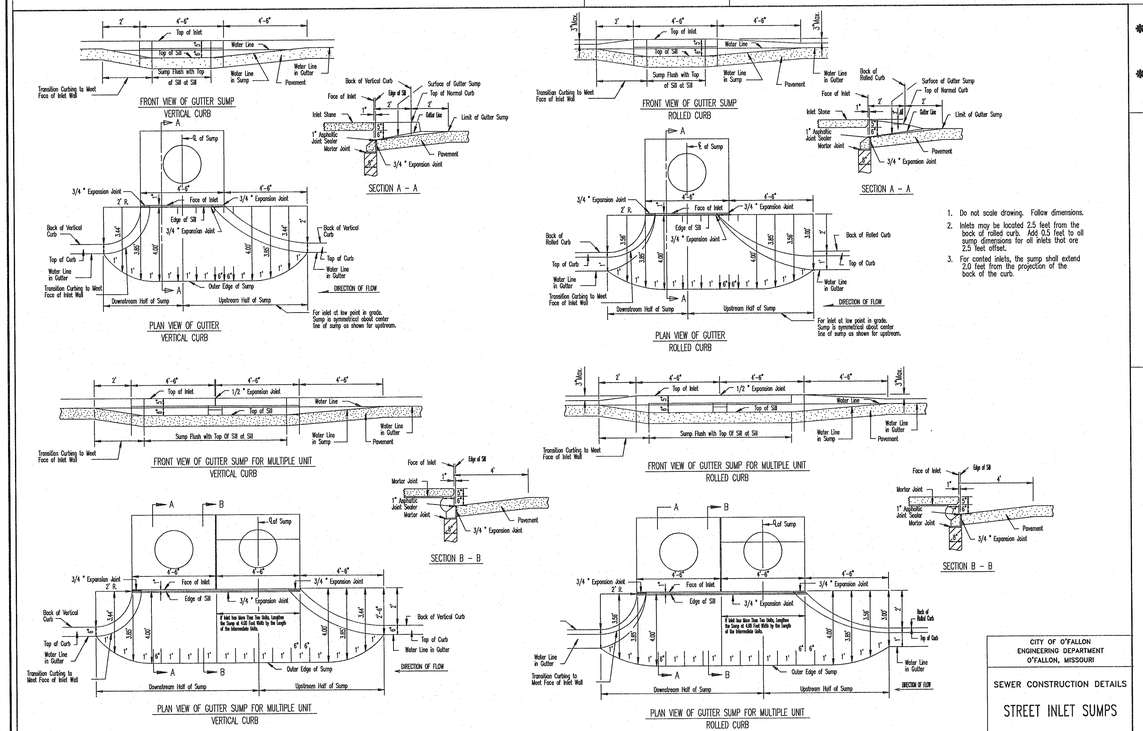

1. Do not scale drawing. Follow dimensions.
2. Inlets may be located 2.5 feet from the back of rolled curb. Add 0.5 feet to all sump dimensions for all inlets that are 2.5 feet offset.
3. For canted inlets, the sump shall extend 2.0 feet from the projection of the back of the curb.

CITY OF O'FALLON
ENGINEERING DEPARTMENT
O'FALLON, MISSOURI

SEWER CONSTRUCTION DETAILS
STREET INLET SUMPS

* All other Storm Details will be by M.S.D. 2007 Standards and Specifications.

* A 5/8" Trash bar shall be centered within the opening(s) of all inlets.



Carefully placed compacted selected earth bedding will be used except if under pavement, or through rock cut areas. If under pavement, or through rock cut areas compacted crushed limestone and screenings is required to the base of pavement or to within 12" of finished surface. Water jetting is allowed under non paved areas.

CITY OF O'FALLON
ENGINEERING DEPARTMENT
O'FALLON, MISSOURI

TRENCH
DETAIL

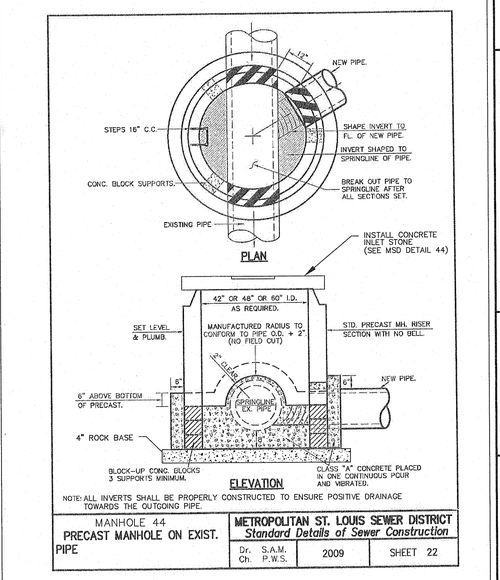

NOTE: ALL INVERTS SHALL BE PROPERLY CONSTRUCTED TO ENSURE POSITIVE DRAINAGE TOWARDS THE OUTGOING PIPE.

MANHOLE 44 PRECAST MANHOLE ON EXIST. PIPE	METROPOLITAN ST. LOUIS SEWER DISTRICT *Standard Details of Sewer Construction*		
	Dr. S.A.M. Ch. P.W.S.	2009	SHEET 22

MODOT GUARDRAIL TYPE A DETAIL

NOTES:
1) THE DOWELED INLET STONE SHALL BE USED AT ALL LOCATIONS.
2) 5000 P.S.I. CONCRETE REQUIRED.

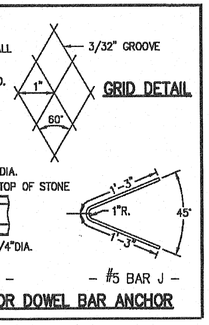

AT HOLE FOR DOWEL BAR ANCHOR

STANDARD - INLET STONES, BLOCKS & DESIGN DETAILS

METROPOLITAN ST. LOUIS SEWER DISTRICT
Standard Details of Sewer Construction

Dr. WSH/SAM
Ch. J.C.K.
2009
SHEET 44

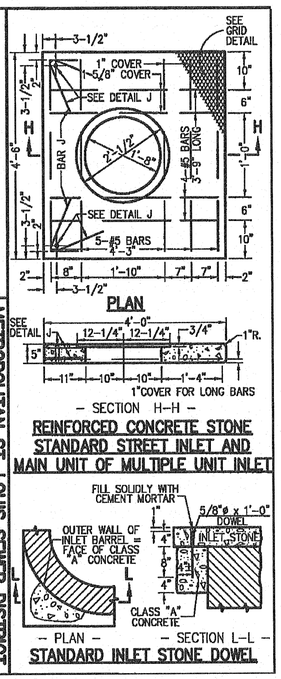

REINFORCED CONCRETE STONE
STANDARD STREET INLET AND
MAIN UNIT OF MULTIPLE UNIT INLET

STANDARD INLET STONE DOWEL

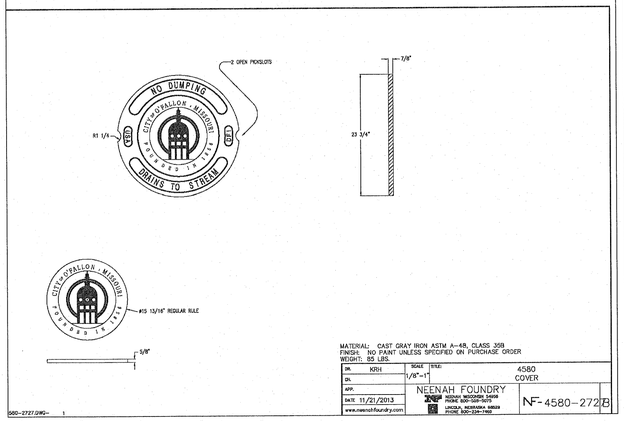

ENGINEERS SEAL DOES NOT APPLY TO CITY OF O'FALLON DETAILS ON THIS SHEET.

PROJECT TITLE:
THE VILLAS AT KEATON WOODS

Bax Project #15-16469 | Issue Date: 03/25/2016

ENGINEERING
PLANNING
SURVEYING
221 Point West Blvd.
St. Charles, MO 63301
636-928-5552
FAX 928-1718

DISCLAIMER OF RESPONSIBILITY
I hereby specify that the documents intended to be authenticated by my seal are limited to this sheet, and I hereby disclaim any responsibility for all other Drawings, Specifications, Estimates, Reports or other documents or instruments relating to or intended to be used for any part or parts of the architectural or engineering project or survey.

REFERENCE ONLY

REVISIONS

12/19/16	P.W.S.D.#2, DUCKETT & CITY COMMENTS
01/05/17	P.W.S.D.#2 COMMENTS
02/20/17	CITY COMMENTS
03/17/17	CITY COMMENTS
09/20/18	CITY COMMENTS
11/06/18	CITY COMMENTS
12/14/18	CITY COMMENTS
12/28/18	CITY COMMENTS

Developer / Owner:
Bridgewater Communities, Inc.
P.O. Box 4607
Chesterfield, Missouri 63005
636-294-6020

REFERENCE DETAILS

P+Z No. 18-003986
June 7, 2018

City No. #18-009384
Permit #RSP18-000006

Page No.
28 of 32