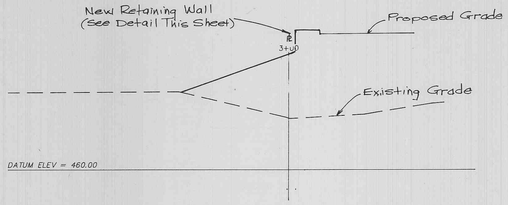

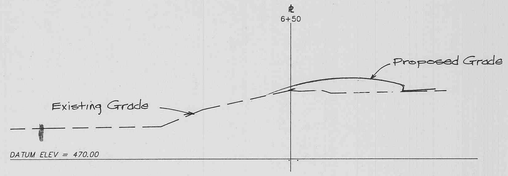

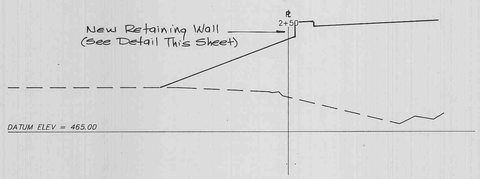

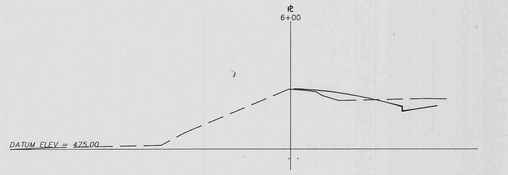

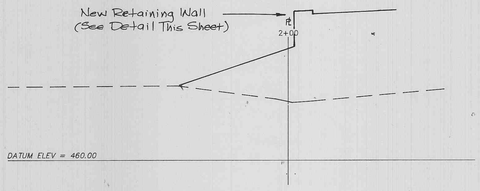

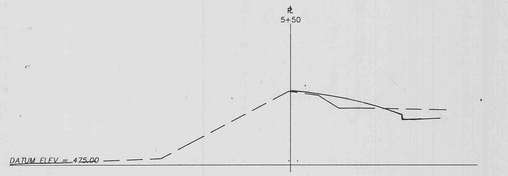

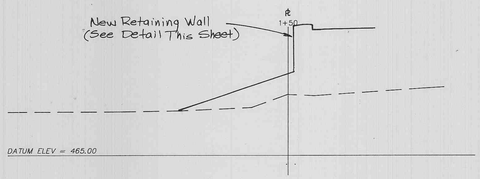

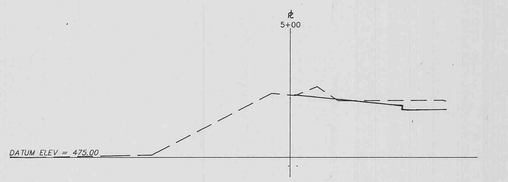

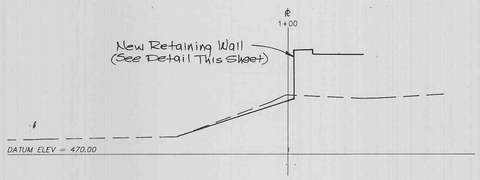

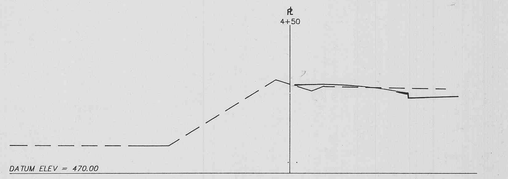

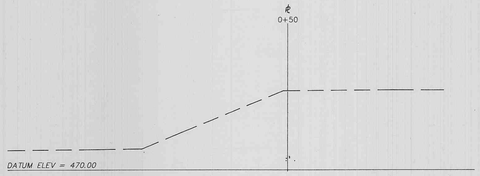

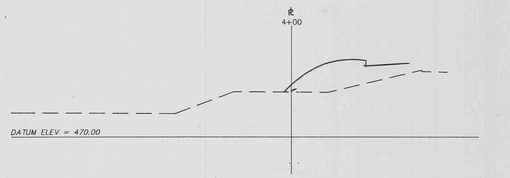

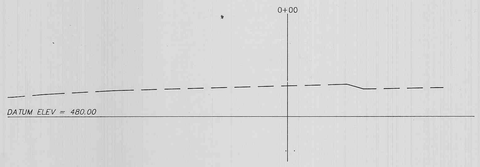

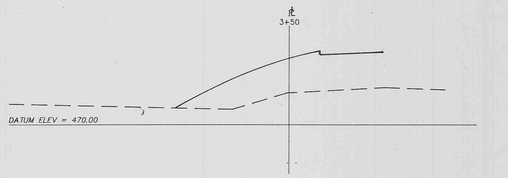



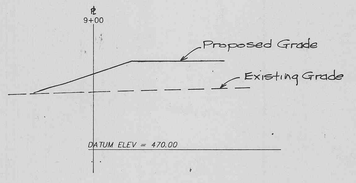

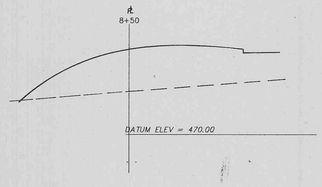

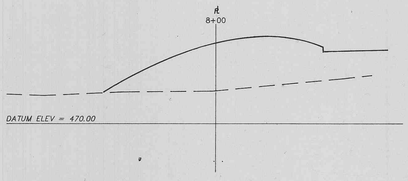

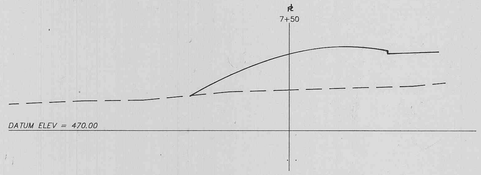

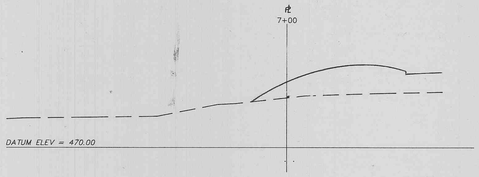

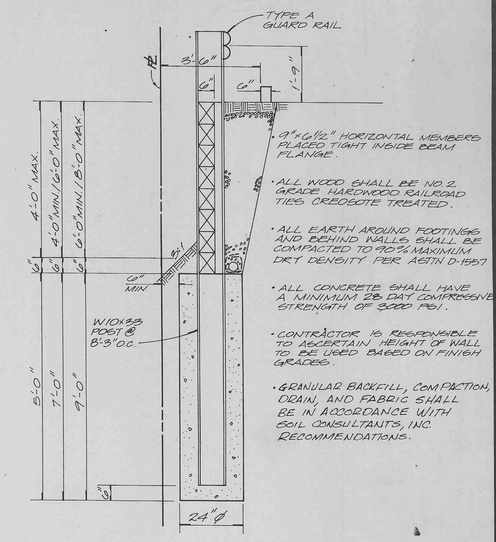

- 9"x6½" HORIZONTAL MEMBERS PLACED TIGHT INSIDE BEAM FLANGE.
- ALL WOOD SHALL BE NO. 2 GRADE HARDWOOD RAILROAD TIES CREOSOTE TREATED.
- ALL EARTH AROUND FOOTINGS AND BEHIND WALLS SHALL BE COMPACTED TO 90% MAXIMUM DRY DENSITY PER ASTM D-1557
- ALL CONCRETE SHALL HAVE A MINIMUM 28 DAY COMPRESSIVE STRENGTH OF 3000 PSI.
- CONTRACTOR IS RESPONSIBLE TO ASCERTAIN HEIGHT OF WALL TO BE USED BASED ON FINISH GRADES.
- GRANULAR BACKFILL, COMPACTION, DRAIN, AND FABRIC SHALL BE IN ACCORDANCE WITH SOIL CONSULTANTS, INC. RECOMMENDATIONS.

SITE RETAINING WALL
SCALE : 1½"= 1'-0"

Begin Wall – Sta. 0+38.86
End Wall – Sta. 3+38.86

SCALE:HORIZ. 1"=10'
VERT. 1"=10'

PREPARED BY:
PICKETT PAY & SILVER
Civil Engineers
Planners
Land Surveyors

WAFZ Distribution Center
OWNER: Trammell Crow Company
CONTRACTOR: R.W.Murray Co.

Revision Dates
/ /
/ /
3 6 /90
1 24 /90
Issue Date
1 10 /
Sheet Title
WALL SE
RWM Jo
5
Sheet Nu
C