



SECTION 1
SCALE 3/16" = 1'-0" (25.02)

- NOTES:**
- The Contractor shall field verify all dimensions and elevations and submit a layout plan for piping, equipment and fittings selected for review with the shop drawings.
 - Existing aerators and associated equipment to be removed and replaced with New Process Equipment. Typical for Aeration Tanks No. 1, No. 2 and No. 3. The existing 20" Influent wall pipe is to be removed and replaced with 30" wall pipe. Refer to Typ. Exist. Concrete Wall Opening Detail. See Sheet G0.19
 - Max. W.L. is Based on a Plant Influent Flow of 16.0 MGD.

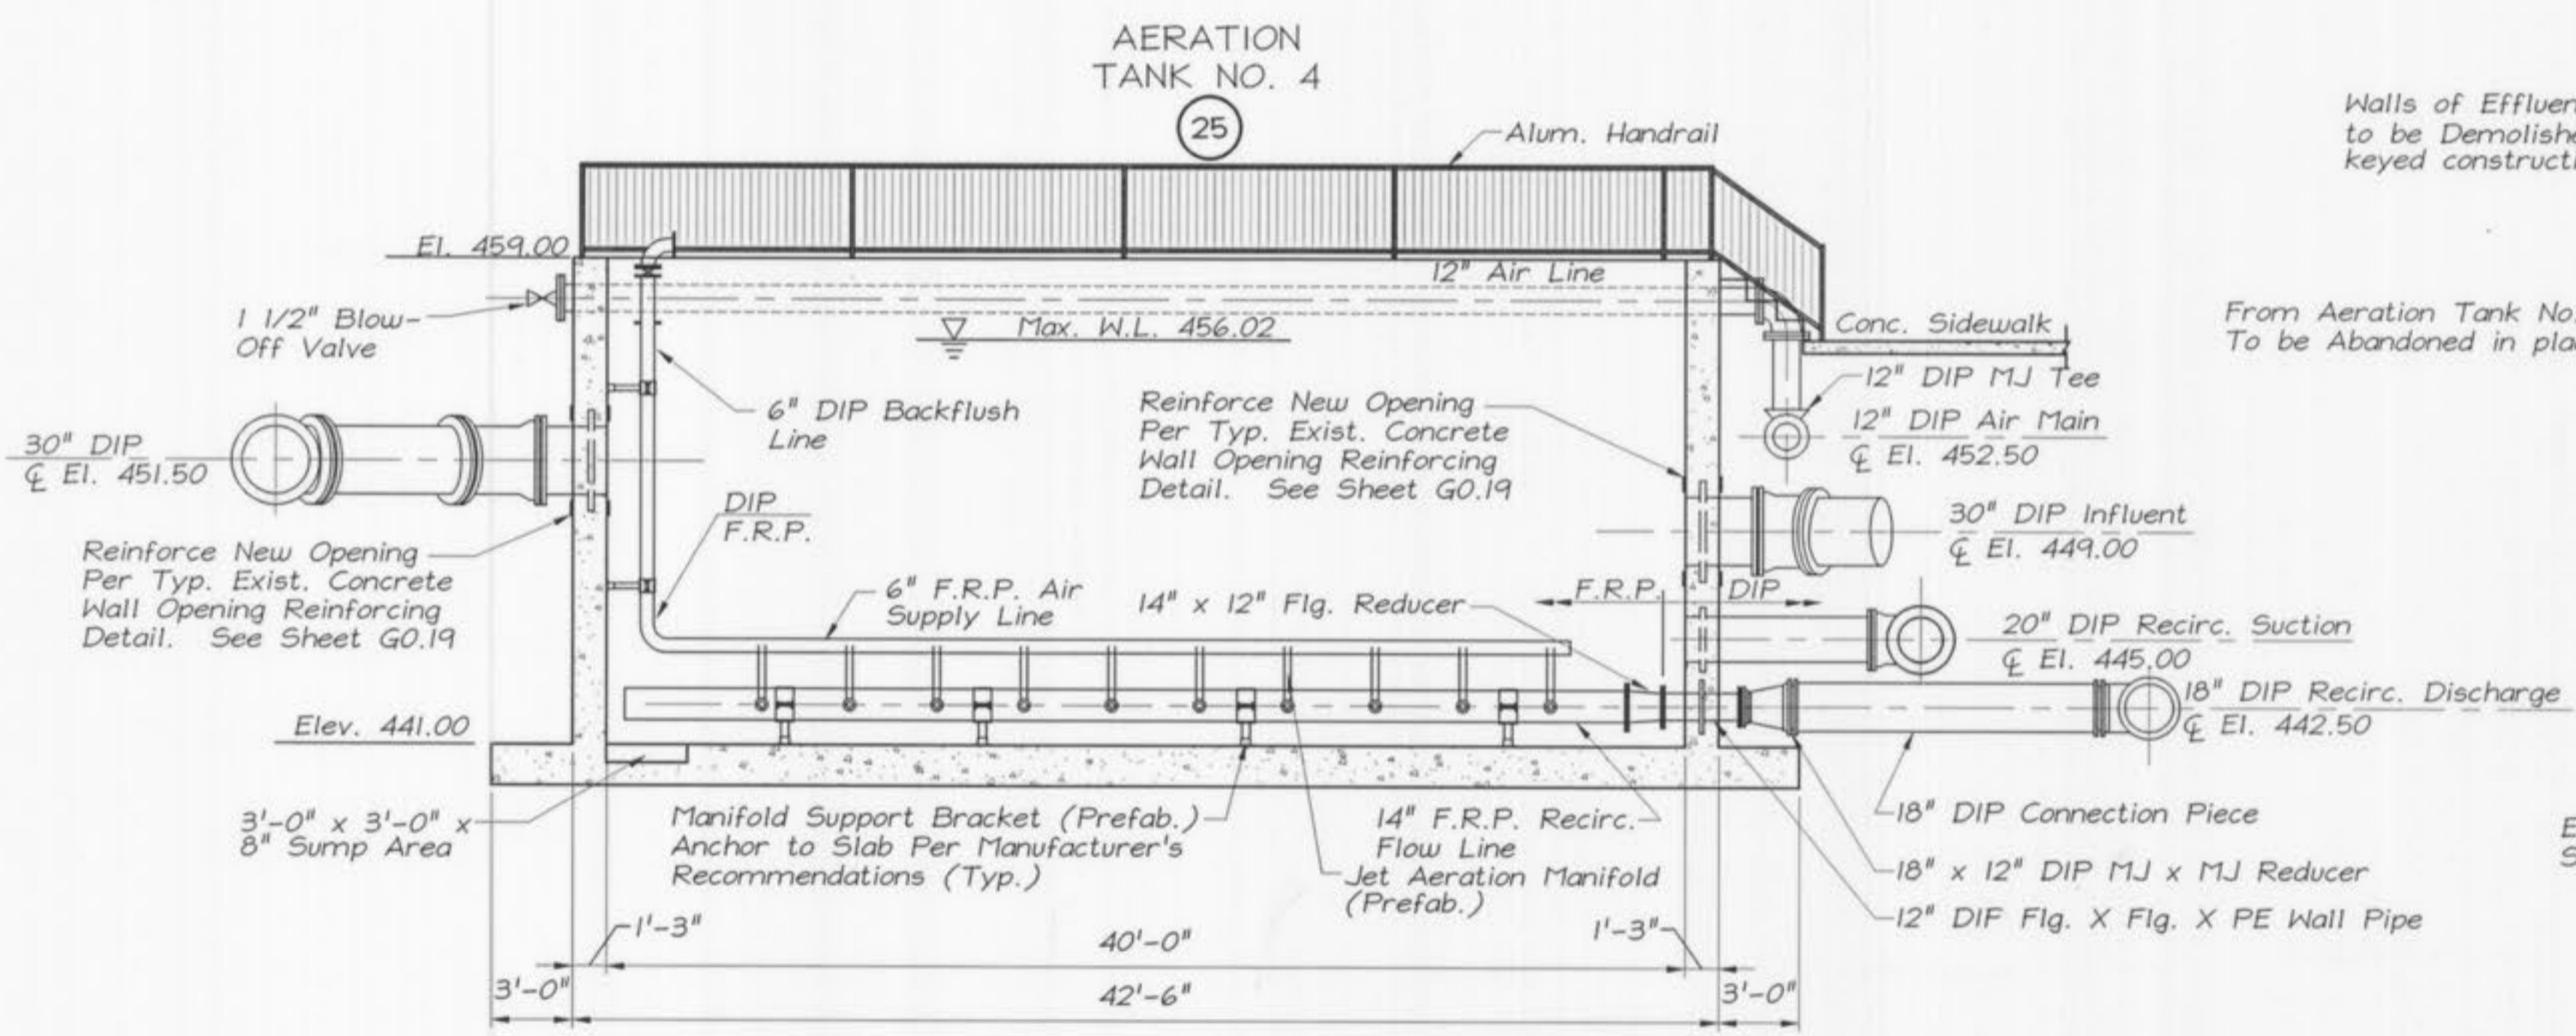

SECTION 2
SCALE 3/16" = 1'-0" (25.02)

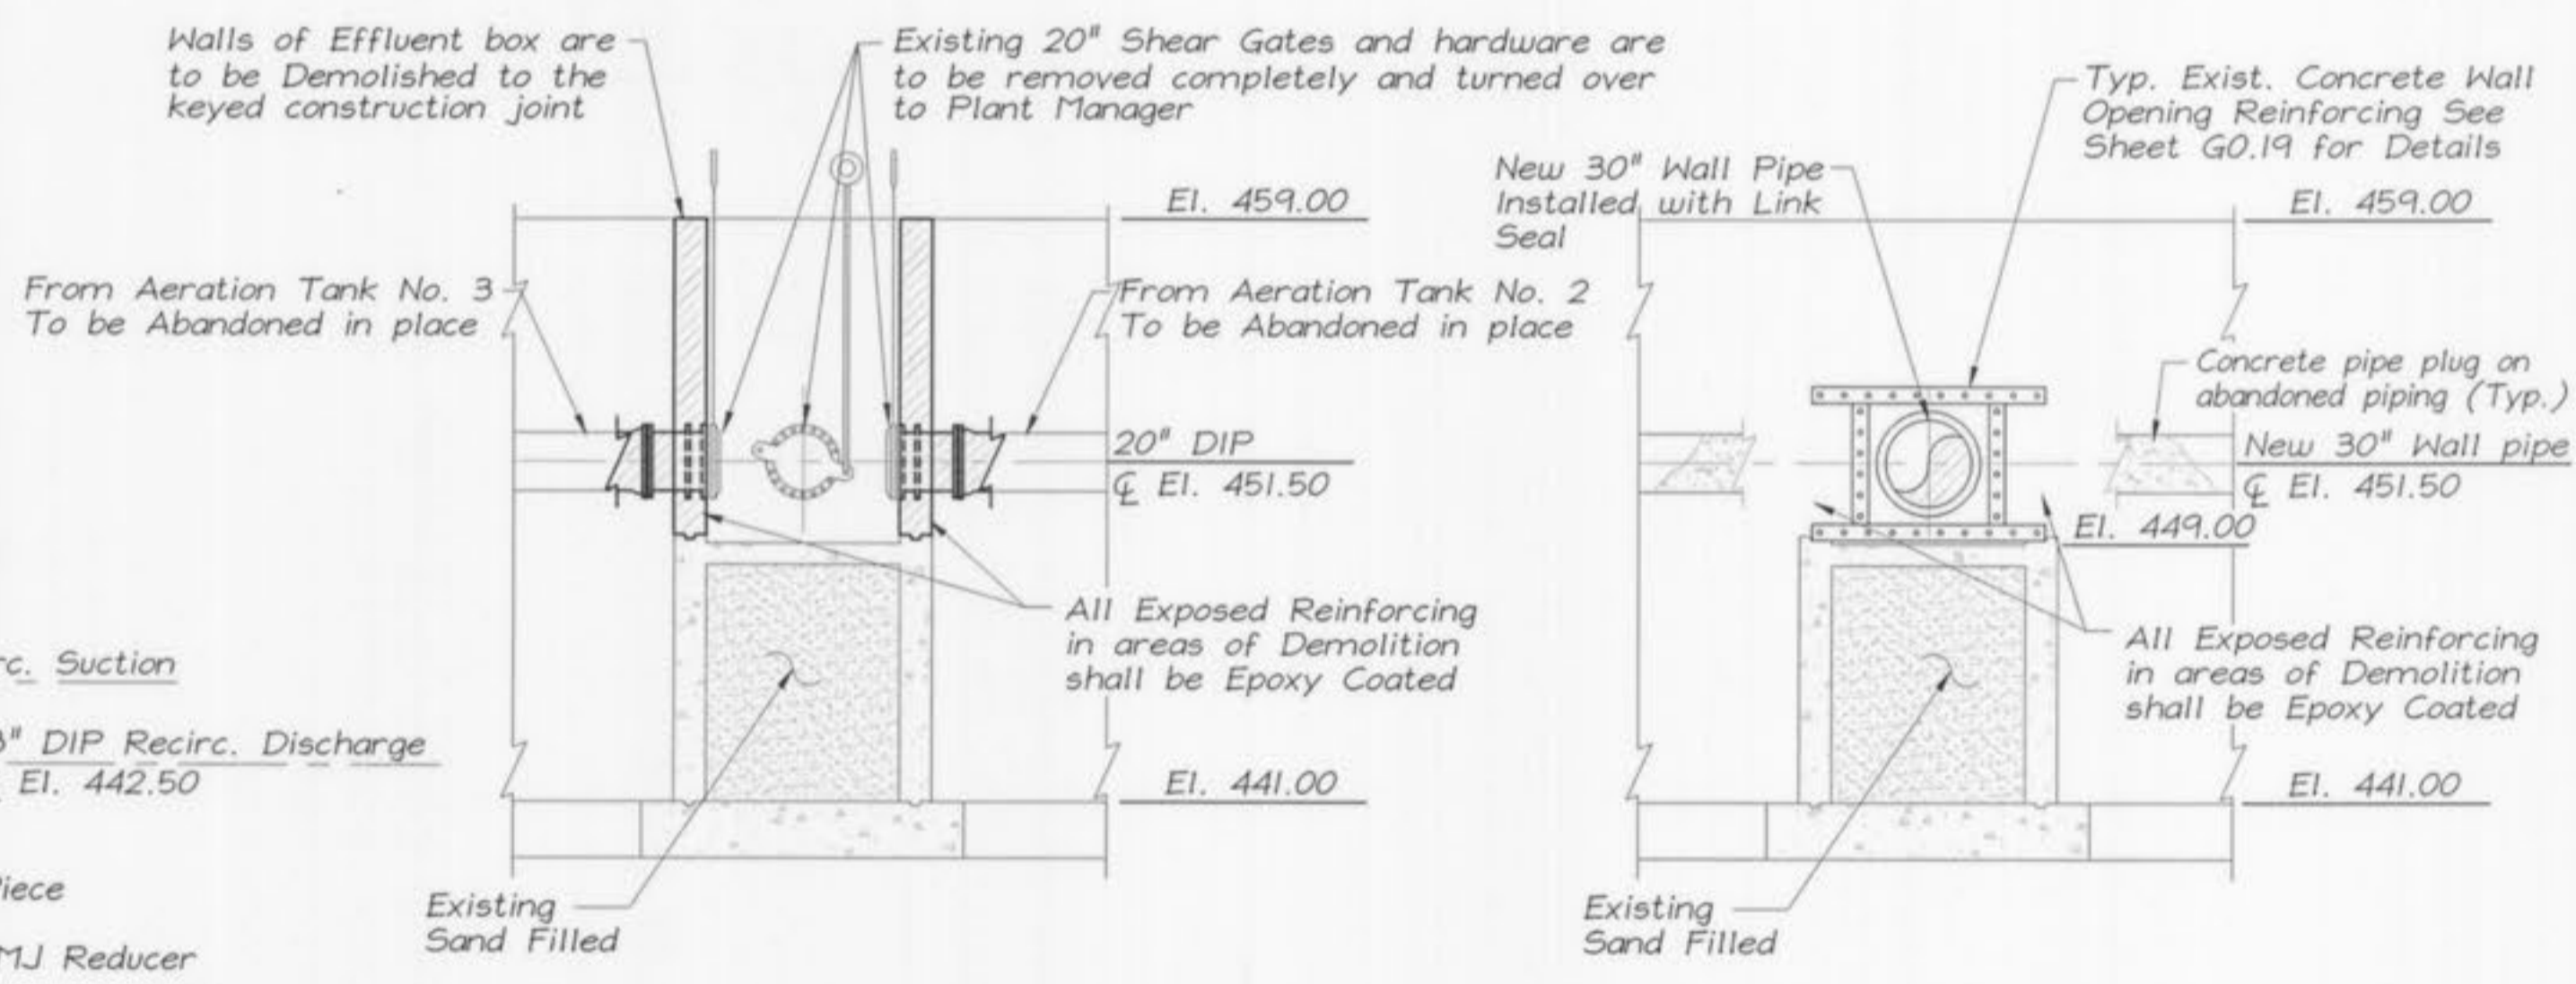

DEMOLITION

MODIFIED

SECTION 3
SCALE 3/16" = 1'-0" (25.02)

JOB NO.: 9234
DATE: 10-08-2001

DESIGNED BY: RJR
DRAWN BY: RJR
CHECKED BY: RJR/TMS
SHEET NUMBER

C25.02