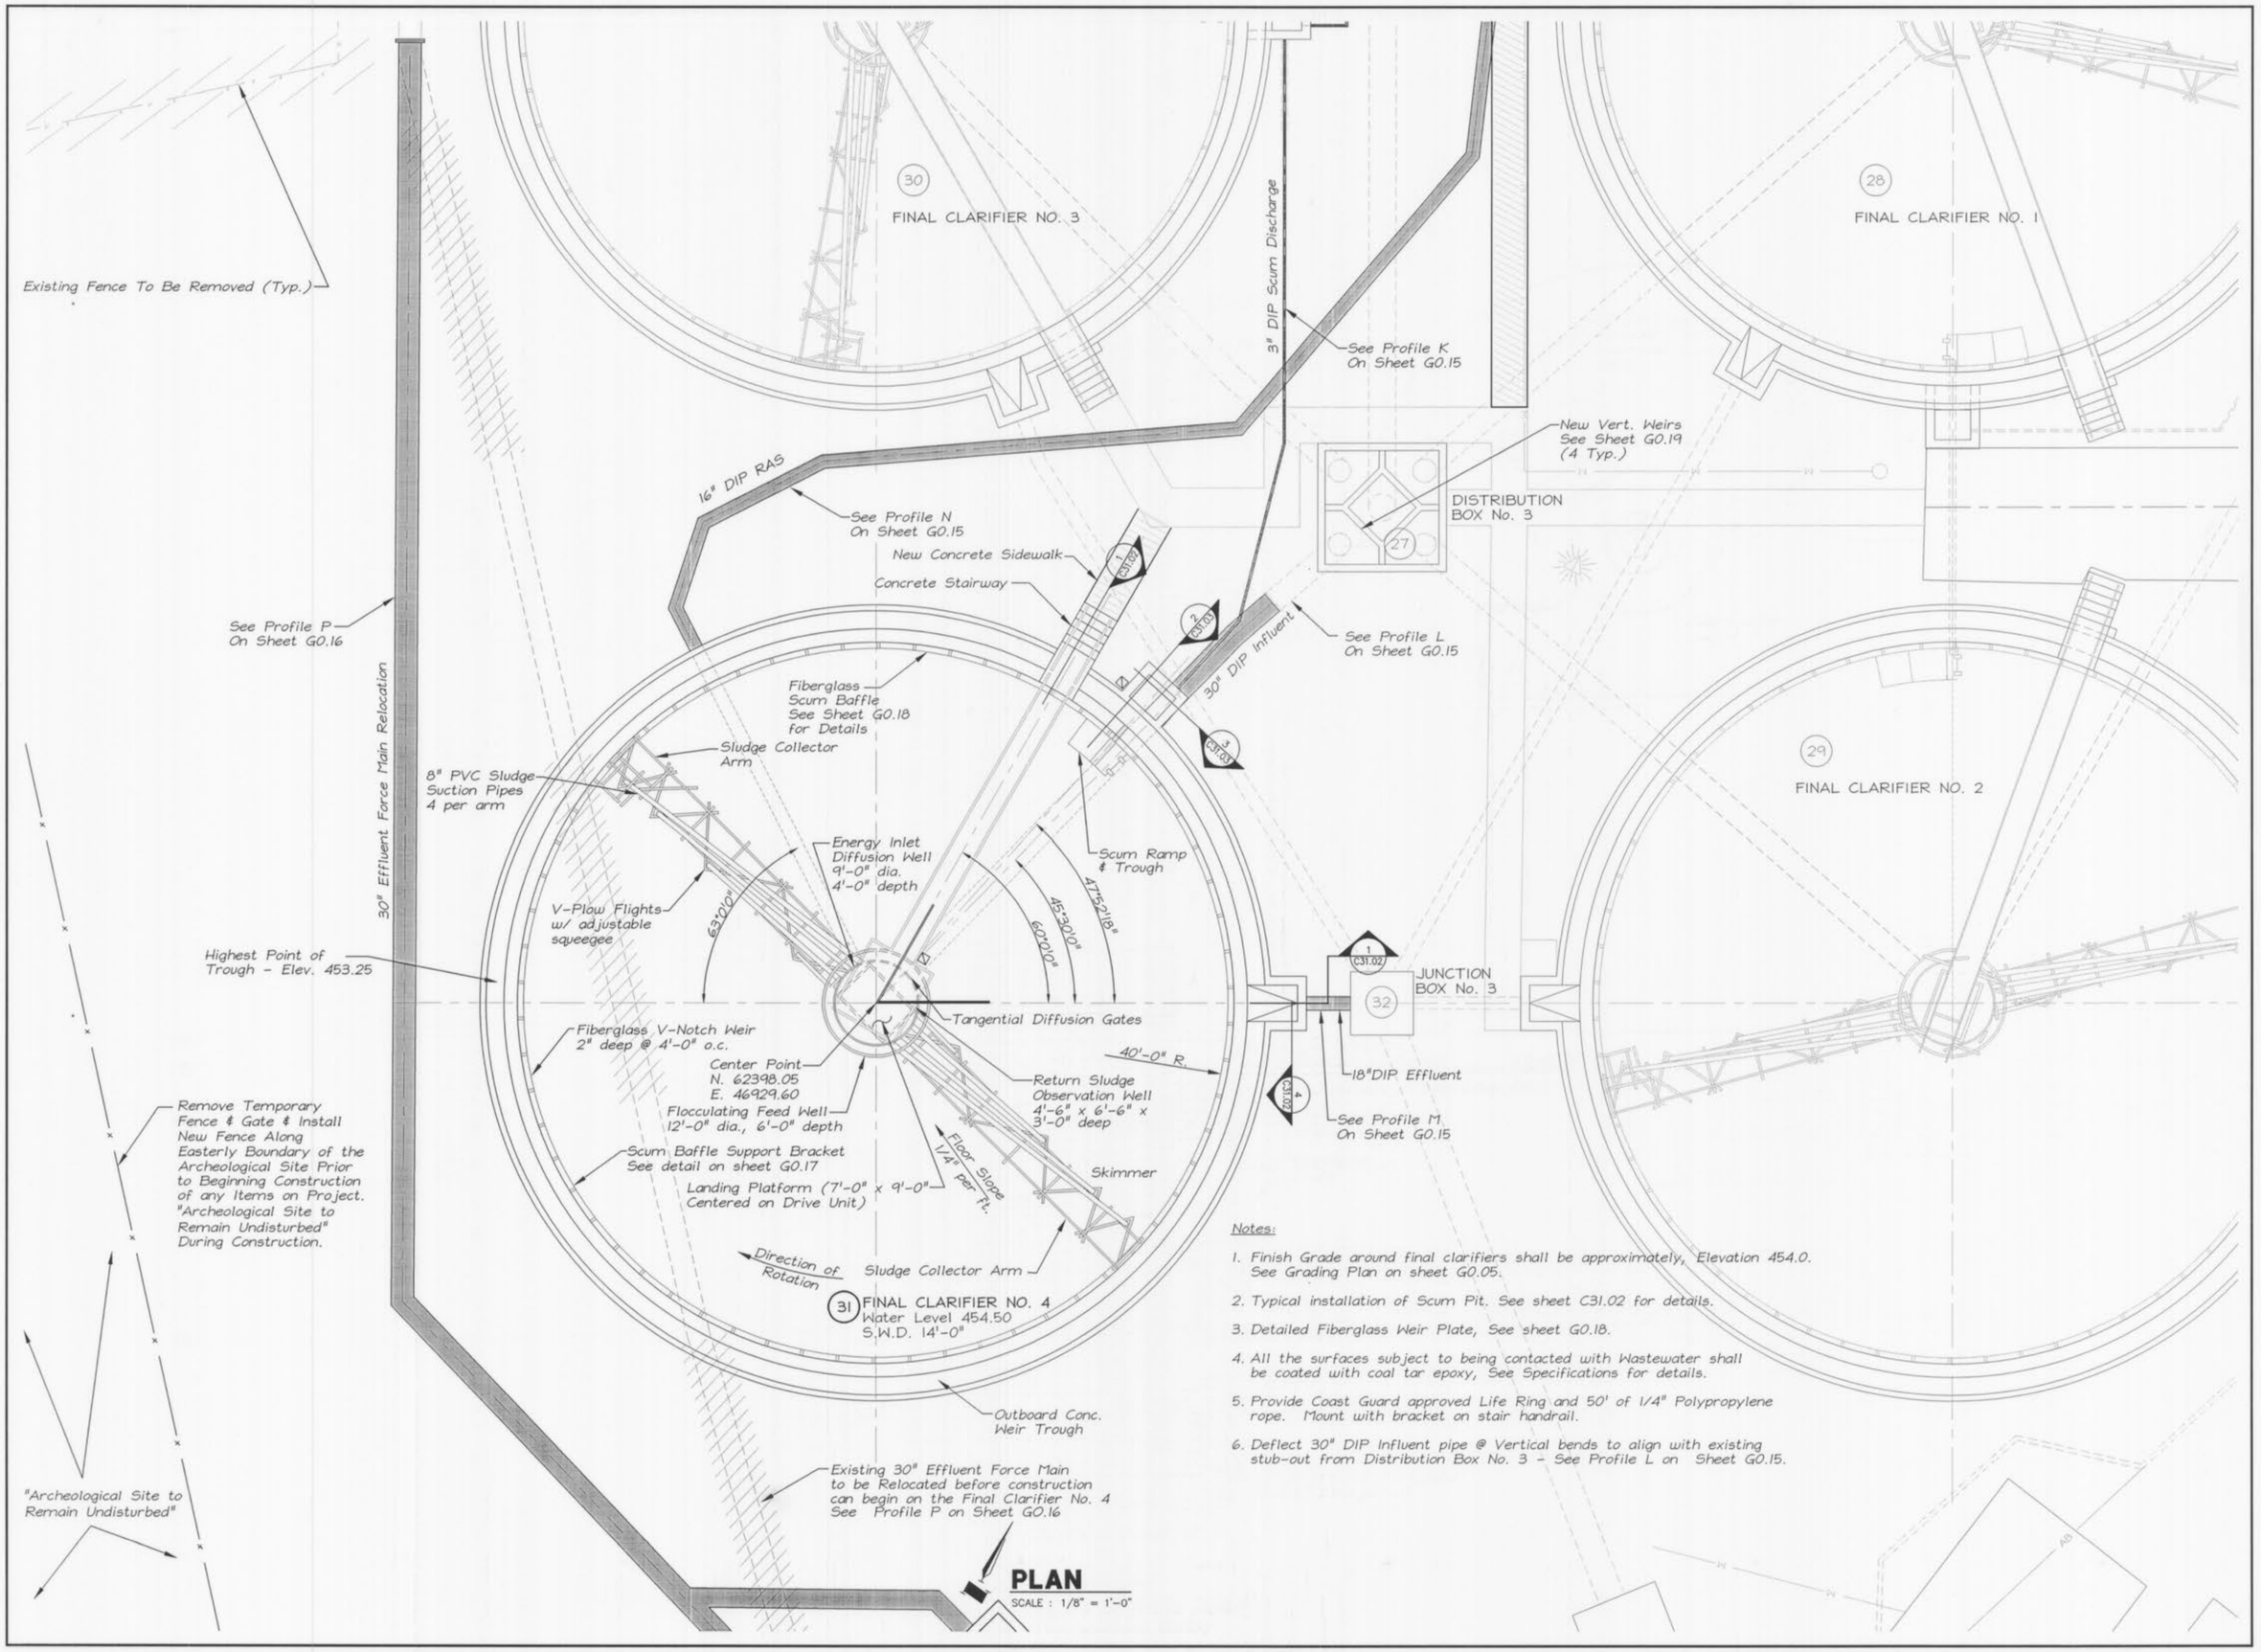

Notes:

1. Finish Grade around final clarifiers shall be approximately, Elevation 454.0. See Grading Plan on sheet G0.05.
2. Typical installation of Scum Pit. See sheet C31.02 for details.
3. Detailed Fiberglass Weir Plate, See sheet G0.18.
4. All the surfaces subject to being contacted with Wastewater shall be coated with coal tar epoxy, See Specifications for details.
5. Provide Coast Guard approved Life Ring and 50' of 1/4" Polypropylene rope. Mount with bracket on stair handrail.
6. Deflect 30" DIP Influent pipe @ Vertical bends to align with existing stub-out from Distribution Box No. 3 - See Profile L on Sheet G0.15.

GEORGE BUTLER ASSOCIATES, INC.
Engineers • Architects
Kansas • Missouri • Illinois

WASTEWATER TREATMENT PLANT EXPANSION

FINAL CLARIFIER NO. 4 PLAN

CITY OF O'FALLON, MISSOURI

JOB NO.: 9234
DATE: 10-08-2001

DESIGNED BY: TMS
DRAWN BY: RGA/DMH
CHECKED BY: RJR/TMS

SHEET NUMBER

C31.01

K:\Client\OFallon\9234\dwg\Final\92341000.dwg Layout: C31.01 -- Thursday October 04, 2001, 8:35am -- Copyright 2001, George Butler Associates, Inc.