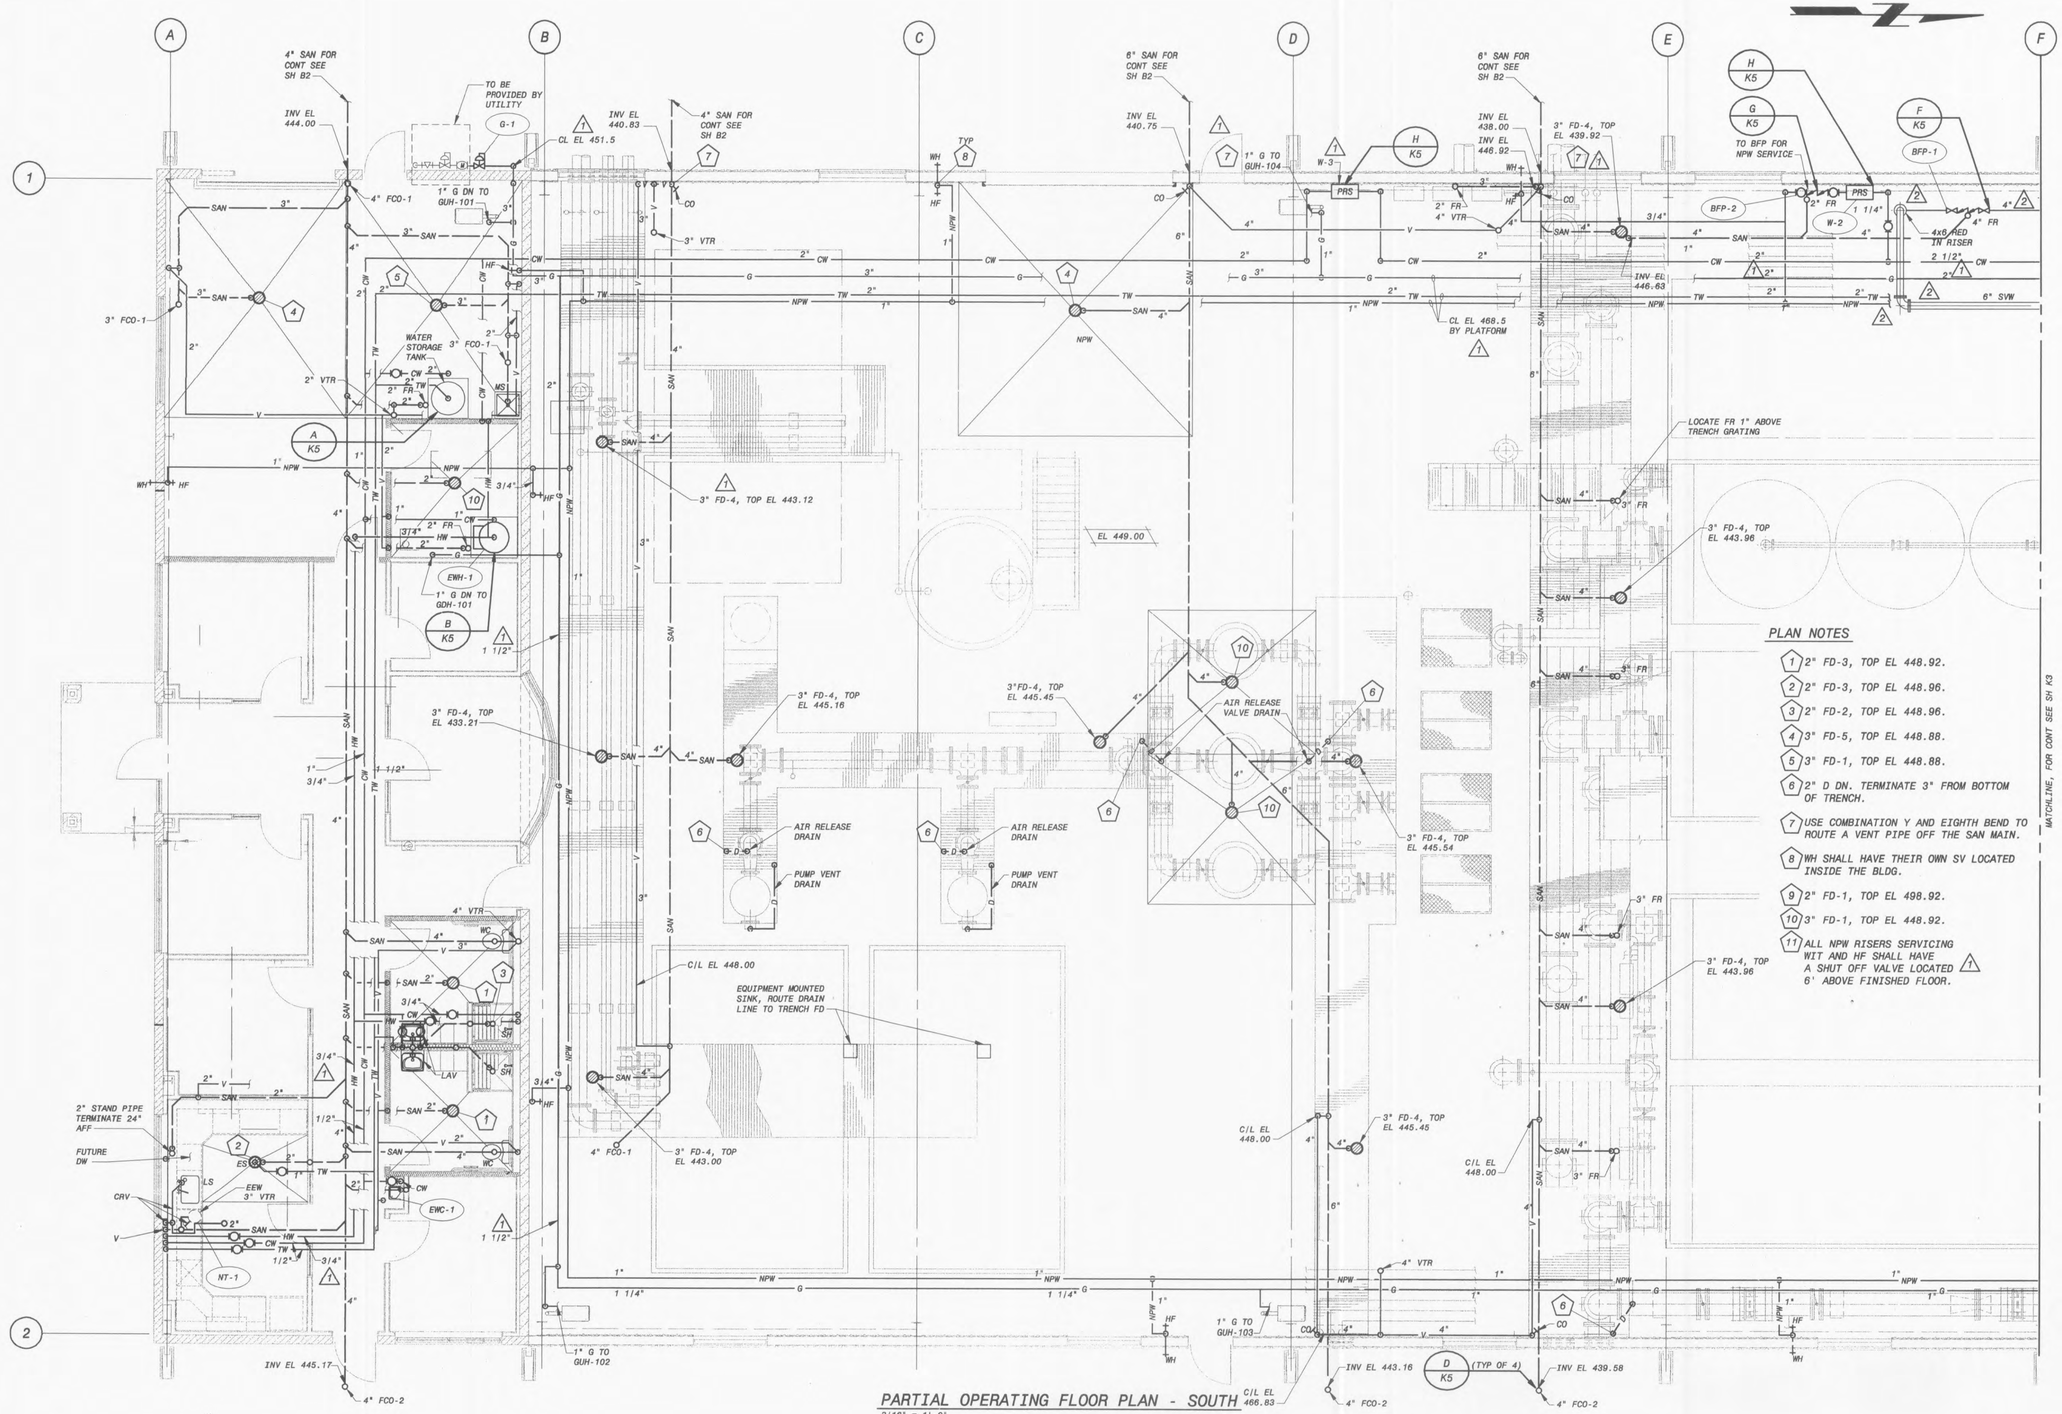

PARTIAL OPERATING FLOOR PLAN - SOUTH

3/16" = 1'-0"

PLAN NOTES

1. 2" FD-3, TOP EL 448.92.
2. 2" FD-3, TOP EL 448.96.
3. 2" FD-2, TOP EL 448.96.
4. 3" FD-5, TOP EL 448.88.
5. 3" FD-1, TOP EL 448.88.
6. 2" D DN. TERMINATE 3" FROM BOTTOM OF TRENCH.
7. USE COMBINATION Y AND EIGHTH BEND TO ROUTE A VENT PIPE OFF THE SAN MAIN.
8. WH SHALL HAVE THEIR OWN SV LOCATED INSIDE THE BLDG.
9. 2" FD-1, TOP EL 498.92.
10. 3" FD-1, TOP EL 448.92.
11. ALL NPW RISERS SERVICING WIT AND HF SHALL HAVE A SHUT OFF VALVE LOCATED 1 6' ABOVE FINISHED FLOOR.

NO.	BY	CK	APP	REVISIONS AND RECORD OF ISSUE	DATE
2				CONFORMED TO CONSTRUCTION RECORDS	
1				ADDENDUM	

XREF1 ID: A-T000000AJ
XREF2 ID: A-T000000CT
XREF3 ID: C-T000000BM
XREF4 ID: H-T000000EH
XREF5 ID:

CYGNET ID: 97515-300-PB-T000000ESC
SAVED: IV44269, 10/25/2004 1:44:43 PM
DWG VER #:
PLOTTED: IV44269, 10/25/2004 1:19:18 PM
USER: IV44269
SW: ACAD-2000i

"THIS DRAWING WAS ORIGINALLY APPROVED FOR CONSTRUCTION BY DAVID W. NELSON ON 10/08/01 AND SEALED BY DAVID W. NELSON A LICENSED PROFESSIONAL ENGINEER IN THE STATE OF MISSOURI, NO. E-29940"

BLACK & VEATCH Corporation
St. Louis, Missouri

CITY OF O'FALLON, MISSOURI
WATER TREATMENT PLANT

MECHANICAL - PLUMBING
PARTIAL OPERATING FLOOR PLAN - SOUTH

DESIGNED:	BCD
DETAILED:	BDL, JMC
CHECKED:	MLP
APPROVED:	DWN
DATE:	10/08/01

PROJECT NO.
97515

K2

SHEET
47 OF 96

D97515
D97515